

**Incorporating  
all 2009  
amendments**



# **BCA 2009**

---

**Building Code of Australia**

**Class 1 and Class 10 Buildings  
Housing Provisions  
VOLUME TWO**

---

# **INTRODUCTION — CONTENTS AND FEATURES**

# INTRODUCTION — <sup>SUPERSEDED</sup> CONTENTS AND FEATURES

---

## © 2009 Australian Government and States and Territories of Australia

The *BCA 2009 (Volume One & Volume Two)* and the *Guide to the BCA* is the copyright of the Australian Government and States and Territories of Australia and, apart from any use as permitted under the Copyright Act 1998, no part may be reproduced without prior permission. Requests and enquiries concerning reproduction and rights should be directed in the first instance to the General Manager, Australian Building Codes Board, GPO Box 9839 Canberra ACT 2601.

### **Australian Building Codes Board**

GPO Box 9839 Canberra ACT 2601

Telephone: Canberra 1300 134 631 Facsimile: + 61 2 6213 7287

Web Site: <http://www.abcb.gov.au>

Email: [bca@abcb.gov.au](mailto:bca@abcb.gov.au)

The Australian Building Codes Board (ABCB) is established by agreement between the Commonwealth Government and each State and Territory Government. It is a co-operative arrangement between the signatories, local government and the building industry.

### **ABCB Important Disclaimer**

The ABCB gives no warranty or guarantee that Volume Two of the BCA is correct or complete. The ABCB shall not be liable for any loss howsoever caused whether due to negligence or otherwise arising from the use of or reliance on Volume Two of the BCA.

The ABCB recommends that anyone seeking to rely on Volume Two of the BCA obtain their own independent expert advice in relation to building or related activities. Its interpretation in no way overrides the approvals processes in any jurisdiction.

### **BCA Customer Support**

Telephone: 1300 134 631

Facsimile: +61 2 6290 8831

Email: [bca@abcb.gov.au](mailto:bca@abcb.gov.au)

ISBN 978-1-921453-46-5

## GENERAL TABLE OF CONTENTS

---

### INTRODUCTION CONTENTS AND FEATURES

Introduction .....	8
--------------------	---

### SECTION 1 GENERAL REQUIREMENTS

1.0	Application .....	13
1.1	Interpretation .....	17
1.2	Acceptance of design and construction .....	29
1.3	Classification .....	31
1.4	Documents adopted by reference .....	34

### SECTION 2 PERFORMANCE PROVISIONS

2.0	Application .....	47
2.1	Structure .....	48
2.2	Damp and weatherproofing .....	51
2.3	Fire safety .....	55
2.4	Health and amenity .....	59
2.5	Safe movement and access .....	64
2.6	Energy efficiency .....	70

### SECTION 3 ACCEPTABLE CONSTRUCTION

3.0	How to use section 3 .....	86
-----	----------------------------	----

#### PART 3.1 SITE PREPARATION

3.1.1	Earthworks .....	93
3.1.2	Drainage .....	97
3.1.3	Termite risk management .....	103

#### PART 3.2 FOOTINGS AND SLABS

3.2	Footings and slabs .....	116
-----	--------------------------	-----



SUPERSEDED  
**INTRODUCTION — CONTENTS AND FEATURES**

---

3.2.2	Preparation .....	119
3.2.3	Concrete and reinforcing .....	126
3.2.4	Site classification .....	130
3.2.5	Footing and slab construction .....	131
<b>PART 3.3 MASONRY</b>		
3.3	Definitions .....	145
3.3.1	Unreinforced masonry .....	146
3.3.2	Reinforced masonry .....	159
3.3.3	Masonry accessories .....	171
3.3.4	Weatherproofing of masonry .....	180
3.3.5	Earthwall construction .....	196
<b>PART 3.4 FRAMING</b>		
3.4.0	Explanation of terms .....	199
3.4.1	Sub-floor ventilation .....	202
3.4.2	Steel framing .....	207
3.4.3	Timber framing .....	215
3.4.4	Structural steel members .....	217
<b>PART 3.5 ROOF AND WALL CLADDING</b>		
3.5.1	Roof cladding .....	233
3.5.2	Gutters and downpipes .....	243
3.5.3	Wall cladding .....	248
<b>PART 3.6 GLAZING</b>		
3.6	Glazing .....	257
<b>PART 3.7 FIRE SAFETY</b>		
3.7.1	Fire separation .....	271
3.7.2	Smoke alarms .....	288
3.7.3	Heating appliances .....	293

3.7.4	Bushfire areas .....	301
3.7.5	Alpine areas .....	317
<b>PART 3.8 HEALTH AND AMENITY</b>		
3.8.1	Wet areas .....	324
3.8.2	Room heights .....	356
3.8.3	Facilities .....	358
3.8.4	Light .....	360
3.8.5	Ventilation .....	362
3.8.6	Sound insulation .....	365
<b>PART 3.9 SAFE MOVEMENT AND ACCESS</b>		
3.9.1	Stair construction .....	386
3.9.2	Balustrades .....	392
3.9.3	Swimming pool access .....	399
3.9.4	Swimming pool water recirculation systems .....	399
<b>PART 3.10 ADDITIONAL CONSTRUCTION REQUIREMENTS</b>		
3.10.1	High wind areas .....	413
3.10.2	Earthquake areas .....	418
<b>PART 3.11 STRUCTURAL DESIGN MANUALS</b>		
3.11	Structural design manuals .....	422
<b>PART 3.12 ENERGY EFFICIENCY</b>		
3.12	Energy efficiency .....	428
3.12.1	Building fabric .....	430
3.12.2	External glazing .....	453
3.12.3	Building sealing .....	467
3.12.4	Air movement .....	471
3.12.5	Services .....	474

**APPENDIX A ADDITIONS**

<b>Commonwealth of Australia</b>	
<b>Australian Capital Territory .....</b>	<b>485</b>
<b>New South Wales .....</b>	<b>491</b>
<b>Northern Territory .....</b>	<b>505</b>
<b>Queensland .....</b>	<b>509</b>
<b>South Australia .....</b>	<b>511</b>
<b>Tasmania .....</b>	<b>523</b>
<b>Victoria .....</b>	<b>527</b>
<b>Western Australia .....</b>	<b>532</b>

**INDEX ABBREVIATIONS AND SYMBOLS**

<b>Index.....</b>	<b>540</b>
<b>Abbreviations and symbols.....</b>	<b>560</b>

**HISTORY OF AMENDMENTS**

<b>History of amendments.....</b>	<b>564</b>
-----------------------------------	------------

**LIST OF AMENDMENTS**

<b>List of amendments.....</b>	<b>579</b>
--------------------------------	------------

## INTRODUCTION

---

### THE BUILDING CODE OF AUSTRALIA

The Building Code of Australia (BCA) is produced and maintained by the Australian Building Codes Board (ABCB) on behalf of the Australian Government and each State and Territory Government.

The BCA is a uniform set of technical provisions for the design and construction of buildings and other structures throughout Australia. It allows for variations in climate and geological or geographic conditions.

### THE AUSTRALIAN BUILDING CODES BOARD

The ABCB is established by agreement between the Australian Government and each State and Territory Government. It is a co-operative arrangement between the signatories, Local Government and the building industry.

The ABCB's mission is to address issues relating to health, safety, amenity and sustainability by providing for efficiency in the design, construction and performance of buildings through the BCA and development of effective regulatory systems.

The Board comprises—

- (a) the Australian, State and Territory Governments' principal officer responsible for building regulatory matters; and
- (b) a representative of the Australian Local Government Association (ALGA); and
- (c) representatives of the building and construction industry.

The Building Codes Committee (BCC) is the peak technical advisory body to the ABCB, with responsibility for technical matters associated with the BCA.

The BCC comprises—

- (a) the General Manager of the ABCB; and
- (b) one nominee each of the Australian, State and Territory Governments' and ALGA members of the ABCB; and
- (c) representatives of the building and construction industry.

### THE BCA — CONTENT

#### GOALS

The goal of the BCA is to enable the achievement of nationally consistent, minimum necessary standards of relevant health, safety (including structural safety and safety from fire), amenity and sustainability objectives efficiently.

This goal is applied so that—

- (a) there is a rigorously tested rationale for the regulation; and
- (b) the regulation generates benefits to society greater than the costs (that is, net benefits); and
- (c) the competitive effects of the regulation have been considered and the regulation is no more restrictive than necessary in the public interest; and
- (d) there is no regulatory or non-regulatory alternative that would generate higher net benefits.

## FORMAT

The BCA is published in two volumes:

**Volume One:** pertains primarily to Class 2 to 9 buildings

**Volume Two:** pertains primarily to Class 1 and 10 buildings (houses, sheds, carports, etc)

Both volumes are drafted in a performance format to provide greater flexibility for the use of new and innovative building products, systems and designs.

A user may choose to comply with the *Deemed-to-Satisfy Provisions* or (described as acceptable construction practice in the *Housing Provisions*) or may use an *Alternative Solution* that satisfies the *Performance Requirements*.

The provisions in this edition are the same as those contained in the preceding edition of the BCA plus changes as detailed in the list at the back of the document.

## STATE AND TERRITORY VARIATIONS AND ADDITIONS

Each State's and Territory's legislation adopts the BCA subject to the variation or deletion of some of its provisions, or the addition of extra provisions. In the *Housing Provisions*, these are divided into two types:

- (a) A variation to the *Housing Provisions* — these are identified following the Clause that is being varied.
- (b) Additional requirements — these are contained in Appendix A .

## SCOPE OF THE HOUSING PROVISIONS

Users of the *Housing Provisions* need to be aware that the acceptable construction practices contained in this document do not cover all types of Class 1 and 10 buildings. The limitations of the acceptable construction practices are discussed in the introduction to Section 3.

## DEFINITIONS

Words with special meanings are printed in italics and are defined in **1.1.1** or, if they are specific to a Part, at the start of that Part in Section 3. Defined terms which appear in figures and diagrams may not be in italics.

## LEGISLATIVE ARRANGEMENTS

### GENERAL

The BCA is given legal effect by building regulatory legislation in each State and Territory. This legislation consists of an Act of Parliament and subordinate legislation which empowers the regulation of certain aspects of buildings and structures, and contains the administrative provisions necessary to give effect to the legislation.

Any provision of the BCA may be overridden by, or subject to, State or Territory legislation. The BCA must therefore be read in conjunction with that legislation. Any queries on such matters should be referred to the State or Territory authority responsible for building regulatory matters.

### BCA ADOPTION

The adoption of the BCA is addressed in **Part 1.0** of the *Housing Provisions*.

## DOCUMENTATION OF DECISIONS

Decisions made under the BCA should be fully documented and copies of all relevant documentation should be retained.

## INTRODUCTION — CONTENTS AND FEATURES

---

Examples of the kind of documentation which should be prepared and retained include:

- (a) Details of the *Building Solution* including all relevant plans and other supporting documentation.
- (b) In cases where an *Alternative Solution* has been proposed—
  - (i) details of the relevant *Performance Requirements*; and
  - (ii) the *Assessment Method* or methods used to establish compliance with the relevant *Performance Requirements*; and
  - (iii) details of any *Expert Judgement* relied upon including the extent to which the judgement was relied upon and the qualifications and experience of the expert; and
  - (iv) details of any tests or calculations used to determine compliance with the relevant *Performance Requirements*; and
  - (v) details of any Standards or other information which were relied upon.

### STRUCTURE

The BCA has been structured as set out in [1.0.3](#) and shown in [Figure 1.0.3](#). It is the ABCB's intent that the *Objectives* and *Functional Statements* be used as an aid to the interpretation of the BCA and not for determining compliance with the BCA.

### FURTHER DEVELOPMENT

Regular amendments are planned to the BCA to improve clarity of provisions, upgrade referenced documents and to reflect the results of research and improved technology.

The ABCB's intention is that the performance provisions of the BCA will be progressively developed. Later stages will therefore include reviewed *Objectives*, *Functional Statements* and *Performance Requirements*.

### COMMENTS

Comments in writing on any matter concerning the text, presentation or further development of the BCA are invited from building and other authorities, industry organisations, professional operatives and the public generally. These comments should be addressed to:

General Manager

Australian Building Codes Board

GPO Box 9839

CANBERRA ACT 2601

SECTION **1**

---

# GENERAL REQUIREMENTS

- 1.0      Application**
- 1.1      Interpretation**
- 1.2      Acceptance of Design and Construction**
- 1.3      Classification**
- 1.4      Standards Adopted by Reference**



## SECTION 1 CONTENTS

### SECTION 1 GENERAL REQUIREMENTS

#### 1.0 Application

- 1.0.1 Adoption
- 1.0.2 BCA Volumes
- 1.0.3 BCA Structure
- 1.0.4 Compliance with the BCA
- 1.0.5 Meeting the Performance Requirements
- 1.0.6 Objectives and Functional Statements
- 1.0.7 Deemed-to-Satisfy Provisions
- 1.0.8 Alternative Solutions
- 1.0.9 Assessment Methods
- 1.0.10 Relevant Performance Requirements

#### 1.1 Interpretation

- 1.1.1 Definitions
- 1.1.2 Adoption of referenced documents
- 1.1.3 Context of reference
- 1.1.4 Differences between referenced documents and the Housing Provisions
- 1.1.5 Application of the Housing Provisions to a particular State or Territory
- 1.1.6 Language
- 1.1.7 Interpretation of diagrams
- 1.1.8 Explanatory information

#### 1.2 Acceptance of design and construction

- 1.2.1 Suitability of materials
- 1.2.2 Evidence of suitability
- 1.2.3 Fire resistance of building elements
- 1.2.4 Early fire hazard indices

#### 1.3 Classification

- 1.3.1 Principles of classification
- 1.3.2 Classification
- 1.3.3 Multiple classifications

#### 1.4 Documents adopted by reference

- 1.4.1 Schedule of referenced documents

## PART 1.0 APPLICATION

---

### 1.0.1 Adoption

The dates of adoption of the Building Code of Australia (Volume Two) and its amendments are shown in the “History of Amendments” division at the end of this Volume.

### 1.0.2 BCA Volumes


- (a) The Building Code of Australia consists of two volumes, Volume One and Volume Two.
- (b) This is Volume Two of the Building Code of Australia (hereafter described as the *Housing Provisions*) which contains the requirements for—
  - (i) Class 1 and 10a buildings (other than access requirements for people with disabilities in Class 10a buildings); and
  - (ii) certain Class 10b structures (refer to Part 1.3 for a full description of the Class 1 and 10 building classifications).
- (c) Volume One contains the requirements for—
  - (i) all Class 2 to 9 buildings; and
  - (ii) access requirements for people with disabilities in Class 10a buildings (**Part D3**); and
  - (iii) certain Class 10b structures.

### 1.0.3 BCA Structure

The structure of the BCA comprises the following as shown in **Figure 1.0.3**:

- (a) The *Objectives*.
- (b) The *Functional Statements*.
- (c) The *Performance Requirements* with which all *Building Solutions* must comply.
- (d) The *Building Solutions*.

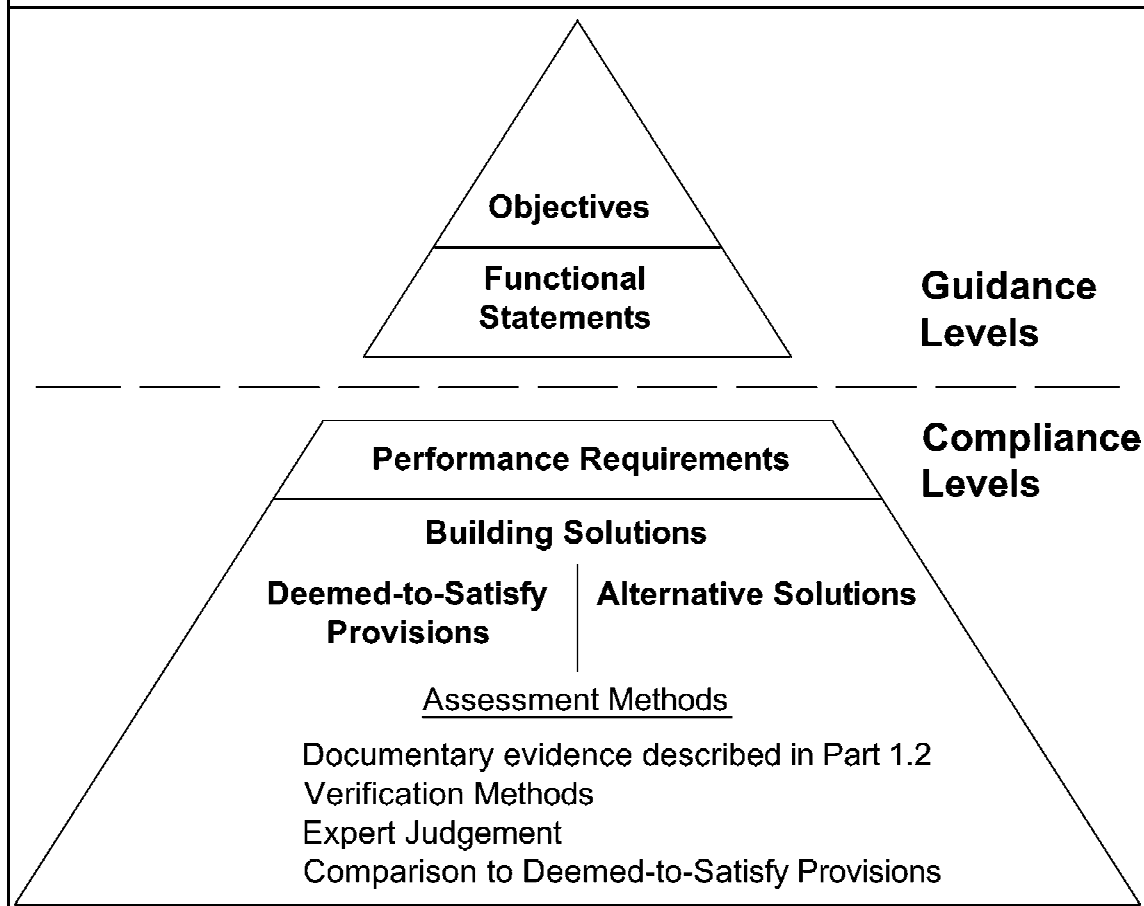**Figure 1.0.3**  
**THE BCA HIERARCHY**



## 1.0.4 Compliance with the BCA

A *Building Solution* will comply with the BCA if it satisfies the *Performance Requirements*.

## 1.0.5 Meeting the Performance Requirements

Compliance with the *Performance Requirements* can only be achieved by—

- (a) complying with the *Deemed-to-Satisfy Provisions*; or
- (b) formulating an *Alternative Solution* which—
  - (i) complies with the *Performance Requirements*; or
  - (ii) is shown to be at least *equivalent* to the *Deemed-to-Satisfy Provisions*; or
- (c) a combination of (a) and (b).

## 1.0.6 Objectives and Functional Statements

The *Objectives* and *Functional Statements* may be used as an aid to interpretation.

### 1.0.7 Deemed-to-Satisfy Provisions

- (a) A *Building Solution* which complies with the *Deemed-to-Satisfy Provisions* is deemed to comply with the *Performance Requirements*.
- (b) Where an acceptable construction manual and an acceptable construction practice contained in the same Part of **Section 3** are deemed to satisfy the same component of a *Performance Requirement*, in order to comply with the *Deemed-to-Satisfy Provisions* it is only necessary to satisfy—
  - (i) the appropriate acceptable construction manual; or
  - (ii) the appropriate acceptable construction practice.
- (c) Where an acceptable construction manual and an acceptable construction practice contained in the same Part of **Section 3** are deemed to satisfy different components of a *Performance Requirement*, compliance with the *Deemed-to-Satisfy Provisions* may require satisfying both the listed acceptable construction manual and the acceptable construction practice for their specific components.

### 1.0.8 Alternative Solutions

- (a) An *Alternative Solution* must be assessed according to one or more of the *Assessment Methods*.
- (b) An *Alternative Solution* will only comply with the BCA if the *Assessment Methods* used to determine compliance with the *Performance Requirements* have been satisfied.
- (c) The *Performance Requirements* relevant to an *Alternative Solution* must be determined in accordance with **1.0.10**.

### 1.0.9 Assessment Methods

The following *Assessment Methods*, or any combination of them, can be used to determine that a *Building Solution* complies with the *Performance Requirements*:

- (a) Evidence to support that the use of a material, form of construction or design meets a *Performance Requirement* or a *Deemed-to-Satisfy Provision* as described in **1.2.2**.
- (b) *Verification Methods* such as—
  - (i) the *Verification Methods* in the BCA; or
  - (ii) such other *Verification Methods* as the *appropriate authority* accepts for determining compliance with the *Performance Requirements*.
- (c) Comparison with the *Deemed-to-Satisfy Provisions*.
- (d) *Expert Judgement*.

### 1.0.10 Relevant Performance Requirements

The following method must be used to determine the *Performance Requirement* or *Performance Requirements* relevant to an *Alternative Solution*:

- (a) Identify the relevant *Deemed-to-Satisfy Provision* of Section 3 that is to be the subject of the *Alternative Solution*.
- (b) Identify the *Performance Requirements* from Section 2 that are relevant to the identified *Deemed-to-Satisfy Provisions*.

- (c) Identify *Performance Requirements* from other parts of Section 2 that are relevant to any aspects of the *Alternative Solution* proposed or that are affected by the application of the *Deemed-to-Satisfy Provisions*, that are the subject of the *Alternative Solution*.

## PART 1.1 INTERPRETATION

### 1.1.1 Definitions

1.1.1.1 In the *Housing Provisions*, definitions are contained as follows:

- (a) In 1.1.1 for definitions that apply to all of the *Housing Provisions*.
- (b) In each Part (as applicable) for definitions that apply to that Part only.

1.1.1.2 In the *Housing Provisions*, unless the contrary appears:

**Alpine area** means land—

- (a) likely to be subject to significant snowfalls; and
- (b) in New South Wales, ACT or Victoria more than 1200 m above the Australian Height Datum; and
- (c) in Tasmania more than 900 m above the Australian Height Datum.

**Explanatory information:**

See **Part 3.7.5** for map of *alpine areas*.

**Alteration**, in relation to a building, includes an addition or extension to a building.

**Alternative Solution** means a *Building Solution* which complies with the *Performance Requirements* other than by reason of complying with the *Deemed-to-Satisfy Provisions*.

**Appropriate authority** means the relevant authority as determined by the building regulatory legislation in each State and Territory.

**Assessment Method** means a method used for determining or establishing that a *Building Solution* complies with the *Performance Requirements*.

**Automatic**, applied to a fire door, smoke door, solid core door, fire shutter, fire *window*, smoke-and-heat vent, sprinkler system, alarm system or the like, means designed to operate when activated by a heat, smoke or fire sensing device.

**Average recurrence interval** applied to rainfall, means the average or expected interval between events of a given rainfall intensity being exceeded.

**Building Solution** means a solution which complies with the *Performance Requirements* and is—

- (a) an *Alternative Solution*; or
- (b) a solution which complies with the *Deemed-to-Satisfy Provisions*; or
- (c) a combination of (a) and (b).

**Breaking surf** means any area of salt water in which waves break on an average of at least 4 days per week but does not include white caps or choppy water.

**Explanatory information:**

*Breaking surf* normally occurs in areas exposed to the open sea. *Breaking surf* does not normally occur in sheltered areas, such as that which occurs around Port Phillip Bay, Sydney Harbour, Swan River, Derwent River and similar locations.

**Cavity** means a void between 2 leaves of masonry, or in masonry veneer construction, a void between a leaf of masonry and the supporting frame.


**Certificate of Accreditation** means a certificate issued by a State or Territory accreditation authority stating that the properties and performance of a building material or method of construction or design fulfil specific requirements of the *Housing Provisions*.

**Certificate of Conformity** means a certificate issued under the ABCB scheme for products and systems certification stating that the properties and performance of a building material or method of construction or design fulfil specific requirements of the *Housing Provisions*.

**Climate zone**, for the purposes of **Part 2.6** and **Part 3.12**, means an area defined in **Figure 1.1.4** and in **Table 1.1.2** for specific locations, having energy efficiency provisions based on a range of similar climatic characteristics.

**Figure 1.1.4**

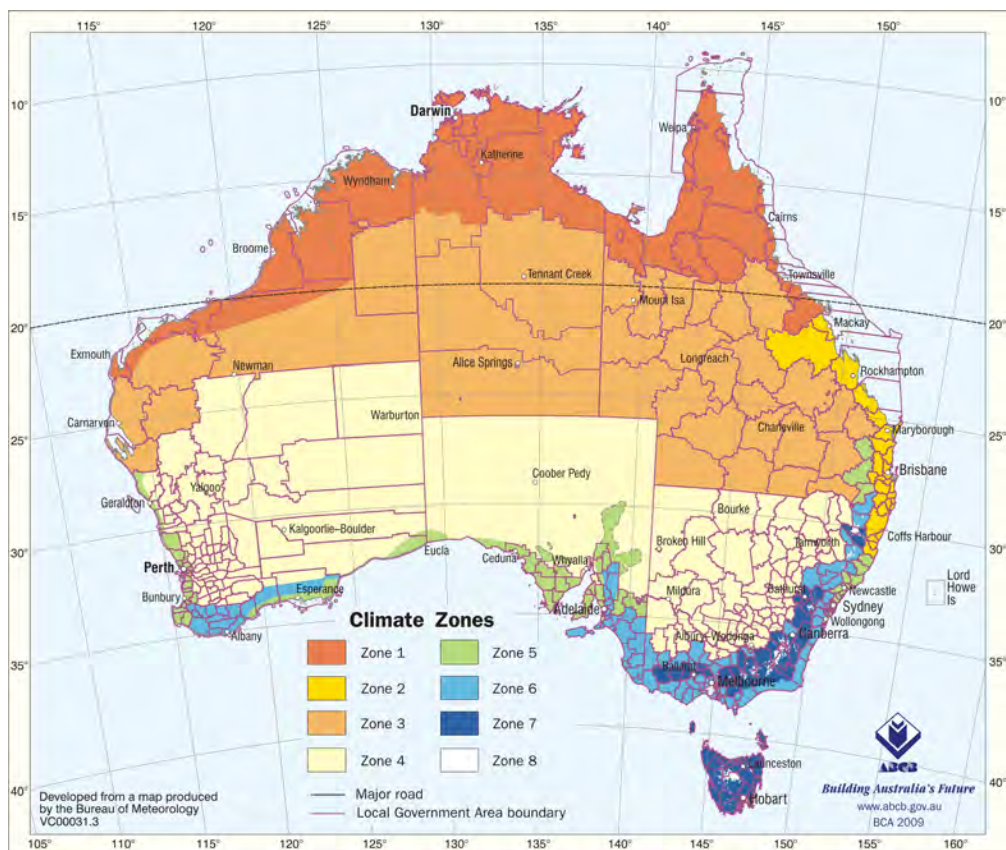**CLIMATE ZONES FOR THERMAL DESIGN**



**Notes:**

1. This map can be viewed in enlargeable form on the Energy Efficiency page of the ABCB web site at [www.abcb.gov.au](http://www.abcb.gov.au).



**Figure 1.1.4****CLIMATE ZONES FOR THERMAL DESIGN**

2. A Zone 4 area in South Australia, other than a council area, at an altitude greater than 300 m above Australian Height Datum, is to be considered as Zone 5.

**Table 1.1.2 CLIMATE ZONES FOR THERMAL DESIGN — VARIOUS LOCATIONS**

Location	<i>Climate zone</i>	Location	<i>Climate zone</i>	Location	<i>Climate zone</i>	Location	<i>Climate zone</i>
Australian Capital Territory				Canberra	7		
New South Wales							
Albury	4	Byron Bay	2	Lord Howe Island	2	Tamworth	4
Armidale	7	Cobar	4	Moree	4	Thredbo	8
Batemans Bay	6	Coffs Harbour	2	Newcastle	5	Wagga Wagga	4
Bathurst	7	Dubbo	4	Nowra	6	Williamtown	5
Bega	6	Goulburn	7	Orange	7	Wollongong	5
Bellingen Shire - Dorrigo Plateau	7	Grafton	2	Perisher Smiggins	8	Yass	6
Bellingen Shire - Valley & Seaboard	2	Griffith	4	Port Macquarie	5		
Bourke	4	Ivanhoe	4	Sydney - East	5		
Broken Hill	4	Lismore	2	Sydney - West	6		
Northern Territory							
Alice Springs	3	Elliot	3	Renner Springs	3		
Darwin	1	Katherine	1	Tennant Creek	3		
Queensland							
Birdsville	3	Cunnamulla	3	Maryborough	2	Toowoomba	5
Brisbane	2	Longreach	3	Mount Isa	3	Torrens Creek	3
Bundaberg	2	Gladstone	2	Normanton	1	Townsville	1
Cairns	1	Labrador	2	Rockhampton	2	Warwick	5
Cooktown	1	Mackay	2	Roma	3	Weipa	1
South Australia							
Adelaide	5	Kingscote	6	Marree	4	Port Lincoln	5
Bordertown	6	Leigh Creek	5	Mount Gambier	6	Renmark	5
Ceduna	5	Lobethal	6	Murray Bridge	6	Tarcoola	4
Cook	4	Loxton	5	Oodnadatta	4	Victor Harbour	6
Elliston	5	Naracoorte	6	Port Augusta	4	Whyalla	4
Tasmania							
Burnie	7	Flinders Island	7	Launceston	7	Rossarden	7
Bicheno	7	Hobart	7	New Norfolk	7	Smithton	7
Deloraine	7	Huonville	7	Oatlands	7	St Marys	7
Devonport	7	King Island	7	Orford	7	Zeehan	7

Table 1.1.2 CLIMATE ZONES FOR THERMAL DESIGN — VARIOUS LOCATIONS— continued

Location	Climate zone	Location	Climate zone	Location	Climate zone	Location	Climate zone
<b>Victoria</b>							
Anglesea	6	Bright	7	Horsham	6	Swan Hill	4
Ararat	7	Colac	6	Melbourne	6	Traralgon	6
Bairnsdale	6	Dandenong	6	Mildura	4	Wangaratta	7
Ballarat	7	Echuca	4	Portland	6	Warrnambool	6
Benalla	6	Geelong	6	Sale	6	Wodonga	6
Bendigo	6	Hamilton	7	Shepparton	4		
<b>Western Australia</b>							
Albany	6	Cocos Island	1	Kalgoorlie-Boulder	4	Port Hedland	1
Balladonia	4	Derby	1	Karratha	1	Wagin	4
Broome	1	Esperance	5	Meekatharra	4	Wyndham	1
Bunbury	5	Exmouth	1	Northam	4		
Carnarvon	3	Geraldton	5	Pemberton	6		
Christmas Island	1	Halls Creek	3	Perth	5		

**Combustible—**

- (a) applied to a material — means *combustible* under AS 1530.1; or
- (b) applied to construction or part of a building — means constructed wholly or in part of *combustible* materials.

**Common wall** means a wall that is common to adjoining buildings other than Class 1 buildings.

**Construction activity actions** means actions due to stacking of building materials or the use of equipment, including cranes and trucks, during construction or actions which may be induced by floor-to-floor propping.

**Damp-proof course (DPC)** means a continuous layer of impervious material placed in a masonry wall or pier, or between a wall or pier and a floor, to prevent the upward or downward migration of water.

**Deemed-to-Satisfy Provisions** means provisions contained in Section 3 which are deemed to comply with the *Performance Requirements*.

**Designated bushfire prone area** means land which has been designated under a power in legislation as being subject, or likely to be subject, to bushfires.

## STATE AND TERRITORY VARIATIONS

**Definition of designated bushfire prone area has been replaced in New South Wales as follows:**

**Designated bushfire prone area** means land that:

- (a) has been designated under legislation; or
- (b) has been identified under an environmental planning instrument, development control plan or in the course of processing and determining a development application,

as land that can support a bushfire or is likely to be subject to bushfire attack.

**Design wind speed** means the design gust wind speed for the area where the building is located, calculated in accordance with AS/NZS 1170.2 or AS 4055 (see Table 1.1.1 for *Housing Provisions design wind speed* descriptions and equivalent values).

**Table 1.1.1 DESIGN WIND SPEED — EQUIVALENT VALUES**

**Notes:**

1. Wind classification map identifying wind regions is contained in **Part 3.10.1** (see **Figure 3.10.1.4**).
2. Information on wind speeds for particular areas may be available from the *appropriate authority*.
3. Shaded areas denote design wind speed areas covered by **Part 3.10.1**, High Wind Areas.
4. “N” = Normal Winds and “C” = Cyclonic Winds.
5. For Serviceability limit state design gusts refer to AS 4055.
6. Unless otherwise specifically referring to non cyclonic winds, a reference to an N wind speed can be interpreted as a reference to the equivalent C wind speed, where such equivalence exists.

**EQUIVALENT VALUES**

Housing Provisions Description	Wind Class — AS 4055			
	For non cyclonic regions A and B	For cyclonic regions C and D	Design gust wind speed (m/sec) Ultimate Limit State (V <sub>h,u</sub> )	Ultimate Limit State wind speed (km/h)
N1	N1		34	123
N2	N2		40	144
N3/C1	N3	C1	50	180
N4/C2	N4	C2	61	220
N5/C3	N5	C3	74	267
N6/C4	N6	C4	86	310

**Domestic services** means the basic engineering systems of a house that use energy or control the use of energy; and—

- (a) includes heating, air-conditioning, mechanical ventilation and hot water systems; but
- (b) excludes cooking facilities and portable appliances.

**Envelope**, for the purposes of **Part 2.6** and **Part 3.12**, means the parts of a building's *fabric* that separate artificially heated or cooled spaces from—

- (a) the exterior of the building; or
- (b) other spaces that are not artificially heated or cooled.

**Equivalent** means equivalent to the level of health, safety and amenity provided by the *Deemed-to-Satisfy Provisions*.

**Expert Judgement** means the judgement of an expert who has the qualifications and experience to determine whether a *Building Solution* complies with the *Performance Requirements*.

**External wall** means an outer wall of a building which is not a *separating wall*.

**Fabric**, for the purposes of **Part 2.6** and **Part 3.12**, means the basic building structural elements and components of a building including the roof, ceilings, walls and floors.

**Fire-resistance level (FRL)** means the grading periods in minutes determined in accordance with **Specification A2.3** of BCA Volume One, for—

- (a) *structural adequacy*; and
- (b) *integrity*; and
- (c) *insulation*,

and expressed in that order.

**Explanatory information:**

A dash means there is no requirement for that criterion. For example, 90/—/— means there is no FRL for integrity and insulation.

**Fire-resisting**, applied to a *structural member* or other part of a building, means having the FRL *required* for that *structural member* or other part.


**Flammability Index** means the index number determined under AS 1530.2.

**Flashing** means a strip or sleeve of impervious material dressed, fitted or built-in to provide a barrier to moisture movement, or to divert the travel of moisture, or to cover a joint where water would otherwise penetrate to the interior of a building.

**Floor area** means, in relation to a room, the area of the room measured within the finished surfaces of the walls, and includes the area occupied by any cupboard or other built-in furniture, fixture or fitting (see **Figure 1.1.1**).

**Figure 1.1.1**

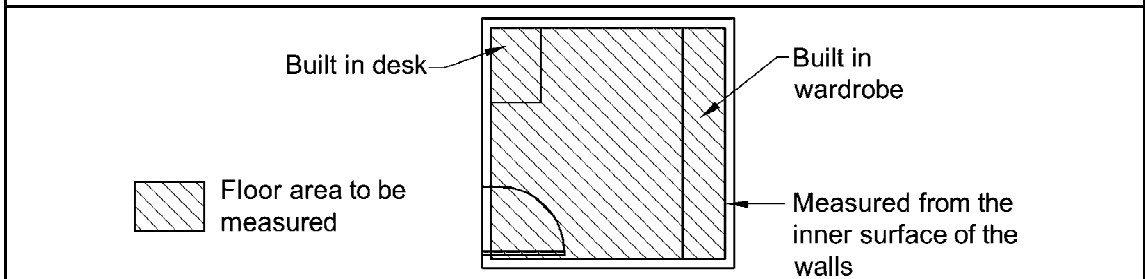
**IDENTIFICATION OF FLOOR AREA OF A ROOM**



**Foundation** means the ground which supports the building (see **Figure 1.1.2**).

Figure 1.1.2

## IDENTIFICATION OF FOUNDATION

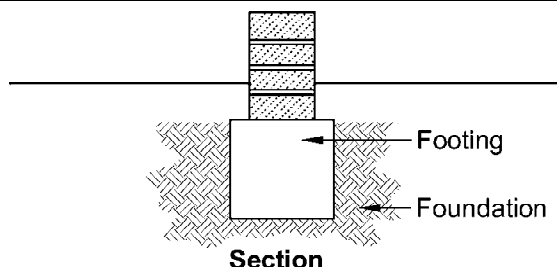

**Functional Statement** means a statement which describes how buildings and building elements achieve the *Objectives*.

**Glazing**, for the purposes of **Part 2.6** and **Part 3.12**, means a transparent or translucent element and its supporting frame located in the external *fabric* of the building, and includes a *window* other than a *roof light*.

**Habitable room** means a room used for normal domestic activities, and—

- (a) includes a bedroom, living room, lounge room, music room, television room, kitchen, dining room, sewing room, study, playroom, family room, home theatre and sunroom; but
- (b) excludes a bathroom, laundry, water closet, pantry, walk-in wardrobe, corridor, hallway, lobby, photographic darkroom, clothes-drying room, and other spaces of a specialised nature occupied neither frequently nor for extended periods.

**High wind area** means a region that is subject to *design wind speeds* more than N3/C1 (see **Table 1.1.1**).

**Housing Provisions** means the requirements for Class 1 and 10 buildings contained in Volume Two of the Building Code of Australia as published by the Australian Building Codes Board.

**Illuminance** means the luminous flux falling onto a unit area of surface.

**Insulation**, in relation to an FRL, means the ability to maintain a temperature on the surface not exposed to the furnace below the limits specified in AS 1530.4.

**Integrity**, in relation to an FRL, means the ability to resist the passage of flames and hot gases specified in AS 1530.4.

**Internal wall** excludes a *separating wall*, *common wall* or party wall.

**Lightweight construction** means construction which incorporates or comprises—

- (a) sheet or board material, plaster, render, sprayed application, or other material similarly susceptible to damage by impact, pressure or abrasion; or
- (b) concrete and concrete products containing pumice, perlite, vermiculite, or other soft material similarly susceptible to damage by impact, pressure or abrasion; or
- (c) masonry having a thickness less than 70 mm.

**Loadbearing** means intended to resist vertical forces additional to those due to its own weight.

**Low rainfall intensity area** means an area with a 5 minute rainfall intensity for an average recurrence interval of 20 years of not more than 125 mm/hour.

**Explanatory information:**

Rainfall intensity figures can be obtained from Table 3.5.2.1.

**Non-combustible—**

- (a) applied to a material — means not deemed *combustible* under AS 1530.1 — Combustibility Tests for Materials; and
- (b) applied to construction or part of a building — means constructed wholly of materials that are not deemed *combustible*.

**Objective** means a statement contained in the BCA which is considered to reflect community expectations.

**Other property** means all or any of the following—

- (a) any building, whether or not on the same or an adjoining allotment; and
- (b) any adjoining allotment; and
- (c) a road.

**Outdoor air** means air outside the building.

**Outfall** means that part of the disposal system receiving *surface water* from the drainage system and may include a natural water course, kerb and channel, or soakage system.

**Performance Requirement** means a requirement which states the level of performance which a *Building Solution* must meet.

**Private garage** means—

- (a) any garage associated with a Class 1 building; or
- (b) any separate single storey garage associated with another building where such garage is capable of accommodating not more than 3 vehicles.

**Professional engineer** means a person who is—

- (a) if legislation is applicable — a registered *professional engineer* in the relevant discipline who has appropriate experience and competence in the relevant field; or
- (b) if legislation is not applicable—
  - (i) a Corporate Member of the Institution of Engineers, Australia; or
  - (ii) eligible to become a Corporate Member of the Institution of Engineers, Australia, and has appropriate experience and competence in the relevant field.

**Registered Testing Authority** means—

- (a) an organisation registered by the National Association of Testing Authorities (NATA) to test in the relevant field; or
- (b) an organisation outside Australia registered by an authority recognised by NATA through a mutual recognition agreement; or
- (c) an organisation recognised as being a *Registered Testing Authority* under legislation at the time the test was undertaken.

**Required** means required to satisfy a *Performance Requirement* or a *Deemed-to-Satisfy Provision* of the *Housing Provisions* as appropriate.

**Roof light**, for the purposes of **Part 2.6** and **Part 3.12**, means a skylight, *window* or the like installed in a roof—

- (a) to permit natural light to enter the room below; and
- (b) at an angle between 0 and 70 degrees measured from the horizontal plane.

**Sanitary compartment** means a room or space containing a closet pan or urinal.

**Sarking-type material** means a material such as a *reflective insulation* or other flexible membrane of a type normally used for a purpose such as waterproofing, vapour proofing or thermal reflectance.


**Self-closing**, applied to a door or *window* means equipped with a device which returns the door or *window* to the fully closed and latched position immediately after each manual opening.

**Separating wall** means a wall that is common to adjoining Class 1 buildings (see **Figure 1.1.3**).

**Figure 1.1.3**

**SEPARATING WALL**

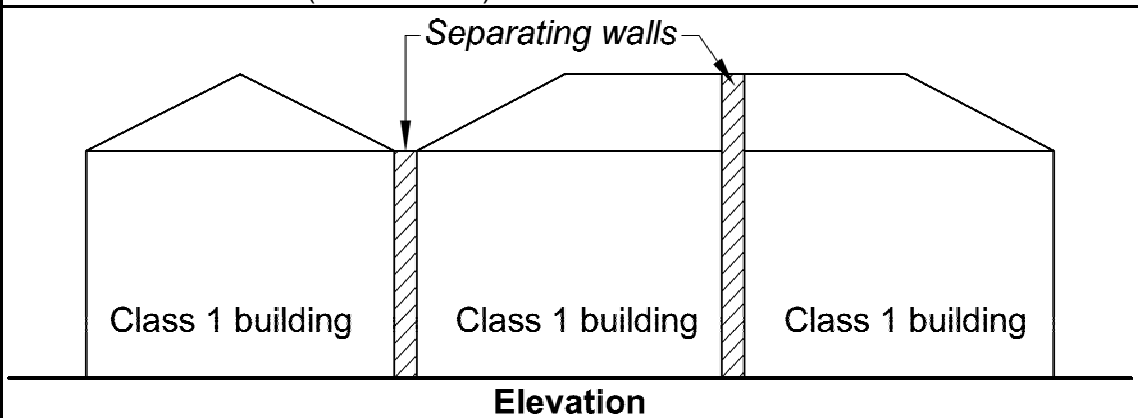**Note:** May also be known as a party wall and typically is *required* to be *fire-resisting* construction (see Part 3.7.1)



**Site** means the part of the allotment of land on which a building stands or is to be erected.

**Sitework** means work on or around a *site*, including earthworks, preparatory to or associated with the construction, *alteration*, demolition or removal of a building.

**Smoke-Developed Index** means the index number for smoke developed under AS/NZS 1530.3.

**Spread-of-Flame Index** means the index number for spread of flame under AS/NZS 1530.3.

**Standard Fire Test** means the Fire-resistance Test of Elements of Building Construction as described in AS 1530.4.

**Structural adequacy**, in relation to an FRL, means the ability to maintain stability and adequate *loadbearing* capacity under AS 1530.4.



**Structural member** means a component or part of an assembly which provides vertical or lateral support to a building or structure.

**Surface water** means all naturally occurring water, other than sub-surface water, which results from rainfall on or around the [site](#) or water flowing onto the [site](#), including that flowing from a drain, stream, river, lake or sea.

**Swimming pool** means any excavation or structure containing water and used principally for swimming, wading, paddling, or the like, including a bathing or wading pool, or spa.

**Verification Method** means a test, inspection, calculation or other method that determines whether a [Building Solution](#) complies with the relevant [Performance Requirements](#).

**Window** includes a roof light, glass panel, glass block or brick, glass louvre, glazed sash, glazed door, or other device which transmits natural light directly from outside a building to the room concerned when in the closed position.

### 1.1.2 Adoption of referenced documents

Where a [Deemed-to-Satisfy Provision](#) references a document, rule, specification or provision, that adoption does not include a provision—

- (a) specifying or defining the respective rights, responsibilities or obligations as between themselves of any manufacturer, supplier or purchaser; or
- (b) specifying the responsibilities of any trades person or other building operative, architect, engineer, authority, or other person or body; or
- (c) requiring the submission for approval of any material, building component, form or method of construction, to any person, authority or body other than a person or body empowered under State or Territory legislation to give that approval; or
- (d) specifying that a material, building component, form or method of construction must be submitted to any person, authority or body for expression of opinion; or
- (e) permitting a departure from the code, rule, specification or provision at the sole discretion of the manufacturer or purchaser, or by arrangement or agreement between the manufacturer and purchaser.

### 1.1.3 Context of reference

- (a) A reference in a [Deemed-to-Satisfy Provision](#) to a document under [1.1.2](#) refers to the edition or issue, together with any amendment, listed in [Part 1.4](#) and only so much as is relevant in the context in which the document is quoted.
- (b) Any—
  - (i) reference in a document listed in [Part 1.4](#) (primary document) to another document (secondary reference); and
  - (ii) subsequent references to other documents in secondary documents and those other documents,

is a reference to the secondary and other document as they existed at the time of publication of the primary document listed in [Part 1.4](#).

- (c) The provisions of [\(b\)](#) do not apply if the secondary referenced document is also a primary referenced document, in which case the edition or issue of the primary referenced document applies.

- (d) Where the *Housing Provisions* references a document under 1.1.2 which is subject to publication of a new edition or amendment not listed under Part 1.4, the new edition or amendment need not be complied with in order to comply with the *Deemed-to-Satisfy Provisions*.

#### 1.1.4 Differences between referenced documents and the Housing Provisions

The *Housing Provisions* overrule in any difference arising between it and any document referenced as part of the acceptable construction practice.

#### 1.1.5 Application of the Housing Provisions to a particular State or Territory

For application within a particular State or Territory, the *Housing Provisions* comprise—

- (a) Sections 1 to 3 (inclusive); and
- (b) the variations and deletions applicable to that State or Territory specified in Sections 1 to 3 inclusive; and
- (c) the additions to Sections 1 to 3 inclusive applicable to that State or Territory specified in the relevant Appendix.

#### 1.1.6 Language

A reference to a building in the *Housing Provisions* is a reference to an entire building or part of a building, as the case requires.

#### 1.1.7 Interpretation of diagrams

Diagrams in the *Housing Provisions* are used to describe specific issues referenced in the associated text. They are not to be construed as containing all design information that is *required* for that particular building element or situation.

##### Explanatory information:

Diagrams are used to explain the requirements of a particular clause. To ensure the context of the requirement is clearly understood, adjacent construction elements of the building that would normally be required in that particular situation are not always shown.

eg: Diagrams to show the installation of *damp-proof courses* will only depict the *damp-proof course* and associated masonry. It will not necessarily show non-related items such as wall ties, adjacent timber flooring, reinforcing for any footing, etc.

Accordingly, aspects of a diagram that are not shown should not be interpreted as meaning these construction details are not *required*.

#### 1.1.8 Explanatory information

These elements of the *Housing Provisions* are non-mandatory. They are used to provide additional guidance on the application of the particular Parts and clauses and do not need to be followed to meet the requirements of the *Housing Provisions*.

The ABCB gives no warranty or guarantee that the Explanatory Information is correct or complete. The ABCB shall not be liable for any loss howsoever caused whether due to negligence or otherwise arising from the use of or reliance on the Explanatory Information.

The ABCB recommends that anyone seeking to rely on the Explanatory Information obtain their own independent expert advice in relation to building or related activities.

## PART 1.2 ACCEPTANCE OF DESIGN AND CONSTRUCTION

### 1.2.1 Suitability of materials

Every part of a building must be constructed in an appropriate manner to achieve the requirements of the *Housing Provisions*, using materials that are fit for the purpose for which they are intended.

### 1.2.2 Evidence of suitability

- (a) Subject to **1.2.3** and **1.2.4**, evidence to support that the use of a material, form of construction or design meets a *Performance Requirement* or a *Deemed-to-Satisfy Provision* may be in the form of one or a combination of the following:
- (i) A report issued by a *Registered Testing Authority*, showing that the material or form of construction has been submitted to the tests listed in the report, and setting out the results of those tests and any other relevant information that demonstrates its suitability for use in the building.
  - (ii) A current *Certificate of Conformity* or a current *Certificate of Accreditation*.
  - (iii) A certificate from a *professional engineer* or other appropriately qualified person which—
    - (A) certifies that a material, design or form of construction complies with the requirements of the *Housing Provisions*; and
    - (B) sets out the basis on which it is given and the extent to which relevant specifications, rules, codes of practice or other publications have been relied upon.
  - (iv) A current certificate issued by a product certification body that has been accredited by the Joint Accreditation Scheme of Australia and New Zealand (JAS–ANZ).
  - (v) \* \* \* \* \*
  - (vi) Any other form of documentary evidence that correctly describes the properties and performance of the material or form of construction and adequately demonstrates its suitability for use in the building.
- (b) Evidence to support that a calculation method complies with an ABCB protocol may be in the form of one or a combination of the following:
- (i) A certificate from a *professional engineer* or other appropriately qualified person which—
    - (A) certifies that the calculation method complies with a relevant ABCB protocol; and
    - (B) sets out the basis on which it is given and the extent to which relevant specifications, rules, codes of practice and other publications have been relied upon.
  - (ii) Any other form of documentary evidence that correctly describes how the calculation method complies with a relevant ABCB protocol.

- (c) Any copy of documentary evidence submitted, must be a complete copy of the original report or document.

### 1.2.3 Fire resistance of building elements

Where a *Deemed-to-Satisfy Provision* requires a building element to have an FRL, it must comply with the acceptable construction method or be determined in accordance with **Specification A2.3** of BCA Volume One.

### 1.2.4 Early Fire Hazard Indices

Where a *Deemed-to-Satisfy Provision* requires a building component or assembly to have an Early Fire Hazard Index, it must be determined in accordance with **Specification A2.4** of BCA Volume One.

#### Explanatory information:

The provisions of **Part 1.2** list acceptable methods to enable verification and acceptance of both the *Performance Requirements* (listed in **Section 2**) and *Deemed-to-Satisfy Provisions* (listed in **Section 3**) of the *Housing Provisions*.

## PART 1.3 CLASSIFICATION

### 1.3.1 Principles of classification

The classification of a building or part of a building is determined by the purpose for which it is designed, constructed or adapted to be used.

#### Explanatory information:

1. Class 1 and 10 buildings are classified in accordance with this Part; and
2. Class 2 to 9 buildings are classified in accordance with [Section A](#) of BCA, Volume One.

### 1.3.2 Classification

Class 1 and 10 buildings are classified as follows:

**Class 1** — one or more buildings, which in association constitute—

(a) **Class 1a** — a single dwelling being—

- (i) a detached house; or
- (ii) one of a group of two or more attached dwellings, each being a building, separated by a [fire-resisting](#) wall, including a row house, terrace house, town house or villa unit; or

(b) **Class 1b** — a boarding house, guest house, hostel or the like—

- (i) with a total area of all floors not exceeding 300 m<sup>2</sup> measured over the enclosing walls of the Class 1b building; and
- (ii) in which not more than 12 persons would ordinarily be resident,

which is not located above or below another dwelling or another Class of building other than a [private garage](#) (see [Figure 1.3.1](#), [1.3.2](#) and [1.3.3](#)).

**Class 10** — a non-habitable building or structure being—

- (a) **Class 10a** — a non-habitable building being a [private garage](#), carport, shed, or the like; or
- (b) **Class 10b** — a structure being a fence, mast, antenna, retaining or free-standing wall, [swimming pool](#), or the like.

(see [Figure 1.3.3](#)).

Figure 1.3.1

## IDENTIFICATION OF CLASS 1 BUILDINGS

**Note:** For **fire-resisting** construction between Class 1 buildings see Part 3.7.1.

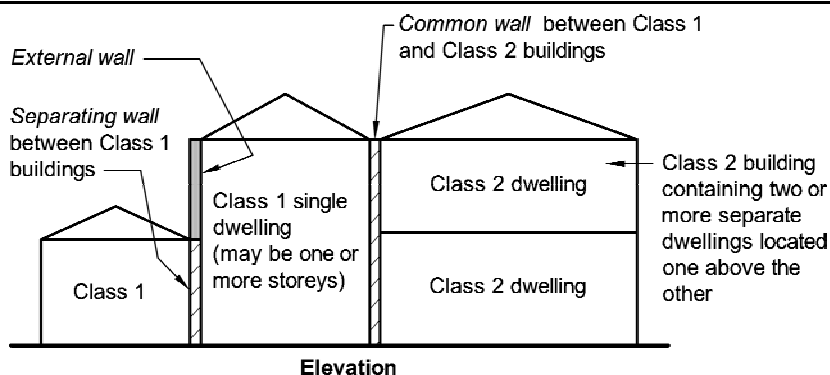


Figure 1.3.2

## TYPICAL CLASS 1 CONFIGURATIONS

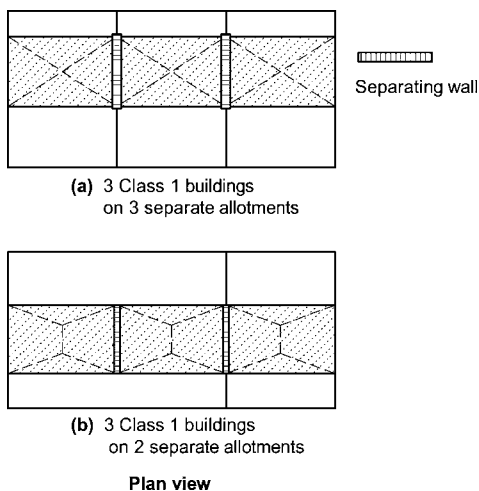
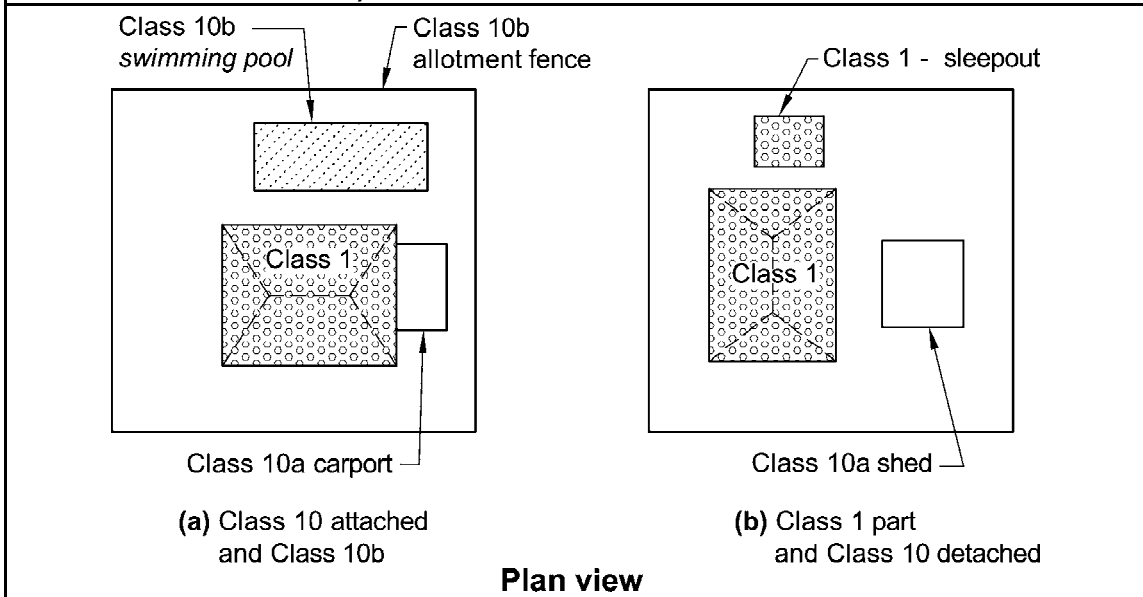




Figure 1.3.3

**DOMESTIC ALLOTMENT — CLASSIFICATION OF BUILDINGS AND STRUCTURES**

- Notes:**
1. A Class 10 building may be attached to a Class 1 building.
  2. A Class 1 may consist of one or more buildings (eg detached bedrooms).

**1.3.3 Multiple classifications**

Each part of a building must be classified separately, and—

- (a) Classes 1a, 1b, 10a and 10b are separate classifications; and
- (b) a reference to—
  - (i) Class 1 — is to Class 1a and 1b; and
  - (ii) Class 10 — is to Class 10a and 10b; and
- (c) where parts have different purposes — if not more than 10% of the *floor area* of a Class 1 building is used for a purpose which is a different classification, the classification of Class 1 may apply to the whole building.

## PART 1.4 DOCUMENTS ADOPTED BY REFERENCE

### 1.4.1 Schedule of referenced documents

The documents listed in [Table 1.4.1](#) are referred to in the *Housing Provisions*.

**Table 1.4.1: SCHEDULE OF REFERENCED DOCUMENTS**

No.	Date	Title	BCA Clause(s)
<b>AS/NZS 1170</b>		Structural design actions	
Part 0	2002	General principles	3.1, 3.10.1.0, 3.11.2
		Amdt 1	
Part 1	2002	Permanent, imposed and other actions	3.1, 3.9.2.3, 3.11.3
		Amdt 1	
		Amdt 2	
Part 2	2002	Wind actions	1.1.1, 3.1, 3.3.2.2, 3.10.1.0, 3.11.3
		Amdt 1	
Part 3	2003	Snow and ice actions	3.1, 3.11.3
		Amdt 1	
<b>AS 1170</b>		Minimum design loads on structures	
Part 4	1993	Earthquake loads	3.1, 3.3.1.1, 3.3.1.2, 3.3.2.1, 3.3.3.1, 3.4.4.1, 3.10.2.0, 3.11.5
		Amdt 1	
<b>AS 1170</b>		Structural design actions	
Part 4	2007	Earthquake actions in Australia	3.11.3, 3.11.6
<b>AS/NZS 1200</b>	2000	Pressure equipment	3.7.3.0
<b>AS 1273</b>	1991	Unplasticized PVC (UPVC) downpipe and fittings for rainwater	3.5.2.2

Table 1.4.1: SCHEDULE OF REFERENCED DOCUMENTS— continued

No.	Date	Title	BCA Clause(s)
<b>AS/NZS 1276</b>		Acoustics—Rating of sound installation in buildings and of building elements	
Part 1	1999	Airborne sound insulation  [Note: Test reports based on AS 1276 — 1979 and issued prior to AS/NZS 1276.1 — 1999 being referenced in the BCA, remain valid. The STC values in reports based on AS 1276 — 1979 shall be considered to be equivalent to $R_w$ values. Test reports prepared after the BCA reference date for AS/NZS 1276.1 — 1999 must be based on that version.]	V2.4.6, 3.8.6.2
<b>AS 1288</b>	2006	Glass in buildings—Selection and Installation  Amdt 1	3.6.0, 3.6.1, 3.6.3, 3.9.2.3, 3.10.1.0, 3.11.6
<b>AS 1289</b>		Methods of testing soils for engineering purposes	
Method 6.3.3	1997	Determination of the penetration resistance of a soil — Perth sand penetrometer test  Amdt 1	3.2.2.2
<b>AS 1397</b>	2001	Steel sheet and strip — Hot-dipped zinc-coated or aluminium/zinc-coated	3.4.2.2, 3.5.1.3
<b>AS 1530</b>		Methods for fire tests on building materials, components and structures	
Part 1	1994	Combustibility test for materials	1.1.1
Part 2	1993	Test for flammability of materials  Amdt 1	1.1.1
Part 4	2005	Fire-resistance test of elements of construction  [Note: Subject to the note to AS 4072.1, reports relating to tests carried out under earlier editions of AS 1530 Parts 1 to 4 remain valid. Reports relating to tests carried out after the date of an amendment to a Standard must relate to the amended Standard]	1.1.1, 3.7.1.8

Table 1.4.1: SCHEDULE OF REFERENCED DOCUMENTS— continued

No.	Date	Title	BCA Clause(s)
<b>AS/NZS 1530</b>		Methods for fire tests on building materials, components and structures	
Part 3	1999	Simultaneous determination of ignitability, flame propagation, heat release and smoke release	1.1.1
<b>AS 1562</b>		Design and installation of sheet roof and wall cladding	
Part 1	1992	Metal Amdt 1 Amdt 2	3.5.1.0
<b>AS/NZS 1562</b>		Design and installation of sheet roof and wall cladding	
Part 2	1999	Corrugated fibre-reinforced cement	3.5.1.0
Part 3	1996	Plastics	3.5.1.0
<b>AS 1657</b>	1992	Fixed platforms, walkways, stairways and ladders — Design, construction and installation  (SAA Code for Fixed Platforms, Walkways, Stairways and Ladders)	3.9.1.2
<b>AS/NZS 1664</b>		Aluminium structures	
Part 1	1997	Limit state design Amdt 1	3.11.6
Part 2	1997	Allowable stress design Amdt 1	3.11.6
<b>AS 1668</b>		The use of mechanical ventilation and air-conditioning in buildings	
Part 2	1991	Mechanical ventilation for acceptable indoor-air quality	3.8.5.0
<b>AS/NZS 1680</b>		Interior lighting	
Part 0	1998	Safe movement	3.8.4.3

Table 1.4.1: SCHEDULE OF REFERENCED DOCUMENTS— continued

No.	Date	Title	BCA Clause(s)
<b>AS 1684</b>		Residential timber-framed construction	
Part 2	2006	Non-cyclonic areas	3.2.5.6, 3.4.1.2, 3.4.3.0, 3.7.4.3, 3.8.1.4, 3.10.1.0
		Amdt 1	
Part 3	2006	Cyclonic areas	3.2.5.6, 3.4.1.2, 3.7.4.3, 3.8.1.4, 3.10.1.0
		Amdt 1	
Part 4	2006	Simplified — Non-cyclonic areas	3.2.5.6, 3.4.1.2, 3.4.3.0, 3.8.1.4
		Amdt 1	
<b>AS 1720</b>		Timber structures	
Part 1	1997	Design methods	3.11.6
		Amdt 1	
		Amdt 2	
		Amdt 3	
		Amdt 4	
<b>AS 1926</b>		Swimming pool safety	
Part 1	1993	Fencing for swimming pools	3.9.3.0, 3.9.3.3, 3.9.3.4
		Amdt 1	
Part 2	1995	Location of fencing for private swimming pools	3.9.3.4
Part 3	2003	Water recirculation and filtration systems	3.9.4.0
<b>AS 2047</b>	1999	Windows in buildings — Selection and installation	3.6.0, 3.6.1, 3.10.1.0, 3.11.6, 3.12.3.3
		Amdt 1	
		Amdt 2	
<b>AS 2049</b>	2002	Roof tiles	3.5.1.0, 3.5.1.2
		Amdt 1	
<b>AS 2050</b>	2002	Installation of roof tiles	3.5.1.0, 3.5.1.2
		Amdt 1	
<b>AS 2159</b>	1995	Piling — Design and installation	3.2.0, 3.11.6
		Amdt 1	

Table 1.4.1: SCHEDULE OF REFERENCED DOCUMENTS— continued

No.	Date	Title	BCA Clause(s)
<b>AS/NZS 2179</b>		Specification for rainwater goods, accessories and fasteners	
Part 1	1994	Metal shape or sheet rainwater goods and metal accessories and fasteners	3.5.2.2
<b>AS/NZS 2269</b>	2004	Plywood-structural	3.5.3.4, 3.8.1.4
<b>AS 2327</b>		Composite structures	
Part 1	2003	Simply supported beams	3.11.6
<b>AS/NZS 2699</b>		Built in components for masonry construction	
Part 1	2000	Wall ties	3.3.3.2
<b>AS 2870</b>	1996	Residential slabs and footings — Construction	3.1.2.4, 3.1.3.2, 3.1.3.3, 3.1.3.5, 3.2.0, 3.2.1, 3.2.2.4, 3.2.2.6, 3.2.3.2, 3.2.4.1, 3.2.5, 3.2.5.2, 3.2.5.6, 3.8.1.4, 3.11.6
		Amdt 1	
		Amdt 2	
		Amdt 3	
		Amdt 4	
<b>AS/NZS 2904</b>	1995	Damp-proof courses and flashings	3.3.4.4, 3.3.4.6, 3.5.3.6
		Amdt 1	
<b>AS/NZS 2908</b>		Cellulose cement products	
Part 2	2000	Flat sheets	3.5.3.3, 3.5.3.4, 3.5.3.5, 3.8.1.4, 3.8.1.5
<b>AS/NZS 2918</b>	2001	Domestic solid fuel burning appliances — Installation	3.7.3.0, 3.7.3.4, 3.7.3.5
<b>AS/NZS 3500</b>		Plumbing and drainage	
Part 3	2003	Stormwater drainage	3.1.2.0, 3.1.2.4, 3.5.2.0, 3.5.2.5
		Amdt 1	
Part 4	2003	Heated water services	3.12.5.0
		Amdt 1	
Part 5	2000	Domestic installations	3.1.2.0, 3.1.2.4, 3.5.2.0, 3.5.2.5, 3.12.5.0
		Amdt 1	
		Amdt 2	
		Amdt 3	

Table 1.4.1: SCHEDULE OF REFERENCED DOCUMENTS— continued

No.	Date	Title	BCA Clause(s)
		Amdt 4	
<b>AS 3600</b>	2001	Concrete structures  Amdt 1 Amdt 2	3.2.2.4, 3.2.3.1, 3.2.5.6, 3.3.3.4, 3.8.1.4, 3.11.6
<b>AS 3660</b> Part 1	2000	Termite management New building work	3.1.3, 3.1.3.0, 3.1.3.2, 3.1.3.4
<b>AS 3700</b>	2001	Masonry structures  Amdt 1 Amdt 2 Amdt 3	3.3.1.0, 3.3.1.1, 3.3.1.6, 3.3.2.0, 3.3.2.1, 3.3.2.2, 3.3.3.0, 3.3.3.1, 3.3.4.0, 3.8.1.4, 3.10, 3.10.1.0, 3.11.6
<b>AS 3740</b>	2004	Waterproofing of wet areas in residential buildings	3.8.1.0
<b>AS 3786</b>	1993	Smoke alarms  Amdt 1 Amdt 2 Amdt 3 Amdt 4	3.7.2.2
<b>AS/NZS 3837</b>	1998	Method of test for heat and smoke release rates for materials and products using an oxygen consumption calorimeter	3.7.4.3
<b>AS 3959</b>	1999	Construction of buildings in bushfire-prone areas  Amdt 1 Amdt 2	3.7.4.0, 3.7.4.2

Table 1.4.1: SCHEDULE OF REFERENCED DOCUMENTS— continued

No.	Date	Title	BCA Clause(s)
<b>AS 4055</b>	2006	Wind loads for housing Amdt 1	1.1.1, 3.3.2.2, 3.11.3
<b>AS 4072</b>		Components for the protection of openings in fire-resistant separating elements	
Part 1	2005	Service penetrations and control joints Amdt 1 [Note: Systems tested to AS 1530.4 prior to 1 January 1995 need not be retested to comply with the provisions in AS 4072.1]	3.7.1.8
<b>AS 4100</b>	1998	Steel Structures	3.2.5.6, 3.3.3.4, 3.4.2.0, 3.4.4.0, 3.10.1.0, 3.11.6
<b>AS/NZS 4200</b>		Pliable building membranes and underlays	
Part 1	1994	Materials Amdt 1	3.5.1.0
Part 2	1994	Installation requirements	3.5.1.0
<b>AS 4254</b>	1995	Ductwork for air-handling systems in buildings Amdt 1 Amdt 2	3.7.1.9, 3.12.5.3
<b>AS/NZS 4256</b>		Plastic roof and wall cladding material	
Part 1	1994	General requirements	3.5.1.0
Part 2	1994	Unplasticized polyvinyl chloride (UPVC) building sheets	3.5.1.0
Part 3	1994	Glass fibre reinforced polyester (GRP)	3.5.1.0
Part 5	1996	Polycarbonate	3.5.1.0
<b>AS/NZS 4600</b>	2005	Cold-formed steel structures	3.3.3.4, 3.4.2.0, 3.4.2.1, 3.4.4.0, 3.10.1.0, 3.11.6
<b>AS/NZS 4858</b>	2004	Wet area membranes	3.8.1.3
<b>AS/NZS 4859</b>		Materials for the thermal insulation of buildings	
Part 1	2002	General criteria and technical provisions Amdt 1	3.12.1.1, 3.12.1.5, 3.12.5.3



Table 1.4.1: SCHEDULE OF REFERENCED DOCUMENTS— continued

No.	Date	Title	BCA Clause(s)
<b>ASTM D2898</b>	1996	Standard test methods for accelerated weathering of fire-retardant-treated wood for fire testing W1	3.7.4.3
<b>ASTM D3018-90</b>	1994	Class A asphalt shingles surfaced with mineral granules	3.5.1.0
<b>ABCB</b>	2006	Protocol for House Energy Rating Software, Version 2006.1	V2.6, V2.6.2.1
<b>ISO 717</b>		Acoustics — Rating of sound insulation in buildings and of building elements	
Part 1	1996	Airborne sound insulation	V2.4.6, 3.8.6.2
<b>ISO 8336</b>	1993E	Fibre cement flat sheets	3.5.3.3, 3.5.3.4, 3.5.3.5
<b>NASH Standard</b>		Residential and low-rise steel framing	
Part 1	2005	Design criteria	3.4.2.0, 3.4.2.1, 3.10.1.0, 3.11.6
		Amdt A	
<b>Northern Territory Deemed to comply Standards manual</b>			3.10.1.0
<b>TN 61</b>		Cement Concrete and Aggregates Australia — Articulated walling	3.2.1, 3.3.1.8

## STATE AND TERRITORY VARIATIONS      SCHEDULE OF REFERENCED DOCUMENTS

<b>AUSTRALIAN CAPITAL TERRITORY REFERENCED DOCUMENTS</b>			
No.	Date	Title	
		Development Control Code for Best Practice Waste Management in the ACT	ACT 3.2
<b>NEW SOUTH WALES REFERENCED DOCUMENTS</b>			
<b>NSW Rural Fire Service</b>	The document in force under the Environmental Planning and Assessment Act, 1979	Planning for Bushfire Protection	3.7.4.0, 3.7.4.2
<b>NORTHERN TERRITORY REFERENCED DOCUMENTS</b>			
<b>BCA 2005</b>	May 2005	Building Code of Australia	2.6, 3.12
<b>QUEENSLAND REFERENCED DOCUMENTS</b>			

Queensland Forest Service of the Department of Primary Industries Construction timbers in Queensland - Properties and specifications for satisfactory performance of construction timbers in Queensland - Class 1 and 10 buildings (Houses, carports, garages, greenhouses and sheds)			3.4.3.0
Building Act 1975			O2.5, F2.5.2, P2.5.3, 3.9.3
<b>SOUTH AUSTRALIAN REFERENCED DOCUMENTS</b>			
<b>South Australian Housing Code 2002 (as amended)</b>			SA 1
<b>SA F1.7</b>	2004	South Australian Minister's Specification — Waterproofing of wet areas in buildings — Additional requirements	3.8.1.0, SA 3.2
<b>AS 1056</b>	1991	Storage water heaters	SA 7.3
Part 1		General requirements	
<b>AS 1428</b>		Design for access and mobility	SA 5.2.3
Part 1	2001	General requirements for access — New building work	
<b>AS 1720</b>	2006	Timber structures	3.7.4.3
Part 2		Timber properties	
<b>AS 4234</b>	1994	Solar water heaters—Domestic and heat pump—Calculation of energy consumption	SA 7.3, SA 7.4
<b>AS 4552</b>	2005	Gas fired water heaters for hot water supply and/or central heating	SA 7.1, SA 7.3
<b>enHealth Council, Department of Health and Ageing</b>	2004	Guidance on the use of rainwater tanks	SA 2.2.4
<b>Department of Climate Change</b>	2008	National Greenhouse Accounts (NGA) Factors	SA 7.3
<b>TASMANIAN REFERENCED DOCUMENTS</b>			
<b>AS/NZS 4013</b>	1999	Domestic solid fuel burning appliances — Method for determination of flue gas emission	3.7.3.0
<b>BCA 2005</b>	May 2005	Building Code of Australia	2.6, 3.12
<b>VICTORIAN REFERENCED DOCUMENTS</b>			
	2008	Plumbing Regulations	V2.6.1, 3.12.0
<b>WESTERN AUSTRALIAN REFERENCED DOCUMENTS</b>			
<b>AS/NZS 2712</b>	2007	Solar and heat pump water heaters — Design and construction	WA 1.2

**SUPERSEDED**  
**GENERAL REQUIREMENTS**

---

<b>AS 4234</b>	2004	Solar water heaters — Domestic and heat pump — Calculation of energy consumption	WA 1.2
<b>AS 4552</b>	2005	Gas fired water heaters for hot water supply and/or central heating	WA 1.2
<b>AS/NZS 3500.4</b>	2003	Plumbing and drainage - Heated water services, Amdt 1	WA 2.3.3

SECTION **2**

---

# PERFORMANCE PROVISIONS

**Objectives**

**Functional Statements**

**Performance Requirements**

- 2.1 Structure**
- 2.2 Damp and Weatherproofing**
- 2.3 Fire safety**
- 2.4 Health and amenity**
- 2.5 Safe movement and access**
- 2.6 Energy Efficiency**

## SECTION 2 CONTENTS

---

### SECTION 2 PERFORMANCE PROVISIONS

#### **2.0 Application**

2.0 Application

#### **2.1 Structure**

P2.1 Structural stability and resistance to actions

#### **2.2 Damp and Weatherproofing**

P2.2.1 Surface water

P2.2.2 Weatherproofing

P2.2.3 Dampness

P2.2.4 Drainage from swimming pools

#### **2.3 Fire Safety**

P2.3.1 Protection from the spread of fire

P2.3.2 Fire detection and early warning

P2.3.3 Heating appliances

P2.3.4 Bushfire areas

P2.3.5 Alpine areas

#### **2.4 Health and Amenity**

P2.4.1 Wet areas

P2.4.2 Room heights

P2.4.3 Facilities

P2.4.4 Light

P2.4.5 Ventilation

P2.4.6 Sound insulation

V2.4.6 Sound insulation

#### **2.5 Safe Movement and Access**

P2.5.1 Stairways and ramps

P2.5.2 Barriers

P2.5.3 Swimming pool access

P2.5.4 Swimming pool water recirculation systems

#### **2.6 Energy Efficiency**

P2.6.1 Building

P2.6.2 Services

V2.6 Definitions

V2.6.1 Application of this Part

V2.6.2 Alternative Verification Methods

**SUPERSEDED**  
**PERFORMANCE PROVISIONS**

---

V2.6.2.1 Verification using stated value  
V2.6.2.2 Verification using a reference building

## PART 2.0 APPLICATION

---

### 2.0 Application

- (a) This Section contains the [Objectives](#), [Functional Statements](#) and [Performance Requirements](#) for Class 1 and 10 buildings (other than access requirements for people with disabilities in Class 10 buildings).
- (b) For the purposes of this Section a reference to a building includes a reference to both Class 1 and 10 buildings unless otherwise specified.

**Note:**

Access requirements for people with disabilities in Class 10 buildings are contained in [Part D3](#) of the BCA Volume One.

## PART 2.1 STRUCTURE

### OBJECTIVE

#### O2.1

The *Objective* is to—

- (a) safeguard people from injury caused by structural failure; and
- (b) safeguard people from loss of amenity caused by structural behaviour; and
- (c) protect *other property* from physical damage caused by structural failure; and
- (d) safeguard people from injury that may be caused by failure of, or impact with, glazing.

### FUNCTIONAL STATEMENT

#### F2.1

- (a) A building or structure is to withstand the combination of loads and other actions to which it may be reasonably subjected.
- (b) Glazing is to be installed in a building to avoid undue risk of injury to people.

### PERFORMANCE REQUIREMENT

#### P2.1 Structural stability and resistance to actions

- (a) A building or structure, to the degree necessary, must—
  - (i) remain stable and not collapse; and
  - (ii) prevent progressive collapse; and
  - (iii) minimise local damage and loss of amenity through excessive deformation, vibration or degradation; and
  - (iv) avoid causing damage to *other properties*;by resisting the actions to which it may reasonably be subjected.
- (b) The actions to be considered to satisfy (a) include but are not limited to—
  - (i) permanent actions (dead loads); and
  - (ii) imposed actions (live loads arising from occupancy and use); and
  - (iii) wind action; and



- (iv) earthquake action; and
  - (v) snow action; and
  - (vi) liquid pressure action; and
  - (vii) ground water action; and
  - (viii) rainwater action (including ponding action); and
  - (ix) earth pressure action; and
  - (x) differential movement; and
  - (xi) time dependent effects (including creep and shrinkage); and
  - (xii) thermal effects; and
  - (xiii) ground movement caused by—
    - (A) swelling, shrinkage or freezing of the subsoil; and
    - (B) landslip or subsidence; and
    - (C) siteworks associated with the building or structure; and
  - (xiv) *construction activity actions*; and
  - (xv) termite actions.
- (c) The structural resistance of materials and forms of construction must be determined using five percentile characteristic material properties with appropriate allowance for—
- (i) known construction activities; and
  - (ii) type of material; and
  - (iii) characteristics of the site; and
  - (iv) the degree of accuracy inherent in the methods used to assess the structural behaviour; and
  - (v) action effects arising from the differential settlement of foundations, and from restrained dimensional changes due to temperature, moisture, shrinkage, creep and similar effects.
- (d) Glass installations that are at risk of being subjected to human impact must have glazing that—
- (i) if broken on impact, will break in a way that is not likely to cause injury to people; and
  - (ii) resists a reasonably foreseeable human impact without breaking; and
  - (iii) is protected or marked in a way that will reduce the likelihood of human impact.

## STATE AND TERRITORY VARIATIONS

**In Queensland after P2.1 insert P2.1.1 as follows:**

### **P2.1.1**

- (a) The risk of *primary building elements* in a Class 1 or 10 building being damaged by subterranean termites must be adequately minimised by the use of a suitable termite management measure that—
- (i) if it serves a non-temporary Class 1 building, has a design life of at least 50 years; or
  - (ii) if it serves a building not specified in (i), has a design life of at least 50 years or the specified design life of the building, whichever is the lesser; or
  - (iii) is easily and readily accessible for replenishment or replacement and is capable of being replenished or replaced.
- (b) A termite management measure required by (a), to the degree necessary, must—
- (i) be accessible to enable the installation, maintenance and inspection of the termite management measure to be carried out; and
  - (ii) incorporate suitable measures to adequately minimise the risk of the termite management measure inadvertently being damaged, bridged or breached.

**Explanatory information:**

**QLD P2.1.1(a)** requires a termite management measure in Queensland to have a design life of at least 50 years unless it is easily and readily accessible for replenishment or replacement and is capable of being replenished or replaced. In recognition that some buildings other than non-temporary Class 1 buildings may be designed to last less than 50 years, the option of the termite management measure having a design life at least equal to that specified for the building is given. If this option is used, the design life of the building should be agreed upon by all relevant stakeholders at the design stage and should form part of the documentation kept by the *appropriate authority*. It should not be assumed that the design life of 50 years in **QLD P2.1.1(a)(i)** and **(ii)** applies to any other provisions of the BCA, unless stated.

An example of a termite management measure that may satisfy **QLD P2.1.1(a)(iii)** is a chemical soil barrier reticulation system beneath a concrete floor slab laid directly on the ground, provided that the system is easily and readily accessible for replenishment and is capable of being replenished.

An example of a termite management measure that may not satisfy **QLD P2.1.1(a)** for a non-temporary Class 1 building is a hand-sprayed chemical soil barrier beneath a concrete floor slab laid directly on the ground if the chemical does not have a design life of at least 50 years. The concrete floor slab being laid directly on the ground would prevent the area beneath the slab from being easily and readily accessible for replenishment or replacement of the termite management measure.

An example of a termite management measure being inadvertently bridged or breached is when a person places a garden or mulch over the top of or above the level of a termite management measure enabling termites to bypass the measure.

## PART 2.2 DAMP AND WEATHERPROOFING

### OBJECTIVE

#### O2.2

The *Objective* is to—

- (a) safeguard occupants from illness or injury and protect the building from damage caused by—
  - (i) *surface water*; and
  - (ii) external moisture entering a building; and
  - (iii) the accumulation of internal moisture in a building; and
  - (iv) discharge of *swimming pool* waste water; and
- (b) protect *other property* from damage caused by—
  - (i) redirected *surface water*; and
  - (ii) the discharge of *swimming pool* waste water.

### STATE AND TERRITORY VARIATIONS

O2.2(a)(iv) and O2.2(b)(ii) do not apply in the Northern Territory.

### FUNCTIONAL STATEMENT

#### F2.2.1 Surface water

A building including any associated *sitework* is to be constructed in a way that protects people and *other property* from the adverse effects of redirected *surface water*.

#### F2.2.2 Weatherproofing and dampness

A building is to be constructed to provide resistance to moisture from the outside and moisture rising from the ground.

#### Limitation:

**F2.2.2** does not apply to a Class 10 building except where its construction contributes to the weatherproofing of the Class 1 building.

### F2.2.3 Drainage from swimming pools

Adequate means for the disposal of *swimming pool* water and drainage is to be provided to a *swimming pool*.

**Note:**

The *Housing Provisions* do not contain any *Deemed-to-Satisfy Provisions* for this *Performance Requirement*.

**STATE AND TERRITORY VARIATIONS**

**F2.2.3 does not apply in the Northern Territory.**

**PERFORMANCE REQUIREMENT**

#### P2.2.1 Surface water

- (a) *Surface water*, resulting from a storm having an *average recurrence interval* of 20 years and which is collected or concentrated by a building or *sitework*, must be disposed of in a way that avoids the likelihood of damage or nuisance to any *other property*.
- (b) *Surface water*, resulting from a storm having an *average recurrence interval* of 100 years must not enter the building.

**Limitation:**

**P2.2.1(b)** does not apply to a Class 10 building where in the particular case there is no necessity for compliance.

- (c) A drainage system for the disposal of *surface water* must—
  - (i) convey *surface water* to an appropriate *outfall*; and
  - (ii) avoid the entry of water into a building; and
  - (iii) avoid water damaging the building.

#### P2.2.2 Weatherproofing

A roof and *external wall* (including openings around *windows* and doors) must prevent the penetration of water that could cause—

- (a) unhealthy or dangerous conditions, or loss of amenity for occupants; and
- (b) undue dampness or deterioration of building elements.

**Limitation:**

**P2.2.2(a)** does not apply to a Class 10 building except where its construction contributes to the weatherproofing of the Class 1 building.

### P2.2.3 Dampness

Moisture from the ground must be prevented from causing—

- (a) unhealthy or dangerous conditions, or loss of amenity for occupants; and
- (b) undue dampness or deterioration of building elements.

**Limitation:**

**P2.2.3** does not apply to a Class 10 building where in the particular case there is no necessity for compliance.

#### STATE AND TERRITORY VARIATIONS

**P2.2.3 has been replaced in South Australia as follows:**

**P2.2.3 Dampness**

- (a) Moisture from the ground must be prevented from causing—
  - (i) undue dampness or deterioration of building elements; and
  - (ii) unhealthy or dangerous conditions, or loss of amenity for occupants.
- (b) Barriers installed to prevent transfer of moisture from the ground must have—
  - (i) high resistance to moisture penetration; and
  - (ii) high resistance to damage during construction; and
  - (iii) high resistance to degradation by dissolved salts.

**In New South Wales delete P2.2.3 and insert NSW P2.2.3 as follows:**

**NSW P2.2.3 Dampness**

- (a) Moisture from the ground must be prevented from causing—
  - (i) unhealthy or dangerous conditions, or loss of amenity for occupants; and
  - (ii) undue dampness or deterioration of building elements.
- (b) Barriers installed beneath slab on ground construction for the purposes of (a) must have a high resistance to damage during construction.

**Limitation:**

**P2.2.3** does not apply to a Class 10 building where in the particular case there is no necessity for compliance.

**Explanatory information:**

The intent of requiring the barrier to have a high resistance to damage during construction is to increase the barrier's ability to resist punctures during construction. By being less susceptible to puncturing, the barrier will provide increased protection against moisture containing dissolved salts from coming into contact with the concrete slab.

### P2.2.4 Drainage from swimming pools

A *swimming pool* must have adequate means of draining the pool in a manner which will not—

- (a) cause illness to people; or

(b) affect *other property*.

**Note:**

The *Housing Provisions* do not contain any *Deemed-to-Satisfy Provisions* for this *Performance Requirement*.

**STATE AND TERRITORY VARIATIONS**

**P2.2.4** does not apply in the Northern Territory.

## PART 2.3 FIRE SAFETY

### OBJECTIVE

#### O2.3

The *Objective* is to—

- (a) safeguard the occupants from illness or injury—
  - (i) by alerting them of a fire in the building so that they may safely evacuate; and
  - (ii) caused by fire from heating appliances installed within the building; and
  - (iii) in *alpine areas*, from an emergency while evacuating the building; and
- (b) avoid the spread of fire; and
- (c) protect a building from the effects of a bushfire.

### STATE AND TERRITORY VARIATIONS

**O2.3(a) has been replaced in Tasmania as follows:**

#### O2.3(a)

- (a) safeguard people from illness or injury—
  - (i) by alerting them of a fire in the building so that they may safely evacuate; and
  - (ii) caused by fire and emissions from heating appliances installed within the building; and
  - (iii) in *alpine areas*, from an emergency while evacuating the building; and

### FUNCTIONAL STATEMENT

#### F2.3.1 Protection from the spread of fire

A Class 1 building is to be protected from the spread of fire.

#### F2.3.2 Fire detection and early warning

A Class 1 building is to be provided with safeguards so that occupants are warned of a fire in the building so that they may safely evacuate.

#### F2.3.3 Heating appliances

Heating appliances using controlled combustion located in a building are to be installed in a way which reduces the likelihood of—

- (a) fire spreading beyond the appliance; and
- (b) smoke from the appliance entering the building.

**STATE AND TERRITORY VARIATIONS**

**F2.3.3(a) has been replaced in Tasmania as follows:**

**F2.3.3(a)**

- (a) fire and harmful emissions spreading beyond the appliance; and

**F2.3.4 Bushfire areas**

A Class 1 building constructed in a *designated bushfire prone area* is to provide resistance to bushfires in order to reduce the danger to life and reduce the risk of the loss of the building.

**F2.3.5 Alpine areas**

A building in an *alpine area* is to be provided with additional measures in view of the increased difficulties in fighting fire and maintaining access and means of egress in snow conditions.

**PERFORMANCE REQUIREMENT****P2.3.1 Protection from the spread of fire**


- (a) A Class 1 building must be protected from the spread of fire from—
  - (i) another building other than an associated Class 10 building; and
  - (ii) the allotment boundary, other than a boundary adjoining a road or public space.(see [Figure 2.3.1](#))
- (b) A Class 10a building must not significantly increase the risk of fire spread between Class 2 to 9 buildings.



Figure 2.3.1

## TYPICAL AREAS OF POTENTIAL FIRE SPREAD

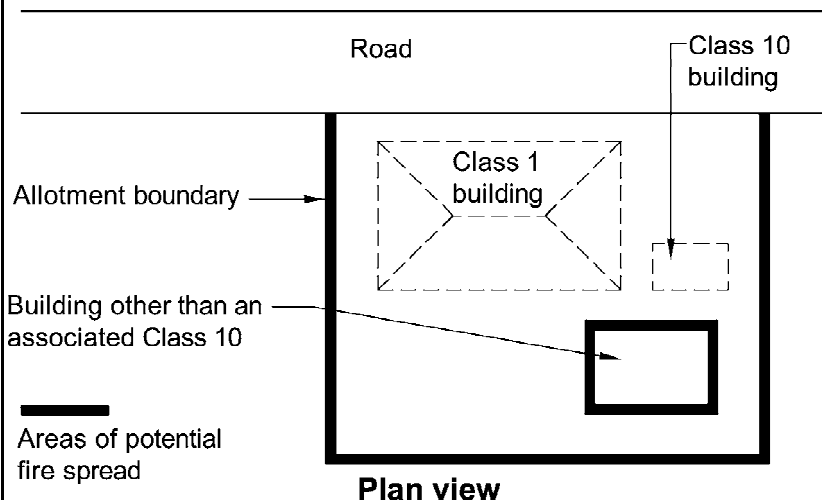**Note:** The following diagram indicates areas of potential fire spread. This situation will differ for corner allotments etc.



## P2.3.2 Fire detection and early warning

In a Class 1 building, occupants must be provided with *automatic* warning on the detection of smoke so that they may evacuate in the event of a fire to a place of safety.

## P2.3.3 Heating appliances

A heating appliance and its associated components within a building, including an open fire-place, chimney, or the like, must be installed—

- (a) to withstand the temperatures likely to be generated by the appliance; and
- (b) so that it does not raise the temperature of any building element to a level that would adversely affect the element's physical or mechanical properties or function; and
- (c) so that hot products of combustion will not—
  - (i) escape through the walls of the associated components; and
  - (ii) discharge in a position that will cause fire to spread to nearby *combustible* materials or allow smoke to penetrate through nearby *windows*, ventilation inlets, or the like in the building containing the heating appliance.

## STATE AND TERRITORY VARIATIONS

**P2.3.3(c) has been replaced in Tasmania as follows:**

**P2.3.3(c)**

- (c) so that hot products of combustion will not—
  - (i) escape through the walls of the associated components; and
  - (ii) discharge in a position that will cause fire to spread to nearby *combustible* materials or allow smoke to penetrate through nearby *windows*, ventilation inlets, or the like in the building containing the heating appliance; and
  - (iii) in the case of solid-fuel burning appliances, be discharged above appropriate emission limits.

**P2.3.4 Bushfire areas**

A Class 1 building that is constructed in a *designated bushfire prone area* must be designed and constructed to reduce the risk of ignition from a bushfire while the fire front passes.

**P2.3.5 Alpine areas**

- (a) An external doorway from a building in an *alpine area* must be installed so that opening the door is not obstructed by snow or ice.
- (b) A building in an *alpine area* containing external trafficable structures forming part of the means of egress must be constructed so that they remain, as far as practicable, useable under snow conditions.
- (c) A building in an *alpine area* must be constructed so that snow or ice is not shed from the building onto the allotment, any adjoining allotment, road or public space in a location or manner that will—
  - (i) obstruct a means of egress from any building to a road or *open space*; or
  - (ii) otherwise endanger people.

## PART 2.4 HEALTH AND AMENITY

### OBJECTIVE

#### O2.4.1 Wet areas

The *Objective* is to safeguard the occupants from illness or injury and protect the building from damage caused by the accumulation of internal moisture arising from the use of *wet areas* in a building.

#### O2.4.2 Room heights

The *Objective* is to safeguard the occupants from injury or loss of amenity caused by inadequate height of a room or space.

#### O2.4.3 Facilities

The *Objective* is to—

- (a) safeguard occupants from illness caused by infection; and
- (b) safeguard occupants from loss of amenity arising from the absence of adequate personal hygiene facilities; and
- (c) enable occupants to carry out laundering; and
- (d) provide for facilities to enable food preparation; and
- (e) enable unconscious occupants of *sanitary compartments* to be removed from the compartment.

#### O2.4.4 Light

The *Objective* is to safeguard occupants from injury, illness or loss of amenity due to—

- (a) isolation from natural light; and
- (b) lack of adequate artificial lighting.

#### O2.4.5 Ventilation

The *Objective* is to safeguard occupants from illness or loss of amenity due to lack of air freshness.

#### O2.4.6 Sound insulation

The *Objective* is to safeguard occupants from illness or loss of amenity as a result of undue sound being transmitted between adjoining dwellings.

**FUNCTIONAL STATEMENT****F2.4.1 Wet areas**

A building is to be constructed to avoid the likelihood of—

- (a) the creation of any unhealthy or dangerous conditions; or
- (b) damage to building elements,

caused by dampness or water overflow from bathrooms, laundries and the like.

**F2.4.2 Room heights**

A building is to be constructed to provide height in a room or space suitable for the intended use.

**F2.4.3 Facilities**

A building is to be provided with suitable—

- (a) space and facilities for personal hygiene; and
- (b) space and facilities for laundering; and
- (c) space and facilities for the preparation and cooking of food; and
- (d) space or other means to permit an unconscious occupant to be removed from a [sanitary compartment](#).

**Application:**

F2.4.3 only applies to a Class 1 building.

**F2.4.4 Light**

- (a) A [habitable room](#) within a building is to be provided with openings to admit adequate natural light consistent with its function or use; and
- (b) A space within a building used by occupants is to be provided with artificial lighting consistent with its function or use which, when activated in the absence of suitable natural light, will enable safe movement.

**F2.4.5 Ventilation**

A space used by occupants within a building is to be provided with adequate ventilation consistent with its function or use.

**F2.4.6 Sound insulation**

A building element which separates dwellings is to be constructed to prevent undue sound transmission between those dwellings.

**PERFORMANCE REQUIREMENT****P2.4.1 Wet areas**

To protect the structure of the building and to maintain the amenity of the occupants, water must be prevented from penetrating—

- (a) behind fittings and linings; or
  - (b) into concealed spaces,
- of sanitary facilities, bathrooms, laundries and the like.

**P2.4.2 Room heights**

A room or space must be of a height that does not unduly interfere with its intended function.

**P2.4.3 Facilities**

- (a) Suitable sanitary facilities for personal hygiene must be provided in a convenient location within or associated with a building, appropriate to its function or use.
- (b) \* \* \* \* \*

This clause has been deliberately left blank.

- (c) Laundering facilities or space for laundering facilities must be provided in a convenient location within or associated with a building, appropriate to its function or use.
- (d) A food preparation facility must be provided which includes—
  - (i) a means for food rinsing, utensil washing and waste water disposal; and
  - (ii) a means for cooking food; and
  - (iii) a space for food preparation.
- (e) A *sanitary compartment* must be constructed with sufficient space or other means to enable an unconscious occupant to be removed from the compartment.

**Application:**

**P2.4.3** only applies to a Class 1 building.

**P2.4.4 Light**

- (a) A *habitable room* must be provided with *windows* so that natural light, when available, provides a level of *illuminance* appropriate to the function or use of that part of the building.
- (b) Artificial lighting must be installed to provide a level of *illuminance* appropriate to the function or use of the building to enable safe movement by occupants.

**Application:**

**P2.4.4(b)** only applies—

- (a) to *sanitary compartments*, bathrooms, shower rooms, airlocks, laundries and the like; and

- (b) if natural lighting of a suitable standard is not available.

### P2.4.5 Ventilation

- (a) A space within a building used by occupants must be provided with means of ventilation with *outdoor air* which will maintain adequate air quality.
- (b) A mechanical air-handling system installed in a building must control—
  - (i) the circulation of objectionable odours; and
  - (ii) the accumulation of harmful contamination by micro-organisms, pathogens and toxins.
- (c) Contaminated air must be disposed of in a manner which does not unduly create a nuisance or hazard to people in the building or *other property*.

### P2.4.6 Sound insulation

- (a) Walls separating dwellings must provide insulation against the transmission of airborne sound sufficient to prevent illness or loss of amenity to the occupants.
- (b) Walls separating a bathroom, *sanitary compartment*, laundry or kitchen in a dwelling from a *habitable room* (other than a kitchen) in an adjoining dwelling, must provide insulation against impact generated sound sufficient to prevent illness or loss of amenity to the occupants.
- (c) The *required* sound insulation of walls must not be compromised by the incorporation or penetration of a pipe or other service element.

#### STATE AND TERRITORY VARIATIONS

In Northern Territory **P2.4.6** is replaced with the following:

#### P2.4.6 Sound insulation

- (a) Walls separating dwellings must provide insulation against the transmission of airborne and impact generated sound sufficient to prevent illness or loss of amenity to the occupants.
- (b) The *required* sound insulation of walls must not be compromised by the incorporation or penetration of a pipe or other service element.

#### VERIFICATION METHODS

### V2.4.6 Sound insulation

Compliance with **P2.4.6(a)** and **(c)** to insulate against transmission of airborne sound through walls separating dwellings is verified when it is measured that the wall has a weighted standardised level difference with spectrum adaptation term ( $D_{nT,w} + C_{tr}$ ) not less than 45 when determined under AS/NZS 1276.1 or ISO 717.1.

**STATE AND TERRITORY VARIATIONS**

**V2.4.6** does not apply in Northern Territory.

## PART 2.5 SAFE MOVEMENT AND ACCESS

## OBJECTIVE

## O2.5

The *Objective* is to—

- (a) provide people with safe access to and within a building; and
- (b) safeguard young children from drowning or injury in a *swimming pool*; and
- (c) safeguard people from drowning or injury due to suction by a *swimming pool* water recirculation system.

**Application:**

**O2.5(b) and (c)** only applies to a *swimming pool* with a depth of water more than 300 mm.

## STATE AND TERRITORY VARIATIONS

**1. O2.5(b) does not apply in New South Wales.**

**Note:** Restriction of access to *swimming pools* in New South Wales is regulated under the Swimming Pools Act 1992.

**2. O2.5(b) does not apply in the Northern Territory.****3. O2.5(b) does not apply in Queensland.**

**Note:** Restriction of access to *swimming pools* in Queensland is regulated under the Building Act 1975.

**4. O2.5(b) does not apply in Western Australia.**

**Note:** Restriction of access to private *swimming pools* in Western Australia is regulated under the Local Government (Miscellaneous Provisions) Act 1960 and the Building Regulations 1989 as amended.

## FUNCTIONAL STATEMENT

**F2.5.1 Safety from falling**

A building is to provide safe access for people to the services and facilities within.

**F2.5.2 Swimming pool access**

A *swimming pool* is to be provided with—



- (a) means to restrict access to it by young children; and
- (b) means to reduce the possibility of a person being entrapped or injured due to suction by a water recirculation system.

**Application:**

**F2.5.2** only applies to a *swimming pool* with a depth of water more than 300 mm.

**STATE AND TERRITORY VARIATIONS**1. **F2.5.2(a) does not apply in New South Wales.**

**Note:** Restriction of access to *swimming pools* in New South Wales is regulated under the Swimming Pools Act 1992.

2. **F2.5.2(a) does not apply in the Northern Territory.**3. **F2.5.2(a) does not apply in Queensland.**

**Note:** Restriction of access to *swimming pools* in Queensland is regulated under the Building Act 1975.

4. **F2.5.2(a) does not apply in Western Australia.**

**Note:** Restriction of access to *swimming pools* in Western Australia is regulated under the Local Government (Miscellaneous Provisions) Act 1960 and the Building Regulations 1989 as amended.

**PERFORMANCE REQUIREMENT****P2.5.1 Stairways and ramps**

So that people can move safely to and within a building—

- (a) walking surfaces must have safe gradients; and
- (b) any stairway or ramp must—
  - (i) \* \* \* \* \*

This clause has been deliberately left blank.

- (ii) have suitable landings to avoid undue fatigue of users; and
- (iii) be suitable for safe passage in relation to the nature, volume and frequency of likely usage; and
- (iv) have slip-resistant walking surfaces on ramps, and on stairway treads or near the edge of the nosing.

**P2.5.2 Barriers**

Where people could fall—

- (a) 1 m or more—

- (i) from a floor or roof of a building or through an opening (other than through an openable [window](#)) in the [external wall](#); or
- (ii) due to a sudden change of level within or associated with a building; or
- (b) 4 m or more from a floor through an openable [window](#),  
a barrier must be provided which must be—
  - (c) continuous and extend for the full extent of the hazard; and
  - (d) of a height to protect people from accidentally falling from the floor or roof or through the opening; and
  - (e) constructed to prevent people from falling through the barrier; and
  - (f) capable of restricting the passage of children; and
  - (g) of strength and rigidity to withstand—
    - (i) the foreseeable impact of people; and
    - (ii) where appropriate, the static pressure of people pressing against it.

### P2.5.3 Swimming pool access

A barrier must be provided to a [swimming pool](#) and must—

- (a) be continuous for the full extent of the hazard; and
- (b) be of a strength and rigidity to withstand the foreseeable impact of people; and
- (c) restrict the access of young children to the pool and the immediate pool surrounds; and
- (d) have any gates and doors fitted with latching devices not readily operated by young children, and constructed to automatically close and latch.

#### Application:

**P2.5.3** only applies to a [swimming pool](#) with a depth of water more than 300 mm.

#### STATE AND TERRITORY VARIATIONS

1. **P2.5.3 does not apply in New South Wales.**

**Note:** Restriction of access to [swimming pools](#) in New South Wales is regulated under the Swimming Pools Act 1992.

2. **P2.5.3 does not apply in the Northern Territory.**

3. **P2.5.3 does not apply in Queensland.**

**Note:** Restriction of access to [swimming pools](#) in Queensland is regulated under the Building Act 1975.

4. **P2.5.3 does not apply in Western Australia.**

**Note:** Restriction of access to [swimming pools](#) in Western Australia is regulated under the Local Government (Miscellaneous Provisions) Act 1960 and the Building Regulations 1989 as amended.

## P2.5.4 Swimming pool water recirculation systems

A *swimming pool* water recirculation system must incorporate safety measures to avoid entrapment of, or injury to, a person.

### Application:

**P2.5.4** only applies to a *swimming pool* with a depth of water more than 300 mm.

## VERIFICATION METHOD

### V2.5.1

Compliance with **P2.5.2(e)** and **(f)** for wire balustrades is verified when the wire balustrade passes the test described below:

#### (a) Application

The test must be carried out on either—


- (i) a prototype of a wire balustrade that is identical to that proposed to be installed on site; or
- (ii) a wire balustrade installed on site.

#### (b) Test equipment

The test equipment must consist of the following:

- (i) A horizontally suspended 125 mm diameter, 405 mm long cylinder of 1 mm thick steel having a highly polished 105 mm long cone at one end with a 20 mm diameter flat leading edge to which an eye bolt is fixed.
- (ii) A sufficiently flexible horizontal cable with mechanisms capable of applying and measuring a tension of 150 N (or a 15.3 kg weight suspended over a low friction pulley) is to be attached to the eye bolt (see **Figure V2.5.1**).
- (iii) A mechanism capable of measuring the tension force applied to each balustrade wire.

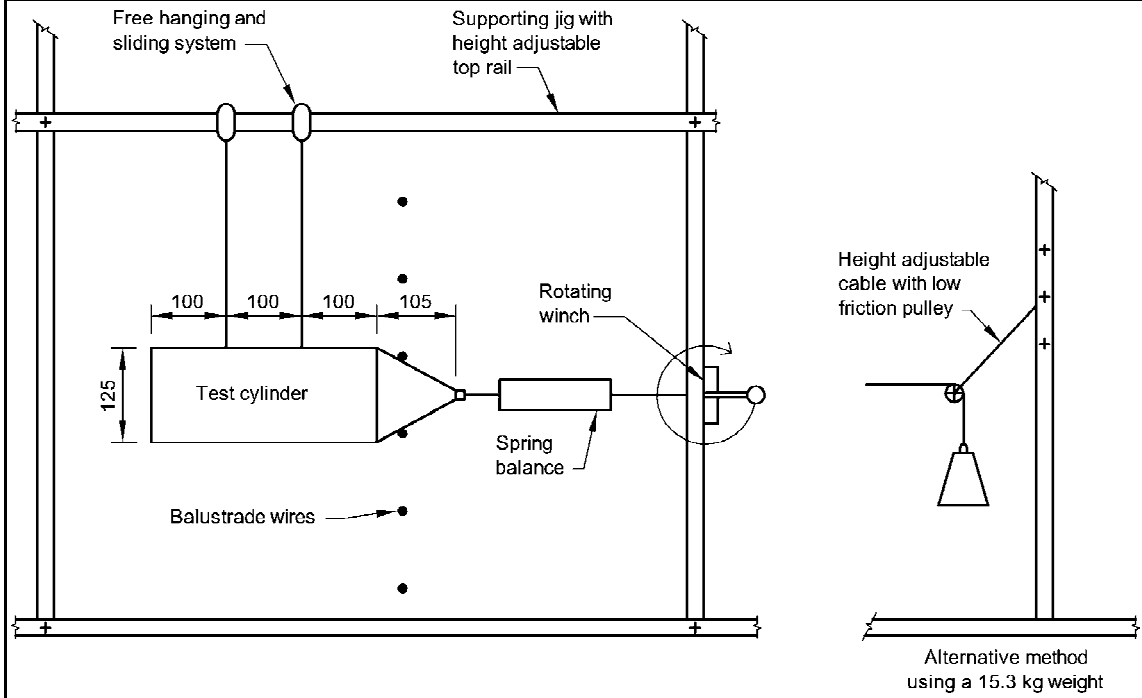Figure V2.5.1

**APPARATUS FOR TESTING WIRE BALUSTRADES****(c) Test procedure**

The test procedure must be as follows:

- (i) Tension the wires, within their safe load, to the same tension in all wires and measure the tensions with a strain indicator.
- (ii) For—
  - (A) horizontal or near horizontal wires, position the cone against a pair of wires at the mid-span between supports, then apply the 150 N tension force to the cone; and
  - (B) vertical wires, position the cone against a pair of wires at the mid-span between supporting rails, then apply the 150 N tension force to the cone; and
  - (C) near-vertical wires, position the cone against a pair of wires at the widest opening between the wires, then apply the 150 N tension force to the cone.
- (iii) Attempt to pull the cone through the gap between the wires under the 150 N load, and—
  - (A) increase the tension in the wires and repeat (ii) until such time as the cone will not pull through; or
  - (B) if it does not pull through, reduce the tension in the wires and repeat step (ii); and.
- (iv) When the cone is just prevented from pulling through the gap, the wires are at the correct tension in which case the cone is withdrawn and the tension recorded.

- (v) Reduce the tension in the wires and repeat steps (ii) to (iv) twice more, recording the tension in each case after the cone has been removed and then calculate the average of the three tensions as the *required* tension for each wire.
- (vi) For prototype tests of horizontal or near horizontal wires, record the deflection of each wire at the average tension calculated in accordance with (v) when a 2 kg mass is hung at mid-span between supports.

(d) **Test report**

The test report must include the following information:

- (i) The name and address of the person supervising the test.
- (ii) The test report number.
- (iii) The date of the test.
- (iv) The wire manufacturer's name and address, and specifications of the wires used in the test including the safe load limit of the wires.
- (v) The construction details of the test specimen, including a description and drawings and details of the components including supports, post or railing spacings and wire spacings.
- (vi) For a prototype test, the *required* tension calculated in accordance with (c)(v).
- (vii) For prototype tests of horizontal or near horizontal wires, the deflection measured in accordance with (c)(vi).

## PART 2.6 ENERGY EFFICIENCY

---

### STATE AND TERRITORY VARIATIONS

1. **Part 2.6 does not apply in New South Wales**

**Note:** The New South Wales Additions contain energy efficiency measures that apply in New South Wales.

2. In the Northern Territory, **Part 2.6** is replaced with BCA 2005 Part 2.6.
3. In Tasmania, **Part 2.6** is replaced with BCA 2005 Part 2.6 until 1 January 2010.

### OBJECTIVE

#### O2.6

The *Objective* is to reduce greenhouse gas emissions by efficiently using energy.

### STATE AND TERRITORY VARIATIONS

**O2.6 has been replaced in Victoria as follows:**

#### O2.6

The *Objective* is to reduce greenhouse gas emissions and conserve water by efficiently using energy and water.

### FUNCTIONAL STATEMENT

#### F2.6

To reduce greenhouse gas emissions, a building, including its *domestic services*, is to be capable of efficiently using energy.

### STATE AND TERRITORY VARIATIONS

**F2.6 has been replaced in Victoria as follows:**

#### F2.6

To reduce greenhouse gas emissions and conserve water, a building, including its *domestic services*, is to be capable of efficiently using energy and water.

**PERFORMANCE REQUIREMENT****P2.6.1 Building**

A building must have, to the degree necessary, a level of thermal performance to facilitate the efficient use of energy for artificial heating and cooling appropriate to—

- (a) the function and use of the building; and
- (b) the internal environment; and
- (c) the geographic location of the building; and
- (d) the effects of nearby permanent features such as topography, structures and buildings; and
- (e) solar radiation being—
  - (i) utilised for heating; and
  - (ii) controlled to minimise energy for cooling; and
- (f) the sealing of the building *envelope* against air leakage; and
- (g) the utilisation of air movement to assist cooling.

**Explanatory information:**

The term “facilitate” is used in **P2.6.1** to highlight the need to consider the installation of energy efficiency measures in a building where there is a likelihood that an artificial heating or cooling system will be installed in the building irrespective of the initial design.

In **P2.6.1(d)** the term “permanent” is used to describe features that will have a long term impact on the building and includes natural features of the landscape, such as mountains and escarpments, while permanent man made features would be buildings likely to be in place for a long period of time.

**STATE AND TERRITORY VARIATIONS****P2.6.1 has been replaced in Victoria as follows:****P2.6.1 Building**

A building must have, to the degree necessary, a level of thermal performance to facilitate the efficient use of energy for artificial heating and cooling and a level of water use performance to facilitate the efficient use of water, appropriate to—

- (a) the function and use of the building; and
- (b) the internal environment; and
- (c) the geographic location of the building; and
- (d) the effects of nearby permanent features such as topography, structures and buildings; and
- (e) solar radiation being—
  - (i) utilised for heating; and
  - (ii) controlled to minimise energy for cooling; and
- (f) the sealing of the building *envelope* against leakage; and

- (g) the utilisation of air movement to assist cooling; and
- (h) water resources available; and
- (i) pertinent water management measures of the responsible water authority.

## P2.6.2 Services

A building's *domestic services*, including any associated distribution system and components must have features that, to the degree necessary, facilitate the efficient use of energy appropriate to—

- (a) the *domestic service* and its usage; and
- (b) the geographic location of the building; and
- (c) the location of the *domestic service*; and
- (d) the energy source.

## VERIFICATION METHODS

## V2.6 Definitions

The following definitions are used in this Part:

**Cooling load** means the calculated amount of energy removed from the cooled spaces of the building annually by artificial means to maintain the desired temperatures in those spaces.

**Heating load** means the calculated amount of energy delivered to the heated spaces of the building annually by artificial means to maintain the desired temperatures in those spaces.

**Reference building** means a hypothetical building that is used to determine the maximum allowable *heating load* and *cooling load* for the proposed building.

**Thermal calculation method** means a calculation method that identifies—

- (a) a *heating load*; or
- (b) a *cooling load*; or
- (c) a *heating load* and a *cooling load* (annual energy load),  
based on the sum of hourly loads or an equivalent approach.

### Explanatory information:

The protocol for *thermal calculation methods* used to determine the energy rating of houses is detailed in the ABCB Protocol for House Energy Rating Software.

Advice on whether a *thermal calculation method* is acceptable should be sought from the *appropriate authority*.

## V2.6.1 Application of this Part

The *Verification Methods* in this Part only apply to—



- (a) a Class 1 building; and
- (b) an enclosed Class 10a building attached to a Class 1 building.

**Explanatory information:**

The *Verification Methods* in this Part are intended to apply to whole Class 1 buildings and to whole Class 1 buildings that incorporate attached and enclosed Class 10a parts, such as attached garages. The *Verification Methods* are not intended to apply to detached garages or to open carports.

**STATE AND TERRITORY VARIATIONS****V2.6.1 is replaced in Victoria as follows:****V2.6.1**

The *Verification Methods* in this Part only apply to—

- (a) a new Class 1 building that has either a rainwater tank connected to all sanitary flushing systems, or a solar water heater system, installed in accordance with the Plumbing Regulations 2008; and
- (b) a Class 1 building other than a new Class 1 building; and
- (c) an enclosed Class 10a building attached to a Class 1 building.

**V2.6.2 Alternative Verification Methods**

Compliance with **P2.6.1** is achieved by verifying the building in accordance with **V2.6.2.1** or **V2.6.2.2**.

**Explanatory information:**

The *thermal calculation method* in **V2.6.2.1** is intended to be used with a procedure for the energy rating of houses, while the *thermal calculation method* in **V2.6.2.2** may be used with a broad range of Australian and international energy analysis software.

**V2.6.2.1 Verification using stated value**

A building must have an energy rating of not less than 5 stars determined using a *thermal calculation method* that complies with the ABCB Protocol for House Energy Rating Software.

**Explanatory information:**

In determining a building's energy rating, the effects of building fixtures such as carpets, heavy curtains, reflective window coverings and the effects of adjoining buildings, topography and the like may be considered in certain situations, provided the fixture or feature has a degree of permanency.

**V2.6.2.2 Verification using a reference building**

- (a) A proposed building must, when compared with a *reference building*, have—
  - (i) in *climate zones* 1 and 2, a *cooling load* equal to or less than that of the *reference building*; or

- (ii) in *climate zones* 7 and 8, a *heating load* equal to or less than that of the *reference building*; or
  - (iii) in *climate zones* 3, 4, 5 and 6, a *heating load* and a *cooling load* equal to or less than that of the *reference building*.
- (b) The *heating load* and *cooling load* for the proposed building and the *reference building* must be determined using the same—
  - (i) *thermal calculation method*; and
  - (ii) location specific data, including that of climate and topography appropriate to the location where the proposed building is to be constructed if the data is available, or the nearest location with similar climatic conditions in the same *climate zone* for which the data is available; and
  - (iii) impact of adjoining structures and features; and
  - (iv) soil conditions; and
  - (v) orientation; and
  - (vi) floor plan, including the location of *glazing*; and
  - (vii) number of storeys; and
  - (viii) solar absorptance of external surfaces; and
  - (ix) roof cladding; and
  - (x) *separating walls*; and
  - (xi) external non-glazed doors; and
  - (xii) intermediate floors; and
  - (xiii) floor coverings; and
  - (xiv) internal zones; and
  - (xv) internal heat gains including people and appliances.
- (c) The *thermal calculation method* used must be capable of assessing the *heating load* and *cooling load* by modelling—
  - (i) the building *fabric*; and
  - (ii) *glazing* and shading; and
  - (iii) air infiltration and ventilation; and
  - (iv) the function and use of the building including zoning, hours of occupation, hours of heating and cooling availability and internal heat gains; and
  - (v) space temperature settings in the range 20°C to 21°C for heating and 25°C to 28°C for cooling; and
  - (vi) relevant built-environment and topographical features; and
  - (vii) the sensible heat component of the *cooling load* and *heating load*.
- (d) Climatic data employed in the *thermal calculation method* must be based on hourly recorded values and be representative of a typical year for the proposed location.
- (e) The *reference building* must be modelled using the requirements described in **Table V2.6.2**.

**Explanatory information:**

1. In (c)(iv), the number of hours per day for which heating and cooling is available would be expected to lie between 8 and 17, with values outside this range unlikely in other than exceptional circumstances.
2. Suitable climatic data including dry-bulb temperature, direct and diffuse solar radiation, wind speed, wind direction and cloud cover can be obtained from the Australian national climate database.
3. The requirements in **Table V2.6.2** provide inputs for the modelling of a hypothetical *reference building* in order to determine the acceptable energy loads. The loads from the modelled *reference building* is then used to establish the maximum loads for the proposed building.

**Table V2.6.2 REFERENCE BUILDING MODELLING REQUIREMENTS**

Item	Description	Minimum criteria to be modelled
1	Roof	Pitched roof (18 degrees)
2	Ceiling	2.4 m high horizontal ceiling
3	Roof insulation	In accordance with <b>Table 3.12.1.1</b>
4	<i>Roof lights</i>	Any <i>roof light</i> in the proposed building provided the <i>roof light</i> is the only means of complying with <b>3.8.4.2</b>
5	<i>External walls</i>	Brick veneer with 110mm thick clay masonry
6	Wall insulation	The minimum <i>Total R-Value</i> specified in option (a) of <b>Table 3.12.1.3</b>
7	Internal walls	70 mm wide timber frame complying with <b>3.4.3</b>
8	Internal linings	10 mm internal plaster linings
9	Ground floor	Concrete slab-on-ground
10	<i>Glazing</i>	In accordance with <b>3.12.2</b>
11	<i>Glazing</i> coverings	Holland blinds operated in a comparable manner as, and using the same criteria applied to, the glazing coverings in the proposed building
12	Building sealing	In accordance with <b>3.12.3</b>
13	Air movement	In accordance with <b>3.12.4</b>

SECTION **3**

---

# ACCEPTABLE CONSTRUCTION

**Introduction**

**The scope of these provisions**

**Suitability of Alternative Solutions**

**The use of maps**

**Consultation with appropriate authorities**

**Layout of Parts 3.1 — 3.12**

**How to use the requirements of each Part**

## SECTION 3 CONTENTS

---

### SECTION 3 ACCEPTABLE CONSTRUCTION

#### **3.0 How to Use Section 3**

Introduction  
The scope of these provisions  
Suitability of Alternative Solutions  
The use of maps  
Consultation with appropriate authorities  
Layout of Parts 3.1 to 3.12  
How to use the requirements of each Part

#### **PART 3.1 SITE PREPARATION**

##### **Explanatory Information**

#### **3.1.1 Earthworks**

3.1.1.0 Application  
3.1.1.1 Earthworks  
3.1.1.2 Excavation adjacent to vacant adjoining property  
3.1.1.3 Excavation adjacent to existing buildings  
3.1.1.4 Fill

#### **3.1.2 Drainage**

3.1.2.0 Acceptable construction manual  
3.1.2.1 Application  
3.1.2.2 Drainage requirements  
3.1.2.3 Surface water drainage  
3.1.2.4 Subsoil drainage  
3.1.2.5 Stormwater drainage

#### **3.1.3 Termite Risk Management**

3.1 Definitions  
3.1.3 Application of this Part  
3.1.3.0 Acceptable construction manual  
3.1.3.1 Application  
3.1.3.2 Installation of termite barriers  
3.1.3.3 Barriers for concrete slab-on-ground  
3.1.3.4 Barriers for suspended floors  
3.1.3.5 Attachments to buildings

#### **PART 3.2 FOOTINGS AND SLABS**

## **Explanatory Information**

### **3.2 Footings and Slabs**

#### 3.2 Definitions

##### 3.2.0 Acceptable construction manual

##### 3.2.1 Application

### **3.2.2 Preparation**

#### 3.2.2.1 Excavation for footings

#### 3.2.2.2 Filling under concrete slabs

#### 3.2.2.3 Foundations for footings and slabs

#### 3.2.2.4 Slab edge support on sloping sites

#### 3.2.2.5 Stepped footings

#### 3.2.2.6 Vapour barriers

#### 3.2.2.7 Edge rebates

### **3.2.3 Concrete and Reinforcing**

#### 3.2.3.1 Concrete

#### 3.2.3.2 Steel reinforcement

### **3.2.4 Site Classification**

#### 3.2.4.1 Site classification

### **3.2.5 Footing and Slab Construction**

#### 3.2.5.1 Footing and slab construction

#### 3.2.5.2 Footings and slabs to extensions to existing buildings

#### 3.2.5.3 Shrinkage control

#### 3.2.5.4 Minimum edge beam dimensions

#### 3.2.5.5 Footings for fireplaces on Class A and S sites

#### 3.2.5.6 Stump footing details

## **PART 3.3 MASONRY**

### **3.3 Definitions**

### **3.3.1 Unreinforced Masonry**

#### 3.3.1.0 Acceptable construction manual

#### 3.3.1.1 Application

#### 3.3.1.2 External walls

#### 3.3.1.3 Internal walls

#### 3.3.1.4 Isolated piers

#### 3.3.1.5 Masonry units

#### 3.3.1.6 Mortar mixes

#### 3.3.1.7 Mortar joints

#### 3.3.1.8 Vertical articulation joints

#### 3.3.1.9 Sub-floor ventilation

#### 3.3.1.10 Shrinkage allowance for timber framing

### **3.3.2 Reinforced Masonry**

#### 3.3.2.0 Acceptable construction manual

- 3.3.2.1 Application
- 3.3.2.2 External wall construction

### **3.3.3 Masonry Accessories**

- 3.3.3.0 Acceptable construction manual
- 3.3.3.1 Application
- 3.3.3.2 Wall ties
- 3.3.3.3 Fixing straps and tie-down systems
- 3.3.3.4 Lintels

### **3.3.4 Weatherproofing of Masonry**

- 3.3.4 Application of this Part
- 3.3.4.0 Acceptable construction manual
- 3.3.4.1 Application
- 3.3.4.2 Width of cavity
- 3.3.4.3 Cavity ventilation and drainage
- 3.3.4.4 Damp-proof courses — materials
- 3.3.4.5 Damp-proof courses — installation
- 3.3.4.6 Flashings
- 3.3.4.7 Location of flashings
- 3.3.4.8 Flashings at the base of cavity walls
- 3.3.4.9 Sill and head flashing
- 3.3.4.10 Flashings at a roof abutting a wall
- 3.3.4.11 Chimney flashings
- 3.3.4.12 Weatherproofing for single skin masonry walls

### **3.3.5 Earthwall Construction**

## **PART 3.4 FRAMING**

### **3.4.0 Explanation of Terms**

- 3.4.0.1 Explanation of terms

### **3.4.1 Sub-Floor Ventilation**

- 3.4.1.1 Application
- 3.4.1.2 Sub-floor ventilation

### **3.4.2 Steel Framing**

- 3.4.2.0 Acceptable construction manual
- 3.4.2.1 Application
- 3.4.2.2 General
- 3.4.2.3 Steel floor framing
- 3.4.2.4 \* \* \* \* \*
- 3.4.2.5 \* \* \* \* \*
- 3.4.2.6 Installation of services

### **3.4.3 Timber Framing**

- 3.4.3.0 Acceptable construction manual
- 3.4.3.1 \* \* \* \* \*

3.4.3.2 \* \* \* \* \*  
3.4.3.3 \* \* \* \* \*  
3.4.3.4 \* \* \* \* \*  
3.4.3.5 \* \* \* \* \*  
3.4.3.6 \* \* \* \* \*  
3.4.3.7 \* \* \* \* \*  
3.4.3.8 \* \* \* \* \*

#### **3.4.4 Structural Steel Members**

3.4.4 Explanation of Terms  
3.4.4.0 Acceptable construction manuals  
3.4.4.1 Application  
3.4.4.2 Structural steel members  
3.4.4.3 Columns  
3.4.4.4 Corrosion protection

### **PART 3.5 ROOF AND WALL CLADDING**

#### **Explanatory Information**

#### **3.5.1 Roof cladding**

3.5.1.0 Acceptable construction manuals  
3.5.1.1 Application  
3.5.1.2 Roof tiling  
3.5.1.3 Metal sheet roofing

#### **3.5.2 Gutters and downpipes**

3.5.2.0 Acceptable construction manual  
3.5.2.1 Application  
3.5.2.2 Materials  
3.5.2.3 Selection of guttering  
3.5.2.4 Installation of gutters  
3.5.2.5 Downpipes — size and installation

#### **3.5.3 Wall Cladding**

3.5.3.1 Application  
3.5.3.2 Timber weatherboard cladding  
3.5.3.3 Fibre cement planks and weatherboard cladding  
3.5.3.4 Fibre-cement sheet wall cladding  
3.5.3.5 Eaves and soffit linings  
3.5.3.6 Flashings to wall openings

### **PART 3.6 GLAZING**

#### **3.6 Glazing**

3.6 Definitions  
3.6.0 Acceptable construction manuals



- 3.6.1 Application
- 3.6.2 Glazing sizes and installation
- 3.6.3 Fully framed glazing installed in perimeter of buildings
- 3.6.4 Human impact safety requirements
- 3.6.4.1 Doors
- 3.6.4.2 Door side panels
- 3.6.4.3 Full height framed glazed panels
- 3.6.4.4 Glazed panels, other than doors or side panels, on the perimeter of rooms
- 3.6.4.5 Bathroom, ensuite and spa room glazing
- 3.6.4.6 Visibility of glazing

## **PART 3.7 FIRE SAFETY**

### **3.7.1 Fire separation**

- 3.7.1.1 Application
- 3.7.1.2 General concession — non-combustible materials
- 3.7.1.3 External walls of Class 1 buildings
- 3.7.1.4 Measurement of distances
- 3.7.1.5 Construction of external walls
- 3.7.1.6 Class 10a buildings
- 3.7.1.7 Allowable encroachments
- 3.7.1.8 Separating walls
- 3.7.1.9 Fire hazard properties
- 3.7.1.10 Roof lights

### **3.7.2 Smoke alarms**

- 3.7.2.1 Application
- 3.7.2.2 Requirements for smoke alarms
- 3.7.2.3 Location — Class 1a buildings
- 3.7.2.4 Location — Class 1b buildings
- 3.7.2.5 Lighting to assist evacuation — Class 1b buildings

### **3.7.3 Heating appliances**

- 3.7.3.0 Acceptable construction manuals
- 3.7.3.1 Application
- 3.7.3.2 Open fireplace construction
- 3.7.3.3 Chimney construction
- 3.7.3.4 Installation of insert fireplaces and flues
- 3.7.3.5 Installation of free standing heating appliances

### **3.7.4 Bushfire areas**

- 3.7.4.0 Acceptable construction manuals
- 3.7.4.1 Application
- 3.7.4.2 Categories of bushfire attack
- 3.7.4.3 Construction requirements

### **3.7.5 Alpine areas**

- 3.7.5.1 Application
- 3.7.5.2 External doorways
- 3.7.5.3 External ramps
- 3.7.5.4 Discharge of external doorways providing a means of egress

#### 3.7.5.5 External trafficable structures

### **PART 3.8 HEALTH AND AMENITY**

#### **3.8.1 Wet areas**

##### 3.8.1 Definitions

##### 3.8.1.0 Acceptable construction manual

##### 3.8.1.1 Application

##### 3.8.1.2 Wet areas

##### 3.8.1.3 Materials — waterproof

##### 3.8.1.4 Materials — water resistant substrates

##### 3.8.1.5 Materials — water resistant surface materials

##### 3.8.1.6 Preformed shower bases

##### 3.8.1.7 Baths and spas

##### 3.8.1.8 Flashings

##### 3.8.1.9 Penetrations

##### 3.8.1.10 Wet area floors

##### 3.8.1.11 Wall sheeting or render

##### 3.8.1.12 Substrate surface preparation for application of membrane in shower areas

##### 3.8.1.13 Stepdown showers

##### 3.8.1.14 Falls in shower floors

##### 3.8.1.15 Bath end walls abutting a shower

##### 3.8.1.16 Bond breaker installation for bonded membranes

##### 3.8.1.17 Vertical membrane termination

##### 3.8.1.18 Hob construction

##### 3.8.1.19 Enclosed showers without hobs or setdowns

##### 3.8.1.20 Unenclosed showers

##### 3.8.1.21 Membrane to drainage connection

##### 3.8.1.22 Installation of internal membranes

##### 3.8.1.23 Installation of an external membrane

##### 3.8.1.24 Base termination of vertical flashing

##### 3.8.1.25 Drainage riser connection

##### 3.8.1.26 Door jambs and architraves on tiled floors

##### 3.8.1.27 Shower screens

#### **3.8.2 Room heights**

##### 3.8.2.1 Application

##### 3.8.2.2 Ceiling heights

#### **3.8.3 Facilities**

##### 3.8.3.1 Application

##### 3.8.3.2 Required facilities

##### 3.8.3.3 Construction of sanitary compartments

#### **3.8.4 Light**

##### 3.8.4.1 Application

##### 3.8.4.2 Natural lighting

##### 3.8.4.3 Artificial lighting

#### **3.8.5 Ventilation**

##### 3.8.5.0 Acceptable construction manual

- 3.8.5.1 Application
- 3.8.5.2 Ventilation requirements
- 3.8.5.3 Location of sanitary compartments

### **3.8.6 Sound insulation**

- 3.8.6.1 Application
- 3.8.6.2 Sound insulation requirements
- 3.8.6.3 General installation requirements for walls
- 3.8.6.4 Services

## **PART 3.9 SAFE MOVEMENT AND ACCESS**

### **3.9.1 Stair construction**

- 3.9.1 Definitions
  - 3.9.1.1 Application
  - 3.9.1.2 General requirements
  - 3.9.1.3 Stair construction
  - 3.9.1.4 Riser and going dimensions
  - 3.9.1.5 Threshold

### **3.9.2 Balustrades**

- 3.9.2.1 Application
- 3.9.2.2 When balustrades or other barriers are required
- 3.9.2.3 Balustrades or other barrier construction

### **3.9.3 Swimming pool access**

- 3.9.3.0 Acceptable construction manual
- 3.9.3.1 Application
- 3.9.3.2 Safety fencing location
- 3.9.3.3 Safety fencing construction
- 3.9.3.4 Gates and fittings
- 3.9.3.4 Gates and fittings

### **3.9.4 Swimming pool water recirculation systems**

- 3.9.4.0 Acceptable construction manual

## **PART 3.10 ADDITIONAL CONSTRUCTION REQUIREMENTS**

### **Explanatory Information**

### **3.10.1 High Wind Areas**

- 3.10.1.0 Acceptable construction manual

### **3.10.2 Earthquake Areas**

- 3.10.2.0 Acceptable construction manuals

## **PART 3.11 STRUCTURAL DESIGN MANUALS**

## **Explanatory Information**

### **3.11 Structural design manuals**

- 3.11.1 Application
- 3.11.2 Resistance to actions
- 3.11.3 Determination of individual actions
- 3.11.4 Acceptable structural design manuals
- 3.11.5 Loading requirements
- 3.11.6 Determination of structural resistance of materials and forms of construction

## **PART 3.12 ENERGY EFFICIENCY**

### **3.12 Energy efficiency**

- 3.12 Definitions
- 3.12.0 Application of Part 3.12

#### **3.12.1 Building fabric**

- 3.12.1 Application
  - 3.12.1.1 Building fabric thermal insulation
  - 3.12.1.2 Roofs
  - 3.12.1.3 Roof lights
  - 3.12.1.4 External walls
  - 3.12.1.5 Floors
  - 3.12.1.6 Attached Class 10a buildings

#### **3.12.2 External Glazing**

- 3.12.2 Application
  - 3.12.2.1 External glazing
  - 3.12.2.2 Shading

#### **3.12.3 Building Sealing**

- 3.12.3 Application
  - 3.12.3.1 Chimneys and flues
  - 3.12.3.2 Roof lights
  - 3.12.3.3 External windows and doors
  - 3.12.3.4 Exhaust fans
  - 3.12.3.5 Construction of roofs, walls and floors
  - 3.12.3.6 Evaporative coolers

#### **3.12.4 Air Movement**

- 3.12.4 Application
  - 3.12.4.1 Air movement
  - 3.12.4.2 Ventilation openings
  - 3.12.4.3 Ceiling fans and evaporative coolers

#### **3.12.5 Services**

- 3.12.5 Application
  - 3.12.5.0 Acceptable construction manual
  - 3.12.5.1 Insulation of services
  - 3.12.5.2 Central heating water piping

3.12.5.3 Heating and cooling ductwork

## PART 3.0 HOW TO USE SECTION 3

### Explanatory information:

This is a non mandatory guide on how to use Section 3 of the *Housing Provisions*.

### 3.1 Introduction

Section 3, **Parts 3.1 to 3.12** are *Deemed-to-Satisfy Provisions* that are considered to be acceptable forms of construction that meet the legislative requirements for complying with the *Housing Provisions* (ie they comply with the *Performance Requirements* listed in Section 2 of the *Housing Provisions*).

**There is no obligation to adopt any particular option contained in Section 3 of the *Housing Provisions*, if it is preferred to meet the *Performance Requirement* in some other way.**

However, if one of the options described in Section 3 is not complied with, then the *appropriate authority* must be satisfied that the *Performance Requirements* have been met.

### 3.2 The scope of these provisions

The *Deemed-to-Satisfy Provisions* (described as “acceptable construction practice” or “acceptable construction manuals”) are indicative of some of the most common forms of national construction practice. In general, either the “acceptable construction practice” or the “acceptable construction manual” may be used as options when proposing a Deemed-to-Satisfy solution.

However, it should be noted that some of these options described as “acceptable construction practice” may have very specific limitations and accordingly will not be suitable for all applications. In the case of the “acceptable construction practice”, these limitations generally relate to climatic (*design wind speed*), geographical and topographical conditions and building geometry or in specific cases, may have a limiting scope that does not fully cover the subject matter of the Part. In the case of the “acceptable construction manual”, the scope may be limited to specific components of the subject matter.

If the “acceptable construction practice” option is not suitable for the proposed construction or *site* conditions, an alternative approach may be found in one of the “acceptable construction manuals” listed at the start of each Part. Similarly, if a particular building element or component *required* to comply with the *Housing Provisions* is not contained in the scope of the “acceptable construction practice”, reference to the appropriate “acceptable construction manual” or **Part 3.11** will need to be made in addition to the “acceptable construction practice”.

Situations where it is necessary for a mixed application of the “acceptable construction practice” and the “acceptable construction manual” may be identified by reference to differing components of the *Performance Requirement* (see **1.0.7(b)**).

### 3.3 Suitability of Alternative Solutions

The options described in Section 3 are typical examples. They are certainly not the only means available of complying with the *Housing Provisions*. The performance nature of this document provides flexibility and allows the use of alternative construction methods even though they may

not be specifically described in an acceptable construction manual or as acceptable construction practice.

*Alternative Solutions* may be used provided they comply with the *Performance Requirements* listed in Section 2 (for further explanation see **Part 1.0**).

### 3.4 The use of maps

Maps have been used throughout Section 3 to indicate areas where particular requirements apply. These maps are indicative and some variation in conditions will apply, especially on the border of marked areas.

It is recommended that the *appropriate authority* be consulted and in most cases they may be able to identify what conditions apply in such areas at the early stage of building design.

### 3.5 Consultation with appropriate authorities

When building in certain locations there may be local conditions that may limit the type of construction that can be used. This is particularly important with *design wind speed* classifications and soil types.

*Appropriate authorities* have a wide range of experience and information on the geographical and topographical conditions found in their area of responsibility, and should be consulted during the initial design stage.

### 3.6 Layout of Parts 3.1 to 3.12

**Parts 3.1** to **3.12** of the *Housing Provisions* are organised in a manner that follows the logical construction sequence of a building. The following chart outlines some of the more frequently used details and where it is located in this document.

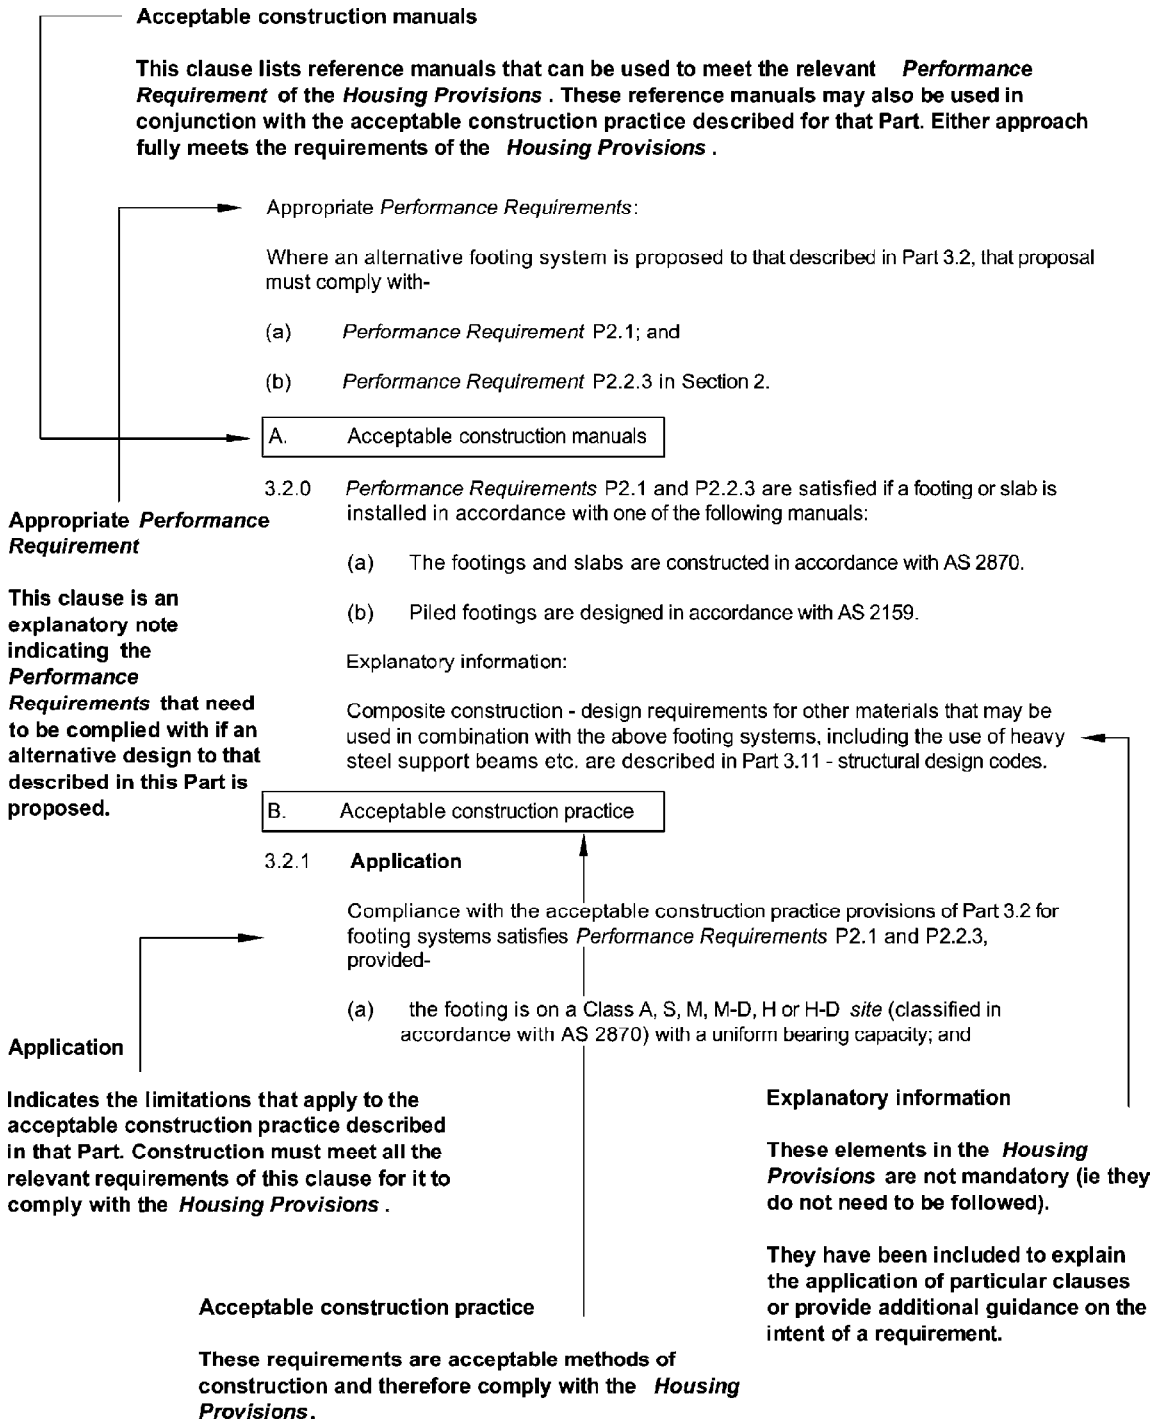
# SUPERSEDED ACCEPTABLE CONSTRUCTION

INFORMATION GUIDE		
	Relevant Part	Part Reference
INITIAL CONCEPT CONSIDERATIONS	Earthwork	3.1.1
	Location of buildings (fire safety)	3.7.1
	Facilities required	3.8.3
	Room heights	3.8.2
	Light and ventilation	3.8.4 and 3.8.5
	Energy Efficiency	3.12
	Site preparation	3.1.2 and 3.1.3
CONSTRUCTION ISSUES	Footing and slabs	3.2
	Masonry	3.3
	Framing	3.4
	Roof and wall cladding	3.5
	Glazing	3.6
	Balustrades	3.9.2
	Wet area waterproofing	3.8.1
SPECIAL REQUIREMENTS	Sound insulation	3.8.8
	Swimming pool access	3.9.3
	Terrace risk management	3.1.3
	Earth wall construction	3.3.5
	Smoke alarms	3.7.2
	Heating appliances	3.7.3
	High wind areas	3.10.1
	Bushfire areas	3.7.4
	Alpine areas	3.7.5
	Earthquake areas	3.10.2

## 3.7 How to use the requirements of each Part

The following is an example page layout from [Part 3.2](#). This diagram explains the concepts behind typical clauses contained throughout [Parts 3.1 to 3.12](#).





# PART 3.1

---

## SITE PREPARATION

- 3.1.1 Earthworks
- 3.1.2 Drainage
- 3.1.3 Termite risk management

## PART 3.1 CONTENTS

---

### PART 3.1 SITE PREPARATION

#### Explanatory Information

#### 3.1.1 Earthworks

- 3.1.1.0 Application
- 3.1.1.1 Earthworks
- 3.1.1.2 Excavation adjacent to vacant adjoining property
- 3.1.1.3 Excavation adjacent to existing buildings
- 3.1.1.4 Fill

#### 3.1.2 Drainage

- 3.1.2.0 Acceptable construction manual
- 3.1.2.1 Application
- 3.1.2.2 Drainage requirements
- 3.1.2.3 Surface water drainage
- 3.1.2.4 Subsoil drainage
- 3.1.2.5 Stormwater drainage

#### 3.1.3 Termite Risk Management

- 3.1 Definitions
- 3.1.3 Application of this Part
- 3.1.3.0 Acceptable construction manual
- 3.1.3.1 Application
- 3.1.3.2 Installation of termite barriers
- 3.1.3.3 Barriers for concrete slab-on-ground
- 3.1.3.4 Barriers for suspended floors
- 3.1.3.5 Attachments to buildings

---

## PART 3.1 EXPLANATORY INFORMATION

---

### Explanatory information:

These provisions relate to general [site](#) preparation for footings, services, drainage and installation of termite barriers to assist in termite management. It should be noted that other construction methods may be used to achieve the same results as specified in this Part provided they comply with the appropriate [Performance Requirement](#).

## PART 3.1.1 EARTHWORKS

### Appropriate *Performance Requirements*:

Where an alternative approach to earthworks is proposed as an *Alternative Solution* to that described in **Part 3.1.1**, that proposal must comply with—

- (a) *Performance Requirement P2.1*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### STATE AND TERRITORY VARIATIONS

Except for **Table 3.1.1.1** as referenced by **Figures 3.1.2.1** and **3.1.2.2** and except for **Clause 3.1.1.0(b)** for determination of a normal site as referenced by **Clause 3.2.1**, **Part 3.1.1** does not apply in New South Wales.

**Note:** In New South Wales the consent authority can determine to place controls on siteworks associated with the erection of a building, by imposing conditions when it grants development consent. These controls can include the safeguarding of excavations and backfilling, provision of retaining walls to prevent soil movement and support for neighbouring buildings. Information addressing siteworks can be found in the Department of Infrastructure Planning and Natural Resources Act and Regulation note “Health, safety and amenity during construction”.

### Acceptable construction practice

#### 3.1.1.0 Application

Compliance with this acceptable construction practice satisfies *Performance Requirement P2.1* for earthworks provided:

- (a) The work is undertaken in normal *site* conditions.
- (b) For the purposes of this Part, normal *site* conditions are defined by the following parameters—
  - (i) a *site* that is classified as A, S, M, H or E in accordance with **Part 3.2**; and
  - (ii) moisture conditions on *site* are as a result of seasonal and climatic changes; and
  - (iii) the *site* is not subject to unusual moisture conditions caused by drains, dams, channels, ponds or tanks which are maintained or removed from the *site*; and
  - (iv) large trees have not been recently removed from the *site*; and
  - (v) soil moisture conditions have not been significantly modified by the removal of buildings or other structures; and
  - (vi) drainage on the allotment is maintained.

**Explanatory information:**

The provisions described in [Part 3.1.1](#) will enable earthworks to be carried out safely and avoid potential damage to adjoining structures and property through the soil collapsing or subsiding during building works. Exceptional [site](#) conditions (including the effects of torrential rain) may need special consideration and additional advice from appropriately qualified people should be considered.

State and Territory legislation may also have requirements that affect the excavation, especially in relation to adjoining property and notification to owners of that property. Advice should be obtained from the [appropriate authority](#) before commencement of works.

**3.1.1.1 Earthworks**

Excavation and fill utilising unprotected embankments can be undertaken in accordance with—

- (a) [Table 3.1.1.1](#) for general earthwork; or
- (b) [3.1.1.2](#) for excavation adjacent to vacant adjoining property; or
- (c) [3.1.1.3](#) for excavation adjacent to existing buildings; or
- (d) [3.1.1.4](#) for fill adjacent to adjoining property.

**3.1.1.2 Excavation adjacent to vacant adjoining property**

Excavation work, using unprotected embankments, adjacent to another allotment can be undertaken provided—

- (a) there are no buildings or structures on the adjoining allotment within 3 m of the allotment boundary adjacent to the excavation; and
- (b) the excavation commences at the allotment boundary and is within the area defined as being suitable for excavation in [Figure 3.1.1.1](#); and
- (c) the slope of the unprotected embankment of the excavation complies with the appropriate soil classification slope described in [Table 3.1.1.1](#).

**3.1.1.3 Excavation adjacent to existing buildings**

Excavation work for footings, drainage trenches or other similar works, adjacent to existing buildings can be undertaken provided—

- (a) the angle to determine the safe area for excavation is taken from the bottom of the shallowest point of the existing footing in accordance with [Figure 3.1.1.2](#); and
- (b) the excavation is within the area defined as being suitable for excavation in [Figure 3.1.1.2](#); and
- (c) the slope of the unprotected embankment of the excavation complies with the appropriate soil classification described in [Table 3.1.1.1](#); and
- (d) for footing excavation adjacent to existing footings—
  - (i) the footing is placed as soon as practicable after exposing the existing footing; and
  - (ii) the existing footing, where on an adjoining property, is completely isolated from the new footing by means of a flexible bond breaker not less than 10 mm thick; and
- (e) the adjoining footing is not left exposed at the completion of works.

Figure 3.1.1.1

**EXCAVATION AFFECTING ADJOINING PROPERTY**

**Note:** The angle for line A–A is defined in Table 3.1.1.1.

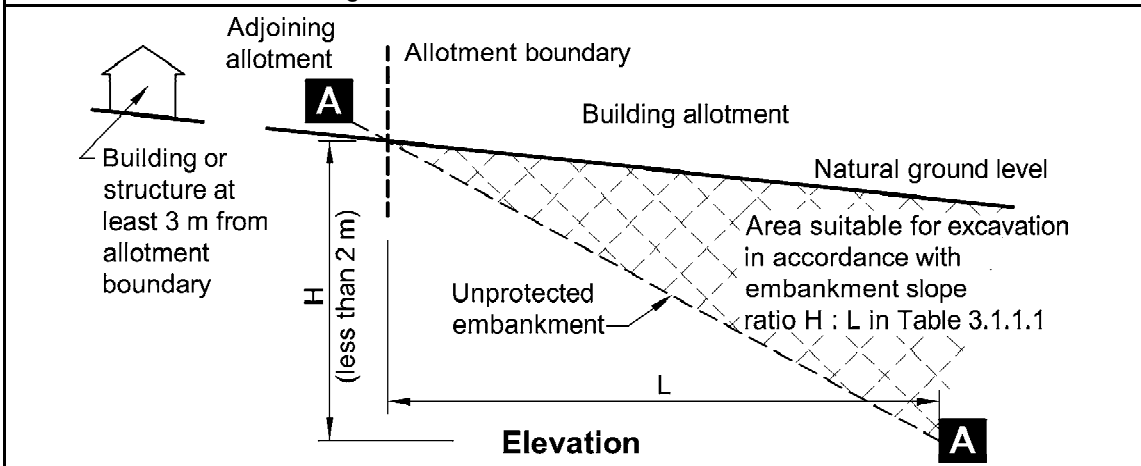
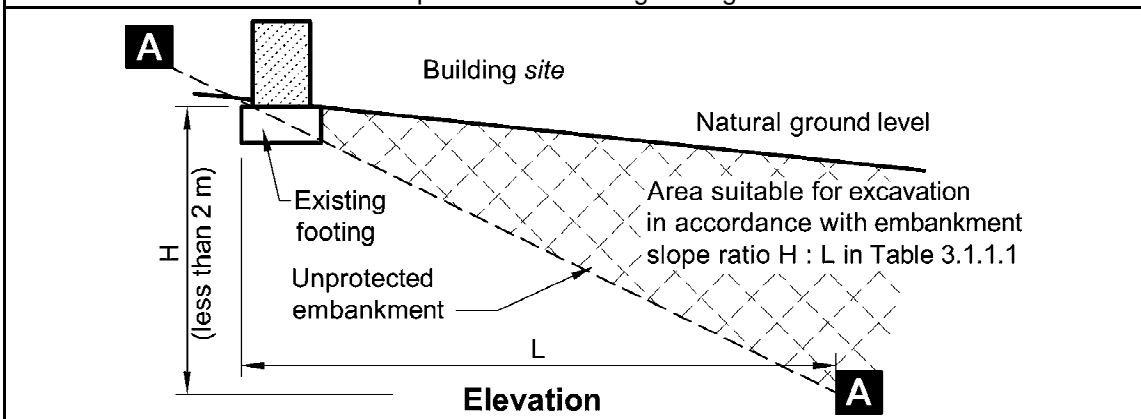


Figure 3.1.1.2

**EXCAVATION ADJACENT TO EXISTING BUILDINGS**

**Note:** Line A–A is defined in Table 3.1.1.1 and taken from the bottom of the shallowest point of the existing footing.

**3.1.1.4 Fill**

Filling works may be carried out provided—

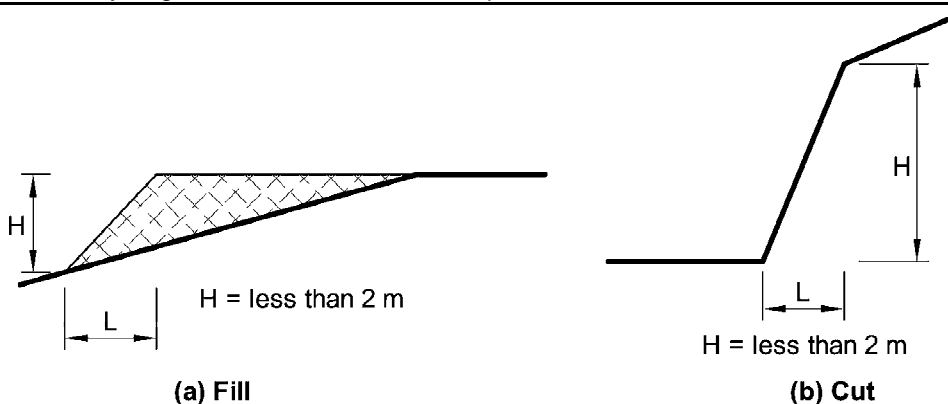
- where the fill is deeper than existing soil level, the gradient of the fill complies with [Table 3.1.1.1](#); and
- where the fill is to be used to support footings or slabs, it is placed and compacted in accordance with [Part 3.2](#).

### Table 3.1.1.1

## UNPROTECTED EMBANKMENTS

**Notes:** For the purposes of this Table:

1. Retaining walls or other types of soil retaining methods must be installed where—
  - (a) the slope ratio is more than that described in Table 3.1.1.1; or
  - (b) the soil type is not described in this Table.
2. Embankments that are to be left exposed at the end of the construction works must be stabilised by vegetation or similar works to prevent soil erosion.



SOIL TYPE (*see Part 3.2.4 for material description)		EMBANKMENT SLOPES H:L	
		Compacted fill (see Part 3.2)	Cut
Stable rock (A*)		2:3	8:1
Sand (A*)		1:2	1:2
Silt (P*)		1:4	1:4
Clay	Firm clay	1:2	1:1
	Soft clay	Not suitable	2:3
Soft soils (P*)		Not suitable	Not suitable



## PART 3.1.2 DRAINAGE

### Appropriate *Performance Requirements*:

Where an alternative drainage system is proposed as an *Alternative Solution* to that described in **Part 3.1.2**, that proposal must comply with—

- (a) *Performance Requirement P2.2.1*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### A. Acceptable construction manual

#### 3.1.2.0

*Performance Requirement P2.2.1* is satisfied for drainage if the drainage is designed and constructed in accordance with AS/NZS 3500.3 — Stormwater drainage, or AS/NZS 3500.5 — Domestic installations, Section 5 — Stormwater drainage.

### B. Acceptable construction practice

#### 3.1.2.1 Application

Compliance with this acceptable construction practice satisfies *Performance Requirement P2.2.1* for drainage of—

- (a) roofs in areas subject to 5 minute duration rainfall intensities of not more than 255 mm per hour over an *average recurrence interval* of 20 years (as per **Table 3.5.2.1**) where a drainage system is *required*; and
- (b) sub-soil areas where excessive soil moisture problems may occur; and
- (c) land adjoining and under buildings,

provided the stormwater drainage system otherwise complies with the acceptable construction manual.

### Explanatory information:

1. The BCA does not require the installation of drainage systems. Accordingly these requirements need only be applied when these systems are used.
2. Information on the need for drainage systems may be obtained from the *appropriate authority*.
3. The legal discharge point from a building *site* is generally determined by local government authorities.

### 3.1.2.2 Drainage requirements


Drainage systems must be installed as follows—

- (a) areas adjoining and under buildings — *surface water* drainage in accordance with 3.1.2.3; and
- (b) where *site* conditions exist that create a need for subsoil water to be diverted away from footings, basements, retaining walls etc — sub-soil drainage in accordance with 3.1.2.4; and
- (c) where underground drainage from roof areas is *required* or permitted — underground stormwater drainage in accordance with 3.1.2.5; and
- (d) excavation for drains adjacent to existing footings must be within the area described in **Figure 3.1.2.1** as being safe for excavation.

**Figure 3.1.2.1**

#### EXCAVATION FOR DRAINS ADJACENT TO FOOTINGS

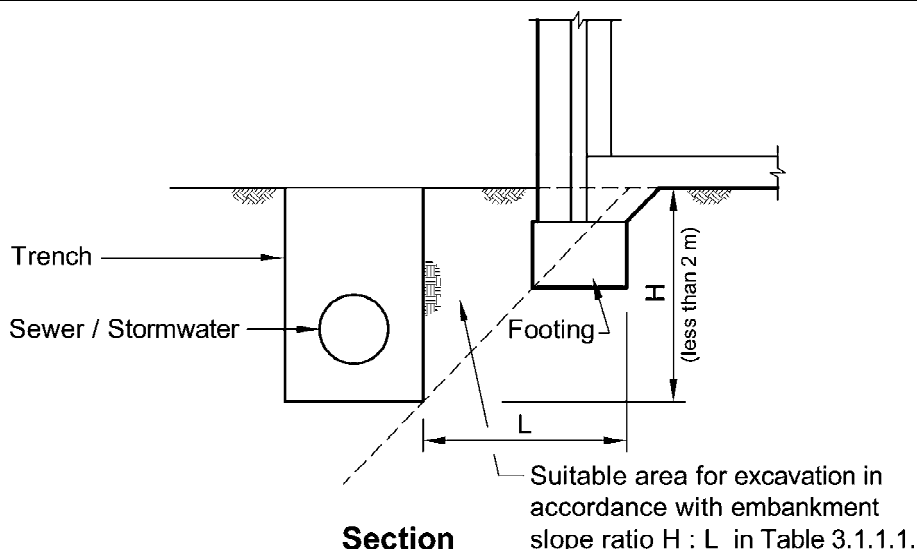**Note:** Any excavation below the area defined as being safe for excavation will need additional protection measures to be determined by appropriately qualified persons.



### 3.1.2.3 Surface water drainage

*Surface water* must be diverted away from Class 1 buildings as follows:

- (a) Slab-on-ground — finished ground level adjacent to buildings:  
the external finished surface surrounding the slab must be drained to move *surface water* away from the building and graded to give a slope of not less than (see **Figure 3.1.2.2**)—
  - (i) 25 mm over the first 1 m from the building in *low rainfall intensity areas* for surfaces that are reasonably impermeable (such as concrete or clay paving); or
  - (ii) 50 mm over the first 1 m from the building in any other case.

(b) Slab-on-ground — finished slab heights:

the height of the slab-on-ground above external finished surfaces must be not less than (see [Figure 3.1.2.2](#))—

- (i) 100 mm above the finished ground level in [low rainfall intensity areas](#) or sandy, well-drained areas; or
- (ii) 50 mm above impermeable (paved or concreted areas) that slope away from the building in accordance with (a); or—
- (iii) 150 mm in any other case.

**Explanatory information:**

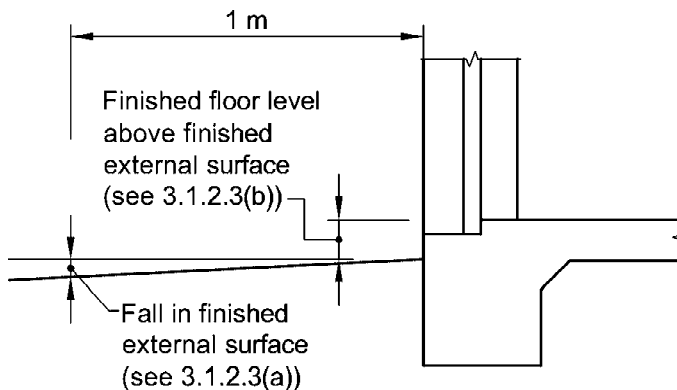
The appropriate slab height above finished ground level and the slope of the external finished surface surrounding the slab may vary depending on:

1. The local plumbing requirements; in particular the height of the overflow relief gully relative to drainage fittings and ground level (to work effectively they must be a minimum of 150 mm below the lowest sanitary fixture).
2. The run-off from storms, particularly in areas of high rainfall intensity, and the local topography.
3. The effect of excavation on a cut and fill [site](#).
4. The possibility of flooding.
5. Termite barrier provisions.

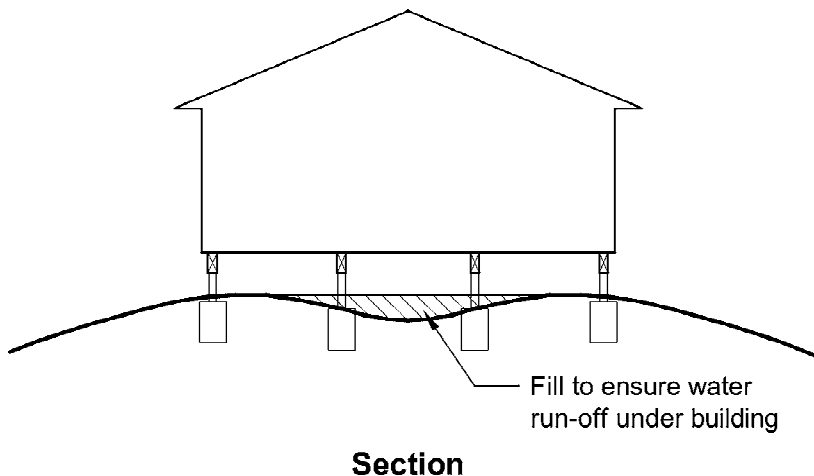
(c) The ground beneath suspended floors must be graded so that the area beneath the building is above the adjacent external finished ground level and [surface water](#) is prevented from ponding under the building (see [Figure 3.1.2.3](#)).

**Figure 3.1.2.2**

**SITE SURFACE DRAINAGE**




**Section**

**Figure 3.1.2.3****GRADING OF GROUND UNDER SUSPENDED FLOORS****3.1.2.4 Subsoil drainage**

Where a subsoil drainage system is installed to divert subsurface water away from the area beneath a building, the subsoil drain must—

- (a) be graded with a uniform fall of not less than 1:300; and
- (b) discharge into an external silt pit or sump with—
  - (i) the level of discharge from the silt pit or sump into an impervious drainage line not less than 50 mm below the invert level of the inlet (see [Figure 3.1.2.4](#)); and
  - (ii) provision for cleaning and maintenance.

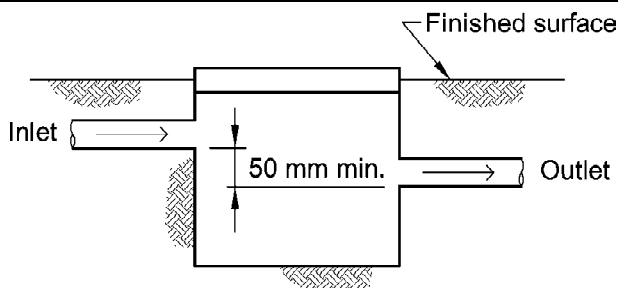
**Figure 3.1.2.4****CONSTRUCTION OF SILT PITS****Explanatory information:**

Subsoil drainage systems may need to be installed where subsurface water movement could damage buildings or cause loss of amenity through the build up of excessive moisture or lateral water pressure. Typical locations of subsoil drainage systems are on the uphill side of cut and fill sites, adjacent to deep footings, behind retaining walls and adjacent to basement walls.

The design and installation of subsoil drainage systems should take into account the nature of the soil and the anticipated water level, quantity and movement. In some cases, detailed investigations involving excavations, field observations and soil tests may be necessary to determine the appropriate solution. Typical subsoil drain configurations are shown in the following diagrams.

In clay soil, subsoil drains can alter the long-term moisture content in the soil, adversely affecting the building foundation by removing or, in some cases, introducing water. In such conditions, subsoil drains should only be used where there are no other options for dealing with subsoil water.

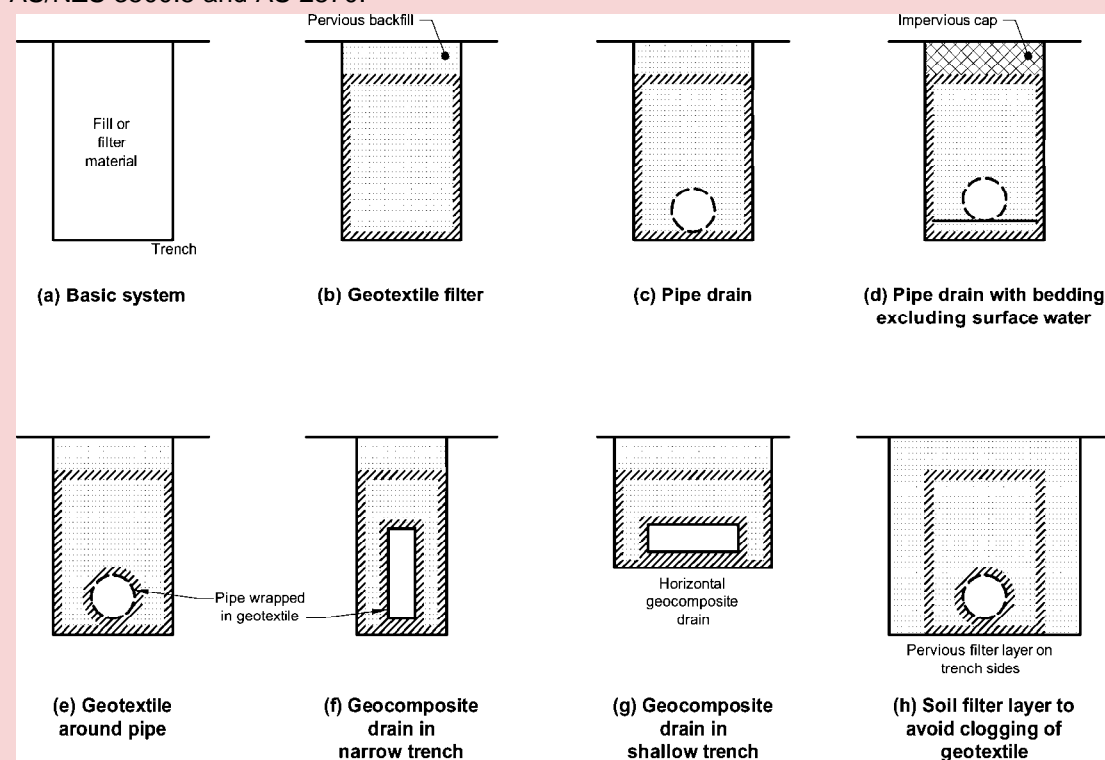Additional guidance on subsoil drainage systems can be found in AS/NZS 3500.3, AS/NZS 3500.5 and AS 2870.



### 3.1.2.5 Stormwater drainage

Where a stormwater drainage system is installed, it must comply with the following:

- The position and manner of discharge of the stormwater drainage system must be to the satisfaction of the [appropriate authority](#).
- The stormwater drainage system must be designed so that any overflow during heavy rain periods is prevented from flowing back into the building.

#### Explanatory information:

The manner of discharge of stormwater drainage systems includes consideration of discharge points. Some examples of discharge points which may be acceptable to the [appropriate authority](#) are:

- (a) A legal discharge point at the allotment boundary.
  - (b) On-site catchment systems, such as stormwater tanks.
  - (c) On-site soil drainage systems, such as soaker wells.
- (c) Cover to stormwater drains:
- the cover to 90 mm Class 6 UPVC stormwater drains installed underground must be not less than—
- (i) under soil — 100 mm; or
  - (ii) under paved or concrete areas — 50 mm; or
  - (iii) under areas subject to light vehicle traffic—
    - (A) reinforced concrete — 75 mm; or
    - (B) paved — 100 mm.

**Explanatory information:**

Different depths of soil cover (or no cover at all) can be achieved using other types of pipes. The cover specified is measured from the top of the pipe to either the finished ground level or, in the case of paved or concreted areas, to the underside of the paving or concrete.

## PART 3.1.3 TERMITE RISK MANAGEMENT

### Definitions

#### 3.1

The following definitions are used in this Part:

**Primary building element** means a member of a building designed specifically to take part of the building loads and includes roof, ceiling, floor, stairway or ramp and wall framing members including bracing members designed for the specific purpose of acting as a brace to those members.

#### Explanatory information:

The loads to which a building may be subjected are dead, live, wind, snow and earthquake loads. Further information on building loads can be found in the 1170 series of Standards.

### STATE AND TERRITORY VARIATIONS

**In Queensland delete definition of primary building element and replace with the following:**

**Primary building element** means—

- (a) a member of a building designed specially to take part of the building loads and includes roof, ceiling, floor, stairway or ramp and wall framing members including bracing members designed for the specific purpose of acting as a brace to those members; and
- (b) door jambs, window frames and reveals, architraves and skirtings.

#### 3.1.3 Application of this Part

- (a) The requirements of this Part apply when a *primary building element* of a Class 1 and 10 building is considered susceptible to termite attack.
- (b) This Part does not apply to Class 1 and 10 buildings as follows (see also **Figure 3.1.3.1**):
  - (i) Buildings in areas where subterranean termites are not known to present a potential risk of attack to the *primary building elements* of the building.

#### Explanatory information:

Termites are not considered to be a risk in Tasmania and a lesser risk in parts of Victoria. The *appropriate authority* may have records of termite activity for each area and may be able to advise you on whether termite risk management is needed.

- (ii) Buildings that have all their *primary building elements* constructed of one, or a combination of, the following materials:
  - (A) Steel, aluminium or other metals.

- (B) Concrete.
- (C) Masonry.
- (D) Fibre-reinforced cement.
- (E) Naturally termite resistant timber in accordance with Appendix C of AS 3660.1.
- (F) Preservative treated timber in accordance with Appendix D of AS 3660.1.
- (iii) Buildings in Tasmania.

#### Explanatory information:

Where individual *primary building elements* are susceptible to termite attack and the remainder of the *primary building elements* are constructed of termite resistant materials, only the susceptible elements need to be provided with a termite barrier.


#### STATE AND TERRITORY VARIATIONS

##### 3.1.3(b)(ii)(E) is replaced by the following clause in the Northern Territory

(E) Naturally termite resistant timber in accordance with Appendix C of AS 3660.1 in areas where *Mastotermes darwiniensis* are not prevalent.

**Figure 3.1.3.1**
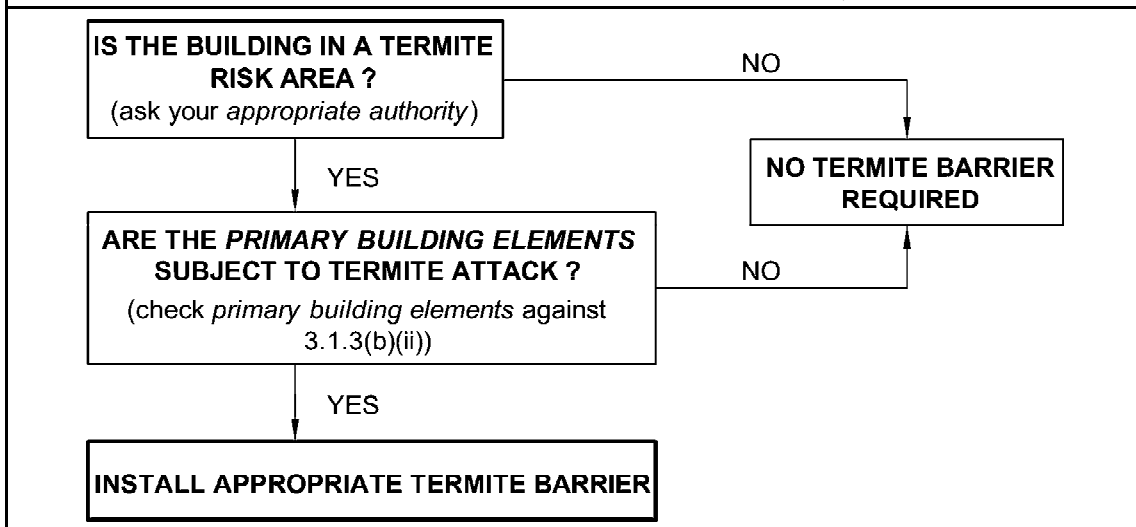
#### FLOW CHART FOR IDENTIFYING IF A TERMITE BARRIER IS REQUIRED



#### Appropriate *Performance Requirements*:

Where an alternative termite barrier or system is proposed as an *Alternative Solution* to that described in **Part 3.1.3**, that proposal must comply with—

- (a) *Performance Requirement P2.1*: and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.



## A. Acceptable construction manual

### 3.1.3.0 Acceptable construction manual

*Performance Requirement P2.1* is satisfied for termite risk management if—

- (a) a termite barrier is installed in a Class 1 or 10 building to minimise the risk of termite attack to *primary building elements* in accordance with AS 3660.1 — Termite management — New building work; and
- (b) a durable notice is installed in accordance with **3.1.3.2(b)**.

#### STATE AND TERRITORY VARIATIONS

**In the Northern Territory delete 3.1.3.0(b) and insert 3.1.3.0(b) and (c) as follows:**

- (b) a durable notice is installed in accordance with **3.1.3.2(b)**; and
- (c) additional termite risk management measures are used in areas where *Mastotermes darwiniensis* are prevalent.

#### STATE AND TERRITORY VARIATIONS

**In Queensland delete 3.1.3.0 and replace with the following:**

### **3.1.3.0 Acceptable construction manual**

*Performance Requirements P2.1* and **P2.1.1** are satisfied for termite risk management if—

- (a) a termite barrier is installed in a Class 1 or 10 building to minimise the risk of the *primary building elements* being damaged by subterranean termites in accordance with AS 3660.1; and
- (b) the termite barrier required by **(a)** has —
  - (i) for a non temporary Class 1 building, a design life of at least 50 years; or
  - (ii) for other than a non-temporary Class 1 building, a design life of at least 50 years or the specified design life of the building, whichever is the lesser.
- (c) a termite barrier need not comply with **(b)** if it is easily and readily accessible for replenishment or replacement and is capable of being replenished or replaced; and
- (d) where a chemical soil barrier is used as an external perimeter barrier, it is—
  - (i) installed by excavating trenches, treating the exposed trench and backfilling the trench with treated material; and
  - (ii) covered by a 50 mm thick concrete cover strip not less than 300 mm wide measured from the external wall of the building; and
- (e) durable notices are installed in accordance with **3.1.3.2(b)**.

## B. Acceptable construction practice

### 3.1.3.1 Application

Compliance with this acceptable construction practice satisfies *Performance Requirement P2.1* for termite risk management.

#### Explanatory information:

The intent of these requirements is to provide for a termite barrier that will ensure that termites will not enter a building by a concealed route. The installation of termite barriers will not stop termite activity from occurring on the *site*.

#### STATE AND TERRITORY VARIATIONS

##### 3.1.3.1 is replaced by the following clause in the Northern Territory.

Compliance with this Part satisfies *Performance Requirement P2.1* for termite risk management provided that additional termite risk measures are used in areas where *Mastotermes darwiniensis* are prevalent.

#### STATE AND TERRITORY VARIATIONS

##### In Queensland delete 3.1.3.1 and replace with the following:

##### 3.1.3.1 Application

Compliance with this Part satisfies *Performance Requirements P2.1* and *P2.1.1* for termite risk management.

### 3.1.3.2 Installation of termite barriers

- (a) A termite barrier or combination of barriers must be installed in accordance with—
  - (i) **3.1.3.3** for concrete slabs-on-ground; or
  - (ii) **3.1.3.4** for suspended floors.

(For barrier options see **Table 3.1.3.1**).
- (b) A durable notice must be permanently fixed to the building in a prominent location, such as in a meter box or the like, indicating—
  - (i) the method of termite risk management; and
  - (ii) the date of installation of the system; and
  - (iii) where a chemical barrier is used, its life expectancy as listed on the National Registration Authority label; and
  - (iv) the installer's or manufacturer's recommendations for the scope and frequency of future inspections for termite activity.

#### Explanatory information:

##### Durable notice

A durable notice must be fixed to the building in a prominent location advising the building occupants that the system should be inspected and maintained.

The notice should be clearly written, on a material that will not deteriorate or fade over time and be located in or near the meter box or similar location so that it can be easily seen and read by future owners of the building. Additional information may be included if desired by the person placing the notice.

## STATE AND TERRITORY VARIATIONS

**In Queensland delete 3.1.3.2 and replace with the following:**

### 3.1.3.2 Installation of termite barriers

- (a) A termite barrier or combination of barriers must be installed in accordance with—
- (i) AS 3660.1 subject to **Clause 3.1.3.0(b), (c) and (d)**; or
  - (ii) **3.1.3.3** for concrete slabs-on-ground; or
  - (iii) **3.1.3.4** for suspended floors.
- (For barrier options, see **Table 3.1.3.1**)
- (b) At least 2 durable notices must be permanently fixed to the building in prominent locations, such as in a meter box and a kitchen cupboard or the like, indicating—
- (i) the method of termite risk management; and
  - (ii) the date of installation of the termite management measure; and
  - (iii) where a chemical barrier is used, its life expectancy as listed on the National Registration Authority label; and
  - (iv) the installer's or manufacturer's recommendations for the scope and frequency of future inspections for termite activity.

### Explanatory information:

#### Durable notices

At least two durable notices must be fixed to the building in prominent locations advising the building occupants that the termite management measure should be inspected and maintained. The notices should be clearly written, on a material that will not deteriorate or fade over time and be located in or near the meter box and in a kitchen cupboard or similar location so that it can be easily seen and read by future owners of the building. Additional information may be included if desired by the person placing the notice.

Table 3.1.3.1 ACCEPTABLE TERMITE BARRIERS

TERMITE MANAGEMENT SYSTEM (as per AS 3660.1)	FOOTING SYSTEM				
	Concrete slab-on-ground complying with AS 2870		Concrete slab-on-ground not complying with AS 2870		Suspended floors
	Penetrations and control joints	Slab perimeter	Beneath slab (includes penetrations and control joints)	Slab perimeter	
Slab edge exposure	Not suitable	Suitable	Not suitable	Suitable	Not applicable
Termite shielding	Not suitable	Not suitable	Not suitable	Not suitable	Suitable
Stainless steel mesh	Partial; or Full system	Partial; or Full system	Full system	Full system	Suitable
Graded stone	Partial; or Full system	Partial; or Full system	Full system	Full system	Partial; or Full system
Chemicals	Full system beneath slab	Perimeter system	Full system beneath slab	Perimeter system	Full system

**Explanatory information:**

A “partial system” as referred to in [Table 3.1.3.1](#) is one that when used in a combination with other systems, will form a “full system”. This is similar to [3.1.3.2](#) which refers to a “termite barrier or combination of barriers”.

For example, if a concrete slab is used as a barrier, it in itself will not provide a complete barrier to termites. Then, depending on the construction methods and the site conditions, additional requirements will be necessary for service penetrations. Each of these are “partial” treatment, yet when integrated, will form a “full system”.

In addition to the acceptable termite barriers described in [Table 3.1.3.1](#), other methods or systems can be used if it can be demonstrated that they meet the relevant [Performance Requirements](#) of the [Housing Provisions](#). Forms of evidence of suitability are described in [Part 1.2](#) — Acceptance of design and construction.

**STATE AND TERRITORY VARIATIONS**

**In Queensland delete Table 3.1.3.1 and replace with the following:**

Table 3.1.3.1 ACCEPTABLE TERMITE BARRIERS

TERMITE MANAGEMENT SYSTEM (as per AS 3660.1)	FOOTING SYSTEM				
	Concrete slab-on-ground complying with AS 2870		Concrete slab-on-ground not complying with AS 2870		Suspended floors
	Penetrations and control joints	Slab perimeter	Beneath slab (includes penetrations and control joints)	Slab perimeter	
Slab edge exposure	Not suitable	Suitable subject to 3.1.3.0(b)	Not suitable	Suitable subject to 3.1.3.0(b)	Not applicable
Termite shielding	Not suitable	Not suitable	Not suitable	Not suitable	Suitable subject to 3.1.3.0(b)
Stainless steel mesh	Partial; or Full system subject to 3.1.3.0(b)	Partial; or Full system subject to 3.1.3.0(b)	Full system subject to 3.1.3.0(b)	Full system subject to 3.1.3.0(b)	Suitable subject to 3.1.3.0(b)
Graded stone	Partial; or Full system subject to 3.1.3.0(b)	Partial; or Full system subject to 3.1.3.0(b)	Full system subject to 3.1.3.0(b)	Full system subject to 3.1.3.0(b)	Partial; or Full system subject to 3.1.3.0(b)
Chemicals	Full system beneath slab subject to 3.1.3.0(b) and (c)	Perimeter system subject to 3.1.3.0(b) and (d)	Full system beneath slab subject to 3.1.3.0(b) and (c)	Perimeter system subject to 3.1.3.0(b) and (d)	Full system subject to 3.1.3.0(b) and (c)

### 3.1.3.3 Barriers for concrete slab-on-ground

- (a) Where a concrete slab-on-ground is to be used as part of a termite barrier system, the slab must be designed and constructed to comply with AS 2870, and—
  - (i) monolithic slabs must have penetrations and the perimeter of the slab treated in accordance with Table 3.1.3.1 (see Figure 3.1.3.2); and
  - (ii) non-monolithic slabs must have penetrations, control joints and the perimeter of the slab treated in accordance with Table 3.1.3.1 (see Figure 3.1.3.3).
- (b) Slabs not constructed in accordance with AS 2870 must have the full area beneath the slab and the perimeter treated in accordance with Table 3.1.3.1.
- (c) The edge of a slab-on-ground may be used as a perimeter barrier provided—
  - (i) the slab edge is left exposed, not less than 75 mm above finished ground level; and
  - (ii) the face of the exposed edge is not rough or honeycombed and does not contain ripples caused by folds in vapour barrier or the like that could conceal termite activity; and
  - (iii) the exposed surface is not rendered, tiled, clad or concealed by *flashing*.

Figure 3.1.3.2

## AREAS TO BE TREATED FOR CONCRETE SLAB-ON-GROUND


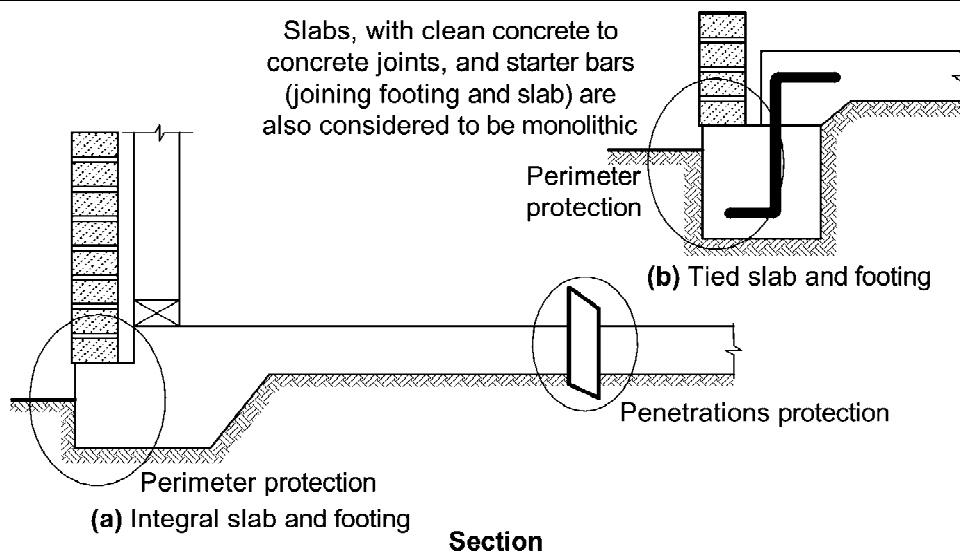


Figure 3.1.3.3

## AREAS TO BE TREATED FOR CONCRETE SLABS

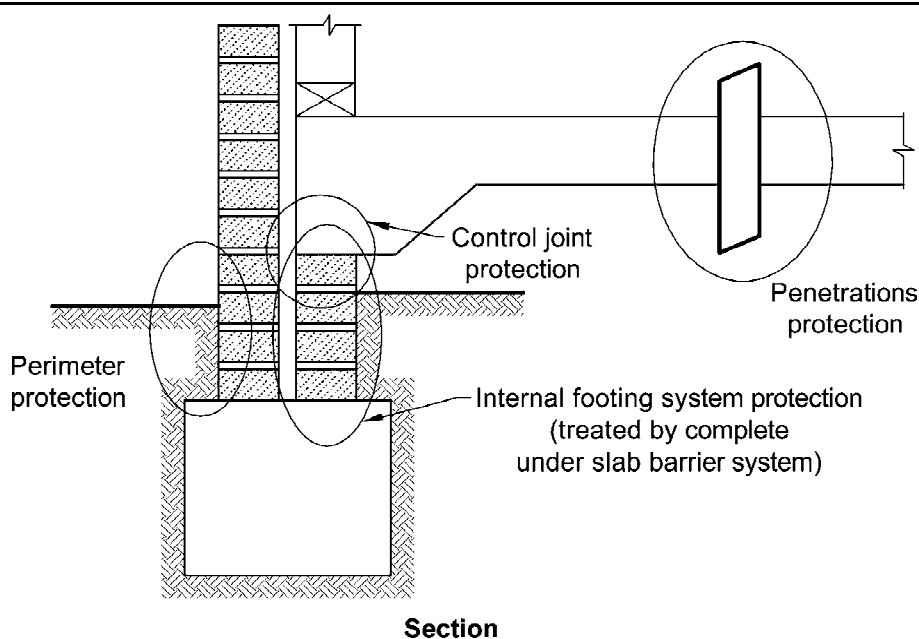

## 3.1.3.4 Barriers for suspended floors

The area beneath a suspended floor of a building must be treated—

- (a) by installing a barrier system in accordance with [Table 3.1.3.1](#); and
- (b) by providing sub-floor ventilation in accordance with [Part 3.4.1](#); and

- (c) where a barrier that needs to be inspected is installed, by providing access to the area of the barrier that needs inspection in accordance with AS 3660.1.

### 3.1.3.5 Attachments to buildings

- (a) Attachments to buildings such as downpipes and service pipes must have a gap to allow clear and uninterrupted visual inspection across the inspection zone.
- (b) Structures such as steps, verandahs, porches, access ramps, carports, trellises, decks, hot-water systems, airconditioners, or the like which are not provided with one of the barrier systems described in this Part, must be separated from the building by a gap of not less than 25 mm, to allow clear and uninterrupted visual inspection across the inspection zone.
- (c) Where attachments or structures, as outlined in (a) and (b), abut a building and there is no clear gap, a barrier must be provided to the attachment, regardless of the size of the attachment.
- (d) For the purposes of this clause, an inspection zone is an unobstructed space which termites must cross or pass in order to gain access to a building or structure and, as a consequence, reveal their presence during visual inspection.

#### Explanatory information: Termites:

##### 1. Barriers — Part of a system

There are more than 350 species of termites in Australia, about 30 of which achieve economic importance by causing costly damage to building structures. Due to the nature of termites, it is extremely difficult to prevent them gaining access to a building.

In addition to the correct installation of a termite barrier, its effectiveness will rely on regular maintenance and competent inspection.

The requirements in the BCA are minimum requirements and owners of buildings may choose to incorporate additional termite management systems in their buildings.

##### 2. The slab as a barrier

A concrete slab, designed and constructed in accordance with AS 2870, can form part of an acceptable termite barrier system. Cracking of the slab is common and does not necessarily indicate the failure of the termite barrier. Most cracks, including those that may appear quite wide on the surface do not necessarily extend for the full depth of the slab.

##### 3. Slab edge exposure

This approach is similar to that applied to termite shields in that termite activity is forced onto the exposed edge of the slab where with regular inspections termite ingress via the perimeter of the building can be detected.

The exposed edge of the slab should be kept clean. Debris such as leaves should be removed to ensure the full 75 mm of the slab is always visible.

##### 4. Treatment of sub-floor areas

The area beneath a building requires special attention to ensure the effectiveness of the termite barrier. The following points should be observed.

- a. Sub-floor ventilation — In suspended floor areas it is important that termite activity is not encouraged by inadequate subfloor ventilation. In conjunction with physical or chemical barriers air flow is critical. Air flow will not only restrict the growth of

fungus which attacks subfloor members (which makes them more susceptible to termite attack), but also creates a climatic atmosphere less conducive to termite activity.

- b. Subfloor access — Termite shielding installed below suspended floors relies on access for both inspection and maintenance to be effective. Accordingly, minimum clearance heights will need to be achieved between the building structure (including ducts) and the ground to allow easy access to all areas where termite shields are used.

Perimeter access doors will also be needed where access is required for inspection and maintenance.



# PART 3.2

---

## FOOTINGS AND SLABS

- 3.2      Footings and slabs
  - 3.2.2    Preparation
  - 3.2.3    Concrete and Reinforcing
  - 3.2.4    Site Classification
  - 3.2.5    Footing and Slab Construction

## PART 3.2 CONTENTS

---

### **PART 3.2 FOOTINGS AND SLABS**

#### **Explanatory Information**

#### **3.2 Footings and Slabs**

##### 3.2 Definitions

##### 3.2.0 Acceptable construction manual

##### 3.2.1 Application

#### **3.2.2 Preparation**

##### 3.2.2.1 Excavation for footings

##### 3.2.2.2 Filling under concrete slabs

##### 3.2.2.3 Foundations for footings and slabs

##### 3.2.2.4 Slab edge support on sloping sites

##### 3.2.2.5 Stepped footings

##### 3.2.2.6 Vapour barriers

##### 3.2.2.7 Edge rebates

#### **3.2.3 Concrete and Reinforcing**

##### 3.2.3.1 Concrete

##### 3.2.3.2 Steel reinforcement

#### **3.2.4 Site Classification**

##### 3.2.4.1 Site classification

#### **3.2.5 Footing and Slab Construction**

##### 3.2.5.1 Footing and slab construction

##### 3.2.5.2 Footings and slabs to extensions to existing buildings

##### 3.2.5.3 Shrinkage control

##### 3.2.5.4 Minimum edge beam dimensions

##### 3.2.5.5 Footings for fireplaces on Class A and S sites

##### 3.2.5.6 Stump footing details

---

## PART 3.2 EXPLANATORY INFORMATION

---

### **Explanatory information:**

This Part specifies the requirements for the excavation and filling for the footing or slab together with the construction of various alternative concrete slab and footing configurations. The slab and footing configurations detailed in [Part 3.2.5](#) are only suitable for the specified soil classifications. The requirements contained in the remainder of this Part are more general and may be applied to all slab and footing construction.

---

## PART 3.2 FOOTINGS AND SLABS

---

### Appropriate *Performance Requirements*:

Where an alternative footing system is proposed as an *Alternative Solution* to that described in **Part 3.2**, that proposal must comply with—

- (a) *Performance Requirement P2.1*; and
- (b) *Performance Requirement P2.2.3*; and
- (c) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### Definitions

## 3.2

The following definitions are used in this Part:

**Articulated masonry** means masonry construction in which special provisions have been made for movement by articulation (see **3.3.1.8**).

**Clad frame** means timber or metal frame construction with exterior timber or sheet wall cladding that is not sensitive to minor movement and includes substructure masonry walls up to 1.5 m high.

**Controlled fill** means material that has been placed and compacted in layers with compaction equipment (such as a vibrating plate) within a defined moisture range to a defined density requirement.

**Finished ground level** means the ground level adjacent to footing systems at the completion of construction and landscaping.

**Footing** means construction that transfers the load from the building to the *foundation*.

**Loadbearing wall**, for the purposes of this Part, means any wall imposing on the footing a load greater than 10 kN/m.

**Mixed construction** means a building consisting of more than one form of construction, particularly in double-storey buildings.

**Rolled fill** means material placed in layers and compacted by repeated rolling by an excavator.

**Single leaf masonry** means outer walls constructed with a single thickness of masonry unit.

**Waffle raft** means a stiffened raft with closely spaced ribs constructed on the ground and with slab panels supported between ribs.

**A. Acceptable construction manual****3.2.0**

*Performance Requirements P2.1* and *P2.2.3* are satisfied for footings and slabs if they are installed in accordance with one of the following manuals:

- (a) The footing or slab is constructed in accordance with AS 2870.
- (b) Piled footings are designed in accordance with AS 2159.

**Explanatory information:**

Composite construction — design requirements for other materials that may be used in combination with the above footing systems, including the use of heavy steel support beams etc are described in **Part 3.11** — structural design codes.

**STATE AND TERRITORY VARIATIONS****In New South Wales delete 3.2.0(a) and insert NSW 3.2.0(a) as follows:**

- (a) The footing or slab is constructed in accordance with AS 2870 except that for the purposes of Clause 5.3.3.1 of AS 2870 a damp-proofing membrane is required to be provided.


**B. Acceptable construction practice****3.2.1 Application**

Compliance with the acceptable construction practice contained in Parts **3.2.2** to **3.2.5** satisfies *Performance Requirements P2.1* and *P2.2.3* for footings and slabs, provided—

- (a) the footing is on a Class A, S, M, M-D, H or H-D *site* (classified in accordance with AS 2870) with a uniform bearing capacity; and
- (b) the slab is not more than 30 m long; and
- (c) slabs containing permanent joints (eg construction joints) are not used; and
- (d) the structure supported by the footing does not contain—
  - (i) more than two trafficable floors; or
  - (ii) a wall height exceeding 8 m, excluding any gable; and
- (e) the footing does not support more than one concrete slab; and

**Explanatory information:**

For the purpose of (e) split level slabs are considered as one slab.

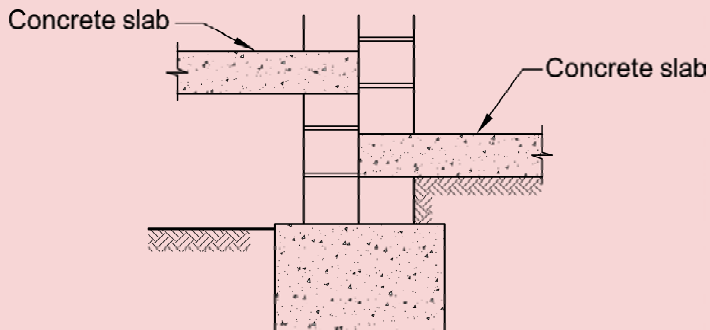

**Diagram 1 - Split level concrete slab**

- (f) the building does not include wing walls or masonry arches not detailed for movement in accordance with Cement Concrete and Aggregates Australia TN 61; and
- (g) single leaf earth or stone masonry walls do not exceed 3 m in height; and
- (h) the *site* is considered to be normal as defined in [Part 3.1.1](#); and
- (i) the *site* is not located in an *alpine area*.

## PART 3.2.2 PREPARATION

### 3.2.2.1 Excavation for footings

- (a) Excavation for footings, including thickenings for slabs and pads must be clean cut with vertical sides, wherever possible.
- (b) The base of the excavation must be—
  - (i) for flat [sites](#), generally level but may slope not more than 1:40 to allow excavations to drain; and
  - (ii) sloping [sites](#) at an angle of not more than 1:10; and
  - (iii) stepped footings in accordance with [3.2.2.5](#).
- (c) Footing excavations must be free of loose earth, tree roots, mud or debris immediately before pouring concrete.
- (d) Topsoil containing grass roots must be removed from the area on which the footing will rest.
- (e) Excavation depths and soil cuts must comply with [Part 3.1.1](#).

#### STATE AND TERRITORY VARIATIONS

##### 3.2.2.1(e) does not apply in New South Wales.

**Note:** In New South Wales the consent authority can determine to place controls on siteworks associated with the erection of a building, by imposing conditions when it grants development consent. These controls can include the safeguarding of excavations and backfilling, provision of retaining walls to prevent soil movement and support for neighbouring buildings. Information addressing siteworks can be found in the Department of Infrastructure Planning and Natural Resources' Act and Regulation note "Health, safety and amenity during construction".

- (f) On loose sand [sites](#) or [sites](#) subject to wind or water erosion, the depth below [finished ground level](#) for footings must be not less than 300 mm.
- (g) Height of finished slab-on-ground must be in accordance with [3.1.2.3\(b\)](#).

### 3.2.2.2 Filling under concrete slabs

Filling placed under a slab (except where the slab is suspended) must comply with the following:

- (a) Filling must be either [controlled fill](#) or [rolled fill](#) as follows:
  - (i) Sand used in [controlled fill](#) or [rolled fill](#) must not contain any gravel size material and achieve a blow count of 7 or more per 300 mm using the test method described in AS 1289, Method 6.3.3.
  - (ii) Clay used in [controlled fill](#) or [rolled fill](#) must be moist during compaction.
  - (iii) [Controlled fill](#):
    - (A) Sand fill up to 800 mm deep — well compacted in layers not more than 300 mm deep by vibrating plate or vibrating roller.

- (B) Clay fill up to 400 mm deep — well compacted in layers of not more than 150 mm by a mechanical roller.
- (iv) *Rolled fill*:
  - (A) Sand fill up to 600 mm deep — compacted in layers of not more than 300 mm by repeated rolling by an excavator or other suitable mechanical equipment.
  - (B) Clay fill up to 300 mm deep — compacted in layers of not more than 150 mm by repeated rolling by an excavator or similar machine.
- (b) \* \* \* \* \*
- (c) A level layer of clean quarry sand must be placed on top of the fill, with a depth of not less than 20 mm.
- (d) A graded stone termite barrier complying with [Part 3.1.3](#) may be substituted for the sand required in [\(c\)](#).

### 3.2.2.3 Foundations for footings and slabs

Footings and slabs, including internal and edge beams, must be founded on soil with an allowable bearing pressure as follows:

- (a) Slab panels, load support panels and internal beams — natural soil with an allowable bearing pressure of not less than 50 kPa or *controlled fill* or *rolled fill* compacted in accordance with [3.2.2.2](#).
- (b) Edge beams connected to the slab — natural soil with an allowable bearing pressure of not less than 50 kPa or *controlled fill* compacted in accordance with [3.2.2.2\(a\)\(iii\)](#) and extending past the perimeter of the building 1 m with a slope ratio not steeper than 2 horizontal to 1 vertical (see [Figure 3.2.2.1](#)).
- (c) Pad footings, strip footings and edge beams not connected to the slab, must be—
  - (i) founded in natural soil with an allowable bearing pressure of not less than 100 kPa; or
  - (ii) for Class A and S *sites* they may be founded on controlled sand fill in accordance with [3.2.2.2\(a\)](#).

### 3.2.2.4 Slab edge support on sloping sites

Footings and slabs installed on the low side of sloping *sites* must be as follows:


- (a) Slab panels — in accordance with [3.2.2.3\(a\)](#).
- (b) Edge beams—
  - (i) supported by *controlled fill* in accordance with [3.2.2.3\(b\)](#) (see [Figure 3.2.2.1](#), Option 1); or
  - (ii) supported by deepened edge beams or bulk piers designed in accordance with AS 3600 (see [Figure 3.2.2.1](#), Option 2); or
  - (iii) deepened (as per AS 2870) to extend into the natural soil level with a bearing capacity in accordance with [3.2.2.3\(b\)](#) (see [Figure 3.2.2.1](#), Option 3); or
  - (iv) stepped in accordance with AS 2870.
- (c) Edge beams not connected to the slab, pad footings and strip footings — founded in accordance with [3.2.2.3\(c\)](#).



- (d) Where an excavation (cut) of the natural ground is used it must be in accordance with [Part 3.1.1](#).

**Figure 3.2.2.1**

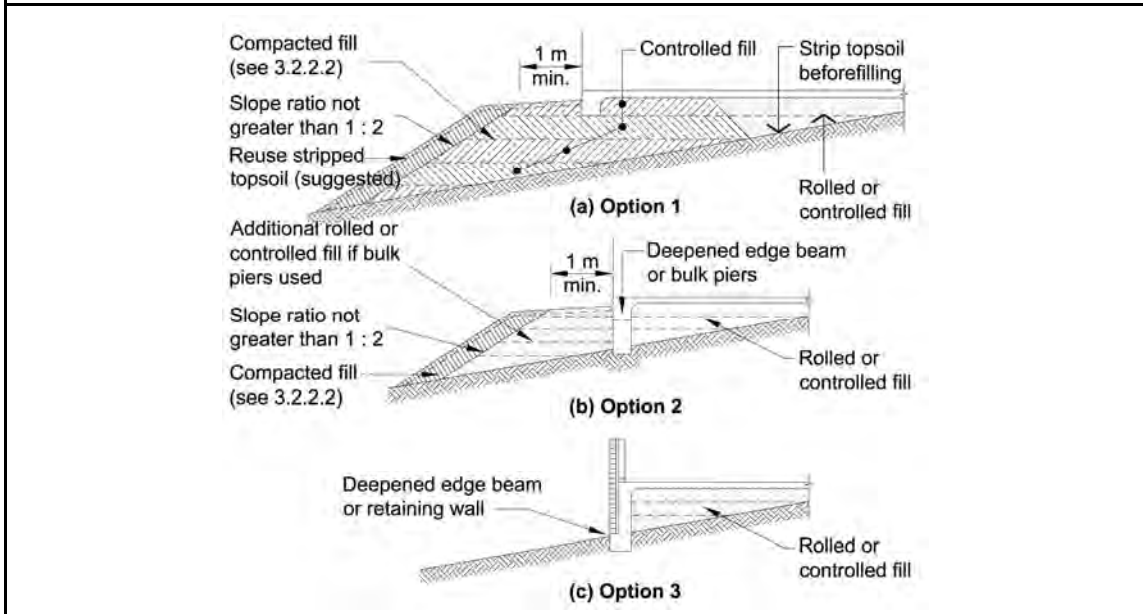**SLAB EDGE SUPPORT ON THE LOW SIDE OF SLOPING SITES**



**Explanatory information:**

The [foundations](#) of a building are critical to its successful performance. As such, the soil must have the strength or bearing capacity to carry the building load with minimum movement.

The bearing capacity of a soil varies considerably and needs to be determined on a [site](#) by [site](#) basis. For this to occur, the appropriate people need to be consulted. These people may include a qualified engineer or experienced engineering geologist, or it may be determined by a person with appropriate local knowledge. The minimum bearing capacity (soil strength rating) may depend on the [site](#) conditions. The soil may be naturally undisturbed or be disturbed by building work or the like. Where soil is disturbed by building work and the like, the bearing capacity can be dramatically altered. This is typically the case for sloping [sites](#) where cut and fill procedures are used. In these situations the soil needs to be consolidated, generally via compaction, to achieve the [required](#) bearing capacity.

There are a number of alternatives for working on cut and filled sites. These are described in [Figure 3.2.2.1](#).

Option 1 of [Figure 3.2.2.1](#) refers to the controlled fill process which involves the compaction of fill in layers to achieve the bearing capacity described in [3.2.2.3](#). The depth of fill for each layer is specified to ensure effective compaction. Fill beyond these depths will need to be installed in accordance with the acceptable construction manuals set out in [3.2.0](#).

Option 2 and 3 of [Figure 3.2.2.1](#) refer to edge beams that extend through the fill into undisturbed soil which provides the [3.2.2.3 required](#) bearing capacity. In this situation the fill is essentially only taking the internal slab loads.

### 3.2.2.5 Stepped footings


Stepped strip footings must be constructed as follows—

- (a) the base of the footing must be horizontal or have a slope of not more than 1:10; or
- (b) be stepped in accordance with one of the methods shown in [Figure 3.2.2.2](#).

**Figure 3.2.2.2**

#### STEPPED STRIP FOOTINGS

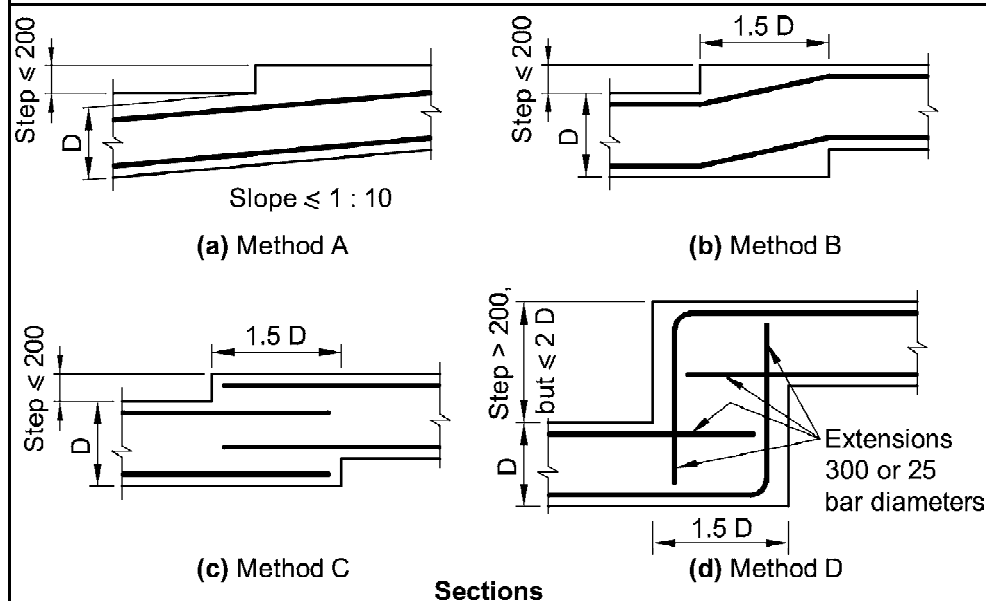**Note:** All measurements in millimetres.



### 3.2.2.6 Vapour barriers

A vapour barrier must be installed under slab-on-ground construction for all Class 1 buildings and for Class 10 buildings where the slab is continuous with the slab of a Class 1 building as follows—

- (a) Materials

A vapour barrier must be—

- (i) 0.2 mm nominal thickness polyethylene film; and
- (ii) medium impact resistant,

determined in accordance with criteria specified in clause 5.3.3.2(c) of AS 2870; and

- (iii) be branded continuously “AS 2870 Concrete underlay, 0.2 mm Medium impact resistance”.

- (b) Installation

A vapour barrier must be installed as follows—

- (i) lap not less than 200 mm at all joints; and

- (ii) tape or seal with a close fitting sleeve around all service penetrations; and
  - (iii) fully seal where punctured (unless for service penetrations) with additional polyethylene film and tape.
- (c) The vapour barrier must be placed beneath the slab so that the bottom surface of the slab is entirely underlaid and extends under edge beams to finish at ground level in accordance with [Figure 3.2.2.3](#) (also see [Figure 3.3.4.9](#) for single skin masonry details).

#### STATE AND TERRITORY VARIATIONS

**In South Australia delete 3.2.2.6 and insert SA 3.2.2.6 as follows:**

##### **SA 3.2.2.6 Damp-proofing membrane**

A continuous damp-proofing membrane must be installed under slab-on-ground construction for all Class 1 buildings and for Class 10 buildings where the slab is continuous with the slab of a Class 1 building as follows—

(a) Materials

A damp-proofing membrane must be—

- (i) 0.2 mm nominal thickness polyethylene film; and
- (ii) high impact resistant with resistance to puncturing and moisture penetration, determined in accordance with criteria specified in clause 5.3.3.2(c) of AS 2870; and
- (iii) be branded continuously “AS 2870 Concrete underlay, 0.2 mm High impact resistance” together with the manufacturer’s or distributor’s name, trade mark or code.

(b) Installation

A damp-proofing membrane must be installed as follows—

- (i) lap not less than 200 mm at all joints; and
- (ii) tape or seal with a close fitting sleeve around all service penetrations; and
- (iii) fully seal where punctured (unless for service penetrations) with additional polyethylene film and tape.

- (c) The damp-proofing membrane must be placed beneath the slab so that the bottom surface of the slab is entirely underlaid and extends under edge beams to finish at ground level in accordance with [Figure 3.2.2.3](#) (also see [Figure 3.3.4.9](#) for single skin masonry details).

**In New South Wales delete 3.2.2.6 and insert NSW 3.2.2.6 as follows:**

##### **NSW 3.2.2.6 Damp-proofing membrane**

A damp-proofing membrane must be installed under slab-on-ground construction for all Class 1 buildings and for Class 10 buildings where the slab is continuous with the slab of a Class 1 building as follows—

(a) Materials

A damp-proofing membrane must be—

- (i) 0.2 mm nominal thickness polyethylene film; and
- (ii) high impact resistant, determined in accordance with criteria specified in clause 5.3.3.2(c) of AS 2870; and
- (iii) be branded continuously "AS 2870 Concrete underlay, 0.2 mm High impact resistance".

(b) Installation

A damp-proofing membrane must be installed as follows—

- (i) lap not less than 200 mm at all joints; and
- (ii) tape or seal with a close fitting sleeve around all service penetrations; and
- (iii) fully seal where punctured (unless for service penetrations) with additional polyethylene film and tape.

- (c) The vapour barrier must be placed beneath the slab so that the bottom surface of the slab is entirely underlaid and extends under edge beams to finish at ground level in accordance with [Figure 3.2.2.3](#) (also see [Figure 3.3.4.9](#) for single skin masonry details).

**Note:**

A range of polyethylene films can be used, including black film and orange film, provided they satisfy the requirements for high impact resistance in accordance with the criteria specified in clause 5.3.3.2(c) of AS 2870.


### 3.2.2.7 Edge rebates

Edge rebates for slab-on-ground, stiffened raft or *waffle raft* with masonry *cavity* or veneer construction must comply with the following:

- (a) The rebate must not be less than 20 mm, except as provided for in [\(d\)](#).
- (b) Exterior masonry must not overhang more than 15 mm past the edge of the slab.
- (c) The edge rebate must be flashed and drained in accordance with [Part 3.3.4](#) and where it cannot be flashed it must be filled with mortar.
- (d) Edge rebates are not *required* for *single leaf masonry*.

**Explanatory information:**

See [3.2.5.4](#) for minimum edge beam details.

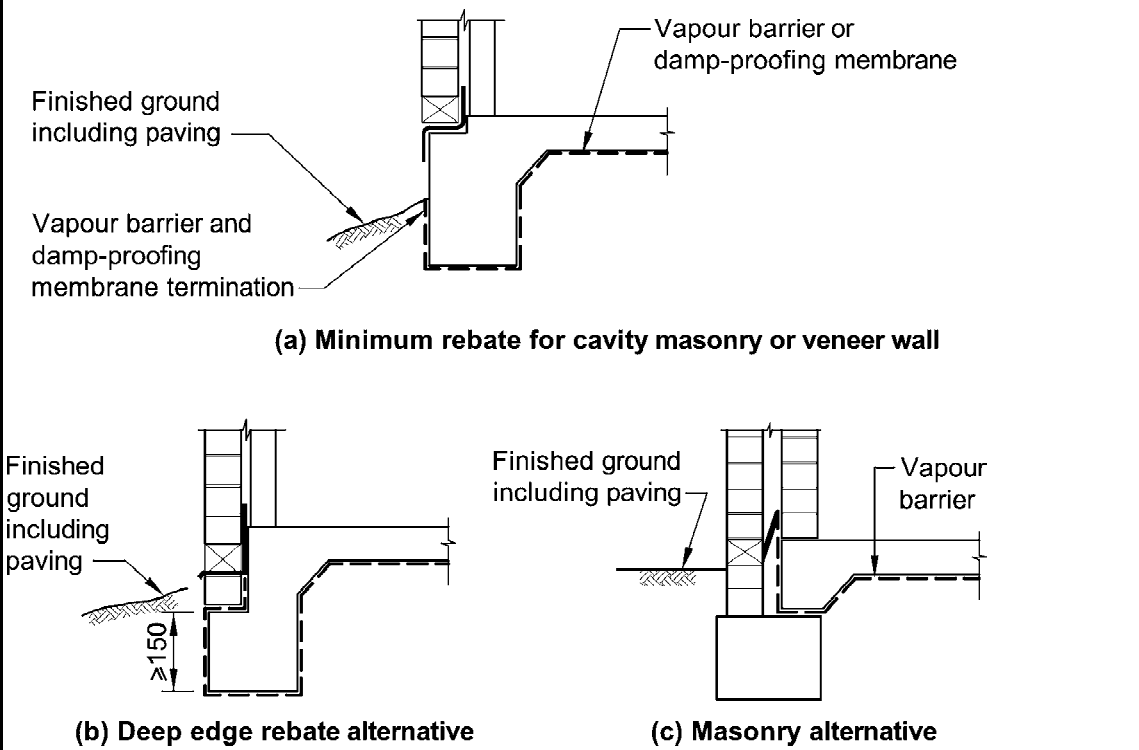**Figure 3.2.2.3****ACCEPTABLE VAPOUR BARRIER AND DAMP-PROOFING MEMBRANE LOCATION****Note:** All dimensions in mm.

## PART 3.2.3 CONCRETE AND REINFORCING

### 3.2.3.1 Concrete

Concrete must comply with the following:

- (a) Concrete must be manufactured to comply with AS 3600; and—
  - (i) have a strength at 28 days of not less than 20 MPa (denoted as N20 grade); and
  - (ii) have a 20 mm nominal aggregate size; and
  - (iii) have a nominal 100 mm slump.
- (b) Water must not be added to the mix to increase the slump to a value in excess of that specified.
- (c) Concrete must be placed and compacted in accordance with good building practice.
- (d) In hot (above 30°Celsius) and windy conditions concrete must be cured by covering with plastic sheeting, spraying with a liquid membrane curing compound or ponding of water on the top surface.

#### STATE AND TERRITORY VARIATIONS

**In South Australia after 3.2.3.1(d) insert SA 3.2.3.1(e), (f) and (g) as follows:**

- (e) Concrete in slabs must be adequately compacted, and slab surfaces, including edges, moist cured for 7 days.
- (f) After vertical surfaces are stripped of formwork, slab edges must be finished prior to curing.
- (g) Loading of concrete slabs with stacked materials or building plant must not occur for a minimum of 7 days after pouring although construction of wall frames and setting out brickwork may be undertaken during this period.

#### Explanatory information:

Compacting concrete by vibration removes air pockets and works the concrete thoroughly around reinforcement, service penetrations etc. and into corners of formwork to increase durability and resistance to termite infestation and salt damp attack. Care should be taken not to over-vibrate.

The finishing and curing of slab edges provides an improved edge finish which is resistant to edge dampness.

#### Explanatory information:

1. Complete discharge of the concrete from the truck should be made within one and a half hours of initial mixing with water unless a suitable retarder has been specified.
2. Care should be taken when using chemical curing methods, because some products may not be compatible with adhesives used to fix surface finishes to the slab.

### 3.2.3.2 Steel reinforcement

- (a) Materials used for reinforcing steel must comply with AS 2870 and be—
- (i) welded wire reinforcing fabric; or
  - (ii) trench mesh; or
  - (iii) steel reinforcing bars.
- (b) Steel reinforcing bars may be substituted for trench mesh in accordance with [Table 3.2.3.2](#).

#### Explanatory information:

Reinforcement types referenced in this Part are described as follows:

1. Square mesh is designated in terms of the diameter of each bar and the spacing of consecutive bars. For example, SL62 consists of 6 mm bar at 200 mm spacings.
2. Trench mesh is designated in terms of the number of longitudinal bars and the diameter of each bar. For example, 3-L11TM consists of 3 longitudinal bars each of which are 11 mm in diameter.
3. Reinforcing bars are designated in terms of the number of bars and the diameter of each bar. For example, 6-N12 consists of 6 bars each of which are 12 mm in diameter.

- (c) Minimum laps for reinforcement as shown in [Table 3.2.3.1](#) and [Figure 3.2.3.1](#) must be provided where reinforcing is used.

**Table 3.2.3.1 MINIMUM LAP FOR REINFORCEMENT**

Reinforcement	Minimum splice (mm)	Minimum Lap at “T” intersections	Minimum Lap at “L” intersections
Steel reinforcing bars	500	Full width across the junction	One outer bar must be bent and continue 500 mm (min) around corner
Trench mesh	500	Full width across the junction	Full width across the junction
Square and Rectangular Mesh	The two outermost transverse wires of one sheet must overlap the two outermost transverse wires of the other	Not applicable	Not applicable

Figure 3.2.3.1

## LAPS IN REINFORCEMENT

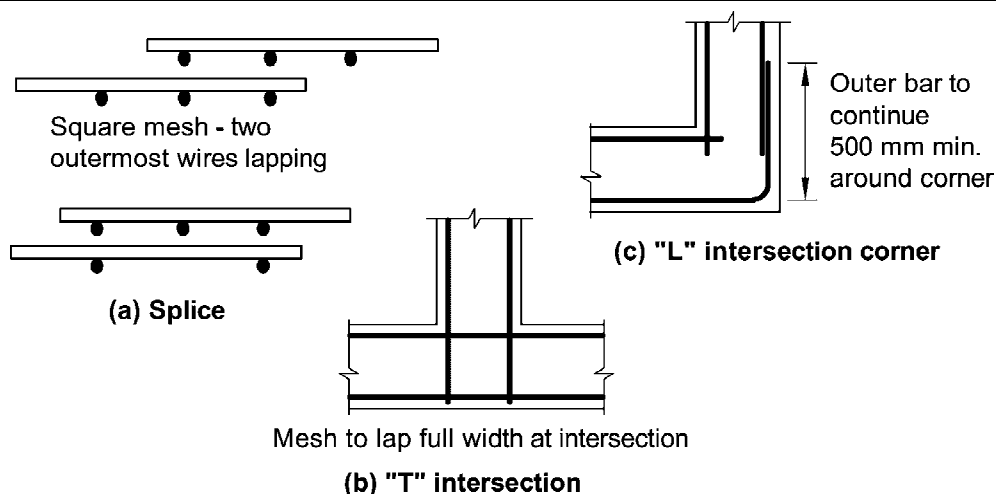


Table 3.2.3.2 ALTERNATIVE MESH/REINFORCING BAR SIZES

**Note:** Where necessary 2 layers of mesh may be used.

Trench mesh (TM)	Area — mm <sup>2</sup>	Reinforcing bar alternative	Trench mesh alternative
2-L8TM	91	2-N10 or 1-N12	not applicable
3-L8TM	136	2-N10 or 2-N12	not applicable
4-L8TM	182	2-N12	2-L11TM
5-L8TM	227	2-N12	3-L11TM
2-L11TM	180	1-N16 or 2-N12	2x2-L8TM
3-L11TM	270	3-N12	2x3-L8TM
4-L11TM	360	2-N16	2x4-L8TM
2-L12TM	222	2-N12	3-L11TM
3-L12TM	333	3-N12	4-L11TM
4-L12TM	444	4-N12	5-L11TM

**Notes:**

1. L11TM and L12TM may be replaced by RL1118 and RL1218 mesh respectively.
2. L11TM may be replaced by two layers of L8TM.

(d) Footings and slabs-on-ground must have concrete cover between the outermost edge of the reinforcement (including ligatures, tie wire etc.) and the surface of the concrete of not less than:

- (i) 40 mm to unprotected ground.
- (ii) 30 mm to a membrane in contact with the ground.



- (iii) 20 mm to an internal surface.
- (iv) 40 mm to external exposure.
- (e) Reinforcement must be cleaned of loose rust, mud, paints and oils immediately prior to the concrete pour.

**Explanatory information:**

In order to obtain a good bond between concrete and reinforcement, the reinforcement should be free of contamination by mud, paint, oils, etc. It is not necessary for the reinforcement to be completely free of rust. Some rusting is beneficial in promoting a good bond as it roughens the surface of the steel. Loose rust, however, must be removed from the reinforcement.

- (f) Reinforcement must be placed as follows:
  - (i) All reinforcement must be firmly fixed in place to prevent it moving during concreting operations.
  - (ii) Reinforcement must be supported off the ground or the forms by bar chairs made from wire, concrete or plastic.
  - (iii) When using wire chairs the minimum concrete cover (see [3.2.3.2\(d\)](#)) to the uncoated portion of the chair must be obtained.
  - (iv) Wire chairs on soft ground or plastic membrane must be placed on flat bases.
  - (v) Bar chairs must be spaced at not more than 800 mm centres for steel fabric.

**Explanatory information:**

Reinforcement is designed to be in a particular place so as to add strength or to control cracking of the concrete. A displacement from its intended location could make a significant difference to the life or serviceability of the structure.

Supports for fabric reinforcement are provided to prevent the fabric distorting when workers walk on top of it to place the concrete and maintain the correct concrete cover to the fabric.

## PART 3.2.4 SITE CLASSIFICATION

### 3.2.4.1 Site classification

The *foundation* where the footing is to be located must be classified in accordance with AS 2870.

#### Explanatory information:

**Table 3.2.4.1** provides a general description of *foundation* soil types that will assist in the classification of the *site*. More detailed information, including differentiation between classifications, can be found in AS 2870 or alternatively contact the *appropriate authority*.

Due to the limitations of this Part, if a *site* is classified as E or P then reference must be made to AS 2870 for design and construction information.

#### Explanatory information:

**Table 3.2.4.1 GENERAL DEFINITION OF SITE CLASSES**

Class	Foundation
<b>A</b>	Most sand and rock <i>sites</i> with little or no ground movement from moisture changes
<b>S</b>	Slightly reactive clay <i>sites</i> with only slight ground movement from moisture changes
<b>M</b>	Moderately reactive clay or silt <i>sites</i> which can experience moderate ground movement from moisture changes
<b>H</b>	Highly reactive clay <i>sites</i> which can experience high ground movement from moisture changes
<b>E</b>	Extremely reactive clay <i>sites</i> which can experience extreme ground movement from moisture changes
<b>A to P</b>	Filled <i>sites</i> — see AS 2870
<b>P</b>	<i>Sites</i> which include soft soils, such as soft clay or silt or loose sands; landslip; mine subsidence; collapsing soils; soils subject to erosion; reactive <i>sites</i> subject to abnormal moisture conditions or <i>sites</i> which cannot be classified otherwise

Note: For classes M, H and E further division based on the depth of the expected movement is *required*. For deep-seated movements, characteristic of dry climates and corresponding to a design depth of suction change  $H_s$ , equal to or greater than 3 m, the classification shall be M-D, H-D or E-D as appropriate. For example, H-D represents a highly reactive *site* with deep moisture changes, and H represents a highly reactive site with shallow moisture changes.

## PART 3.2.5 FOOTING AND SLAB CONSTRUCTION

### Explanatory information:

The footings included in this Part reflect the requirements of AS 2870 and apply to the most common types of soil conditions. If the soil conditions on [site](#) are not covered by this Part then additional guidance can be obtained from AS 2870 or the [appropriate authority](#).

These provisions are not meant to prohibit the use of alternative traditional footing methods found through experience to be suitable for local soil conditions (especially those used in stable soils). Such footings may be appropriate, provided they meet the relevant [Performance Requirements](#) listed in [Section 2](#).

The diagrams in this Part reflect acceptable footing designs only. They do not provide details for termite barriers such as the correct placement of ant capping and slab edge exposure.

For details on termite barriers see [Part 3.1.3](#).

### 3.2.5.1 Footing and slab construction

- (a) Footing and slab construction, including size and placement of reinforcement, must comply with the relevant provisions of this Part and the following details:
  - (i) Footings for stumps — the appropriate details in [3.2.5.6](#) and [Table 3.2.5.2](#).
  - (ii) Stiffened raft Class A, S, M, M-D, H and H-D [sites](#) — the appropriate details in [Figure 3.2.5.3\(a\)](#) and [Figure 3.2.5.3\(b\)](#).
  - (iii) Strip footing systems in Class A, S, M, M-D and H [sites](#) — the appropriate details in [Figure 3.2.5.4\(a\)](#) and [Figure 3.2.5.4\(b\)](#).
  - (iv) Footing slabs for Class A [sites](#) — the appropriate details in [Figure 3.2.5.5](#).
- (b) Footings for *single leaf masonry*, *mixed construction* and *earth wall masonry* must comply with the equivalent footing construction set out in [Table 3.2.5.1](#).

### 3.2.5.2 Footings and slabs to extensions to existing buildings

- (a) Footings to extensions to Class 1 or 10 buildings may be of similar proportions and details to those used with an existing same Class of building on the same allotment provided—
  - (i) masonry and masonry veneer walls are articulated at the junction with the existing building; and
  - (ii) the performance of the existing building has been satisfactory, i.e. there has been no significant cracking or movement (see Section 2 of AS 2870 for acceptable footing performance); and
  - (iii) there are no unusual moisture conditions on the [site](#).
- (b) Class 10 buildings of *clad framed* construction may use footing systems appropriate for one class of reactivity less severe than for a house.  
e.g.: Site classification M can be reduced to S.


Table 3.2.5.1 EQUIVALENT FOOTING CONSTRUCTION

Actual construction		Equivalent footing construction (see <a href="#">Figure 3.2.5.2 to 5</a> )
External walls	Internal walls	
<b>Single leaf masonry</b>		
Reinforced <i>single leaf masonry</i>	<i>Articulated masonry</i> on Class A and S <a href="#">sites</a> ; or framed	<i>Articulated masonry veneer</i>
Reinforced <i>single leaf masonry</i>	<i>Articulated masonry</i> or reinforced <i>single leaf masonry</i>	Masonry veneer
Articulated <i>single leaf masonry</i>	<i>Articulated masonry</i>	Articulated full masonry
<b>Mixed construction</b>		
Full masonry	Framed	Articulated full masonry
Articulated full masonry	Framed	Masonry veneer
<b>Earth wall masonry</b>		
Infill panels of earth masonry	Framed earth masonry	<i>Articulated masonry veneer</i>
<a href="#">Loadbearing</a> earth masonry	<a href="#">Loadbearing</a> earth masonry	Articulated full masonry

### 3.2.5.3 Shrinkage control

- (a) Where brittle floor coverings, such as ceramic tiles, are to be used over an area greater than 16 m<sup>2</sup>, one of the following additional measures must be taken to control the effect of shrinkage cracking—
- (i) the amount of shrinkage reinforcement (steel reinforcement mesh in the slab panel) must be—
    - (A) increased to SL92 or equivalent throughout the affected slab area; or
    - (B) doubled with an additional sheet of slab mesh throughout the affected slab area; or
  - (ii) the bedding system for brittle coverings must be selected on the basis of the expected slab movement and the characteristics of the floor covering (including the use of expansion joints etc.); or
  - (iii) the placement of floor covering must be delayed for not less than 3 months after the concrete has been poured.
- (b) At re-entrant or internal corners, two strips, minimum 2 m in length, of 3–L8TM or one strip of 3–L11TM (or 3–N12 bars) must be placed diagonally across the corner in accordance with [Figure 3.2.5.1](#).

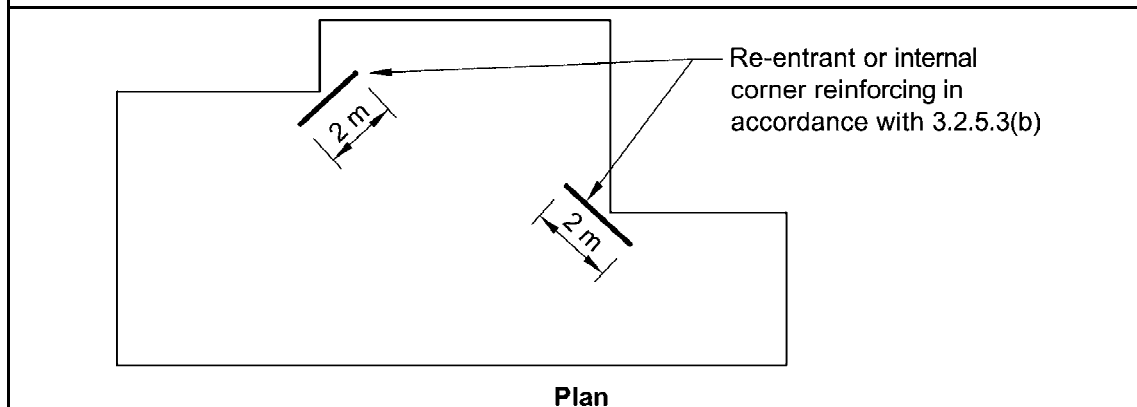Figure 3.2.5.1

**REINFORCING AT RE-ENTRANT CORNERS****3.2.5.4 Minimum edge beam dimensions**

Except for *waffle raft* slabs, where the edge rebate is more than 150 mm in depth, the width of the edge beam at the base of the rebate must not be less than 200 mm, except that if R10 or N10 ties at 900 mm spacing (or equivalent) are provided to resist vertical forces, the width of the edge beam at the base of the rebate can be reduced to 150 mm.

**3.2.5.5 Footings for fireplaces on Class A and S sites**

- (a) Fireplaces must be supported on a pad footing—
  - (i) 150 mm thick for single storey (one trafficable floor and a wall height not more than 4.2 m) construction; and
  - (ii) 200 mm thick for 2 storey (two trafficable floors and a wall height not more than 8 m) construction; and
  - (iii) reinforced top and bottom with SL72 mesh; and
  - (iv) extending 300 mm past the edges of the masonry except for any edge flush with the outer wall.
- (b) The pad footing may form an integral part of the slab.

**3.2.5.6 Stump footing details**

- (a) Footings for stumps must comply with—
  - (i) the provisions of [Table 3.2.5.2](#) for Class A and Class S [sites](#); or
  - (ii) the appropriate acceptable construction manual listed in—
    - (A) [Part 3.4.3](#); or
    - (B) [3.2.0](#).
- (b) Concrete stumps must—
  - (i) be designed in accordance with—
    - (A) AS 3600; or
    - (B) [Table 3.2.5.2](#); and


- (ii) use a minimum 20 MPa concrete as defined in AS 3600.
- (c) Steel stumps must be—
  - (i) designed in accordance with—
    - (A) AS 4100; or
    - (B) [Table 3.2.5.2](#); and
  - (ii) fully enclosed and sealed with a welded top plate; and
  - (iii) encased in concrete sloping away from the stump and finishing not less than 100 mm above *finished ground level*; and
  - (iv) corrosion protected in accordance with [Part 3.4.4](#).
- (d) Timber stumps must be designed in accordance with—
  - (i) AS 1684 Parts 2, 3 or 4; or
  - (ii) [Table 3.2.5.2](#).
- (e) Stumps must be braced—
  - (i) by a full perimeter masonry base; or
  - (ii) for concrete stumps — in accordance with AS 3600; or
  - (iii) for steel stumps — in accordance with AS 4100; or
  - (iv) for timber stumps — in accordance with AS 1684 Parts 2, 3 or 4.
- (f) Stumps must be embedded into the foundation material not less than 30% of their height above ground level or 450 mm, whichever is the greater.

**Table 3.2.5.2 STUMP FOOTING — IN AREAS WITH A DESIGN WIND SPEED OF NOT MORE THAN N2**

LENGTH OF STUMP (mm) (including embedded length)	CONCRETE		STEEL	TIMBER
	Minimum size (mm)	REINFORCEMENT Number of 5 mm (min.) hard drawn wires	Minimum size (mm) (SHS = square hollow section)	Minimum size (mm)
Less than 1400	100 × 100 or 110 diameter	1	75 × 75 × 2.0 SHS	100 × 100 or 110 diameter
1401–1800	100 × 100 or 110 diameter	2	75 × 75 × 2.0 SHS	100 × 100 or 110 diameter
1801–3000	125 × 125 or 140 diameter	2	75 × 75 × 2.0 SHS	100 × 100 or 110 diameter

Figure 3.2.5.2
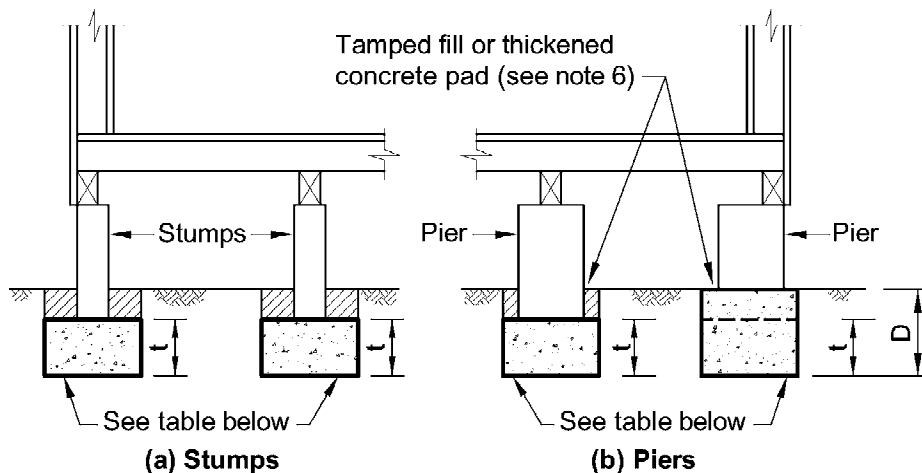
## PAD FOOTINGS FOR CLAD FRAME, CLASS A AND S SITES



## MINIMUM DIMENSIONS OF CIRCULAR AND SQUARE PAD FOOTINGS FOR CLAD FRAME CLASS A AND S SITES


Effective supported areas — m <sup>2</sup>	Width of square pad — mm	Width of circular pad — mm	Thickness (t) — mm	Depth — mm
10	400	500	200	400
20	500	600	200	400
30	600	750	250	400

## Notes:

- The effective area supported by a pad footing is the sum of—
  - the supported floor area; and
  - the supported roof area (if applicable); and
  - half the supported wall area in elevation (if applicable).
- The width or diameter can be reduced to one half the above footings on rock.
- The pad footings must be constructed in concrete except that masonry footings can be used under masonry piers.
- Pad footing sizes must also apply to footings supporting roof and floor loads only.
- The *foundation* must provide an allowable bearing pressure of not less than 100 kPa.
- The excavation must be backfilled with manually rodded tamped soil, or the footing thickness shall be increased by 50 mm.
- Where stump pad footings provide resistance to horizontal or uplift forces, the minimum size of the footing must comply with AS 2870.
- Braced stumps must comply with 3.2.5.6(e).

Figure 3.2.5.3(a)
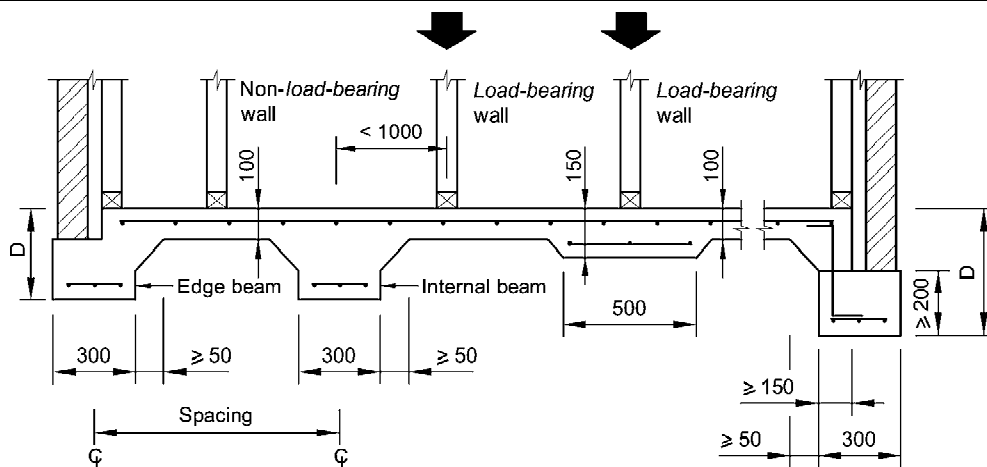
## FOOTING SLAB AND STIFFENED RAFT SLAB DETAILS FOR CLASS A AND S SITES



REINFORCEMENT FOR STIFFENED RAFT FOOTINGS					Slab Fabric		
Site Class	Type of Construction	Depth (D) mm	Bottom reinf.	Max. spacing c/l to c/l (m)	Slab length <18 m	Slab length <25 m	Slab length <30 m
Class A	Clad Frame	300	3–L8TM	–	SL72	SL82	SL92
	Articulated masonry veneer	300	3–L8TM	–	SL72	SL82	SL92
	Masonry veneer	300	3–L8TM	–	SL72	SL82	SL92
	Articulated full masonry	400	3–L8TM	–	SL72	SL82	SL92
	Full masonry	400	3–L8TM	–	SL72	SL82	SL92
Class S	Clad Frame	300	3–L8TM	–	SL72	SL82	SL92
	Articulated masonry veneer	300	3–L8TM	–	SL72	SL82	SL92
	Masonry veneer	300	3–L11TM	–	SL72	SL82	SL92
	Articulated full masonry	400	3–L11TM	–	SL72	SL82	SL92
	Full masonry	450	3–L11TM	5.0*	SL82	SL82	SL92

**Notes:**

1. Internal and external edge beams must be arranged to form an integral structural grid (see Clauses 5.3.8 and 5.3.9 of AS 2870).
2. A 10% increase in spacings is permitted where the spacing in the other direction is 20% less than that specified.
3. Where external beams are wider than 300 mm, an extra bottom bar or equivalent of the same bar size is required for each 100 mm additional width.




Figure 3.2.5.3(a)

**FOOTING SLAB AND STIFFENED RAFT SLAB DETAILS FOR CLASS A AND S SITES**

4. Where a reinforced *single leaf masonry* wall is constructed directly above and structurally connected to a concrete edge beam, the beam may be reduced to 300 mm wide by 300 mm deep and reinforced with 3–L8TM reinforcement.
5. Alternative reinforcement sizes must comply with AS 2870.
6. Internal beam details and spacings shall comply with **Figure 3.2.5.3(a)** or **(b)**. At a re-entrant corner where an external beam continues as an internal beam, the internal beam details shall be continued for a length of 1 m into the external beam.

\* See Note 2.

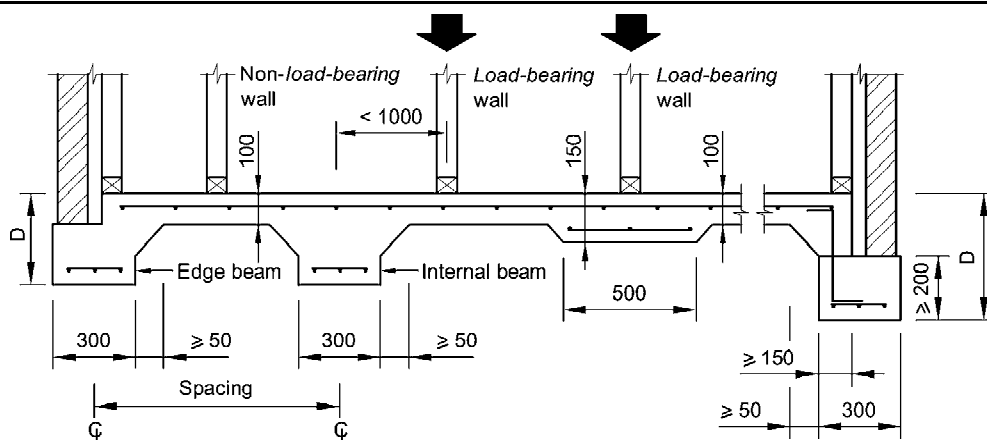Figure 3.2.5.3(b)

**FOOTING SLAB AND STIFFENED RAFT SLAB DETAILS FOR CLASS M, M-D, H AND H-D SITES****REINFORCEMENT FOR STIFFENED RAFT FOOTINGS****Slab Mesh**

Site Class	Type of Construction	Depth (D) mm	Bottom reinf.	Max. spacing c/l to c/l (m)	Slab length <18 m	Slab length <25 m	Slab length <30 m
Class M	Clad Frame	300	3–L11TM	6.0*	SL72	SL82	SL92
	Articulated masonry veneer	400	3–L11TM	6.0*	SL72	SL82	SL92
	Masonry veneer	400	3–L11TM	5.0*	SL72	SL82	SL92
	Articulated full masonry	500	3–L12TM	4.0	SL82	SL82	SL92
	Full masonry	800	3–N16	4.0	SL92	SL92	SL92

**Figure 3.2.5.3(b)****FOOTING SLAB AND STIFFENED RAFT SLAB DETAILS FOR CLASS M, M-D, H AND H-D SITES**

Class M-D	Clad Frame	400	3-L11TM	5.0*	SL72	SL82	SL92
	Articulated masonry veneer	400	3-L11TM	4.0	SL72	SL82	SL92
	Masonry veneer	500	3-L12TM	4.0	SL82	SL82	SL92
	Articulated full masonry	625	3-L12TM	4.0	SL92	SL92	SL92
	Full masonry	–	–	–	–	–	–
Class H	Clad Frame	400	3-L11TM	5.0*	SL72	SL82	SL92
	Articulated masonry veneer	500	3-L12TM	4.0	SL82	SL82	SL92
	Masonry veneer	700	3-N16	4.0	SL92	SL92	SL92
	Articulated full masonry	1000	4-N16	4.0	SL102	SL102	SL102
	Full masonry	–	–	–	–	–	–
Class H-D	Clad Frame	500	3-L11TM	4.0	SL82	SL82	SL92
	Articulated masonry veneer	600	3-L12TM	4.0	SL92	SL92	SL92
	Masonry veneer	–	–	–	–	–	–
	Articulated full masonry	1200	4-N16	4.0	SL102	SL102	SL102
	Full masonry	–	–	–	–	–	–


**Notes:**

1. Internal and external edge beams must be arranged to form an integral structural grid (see Clauses 5.3.8 and 5.3.9 of AS 2870).
2. A 10% increase in spacings is permitted where the spacing in the other direction is 20% less than that specified.
3. Where external beams are wider than 300 mm, an extra bottom bar or equivalent of the same bar size is required for each 100 mm additional width.
4. Where a reinforced *single leaf masonry* wall is constructed directly above and structurally connected to a concrete edge beam, the beam may be reduced to 300 mm wide by 300 mm deep and reinforced with 3-L8TM reinforcement.
5. Alternative reinforcement sizes must comply with AS 2870.

**Figure 3.2.5.3(b)****FOOTING SLAB AND STIFFENED RAFT SLAB DETAILS FOR CLASS M, M-D, H AND H-D SITES**

6. Internal beam details and spacings shall comply with [Figure 3.2.5.3\(b\)](#). At a re-entrant corner where an external beam continues as an internal beam, the internal beam details shall be continued for a length of 1 m into the external beam.

\* See Note 2.

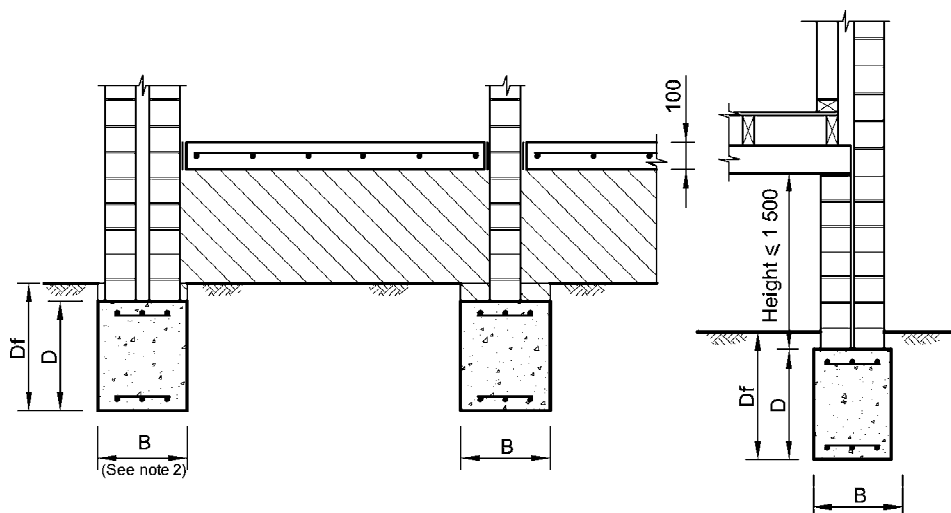**Figure 3.2.5.4(a)****STRIP FOOTING SYSTEMS IN CLASS A AND S SITES****DIMENSIONS AND REINFORCEMENT FOR STRIP FOOTING SYSTEMS**


Site Class	Type of construction	D	B	Reinforcement (top and bottom)
Class A	Clad frame	300	300	3–L8TM
	Articulated masonry veneer	300	300	3–L8TM
	Masonry veneer	300	300	3–L8TM
	Articulated full masonry	300	400	4–L8TM
	Full masonry	300	400	4–L8TM
Class S	Clad frame	400	300	3–L8TM
	Articulated masonry veneer	400	300	3–L8TM
	Masonry veneer	400	300	3–L8TM
	Articulated full masonry	400	400	4–L11TM
	Full masonry	500	400	4–L11TM

**Notes:**

1. All masonry walls must be supported on strip footings.

**Figure 3.2.5.4(a)****STRIP FOOTING SYSTEMS IN CLASS A AND S SITES**

2. Internal strip footings shall be of the same proportions as the external footings and run from external footing to external footing. "Side slip joints" consisting of a double layer of polyethylene shall be provided at the sides of the footing only.
3. Infill floors may be concrete slabs, brick paving, stone flags or compacted and stabilised earth. For concrete slab infill panels, mesh may be required to control shrinkage in slab panels and around openings or restrained regions. Concrete infill slabs must use a minimum of SL62 mesh to control shrinkage (see also [Clause 3.2.5.3](#)).
4. Where footings are wider than the specified width, an extra bottom bar or equivalent of the same bar size is required for each 100 mm additional width. If strip footings deeper than those required are used, the reinforcement shall be increased to match that specified for the deepened proportions.
5. The measurement of  $D_f$  is greater or equal to  $D$  plus 75 mm.
6. Alternative reinforcing sizes must comply with AS 2870.

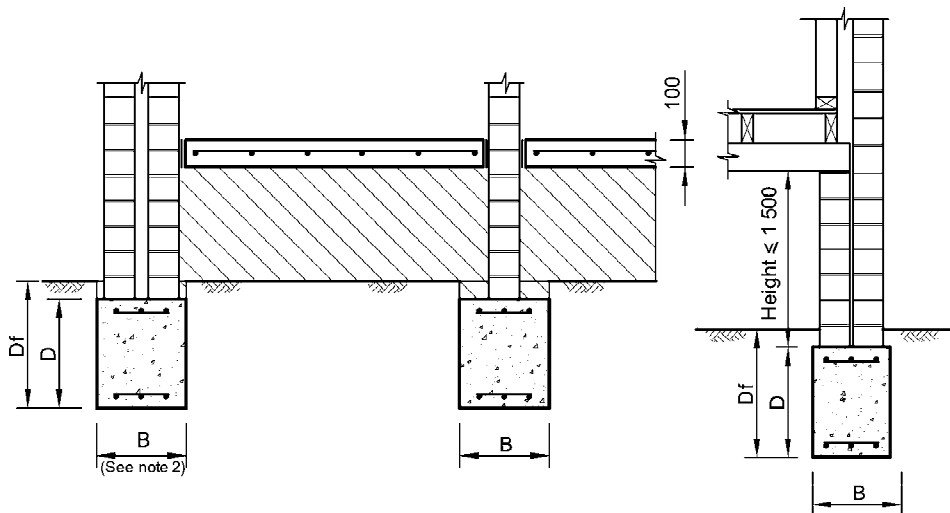**Figure 3.2.5.4(b)****STRIP FOOTING SYSTEMS IN CLASS M, M-D AND H SITES****DIMENSIONS AND REINFORCEMENT FOR STRIP FOOTING SYSTEMS**

Site Class	Type of construction	D	B	Reinforcement (top and bottom)
Class M	Clad frame	400	300	3-L11TM
	Articulated masonry veneer	450	300	3-L11TM
	Masonry veneer	500	300	3-L12TM
	Articulated full masonry	600	400	4-L12TM
	Full masonry	900*	400	4-L12TM

**Figure 3.2.5.4(b)****STRIP FOOTING SYSTEMS IN CLASS M, M-D AND H SITES**

Class M-D	Clad frame	500	300	3–L11TM
	Articulated masonry veneer	550	300	3–L12TM
	Masonry veneer	700*	300	3–N16
	Articulated full masonry	1100*	400	4–N16
Class H	Clad frame	500	300	3–L11TM
	Articulated masonry veneer	600	300	3–L12TM
	Masonry veneer	850*	300	3–N16
	Articulated full masonry	1100*	400	4–N16

**Notes:**


1. All masonry walls must be supported on strip footings.
2. For beams 700 mm or deeper, as specified in the table above, internal footings shall be provided at no more than 6 m centres and at re-entrant corners to continue footings to the opposite external footing. Internal strip footings shall be of the same proportions as the external footings and run from external footing to external footing. "Side slip joints" consisting of a double layer of polyethylene shall be provided at the sides of the footing only.
3. Infill floors shall only be used for Class A and S sites.
4. Where footings are wider than the specified width, an extra bottom bar or equivalent of the same bar size is required for each 100 mm additional width. If strip footings deeper than those required are used, the reinforcement shall be increased to match that specified for the deepened proportions.
5. The measurement of  $D_f$  is greater or equal to  $D$  plus 75 mm.
6. Alternative reinforcing sizes must comply with AS 2870.
7. For Class M articulated full masonry and full masonry, internal strip footings must be of the same proportions as the external footing and run from external footing to external footing.
8. For site Classes M-D and H, a provision shall be made by methods such as an adequate crawl space to allow for future re-levelling due to drying effects.

\* See Note 2.

Figure 3.2.5.5

## FOOTING SLABS FOR CLASS A SITES SUITABLE FOR:

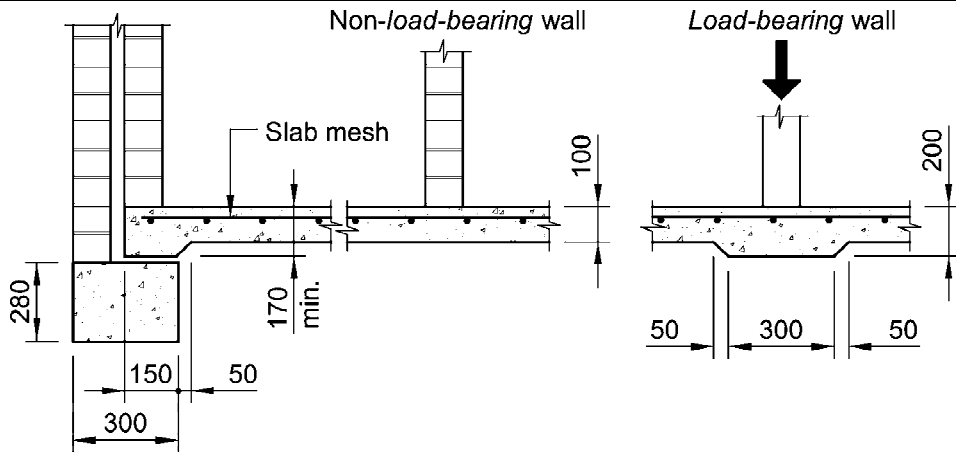- (a) CLAD FRAME.
- (b) ARTICULATED MASONRY VENEER.
- (c) MASONRY VENEER.
- (d) ARTICULATED FULL MASONRY.
- (e) FULL MASONRY.



## Notes:

1. Use SL63 when slab length is less than 12 m.
2. Use SL62 when slab length is less than 18 m.
3. Use SL72 when slab length is less than 25 m.
4. Use SL82 when slab length is less than 30 m.
5. In parts of Western Australia (around Perth) and other locations where the [site](#) consists of extremely stable sands, and where specified by a [professional engineer](#), the slab thickness may be reduced to 85 mm and reinforced as follows:
  - (a) Use SL53 when slab length is less than or equal to 12 m.
  - (b) Use SL63 when slab length is less than or equal to 18 m.
  - (c) Use SL62 when slab length is less than or equal to 25 m.
6. Dune sands may require compaction.

# PART 3.3

---

## MASONRY

### 3.3 Definitions

#### 3.3.1 Unreinforced Masonry

#### 3.3.2 Reinforced Masonry

#### 3.3.3 Masonry Accessories

#### 3.3.4 Weatherproofing of Masonry

#### 3.3.5 Earthwall Construction

## PART 3.3 CONTENTS

### PART 3.3 MASONRY

#### **3.3 Definitions**

##### **3.3.1 Unreinforced Masonry**

- 3.3.1.0 Acceptable construction manual
- 3.3.1.1 Application
- 3.3.1.2 External walls
- 3.3.1.3 Internal walls
- 3.3.1.4 Isolated piers
- 3.3.1.5 Masonry units
- 3.3.1.6 Mortar mixes
- 3.3.1.7 Mortar joints
- 3.3.1.8 Vertical articulation joints
- 3.3.1.9 Sub-floor ventilation
- 3.3.1.10 Shrinkage allowance for timber framing

##### **3.3.2 Reinforced Masonry**

- 3.3.2.0 Acceptable construction manual
- 3.3.2.1 Application
- 3.3.2.2 External wall construction

##### **3.3.3 Masonry Accessories**

- 3.3.3.0 Acceptable construction manual
- 3.3.3.1 Application
- 3.3.3.2 Wall ties
- 3.3.3.3 Fixing straps and tie-down systems
- 3.3.3.4 Lintels

##### **3.3.4 Weatherproofing of Masonry**

- 3.3.4 Application of this Part
- 3.3.4.0 Acceptable construction manual
- 3.3.4.1 Application
- 3.3.4.2 Width of cavity
- 3.3.4.3 Cavity ventilation and drainage
- 3.3.4.4 Damp-proof courses — materials
- 3.3.4.5 Damp-proof courses — installation
- 3.3.4.6 Flashings
- 3.3.4.7 Location of flashings
- 3.3.4.8 Flashings at the base of cavity walls
- 3.3.4.9 Sill and head flashing
- 3.3.4.10 Flashings at a roof abutting a wall
- 3.3.4.11 Chimney flashings
- 3.3.4.12 Weatherproofing for single skin masonry walls



**3.3.5 Earthwall Construction**

---

**Definitions****3.3**

The following definitions are used in this Part:

**Bond beam** means a reinforced concrete or masonry member which acts as a lintel or stiffening beam to the masonry.

**Engaged pier** means a pier bonded to a masonry wall by course bonding of masonry units or by masonry ties.

**Lateral support** means a support (including footing, buttress, cross wall, beam, floor or braced roof structure) that effectively restrains the wall or pier at right angles to the face of the wall or pier.

**Perpend** means a vertical joint between adjacent masonry units.

**Reinforced masonry** means masonry reinforced with steel reinforcement that is placed in a bed joint or grouted into a core to strengthen the masonry.

**Unreinforced masonry** means masonry that is not reinforced.

## PART 3.3.1 UNREINFORCED MASONRY

### Appropriate *Performance Requirements*

Where an alternative masonry walling system is proposed as an *Alternative Solution* to that described in **Part 3.3.1**, that proposal must comply with—

- (a) *Performance Requirement P2.1*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### A. Acceptable construction manual

#### 3.3.1.0

*Performance Requirement P2.1* is satisfied for *unreinforced masonry* (including masonry-veneer) if it is designed and constructed in accordance with AS 3700 Masonry structures.

#### Explanatory information:

Composite construction: Design requirements for other materials that may be used in combination with masonry ie heavy steel support beams etc. are described in **Part 3.11** — Structural design.

### B. Acceptable construction practice

#### 3.3.1.1 Application

Compliance with this Part satisfies *Performance Requirement P2.1* for *unreinforced masonry*, provided—

- (a) the *unreinforced masonry* is constructed on footings that comply with **Part 3.2**; and
- (b) the building is located in an area with a *design wind speed* of not more than N3; and
- (c) for earthquake design, the building is defined as a design category H1 or H2 domestic structure in accordance with AS 1170.4 (1993); and

#### Explanatory information:

1. This covers all *sites* except those identified by the site investigation as having soft soil (having a soil profile with more than 5 m of soft clay, loose sand, silt or uncontrolled fill) as defined by AS 1170.4 (1993).
2. For earthquake design H3, see AS 3700.

- (d) the building is not constructed in an *alpine area*; and
- (e) masonry accessories, including wall ties and lintels are installed in accordance with **Part 3.3.3**.

### 3.3.1.2 External walls

- (a) Masonry veneer must comply with the relevant provisions of this Part and be constructed as follows:
  - (i) Bracing requirements — masonry veneer *external walls* must be tied to a *loadbearing* frame constructed in accordance with **Part 3.4**.
  - (ii) Masonry veneer walls, non-*loadbearing*, must be constructed with a leaf of masonry not less than 90 mm wide.
- (b) *Cavity* masonry and solid masonry walls must comply with the relevant provisions of this Part and be constructed as follows:
  - (i) The height of the wall between *lateral supports* (floor or roof) must be not more than 3 m with the exception of a gable where the height to the ridge from a floor which serves as lateral support may be not more than 5 m (refer to **Figure 3.3.1.1**).
  - (ii) Masonry cross walls must be—
    - (A) not less than 2 m in length at not more than 9 m centres; and
    - (B) connected directly or by a floor or ceiling diaphragm to the wall being supported.
- (c) *Cavity* walls must be constructed of two leaves, with each leaf not less than 90 mm wide.


#### Explanatory information:

For minimum *cavity* widths for veneer and *cavity* masonry, see **3.3.4.2**

**Figure 3.3.1.1**

#### HEIGHT RESTRICTIONS FOR MASONRY WALLS INCLUDING GABLE ROOF

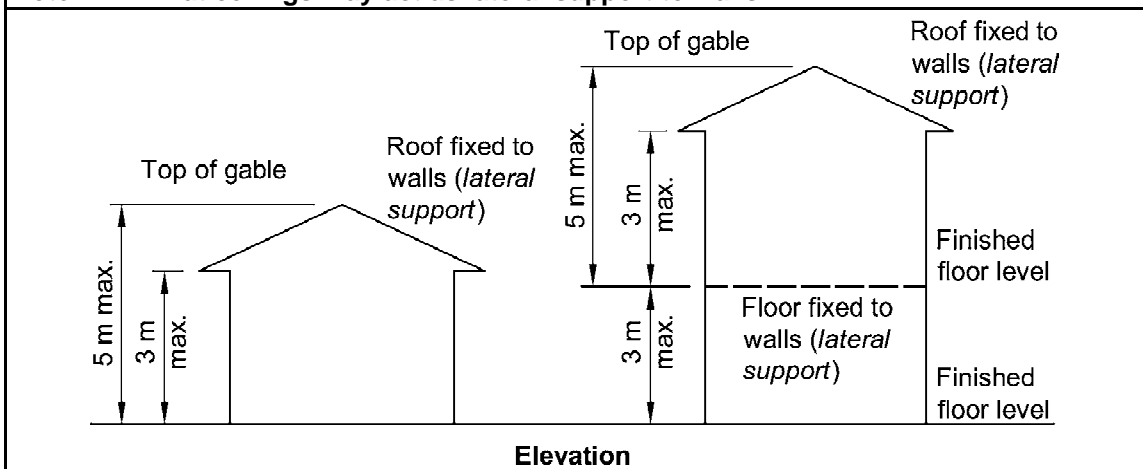**Note:** Flat ceilings may act as lateral support to walls.




- (d) Unreinforced single leaf walls with *engaged piers* and return walls must comply with the relevant provisions of this Part and be constructed in accordance with the following:

- (i) The adjoining roof structure must be—
  - (A) connected to the *engaged piers*, (see **Figure 3.3.1.2**); or
  - (B) fixed to, or within 300 mm, of the return supports (see **Figure 3.3.1.3**).
- (ii) Stack bonded piers must have wall ties at every fourth course.
- (iii) Pier and return supports size limitations:
  - (A) Single-leaf *unreinforced masonry* walls with *engaged piers* must comply with **Figure 3.3.1.2**.
  - (B) Single-leaf *unreinforced masonry* walls with return supports must comply with **Figure 3.3.1.3**.
- (iv) There must not be more than one opening per wall panel, and any opening must not be more than 900 mm high × 600 mm wide (see **Figure 3.3.1.3**).
- (v) An *engaged pier* or return wall, must be provided at both sides of a door or full height window opening (see **Figure 3.3.1.2**).
- (vi) Articulation joints must be located within 300 mm of vertical supports (see **3.3.1.8**).

**Figure 3.3.1.2****PIERS IN EXTERNAL SINGLE LEAF WALLS (not more than N3)**

**Note:** Piers are not *required* for 140 mm and 190 mm walls provided the roof structure is fixed to the walls at not more than 3.5 m centres to provide *lateral support* to the top of the walls.

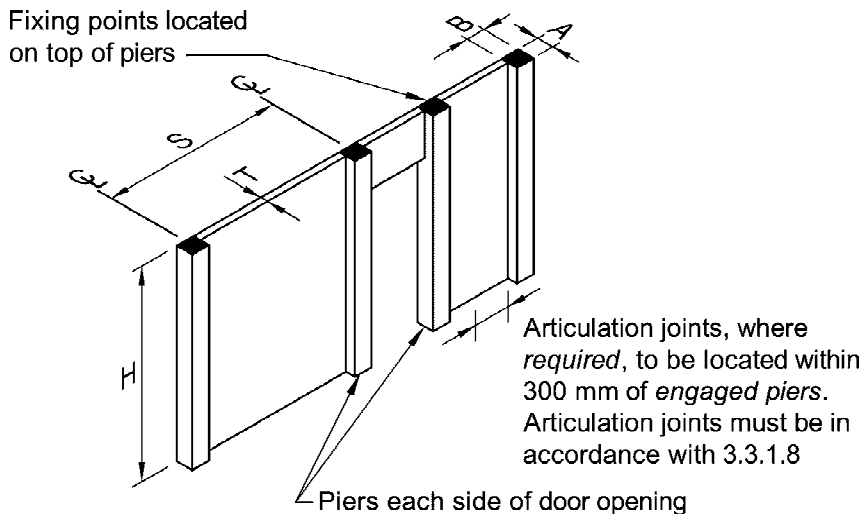

**Figure 3.3.1.2****PIERS IN EXTERNAL SINGLE LEAF WALLS (not more than N3)****Table a.** (Dimensions in mm)

Thickness of wall (min.)		T	90	110	140	190
Pier size (min.)	Not more than N2	AxB	290x190	350x230	–	–
	Not more than N3	AxB	290x290*	350x350*	–	–
Spacing of piers (max.)		S	1650	1800	–	–
Height (max.)		H	2400	2700	2400	2700
* Piers in areas with a design wind speed of more than N2 must be vertically reinforced with at least 1/Y12, tied to the footing.						


- (e) A Class 10a building containing not more than 1 storey may be enclosed with masonry *external walls* not less than 110 mm in thickness, provided that—
- (i) the building measured in the direction of the span of the roof is not more than 9 m and the height is not more than 3 m; and
  - (ii) piers are formed that are not less than 230 mm wide, project not less than 120 mm and are spaced at not more than 3 m centres; and
  - (iii) the roof does not place any thrust onto the *external walls*; and
  - (iv) cross walls are constructed at not more than 9 m centres; and
  - (v) the Class 10a building is located in an area with a *design wind speed* of not more than N2; and
  - (vi) the building is a design category H1 domestic structure in accordance with AS 1170.4 (1993).

**STATE AND TERRITORY VARIATIONS****3.3.1.2(e) does not apply in NSW.**

**Figure 3.3.1.3****RETURN SUPPORTS LIMITATIONS FOR EXTERNAL SINGLE-LEAF WALLS (for earthquake design category H1)**

**Note:** Return supports are not *required* for 140 mm and 190 mm walls provided the roof structure is fixed at not more than 3.5 m centres to provide *lateral support* to the top of the walls.

Fixing points and articulation joints, where *required*, to be located within 300 mm of return walls. Articulation joints must be in accordance with 3.3.1.8

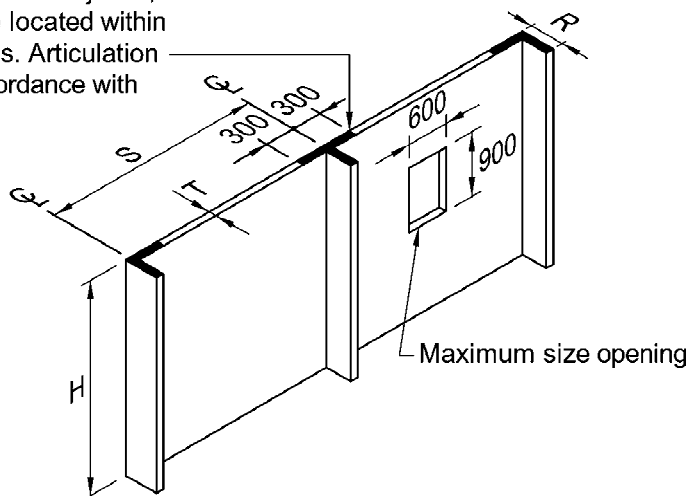**Table a.** (Dimensions in mm)

Thickness of wall (min.)	T	90	110	140	190
Return length (min.)	R	450	450	—	—
Spacing of returns (max.)	S	3000 (N2) 2500 (N3)	3700 (N2) 3000 (N3)	—	—
Height (max.)	H	2400	2400	2400	2700

**3.3.1.3 Internal walls**

Internal masonry walls must comply with the relevant provisions of this Part and be constructed as follows:


- (a) Internal masonry walls must be not less than 75 mm thick.
- (b) Where wall junctions occur they must be bonded or an articulation joint provided in accordance with 3.3.1.8.
- (c) Single leaf internal walls must be supported by either—
  - (i) the ceiling structure in accordance with Figure 3.3.1.4(a); or
  - (ii) return walls in accordance with Figure 3.3.1.4(b). A full height door frame or stud fastened at the ceiling framing and tied to the wall at 300 mm centres can be considered equivalent to a return wall.

Figure 3.3.1.4

## SUPPORT FOR INTERNAL WALLS (Dimensions in mm)


Diagram a.

## Supported by ceiling structure

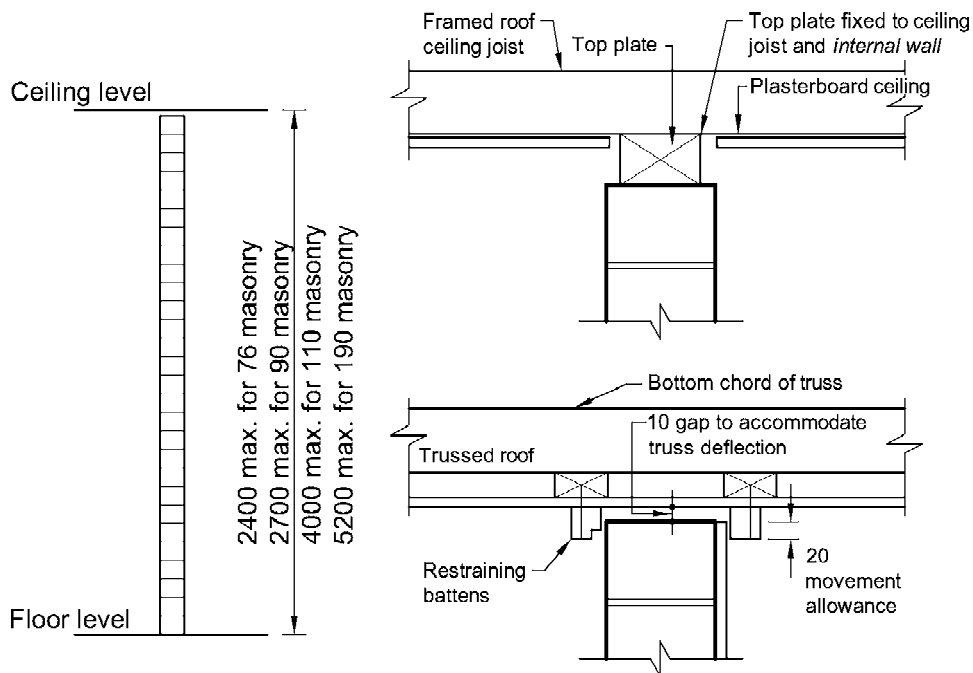

**Figure 3.3.1.4****SUPPORT FOR INTERNAL WALLS** (Dimensions in mm)**Diagram b.** Supported by return walls**Notes:**

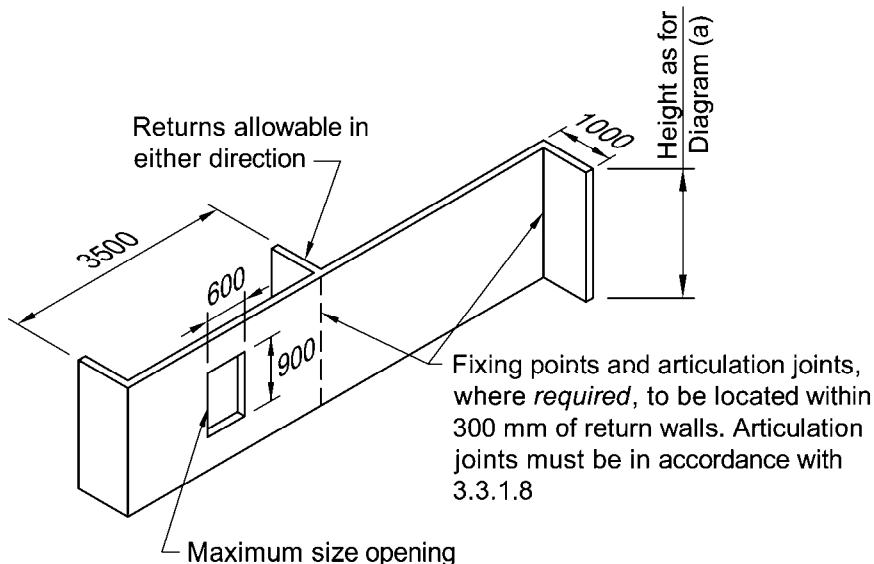1. An opening of not more than 600x900 mm is allowed to internal walls; and
2. The maximum allowable height for the wall is described in Diagram a.

**3.3.1.4 Isolated piers**

- (a) Isolated masonry piers supporting carports, verandahs, porches and similar roof structures, which form part of the main roof, or are attached to a wall of a Class 1 building must be not less than 290x290 mm and—
  - (i) must be not more than 2.7 m high (see [Figure 3.3.1.5](#)); and
  - (ii) must be spaced at not more than 3 m centres (see [Figure 3.3.1.5](#)); and
  - (iii) must comply with the relevant parts of (b), (c) or (d); and
  - (iv) may also support a roller door.
- (b) Isolated piers supporting tiled roofs  
 Isolated piers supporting tiled roofs must have a built-in 32x0.8 mm galvanised steel strap fixed to the roof structure and looped around a 10 mm diameter galvanised steel rod built into the pier not less than six courses below the top of the pier.
- (c) Isolated piers supporting sheet roofs must have—
  - (i) a built-in 32x0.8 mm galvanised steel strap fixed to the roof structure and extending the full height of the pier which is looped around a 10 mm diameter galvanised steel rod cast into the footing when poured; or



- (ii) a 10 mm diameter galvanised steel rod cast into the footing, threaded at the top and extending the full height of the pier.
- (d) Piers for a free standing carport must—
  - (i) be not less than 290×290 mm with the central core filled with 20 MPa concrete, or an exposure class mortar (see [Table 3.3.1.2](#)) complying with [3.3.1.6](#); and
  - (ii) have the core reinforced with one Y12 steel reinforcing rod cast into the footing and extending the full height of the pier to connect to the roof structure.
- (e) Sub-floor isolated piers must comply with [Figure 3.3.1.6](#).


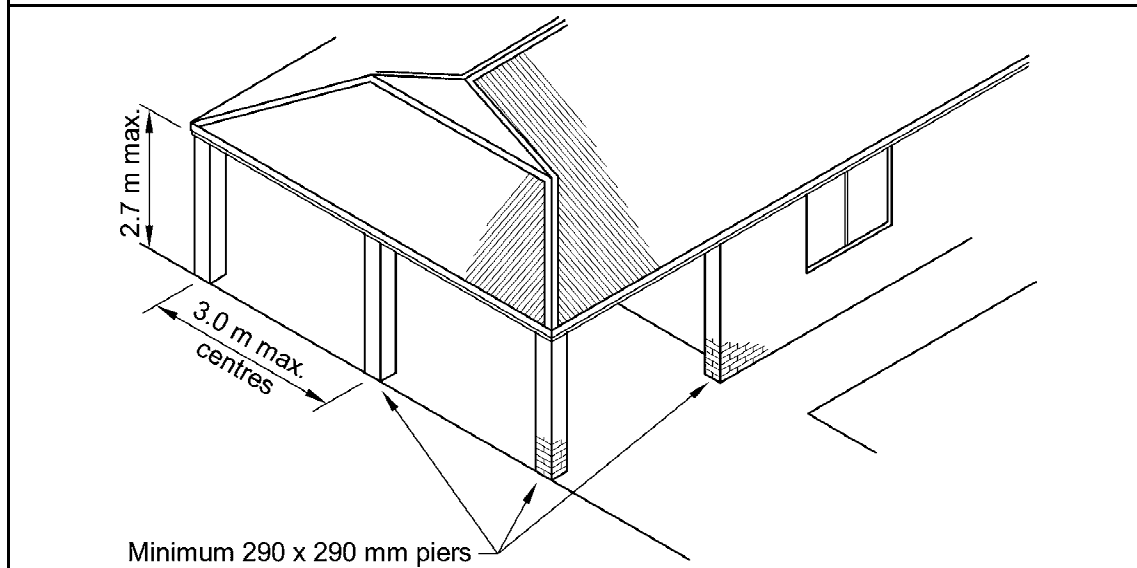
**Figure 3.3.1.5****ISOLATED PIERS UNDER MAIN ROOF**

Figure 3.3.1.6

## SUB-FLOOR ISOLATED PIERS — MAXIMUM HEIGHTS

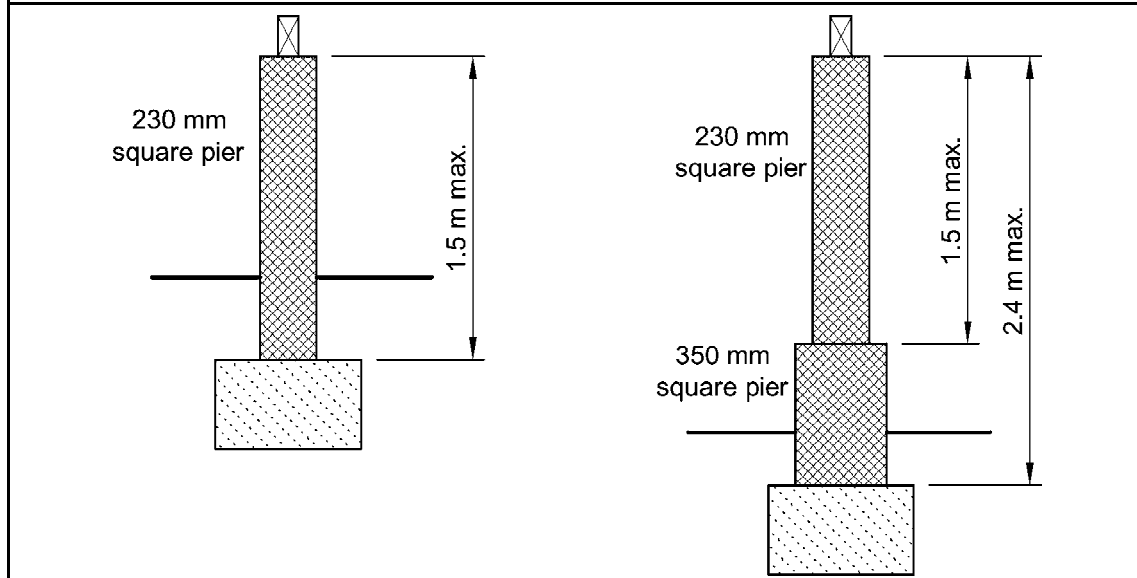

## 3.3.1.5 Masonry units

- (a) Mixing of clay with concrete or calcium silicate masonry panels for walling is not permitted; unless—
  - (i) at vertical junctions, a control joint is installed; and
  - (ii) at horizontal junctions, a slip joint using a membrane similar to that used for *damp-proof courses* is installed between the panels of the two different materials.
- (b) Masonry units must be classified and used in the exposure conditions appropriate to their classification as described in **Table 3.3.1.1**.

Table 3.3.1.1 EXPOSURE CONDITIONS

CLASSIFICATION	APPLICATION
<b>Protected (PRO)</b>	Suitable for use above <i>damp-proof course</i> provided they are protected at the top of the wall by appropriate roofs, eaves, copings or toppings in— <ul style="list-style-type: none"> <li>(a) internal walls; and</li> <li>(b) coated or rendered <i>external walls</i></li> </ul>
<b>General purpose (GP)</b>	Suitable for all uses except exposure class

Table 3.3.1.1 EXPOSURE CONDITIONS—continued

CLASSIFICATION	APPLICATION
Exposure Class (EXP)	<p>Suitable for use in all classifications including severe local conditions such as:</p> <ul style="list-style-type: none"> <li>(a) Below the <i>damp-proof course</i> in areas where walls are expected to be attacked by salts in the ground water or brickwork itself (salt attack or salt damp).</li> <li>(b) On sea fronts where walls are exposed to attack from salt spray, or in heavily polluted areas subject to deposition of atmospheric pollution (further protection may be required in severe environments).</li> <li>(c) In retaining walls.</li> <li>(d) Under regular cyclic freeze and thaw conditions.</li> </ul>

### 3.3.1.6 Mortar mixes

Mortar used for masonry construction must comply with AS 3700 except that the mortar may be mixed by volume in the proportions stated in [Table 3.3.1.2](#).

Table 3.3.1.2 MORTAR MIXES

<b>Note:</b> Additives may be used provided they comply with the appropriate specified rate.		
BRICK CLASSIFICATION (as per <a href="#">Table 3.3.1.1</a> )	MORTAR MIXED BY VOLUME Cement: Lime: Sand	
	General use	Suitable for concrete masonry — requires the use of methyl cellulose water thickener
<b>Protected</b>	1:2:9	1:0:5
<b>General purpose</b>	1:1:6	1:0:5
<b>Exposure class</b>	1:0.5:4.5	1:0:4


### 3.3.1.7 Mortar joints

- (a) Unless otherwise specified masonry bed and *perpend* joints are to be a nominal 10 mm.
- (b) Where raked joints are used they must not be—
  - (i) deeper than 10 mm; or
  - (ii) used in saline environments or areas subject to heavy industrial air-borne pollution.

### 3.3.1.8 Vertical articulation joints

- (a) Vertical articulation joints must be provided in *unreinforced masonry* walls except walls built where the *site* soil classification is A or S (see [Part 3.2.4](#)).

- (b) Articulation joints between masonry elements must have a width not less than 10 mm and be provided (see **Figures 3.3.1.7** and **3.3.1.8**)—
- (i) in straight, continuous walls having no openings, at not more than 6 m centres and not closer than the height of the wall away from corners; and
  - (ii) where the height of the wall changes by more than 20%, at the position of change in height; and
  - (iii) where openings more than 900×900 mm occur, at not more than 5 m centres, and positioned in line with one edge of the opening; and
  - (iv) where walls change in thickness; and
  - (v) at control or construction joints in footing slabs; and
  - (vi) at junctions of walls constructed of different masonry materials; and
  - (vii) at deep chases (rebates) for service pipes.

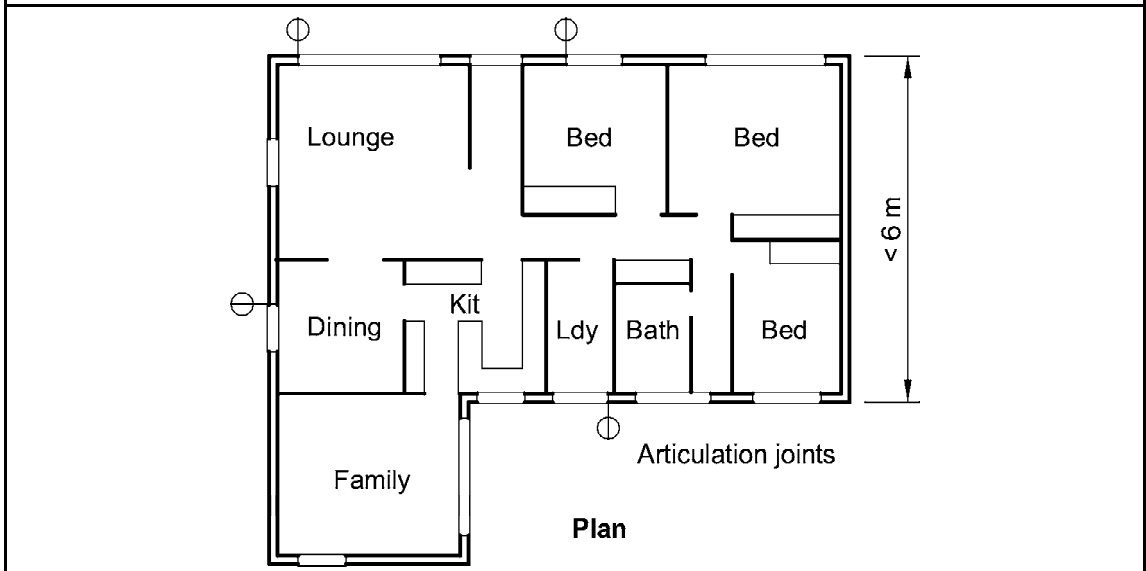**Figure 3.3.1.7****TYPICAL VERTICAL ARTICULATION JOINT LOCATIONS**


- (c) For all articulation joints in *cavity* walls, extendable masonry anchors must be built in at every fourth course (see **Figure 3.3.1.9**). For veneer construction the extendable ties may be omitted.
- (d) For single leaf masonry walls stabilised by return walls, or *engaged piers*, any articulation joints must be within 300 mm of the vertical support (see **Figures 3.3.1.3**, and **3.3.1.4(b)**).
- (e) Where masonry is *required* to be waterproof all joints must be sealed with a flexible, compressible material (see **Figure 3.3.1.9**).
- (f) Articulation joints must not be constructed adjacent to arched openings.
- (g) Articulation joints must not be located in *unreinforced masonry* above garage door openings or the like unless the panel of masonry is laterally supported with masonry ties or other suitable means.




**Explanatory information: Design for other masonry wall types**

The above design criteria are typical for clay masonry construction. Alternative designs may be appropriate and consideration should be given to a number of important factors to achieve an effective system, including—

- (a) expected soil movement — based on soil engineer's report; and
- (b) expected masonry unit growth — based on manufacturer's specifications; and
- (c) construction of wall ie openings, length of wall, height.

For more detailed requirements of articulation joints, refer to the Cement Concrete and Aggregates Australia — Technical Note 61.

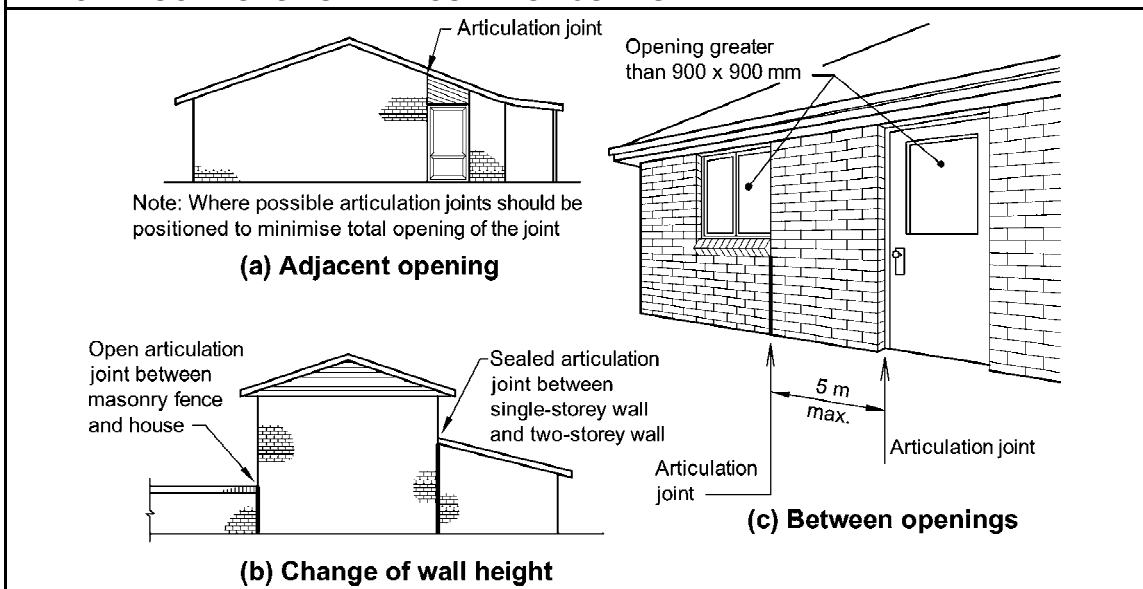**Figure 3.3.1.8****TYPICAL LOCATIONS FOR ARTICULATION JOINTS**

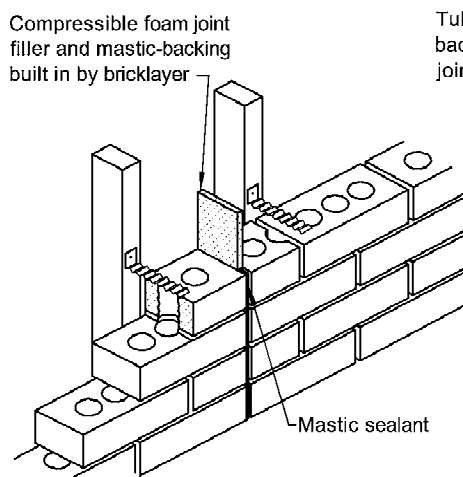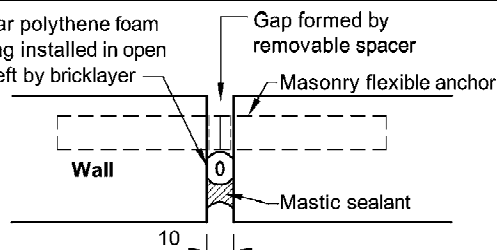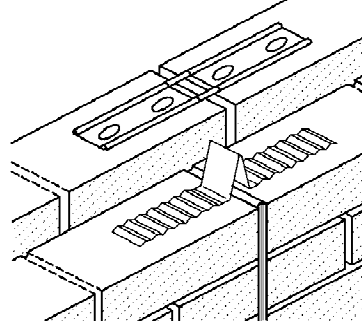**Figure 3.3.1.9****VERTICAL ARTICULATION JOINT DETAILS****(a) Single skin masonry****(b) Alternative joint detail****(c) Cavity wall extendible anchors****3.3.1.9 Sub-floor ventilation**

Ventilation under suspended floors must be in accordance with [Part 3.4.1](#).

**3.3.1.10 Shrinkage allowance for timber framing**

- (a) In masonry veneer walls a gap must be left between the timber frame and the top of the masonry wall, including [window](#) sills etc., to allow for settlement of the timber framing caused by timber shrinkage. These clearances must be not less than—
- (i) 5 mm at sills or lower and single storey [windows](#); and
  - (ii) 8 mm at roof overhangs of single storey buildings; and
  - (iii) 10 mm at sills of second storey [windows](#); and
  - (iv) 12 mm at roof overhangs to two storey buildings.
- (b) The clearances described in (a) must be doubled if the timber framing is unseasoned hardwood.

## PART 3.3.2 REINFORCED MASONRY

### Appropriate *Performance Requirements*

Where an alternative *reinforced masonry* system is proposed as an *Alternative Solution* to that described in **Part 3.3.2**, that proposal must comply with—

- (a) *Performance Requirement P2.1*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### A. Acceptable construction manual

#### 3.3.2.0

*Performance Requirement P2.1* is satisfied for *reinforced masonry* if it is designed and constructed in accordance with AS 3700 Masonry Structures.

#### Explanatory information:

Design requirements for other materials that may be used in combination with masonry (heavy steel support beams etc.) are described in **Part 3.11** — Structural design.

### B. Acceptable construction practice

#### 3.3.2.1 Application

Compliance with this acceptable construction practice satisfies *Performance Requirement P2.1* for *reinforced masonry*, provided—

- (a) the *reinforced masonry* is constructed on footings that comply with **Part 3.2**; and
- (b) the building is located in an area with a *design wind speed* of not more than N3; and

#### Explanatory information:

1. Information on *design wind speeds* for particular areas may be obtained from the *appropriate authority*.
  2. Masonry walls in an area with a *design wind speed* of more than N3 should be designed in accordance with AS 3700 or **Part 3.10.1**.
- (c) for earthquake design, the building is defined as a design category H1 or H2 domestic structure in accordance with AS 1170.4 (1993); and

**Explanatory information:**

1. This covers all [sites](#) except those identified by the [site](#) investigation as having soft soil (having a soil profile with more than 5 m of soft clay, loose sand, silt or uncontrolled fill) as defined by AS 1170.4 (1993).
2. For earthquake design H3, see AS 3700.

- (d) the building is not constructed in an [alpine area](#).

**3.3.2.2 External wall construction**


[Reinforced masonry external walls](#) must consist of masonry units complying with AS 3700 and constructed in accordance with the following (see also [Figure 3.3.2.1](#)):

- (a) The [external wall](#) thickness must not be less than 140 mm.
- (b) Tie down rods must be provided and be—
  - (i) not less than one Y12 steel reinforcing bar (or equivalent); and
  - (ii) spaced at not more than 1.8 m centres between openings; and
  - (iii) fully grouted into the block work with a grout having a characteristic compressive strength of 20 MPa; and
  - (iv) lapped with coggled steel starter bars of a size not less than the tie down rods, set 250 mm into the concrete edge beam or footing in accordance with [Figure 3.3.2.1](#).



Figure 3.3.2.1

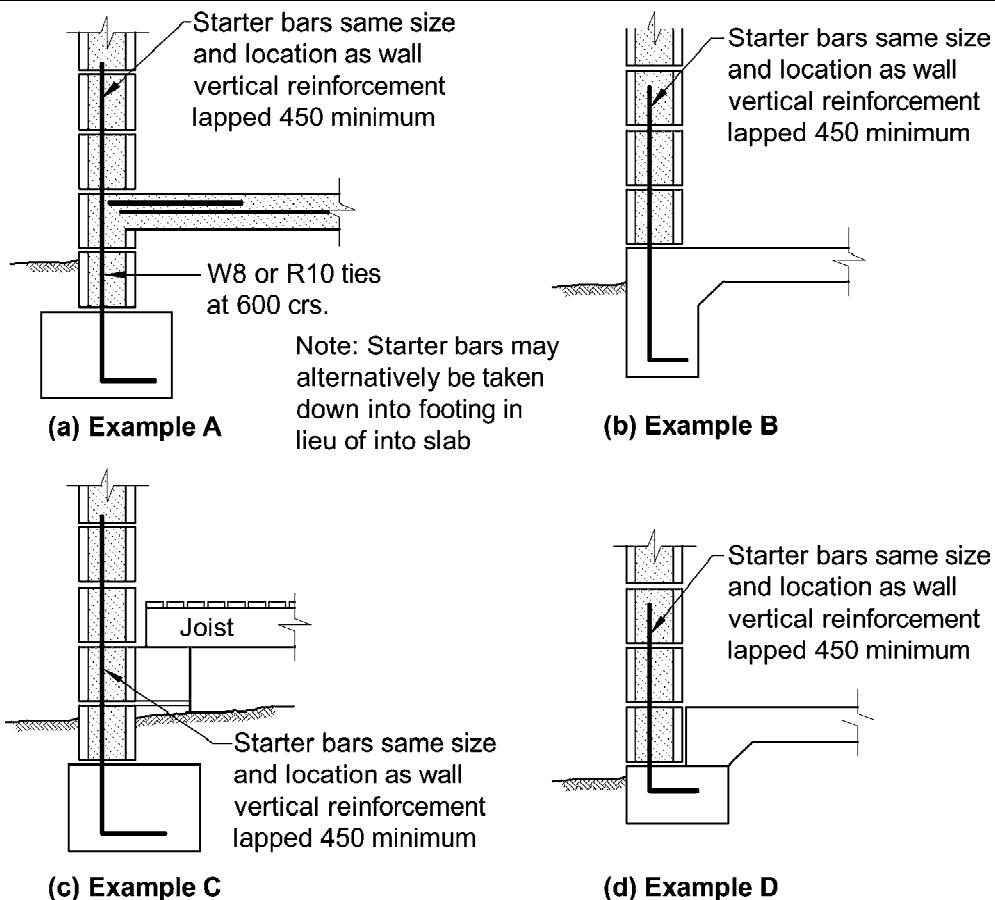
## TYPICAL FOOTING/TIE DOWN DETAILS



- (c) A continuous reinforced concrete *bond beam* must—
- be installed at the top of the walls in accordance with [Figure 3.3.2.2](#) and [Figure 3.3.2.3](#); and
  - have not less than two Y12 bars set in concrete grout with a characteristic compressive strength of 20 MPa; and
  - at door and *window* openings the *bond beam* may serve as a lintel supporting the roof trusses, provided additional reinforcement is placed in accordance with [Figure 3.3.2.4](#); and
  - at first floor level a one course *bond beam* must be constructed in accordance with [Figure 3.3.2.2](#).
- (d) All cores in masonry hollow block work below ground level must be filled with concrete grout.

Figure 3.3.2.2

## TYPICAL BOND BEAM DETAILS

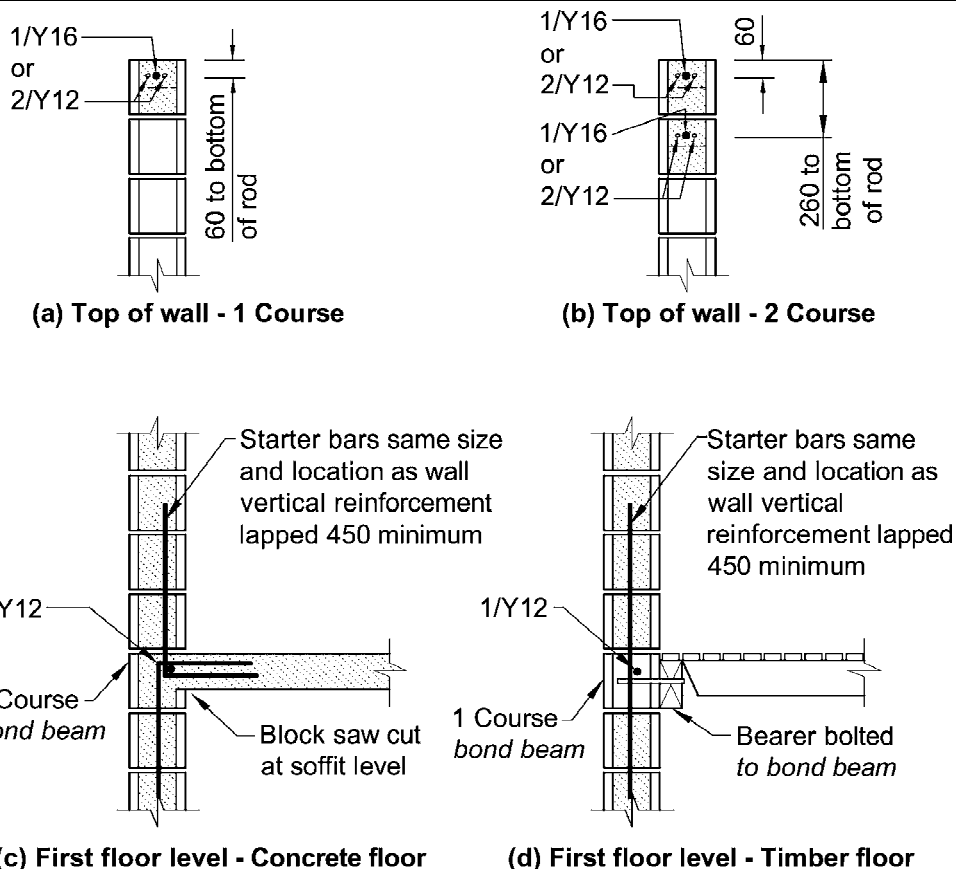


(e) Lintels must be installed in accordance with the following:

- (i) Lintels must be supported on reinforced piers in accordance with [Table 3.3.2.1](#) (where appropriate).
- (ii) Lintels carrying roof loads must be constructed in accordance with the appropriate requirements of [Figure 3.3.2.3](#) and [Figure 3.3.2.4](#).

Table 3.3.2.1

## ADDITIONAL WALL PIER REINFORCING



MAXIMUM SUM OF OPENINGS BESIDE PIERS "L1 + L2"

ALL CORES REINFORCED WITH ONE Y12 ROD

END CORES ONLY REINFORCED  
WITH Y12 ROD

**Table 3.3.2.1**

**ADDITIONAL WALL PIER REINFORCING**

WIDTH OF PIER "W" (mm)			WIDTH OF PIER "W" (mm)	
200	400	600	600	800
4000	6000	6000	6000	6000

**Figure 3.3.2.3**

**TYPICAL REINFORCED WALL**


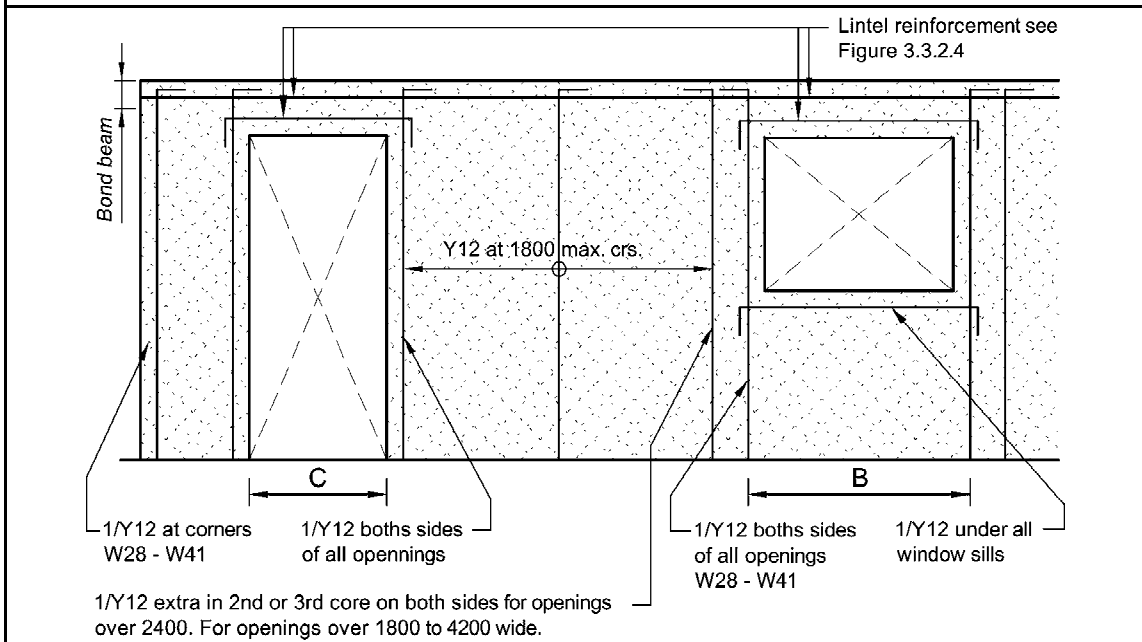


Figure 3.3.2.4

## REINFORCEMENT AND CONSTRUCTION OF LINTELS

Diagram a.

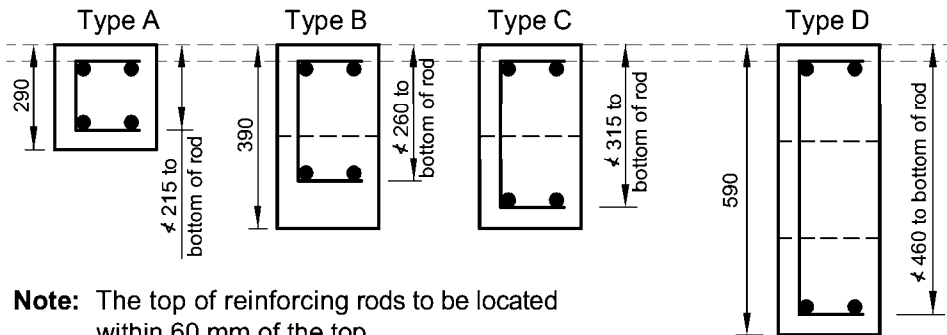Lintel types



**Note:** The top of reinforcing rods to be located within 60 mm of the top

Table a. Reinforcement for lintel types

CODE				REINFORCEMENT	
A1	B1	C1	D1	2-Y12	Top and Bottom
A2	B2	C2	D2	1-Y16	Top and Bottom
A3S	B3S	C3S	D3S	2-Y12	Top and Bottom with W8 Stirrups @ 200 crs
A4S	B4S	C4S	D4S	1-Y16	Top and Bottom with W8 Stirrups @ 200 crs
A5	B5	C5	D5	2-Y16	Top and Bottom
A6S	B6S	C6S	D6S	2-Y16	Top and Bottom with W8 Stirrups @ 200 crs

Figure 3.3.2.4 (Continued)

## REINFORCEMENT AND CONSTRUCTION OF LINTELS

Diagram b. Measurement of roof loads

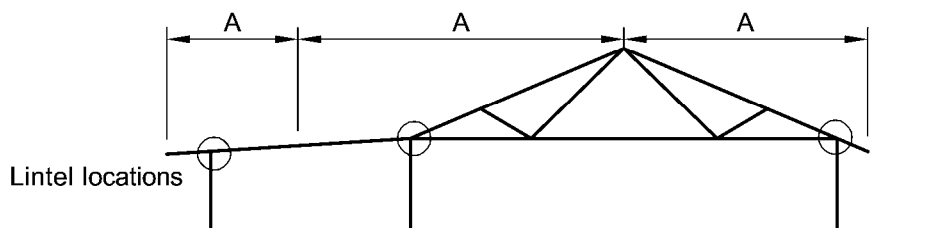


Table b. Lintel reinforcing for standard truss loading

**Note:** In lintels and [bond beams](#) using 2/Y12 bars, 1/Y16 bar may be used instead

OPENING (mm)	MINIMUM LINTEL REINFORCEMENT FOR STANDARD TRUSS LOADING								
	Maximum “A” – 4.6 m			Maximum “A” – 5.6 m			Maximum “A” – 6.6 m		
	LINTEL DEPTH (mm)			LINTEL DEPTH (mm)			LINTEL DEPTH (mm)		
	300	400	600	300	400	600	300	400	600
900	A1	B1 OR C1	D212	A1	B1 OR C1	D1	A1	B1 OR C1	D1
1200	A1	B1 OR C1	D212	A1	B1 OR C1	D1	A1	B1 OR C1	D1
1800	A1	B1 OR C1	D212	A1	B1 OR C1	D1	A3S	B1 OR C1	D1
2400	A1	B1 OR C1	D212	A3S	B1 OR C1	D1	A6S	B3S OR C1	D1
3000	A6S	B3S OR C1	D5	A6S	B6S OR C5	D1		B6S OR C66	D1
3600	–	B3S OR C5	D5		B6S OR C6S	D1		C6S	D5
4200	–	C6S	D5		C6S	D5			D6
4800	–	C6S	D5			D6			D6

- (f) Bracing walls must be installed in buildings to control lateral loading in accordance with the following:
- The walls must be constructed in accordance with [Figure 3.3.2.5](#).
  - The permissible bracing capacity is determined in accordance with [Table 3.3.2.2](#) after considering [Figure 3.3.2.6](#).

Figure 3.3.2.5

## TYPICAL BRACING WALL DETAILS

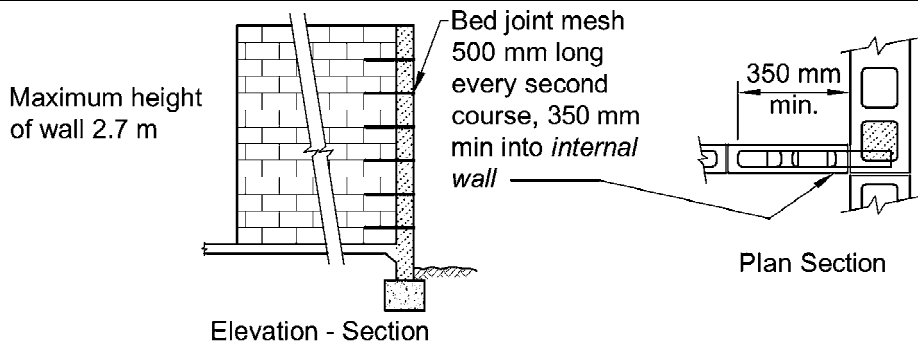
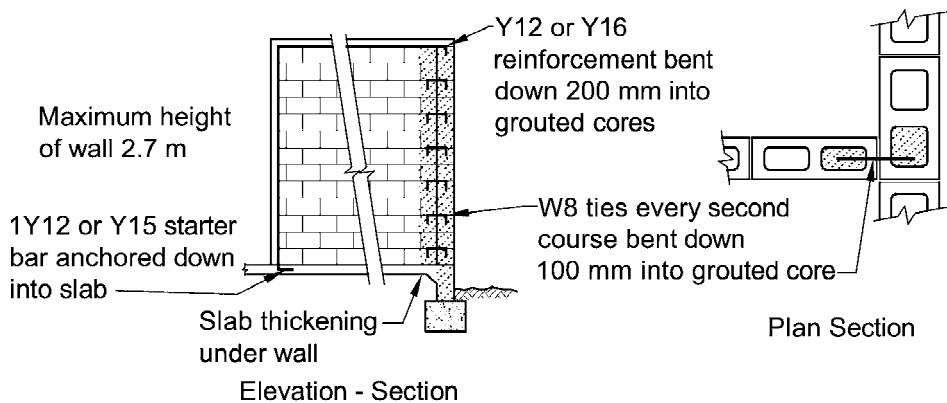
(a) 90 and 110 mm walls tied to *external wall*(b) 140 and 190 mm walls tied to *external wall* with or without tie-down into slab

Figure 3.3.2.6

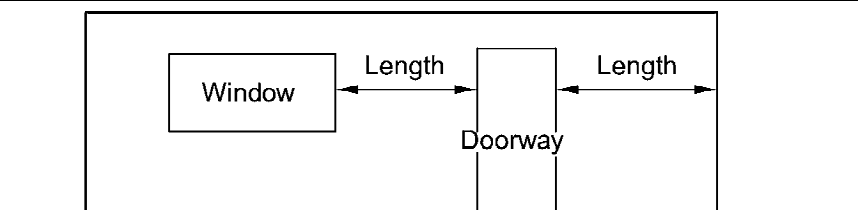
IDENTIFYING WALL LENGTHS—(To be used with [Table 3.3.2.2](#))

Table 3.3.2.2 BRACING CAPACITY OF WALLS 2.7 m HIGH

**Note:** Where a bracing wall is connected at only one end to a wall with a single course *bond beam*, the bracing value is limited by shear through the *bond beam* to 28.8 kN. Where it is necessary to use higher values a double *bond beam* must be used.

Wall Length (m)	PERMISSIBLE BRACING CAPACITY (kN)						
	90 mm & 110 mm Walls	140 mm Wall			190 mm Wall		
		No Tie down	Tie down size		No Tie down	Tie down size	
			Y12	Y16		Y12	Y16
0.4	—	—	2.4	4.1	0.1	2.4	4.2
0.6	—	0.1	4.1	6.7	0.2	4.1	7.4
0.8	0.2	0.3	5.8	7.8	0.3	6.0	10.0
1.0	0.4	0.5	7.6	9.0	0.6	7.8	11.2
1.2	0.5	0.7	9.5	10.0	0.8	9.7	12.4
2.4	2.1	2.8	16.8	16.8	3.3	19.6	19.6
3.0	3.3	4.4	20.2	20.2	5.2	23.2	23.2
3.6	4.8	6.3	23.5	23.5	7.4	26.8	26.8
4.2	6.6	8.6	26.9	26.9	10.2	30.4	30.4
4.8	8.6	11.2	30.2	30.2	13.3	34.0	34.0
5.4	10.5	14.2	33.6	33.6	16.8	37.6	37.6
6.0	10.5	17.6	37.0	37.0	20.7	40.4	40.4

- (g) Roof trusses must be tied to the *reinforced masonry* wall with a method appropriate to the design strength nominated in **Figure 3.3.2.7(a)** or **(b)** after taking into consideration—
- (i) the uplift force as determined in accordance with **Table 3.3.2.3**; and
  - (ii) the net design uplift pressure as determined in accordance with AS 4055 or AS/NZS 1170.2.

Table 3.3.2.3 ROOF TRUSSES—UPLIFT FORCES

DESIGN WIND SPEED	NET DESIGN UPLIFT PRESSURE (kPa)		NET DESIGN UPLIFT FORCE ON STANDARD TRUSS (kN)								
			TRUSSES AT 600 mm SPACING			TRUSSES AT 900 mm SPACING					
			TILE ROOF			TILE ROOF			SHEET ROOF		
	TILE ROOF	SHEET ROOF	DIMENSION "A" (m)			DIMENSION "A" (m)			DIMENSION "A" (m)		
			4.6	5.6	6.6	4.6	5.6	6.6	4.6	5.6	6.6
N2	0.00	0.42	0.0	0.0	0.0	0.0	0.0	0.0	1.7	2.1	2.5
N3	0.44	0.81	1.2	1.5	1.7	1.8	2.2	2.6	3.4	4.1	4.8

**Notes:**

1. For a standard truss, the uplift force at each end is equal to the pressure multiplied by dimension "A" multiplied by the truss spacing.
2. Uplift forces for other values of dimension "A" may be interpolated.
3. Sheet roof includes metal tile.
4. Dimension "A" is determined in accordance with [Figure 3.3.2.4](#) Diagram b.


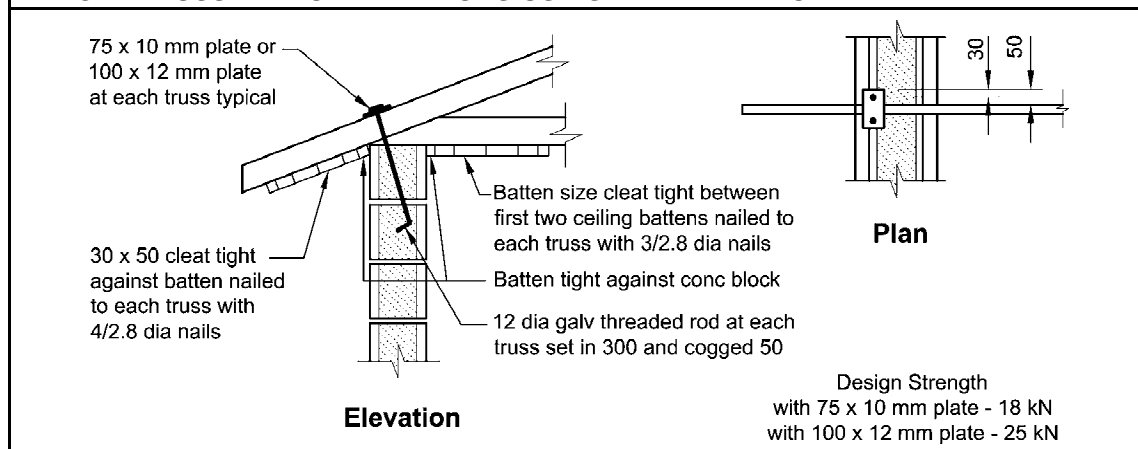
**Figure 3.3.2.7(a)****TYPICAL TRUSS TIE-DOWN METHODS USING THREADED ROD**



Figure 3.3.2.7(b)

## TYPICAL TRUSS TIE-DOWN METHODS — USING TOP PLATE

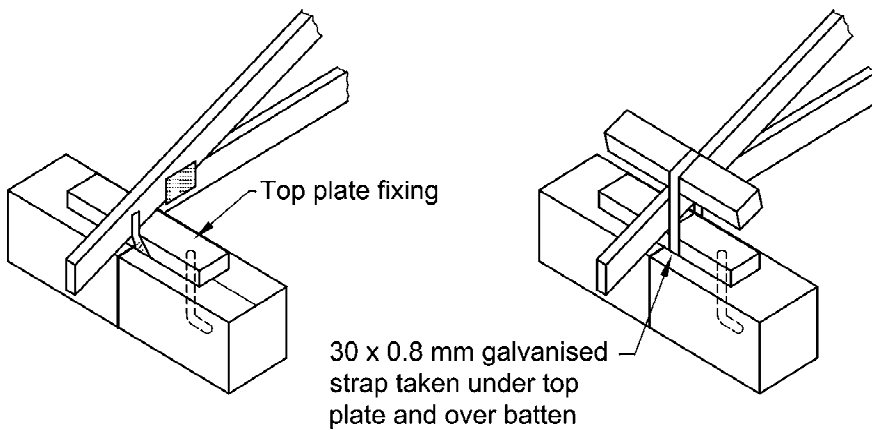

M12 bolt cast into *bond beam* within 100 mm of truss with J2, J3 or JD4 timber top plate  
 Design strength with bolt anchored in top course — 12.5kN  
 Design strength with bolt anchored below top course — 17kN



**Explanatory information:**

Joint groups (J2, J3 and JD4) are a classification of the strength of a timber species for the purpose of joint design. Typically, mixed Australian grown softwoods are joint group JD4 and mixed hardwoods are joint group J2 or J3.

- (h) Gable ends to buildings must be constructed in accordance with one of the following:
- (i) Where a timber frame is used above the *bond beam* the gable end must be supported by a ceiling diaphragm in accordance with **Figure 3.3.2.8**, Diagram a, by—
    - (A) anchoring the end truss to the wall; or
    - (B) bracing the end truss back to the internal trusses.
  - (ii) Where block work continues above the *bond beam*, fixed to the blockwork in accordance with **Figure 3.3.2.8**, Diagram b.

Figure 3.3.2.8

## TYPICAL GABLE END CONSTRUCTION DETAILS

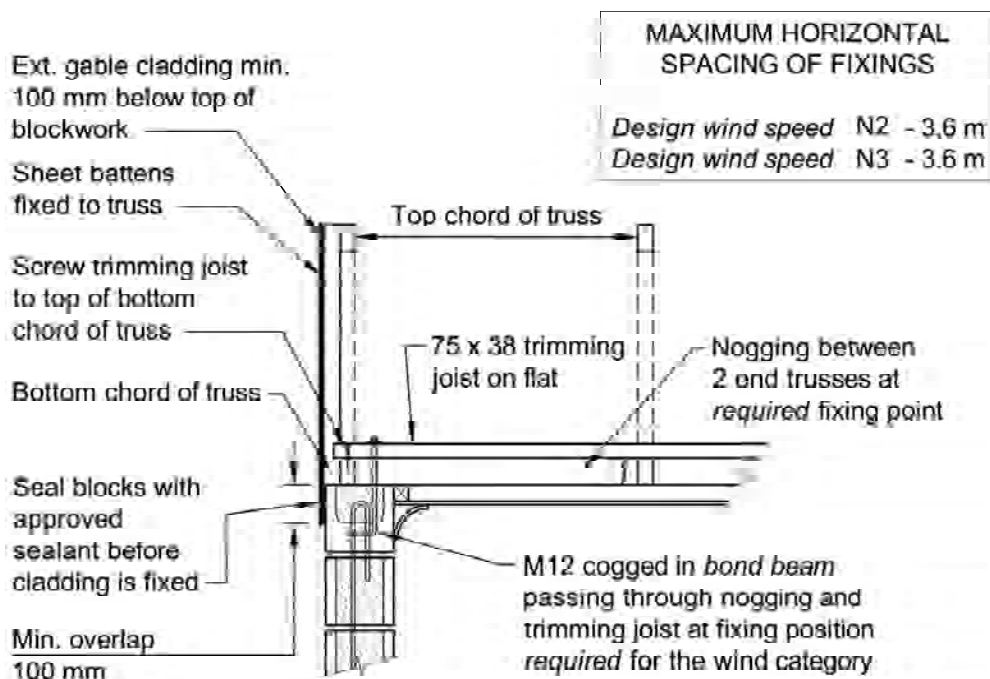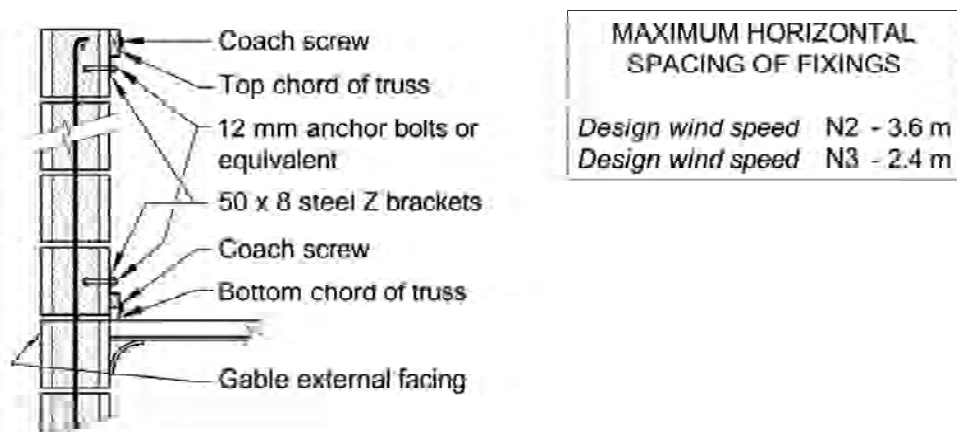Diagram a. Timber frame above *bond beam*Diagram b. Blockwork above *bond beam*

## PART 3.3.3 MASONRY ACCESSORIES

### Appropriate *Performance Requirements*

Where an alternative masonry accessory is proposed as an *Alternative Solution* to that described in **Part 3.3.3**, that proposal must comply with—

- (a) *Performance Requirement P2.1*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### A. Acceptable construction manual

#### 3.3.3.0

*Performance Requirement P2.1* is satisfied for masonry accessories if they are constructed and installed in accordance with AS 3700 — Masonry Structures.

### B. Acceptable construction practice

#### 3.3.3.1 Application

Compliance with this acceptable construction practice satisfies *Performance Requirement P2.1* for masonry accessories provided—

- (a) the building is located in an area with a *design wind speed* of not more than N3; and

#### Explanatory information:

1. Information on wind speeds for particular areas may be available from the *appropriate authority*.
2. Masonry walls in an area with a *design wind speed* of more than N3 must be designed in accordance with AS 3700.

- (b) for earthquake design, the building is defined as a design category H1 or H2 domestic structure in accordance with AS 1170.4 (1993); and

#### Explanatory information:

1. This covers all *sites* except those identified by the *site* investigation as having soft soil (having a soil profile with more than 5 m of soft clay, loose sand, silt or uncontrolled fill) as defined by AS 1170.4 (1993).
2. For earthquake design H3, see AS 3700.


- (c) The building is not constructed in an *alpine area*.

### 3.3.3.2 Wall ties

- (a) Masonry wall ties must be used to connect—
  - (i) masonry veneer wall cladding to a timber or metal *loadbearing* frame complying with **Part 3.4**; and
  - (ii) the two leaves of *cavity* masonry; and
  - (iii) two leaves of masonry forming a single wall with no *cavity*; and
  - (iv) intersecting masonry walls at a joint where course bonding is not employed.
- (b) Where articulation joints occur in masonry walls, ties must be built in both sides of the joint and spaced not more than 300 mm from the joint (see **Figure 3.3.3.1**).
- (c) Masonry wall ties must be installed in such a manner as to prevent moisture travelling along the tie to the inner leaf of masonry or frame.
- (d) Masonry veneer ties must be installed in accordance with Figure 3.3.3.1.
- (e) Wall ties must be classified in accordance with AS/NZS 2699.1 and installed as follows:
  - (i) Light duty ties must only be used in veneer clad buildings in areas where the *design wind speed* is not more than N2, and must be spaced in accordance with **Figure 3.3.3.1** as if for medium duty ties.
  - (ii) Medium duty ties must be—
    - (A) for veneer and *cavity* construction — spaced in accordance with **Figure 3.3.3.1**; and
    - (B) for solid or monolithic construction, in accordance with **(f)**.
- (f) Ties for solid or monolithic construction must be medium duty classification spaced not more than 400 mm in each direction and—
  - (i) the intersection of internal and external *cavity* or solid masonry walls must be bonded at the joint using medium duty ties at not more than 400 mm vertical spacing; and
  - (ii) in walls more than 200 mm in thickness, an additional tie is *required* within the spacing specified in **(i)** for every 200 mm of the thickness of the masonry units making the connection.
- (g) Masonry wall ties must be protected against corrosion in accordance with **Table 3.3.3.1**.

**Figure 3.3.3.1****TYPICAL BRICK TIES SPACINGS IN CAVITY AND VENEER CONSTRUCTION****Note:**

1. Solid masonry ties must be of a size appropriate to the *cavity* width and built not less than 50 mm into each leaf.
2. Wall tie spacings indicated on the diagram are indicative and may be reduced according to the nature of the wall.
3. Location of wall ties immediately adjacent to ties connecting an intersecting wall may be increased to not more than 600 mm away from the intersecting wall ties.

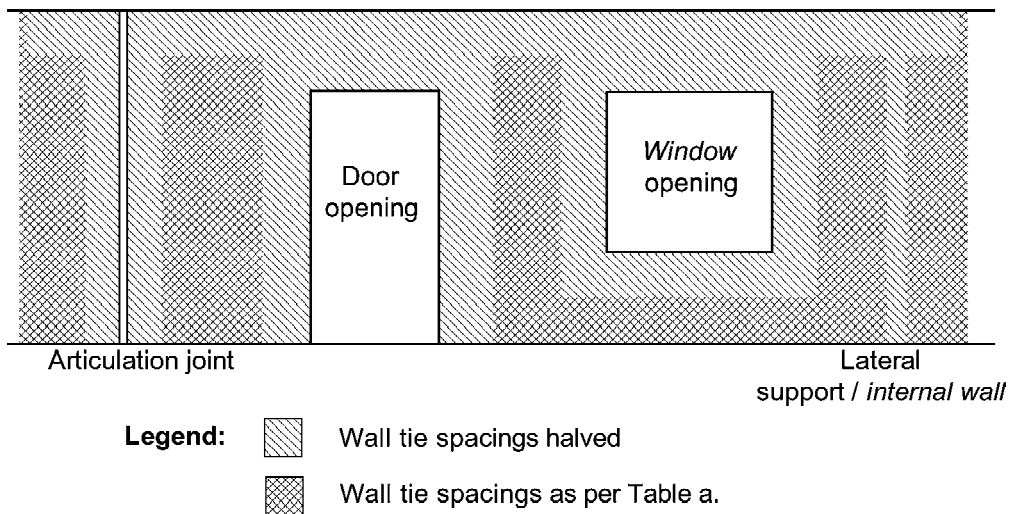**Diagram a. — Spacing for medium duty wall ties — cavity and veneer construction****Table a. — Spacing for medium duty wall ties — cavity and veneer construction**

DESIGN WIND SPEED (non-cyclonic)	CAVITY MASONRY	MASONRY VENEER CONSTRUCTION	
		450 STUD WALLS	600 STUD WALLS
N1–N3	600 x 600	600 x 450	600 x 600

**Note:**

1. Inner leaf masonry thickness 70 to 150 mm for *cavity* walls.
2. Around openings and at control joints, the vertical tie spacings are halved (ie the number of ties must be doubled).
3. In veneer construction, masonry must be tied to stud wall framing at all regular stud positions, including gable ends.

Table 3.3.3.1 CORROSION PROTECTION FOR WALL TIES

EXPOSURE CONDITION	TIE SPECIFICATION (minimum corrosion protection)
<b>Areas—</b> <ul style="list-style-type: none"> <li>less than 1 km from <i>breaking surf</i> ; or</li> <li>less than 100 m from salt water not subject to <i>breaking surf</i>; or</li> <li>within heavy industrial areas.</li> </ul>	<ul style="list-style-type: none"> <li>Grade 316 or 316L stainless steel.</li> <li>Engineered polymer.</li> </ul>
<b>Areas—</b> <ul style="list-style-type: none"> <li>1 km or more but less than 10 km from <i>breaking surf</i>; or</li> <li>100 m or more but less than 1 km from salt water not subject to <i>breaking surf</i>.</li> </ul>	<ul style="list-style-type: none"> <li>Sheet steel ties galvanised after manufacture — 470g/m<sup>2</sup> on each side.</li> <li>Galvanised wire ties — 470g/m<sup>2</sup> coating mass.</li> </ul>
<b>All other areas.</b>	<ul style="list-style-type: none"> <li>Ties manufactured from galvanised sheet steel — Z600.</li> <li>Sheet steel ties galvanised after manufacture — 300g/m<sup>2</sup> on each side.</li> </ul>



**Explanatory information:**

Wall ties that are suitable for use in a more severe exposure condition are also suitable for use in the less severe exposure conditions, i.e. stainless steel and engineered polymer ties are suitable for use in all conditions and 470g/m<sup>2</sup> galvanised ties can be used in all exposure conditions except the most severe.

**3.3.3.3 Fixing straps and tie-down systems**

- (a) Timber door and *window* frames abutting masonry must be—
- fixed with 300 mm long 32×0.8 mm kinked galvanised steel straps; and
  - fixed to back of frames; and
  - set into courses not less than 150 mm at not more than 400 mm intervals.
- (b) For areas with a *design wind speed* of N1 or N2 and a building width from outside wall to outside wall of not more than 10 m in the direction of the roof span (see **Figure 3.3.3.3(a)**), sheet metal and tiled roofs must be tied down using one of the following methods:
- 32×0.8 mm galvanised steel straps at not more than 1.2 m centres and corresponding with truss or rafter positions, looped around 10 mm diameter galvanised mild steel rods—
    - built-in across the *cavity* at a course not less than 900 mm below the top of the wall; and
    - embedded not less than 50 mm into each leaf.

- (ii) 25x1 mm galvanised steel straps at not more than 1.2 m centres and corresponding with truss or rafter positions, built into the masonry inner leaf not less than 50 mm and 900 mm below the top of the wall (see [Figure 3.3.3.3\(b\)](#)).

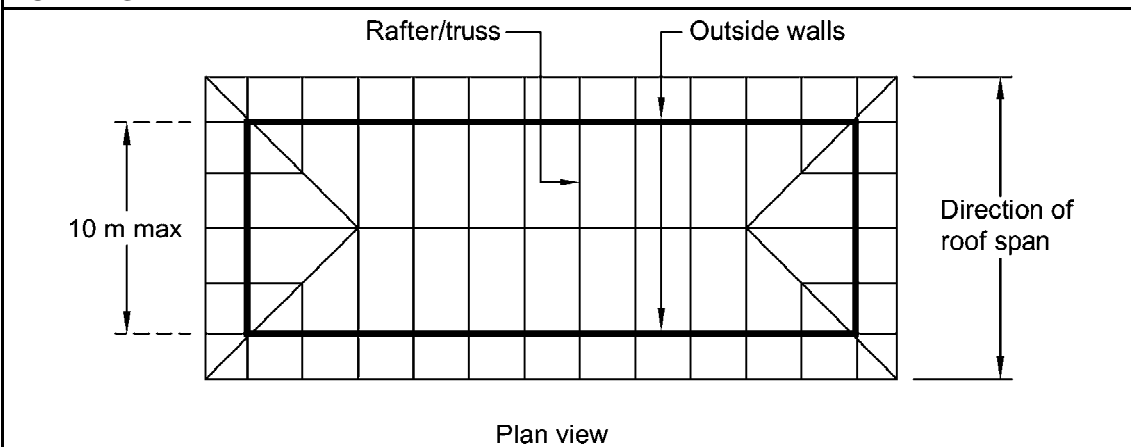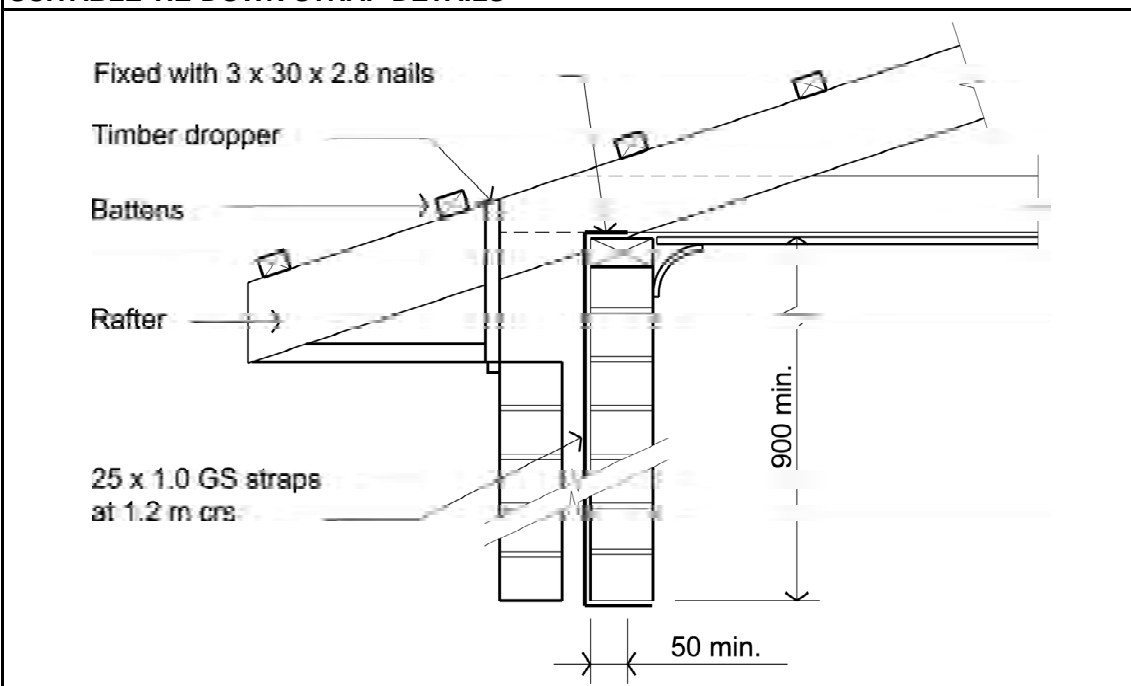**Figure 3.3.3.3(a)****BUILDING WIDTH****Figure 3.3.3.3(b)****SUITABLE TIE-DOWN STRAP DETAILS****3.3.3.4 Lintels**

- (a) Lintels in masonry may be—
- (i) steel lintels complying with this Part; or

- (ii) steel lintels complying with AS 4100, AS/NZS 4600; or
- (iii) reinforced concrete beams designed in accordance with AS 3600.

#### Explanatory information:

Lintels that support structures other than masonry walls are covered in [Section 3.4.4](#) — Structural steel members.

- (b) Steel lintels must comply with [Figure 3.3.3.5](#) and—
  - (i) the long leg of angles must be vertical (see [Figure 3.3.3.4](#)); and
  - (ii) each angle or flat can carry a maximum 110 mm wall thickness; and
  - (iii) the minimum bearing length at each end of the lintel must be—
    - (A) for clear spans less than 1 m — 100 mm; and
    - (B) for clear spans more than 1 m — 150 mm (see [Figure 3.3.3.4](#)); and
  - (iv) there must be not less than three courses of brickwork over openings; and
  - (v) all loads must be uniformly distributed (point loads are not allowed).
- (c) Corrosion protection of lintels must be in accordance with [Table 3.3.3.2](#).

**Figure 3.3.3.4**

#### LINTEL INSTALLATION






Figure 3.3.3.5

## LINTELS SUPPORTING ROOFS AND MASONRY WALLS

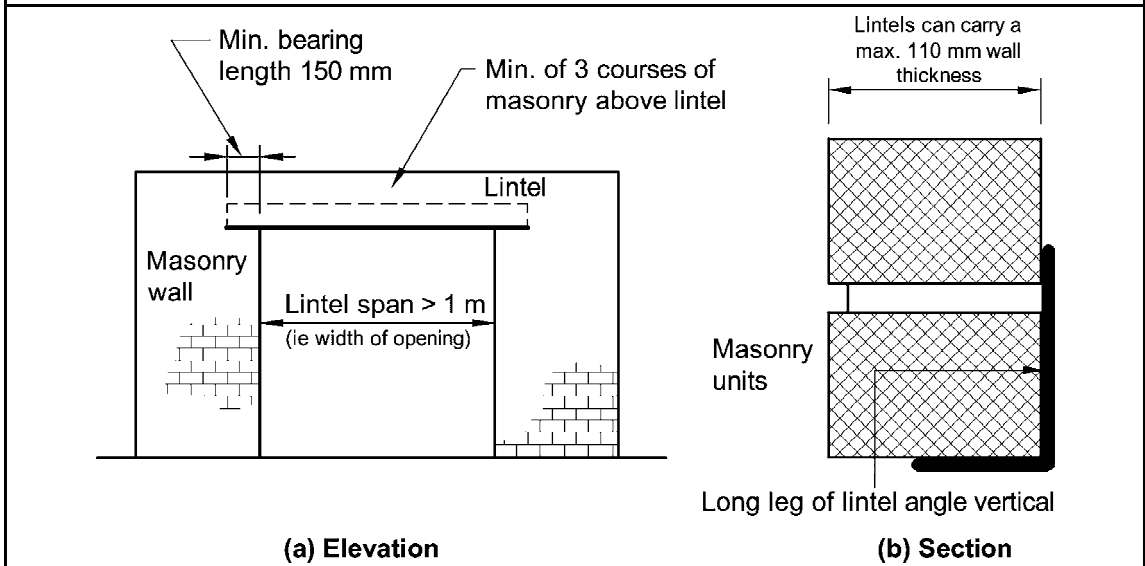Diagram a. — Lintel types as described in Table a.

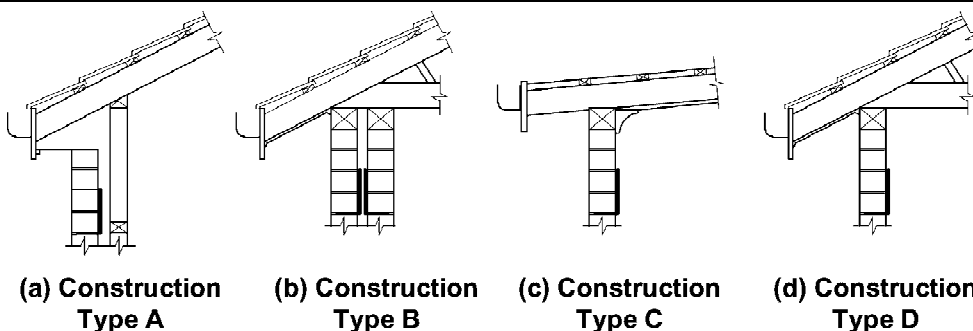


Table a. — Lintels spans

*Design wind speed* not more than N3 — Maximum roof span 10 m

Steel Section	Mass(kg/m)	Construction Type See Diagram a.			
		A	B	C	D
Angles		MAXIMUM CLEAR SPAN OF LINTEL (mm)			
90x90x6EA	8.22	3010	2050	2050	1570
90x90x8EA	10.6	3010	2170	2170	1810
100x100x6EA	9.16	3130	2290	2290	1810
100x100x8EA	11.8	3370	2410	2410	1930
150x90x8UA	14.3	4210	3370	3370	2770
150x100x10UA	18	4330	3490	3610	3010
Flats					
75x8	4.71	490	250	—	—
75x10	5.89	610	250	250	250

## 3.3.3.5 Corrosion protection

Corrosion protection of built-in structural steel members such as lintels, shelf angles, connectors, accessories (other than wall ties) and the like must be in accordance with [Table 3.3.3.2](#).

Table 3.3.3.2 Corrosion protection of built-in structural steel members

Environment	Minimum Protective Coating
<b>Very Low</b> <sup>Note 1</sup>	<ul style="list-style-type: none"> <li>Degrease and power tool clean very thoroughly and apply 75 µm epoxy zinc or epoxy zinc phosphate primer.</li> <li>Blast to grade 2.5 <sup>Note 7</sup> / 75 µm zinc silicate type 3 / 4 or 6 <sup>Note 8</sup>.</li> <li>Hot dip galvanising — 300 g/m<sup>2</sup>.</li> <li>Hot dip galvanising — 100 g/m<sup>2</sup> / 100 µm epoxy phosphate primer.</li> </ul>
<b>Low</b> <sup>Note 2</sup>	<ul style="list-style-type: none"> <li>Blast to grade 2.5 / 75 µm zinc silicate type 3 / 4 or 6.</li> <li>Hot dip galvanising — 600 g/m<sup>2</sup>.</li> <li>Hot dip galvanising — 300 g/m<sup>2</sup> / 75 µm epoxy phosphate primer.</li> <li>Hot dip galvanising — 100 g/m<sup>2</sup> / 75 µm epoxy phosphate primer / 125 µm epoxy MIO <sup>Note 9</sup>.</li> </ul>
<b>Medium</b> <sup>Note 3</sup>	<ul style="list-style-type: none"> <li>Blast to grade 2.5 / 100 µm zinc silicate type 3 or 6 <sup>Note 10</sup>.</li> <li>Hot dip galvanising — 600 g/m<sup>2</sup>.</li> <li>Hot dip galvanising — 300 g/m<sup>2</sup> / 75 µm epoxy phosphate primer / 125 µm epoxy MIO.</li> </ul>
<b>High</b> <sup>Note 4</sup>	<ul style="list-style-type: none"> <li>Blast to grade 2.5 / 100 µm zinc silicate type 3 or 6 / 100 µm epoxy phosphate primer / 100 µm epoxy MIO.</li> <li>Hot dip galvanising — 600 g/m<sup>2</sup> / abrade with industrial grade abrasive paper / 100 µm epoxy phosphate primer / 100 µm epoxy MIO.</li> <li>Stainless steel 316 / 316L.</li> </ul>
<b>Very High</b> <sup>Note 5</sup>	<ul style="list-style-type: none"> <li>Hot dip galvanising — 600 g/m<sup>2</sup> / abrade with industrial grade abrasive paper / 100 µm epoxy phosphate primer / 100 µm epoxy MIO.</li> <li>Zinc silicate 100 µm type 3 or 6 / 100 µm epoxy phosphate primer / 100 µm epoxy MIO.</li> <li>Stainless steel 316 / 316L.</li> </ul>
<b>Notes:</b> <ol style="list-style-type: none"> <li><b>Very low — interior dry</b> includes areas with sealed interior spaces.</li> <li><b>Low — rural inland</b> includes dry rural areas remote from the coast or sources of pollution. Many areas of Australia beyond at least 50 km from the sea are in this category, including most cities and towns such as Canberra, Ballarat, Toowoomba, Alice Springs and some suburbs of cities on sheltered bays such as Melbourne, Hobart, Brisbane and Adelaide that are more than 1 km from the sea. However each of these have many exceptions which are in more corrosive categories.</li> </ol>	

Table 3.3.3.2 Corrosion protection of built-in structural steel members— continued

Environment	Minimum Protective Coating
3.	<b>Medium — urban inland, coastal or industrial</b> typically coastal areas with low salinity around sheltered bays, such as Port Phillip Bay. This extends from about 50 m from the shoreline to a distance of about 1 km inland but seasonally or in semi-sheltered bays extends 3 to 6 km inland. Along ocean front areas with <i>breaking surf</i> and significant salt spray, it extends from 1 km inland to about 10 to 50 km depending on wind direction and topography. Much of the metropolitan areas of Wollongong, Sydney, Newcastle and the Gold Coast are in this category. This can extend to 30 to 70 km inland in South Australia while on some evidence, other southern Australian coastal zones are in this, or a more severe category. This also includes urban and industrial areas with low pollution and for several kilometres around large industries such as steel works and smelters. Microclimatic effects such as proximity to airports and sewerage treatment works may also place a site within this category. Interior environments with medium corrosivity can also occur in humid production rooms such as food processing plants, laundries, breweries, printing works, dairies and swimming pools.
4.	<b>High</b> typically occurs on the coast around sheltered bays. Category high extends up to 50 m inland from the shoreline. In areas of rough seas and surf it extends from several hundred metres to about 1 km inland. As with other categories the extent depends on wind, wave action and topography. The category will also be found inside industrial plants and can influence a distance of 1.5 km down wind of the plant. Best considered as a microclimate, contaminated environments such as occur in indoor swimming pools, dye works, paper manufacturing, foundries, smelters and chemical processing may also contain this category.
5.	<b>Very high</b> is typical of offshore conditions and is found on the beachfront in regions of rough seas and surf beaches. It can extend inland for several hundred metres. For example, in Newcastle it exceeds 500 m from the coast. It is also found in aggressive industrial areas with a pH of less than 5. Some of the influences of damp or contaminated interior environments of category high, may extend into this category.
6.	"Very thoroughly" means power tool cleaning to the best practical condition obtainable.
7.	Blast grade 2.5 means abrasive blast cleaning.
8.	Zinc silicate types 3, 4 or 6 means inorganic zinc silicate paint.
9.	MIO means micaceous iron oxide 2 pack epoxy coating.
10.	Zinc silicate type 3 or 6 means inorganic zinc silicate paint.
11.	The chosen coatings for built-in steel items must have sufficient impact resistance to ensure that they remain intact during transportation and handling on site.
12.	All epoxy coatings to be 2 pack.
13.	All galvanised or painted zinc coatings require a 2 pack adhesion promoting primer, prior to top coating.
14.	All climatic zones described contain variation of greater corrosion severity. If significant this must be addressed by designing for the most severe occurring climatic zone.

## PART 3.3.4 WEATHERPROOFING OF MASONRY

### Appropriate *Performance Requirements*

Where an alternative waterproofing system is proposed as an *Alternative Solution* to that described in **Part 3.3.4**, that proposal must comply with —

- (a) *Performance Requirement P2.2.2*; and
- (b) *Performance Requirement P2.2.3*; and
- (c) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### 3.3.4 Application of this Part

- (a) This Part applies to every external wall (including the junction between the wall and any window or door) of a Class 1 building.
- (b) This Part does not apply to any Class 10 building except where its construction contributes to the weatherproofing of the Class 1 building.

#### A. Acceptable construction manual

#### 3.3.4.0

*Performance Requirement P2.2.2* is satisfied for weatherproofing of masonry if it is carried out in accordance with the appropriate provisions of AS 3700.

#### B. Acceptable construction practice

### 3.3.4.1 Application

Compliance with this acceptable construction practice satisfies *Performance Requirement P2.2.2* for weatherproofing of masonry, provided the masonry wall is constructed in accordance with **Part 3.3.1** or **Part 3.3.2**.

### 3.3.4.2 Width of cavity

In brick veneer and *cavity* masonry construction, a *cavity* must be provided between the inner and outer masonry leaves or the masonry leaf and the supporting frame as follows:

- (a) Brick veneer—not less than 25 mm width.
- (b) *Cavity* masonry—not less than 35 mm nor more than 65 mm width.
- (c) Except for mullions, the minimum *cavity* width specified in (a) and (b) is to be maintained between the outer masonry leaf and any services, insulation or sheet bracing located in the *cavity*.

- (d) Where mullions are located within a *cavity* as permitted by (c), a vertical *DPC* must be placed between the outer masonry leaf and the mullion to prevent moisture penetration.


### 3.3.4.3 Cavity ventilation and drainage

Open perpendicular joints (weepholes) must be created in the course immediately above any *DPC* or *flashing* at centres not exceeding 1.2 m, except in the following situations:


- (a) Weepholes are not *required* for head or sill openings less than 1 m wide.
- (b) Weepholes are not *required* where—
- (i) the external masonry is weatherproofed in accordance with 3.3.4.12(a); and
  - (ii) the perimeter joint of all *windows* are sealed; and
  - (iii) a *damp-proof course* is installed in accordance with 3.3.4.5.

Figure 3.3.4.1

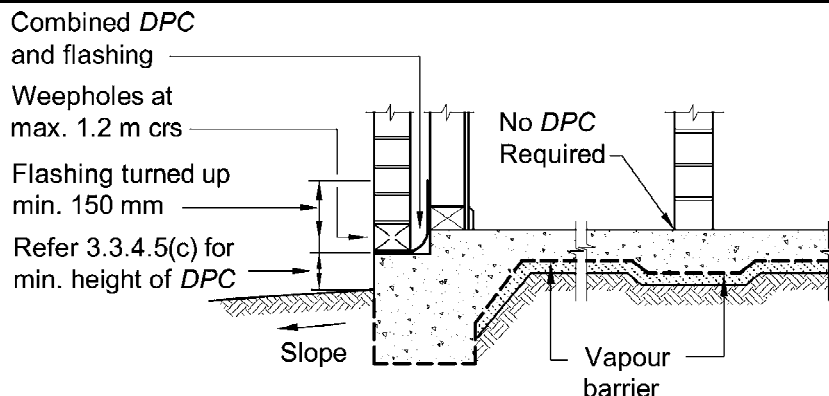
## LOCATION OF DPCs AND FLASHINGS IN SUB-FLOOR STRUCTURES



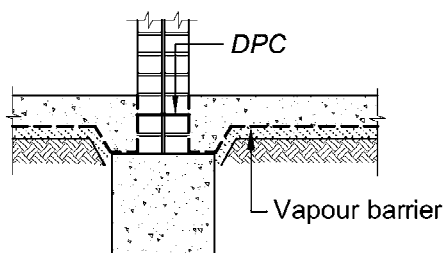
(a) Masonry veneer



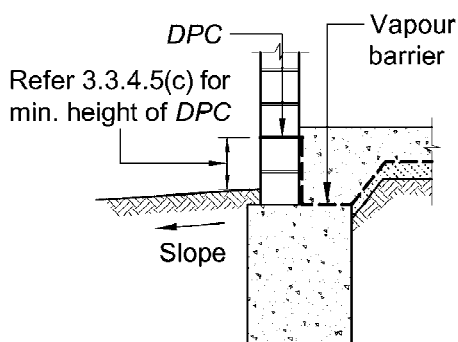
(b) Internal wall



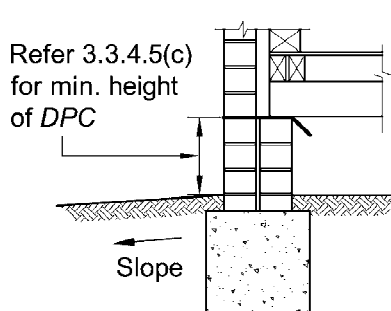(c) Single leaf



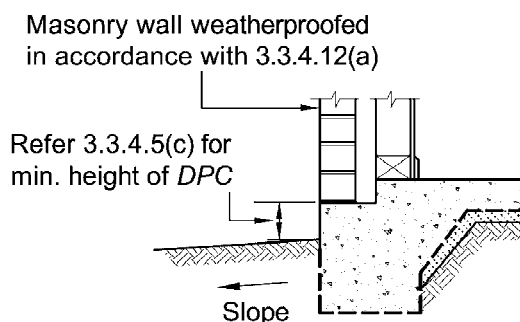(d) Suspended floor



(e) Weatherproofed masonry veneer

## 3.3.4.4 Damp-proof courses — materials

*Damp-proof courses* must consist of—

- (a) a material that complies with AS/NZS 2904; or

- (b) embossed black polyethylene film of high impact resistance and low slip, with a nominal thickness of 0.5 mm prior to embossing, and meeting the requirements of clause 7.6 of AS/NZS 2904; or
- (c) polyethylene coated metal, that has an aluminium core of not less than 0.1 mm thick, is coated both sides with bitumen adhesive enclosed in polyethylene film of not less than 0.1 mm thick on each face, and has a nominal total thickness of not less than 0.5 mm prior to embossing; or
- (d) bitumen impregnated materials of not less than 2.5 mm thickness, that meet the requirements of clause 7.5 of AS/NZS 2904, when used in walls which are not higher than 7.8 m above the level of the [DPC](#); or
- (e) termite shields (with no penetrations) continuous through the wall or pier.

#### STATE AND TERRITORY VARIATIONS

**In South Australia delete 3.3.4.4 and insert SA 3.3.4.4 as follows:**

##### **SA 3.3.4.4 Damp-proof courses — materials**

[Damp-proof courses](#) and [flashings](#) used as [DPCs](#) must consist of—

- (a) embossed black polyethylene film meeting the requirements of clause 7.6 of AS/NZS 2904; or
- (b) polyethylene coated aluminium meeting the requirements of clause 7.4 of AS/NZS 2904; or
- (c) bitumen impregnated materials of not less than 2.5 mm thickness, meeting the requirements of clause 7.5 of AS/NZS 2904, when used in walls not higher than 7.8 m above the level of the [damp-proof course](#).

#### 3.3.4.5 Damp-proof courses—installation

- (a) [DPCs](#) must be—
  - (i) located in accordance with [Figure 3.3.4.1](#) to form a continuous damp-proofing barrier around buildings, and in walls and piers below suspended floors; and
  - (ii) of sufficient width to extend through the entire width of the masonry leaves.
- (b) A [flashing](#) that extends through the entire width of the masonry leaves may also be used as a [DPC](#) (see [Figure 3.3.4.1](#)).
- (c) The height of a [DPC](#), or [flashing](#) serving as a [DPC](#), (see [Figure 3.3.4.1](#)), must be not less than—
  - (i) 150 mm above the adjacent ground level; or
  - (ii) 75 mm above the finished surface level of adjacent paved, concreted or landscaped areas that slope away from the wall (see [Figure 3.3.4.1](#)); or
  - (iii) 50 mm above finished paved, concreted or landscaped areas complying with [3.1.2.3\(b\)\(ii\)](#) and protected from the direct effects of the weather by a carport, verandah or the like; or
  - (iv) in [low rainfall intensity areas](#) where the site classification is A, S, M-D or H-D in accordance with AS 2870—
    - (aa) 15 mm above finished paved, concreted or landscaped areas; or

- (bb) 0 mm if the *DPC* is protected from the direct effects of the weather by a carport, verandah or the like.

**Explanatory information:**

150 mm clearance between the *DPC* and adjacent ground level reduces the risk of the effectiveness of the *DPC* being affected by changes in the surface level. Where changes in surface level are less likely to occur, such as where the adjacent surface is finished with paving, concreting or landscaping, the height of the *DPC* above that surface may be reduced to 75 mm. When also protected from the weather by a carport, verandah or the like the height of the *DPC* may be reduced to 50 mm.

Further reductions in the height of a *DPC* are permitted in *low rainfall intensity areas*.

- (d) Masonry units and mortar below the lowest *DPC* must be of the appropriate classification for the exposure condition (see [Table 3.3.1.1](#) and [Table 3.3.1.2](#)).
- (e) *DPCs* may be stepped where a change in floor level occurs.
- (f) *DPCs* must be installed under the coping to parapets where the parapet is more than 300 mm above the adjoining roof cladding (see [Figure 3.3.4.2](#)).
- (g) In chimney stacks—
- (i) the *DPC* must be installed between 150 mm and 300 mm above the highest point where the chimney meets the roof; or
  - (ii) two *DPCs* may be used to avoid a high *flashing* upstand (see [Figure 3.3.4.3](#)).
- (h) Lap joints in a *DPC* must be not less than 150 mm.

**Explanatory information:**

A *DPC* is used to prevent the penetration of water and moisture into a building. As a result, careful consideration must be given to the location of a *DPC* and its intended use. In addition to the provision of this clause, termite risk management in accordance with [Clause 3.1.3](#) may also need to be considered when determining the appropriate location of the *DPC*.

**STATE AND TERRITORY VARIATIONS**

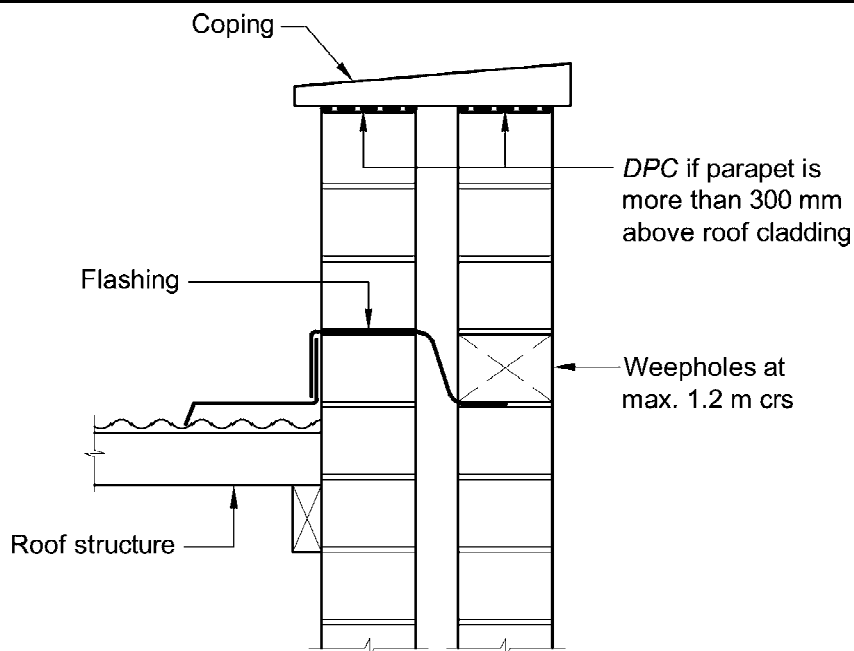
**In South Australia delete 3.3.4.5(b) and insert SA 3.3.4.5(b) as follows:**

- (b) A *flashing* that extends through the entire width of the masonry leaves and complies with [SA 3.3.4.4](#) may also be used as a *DPC*.

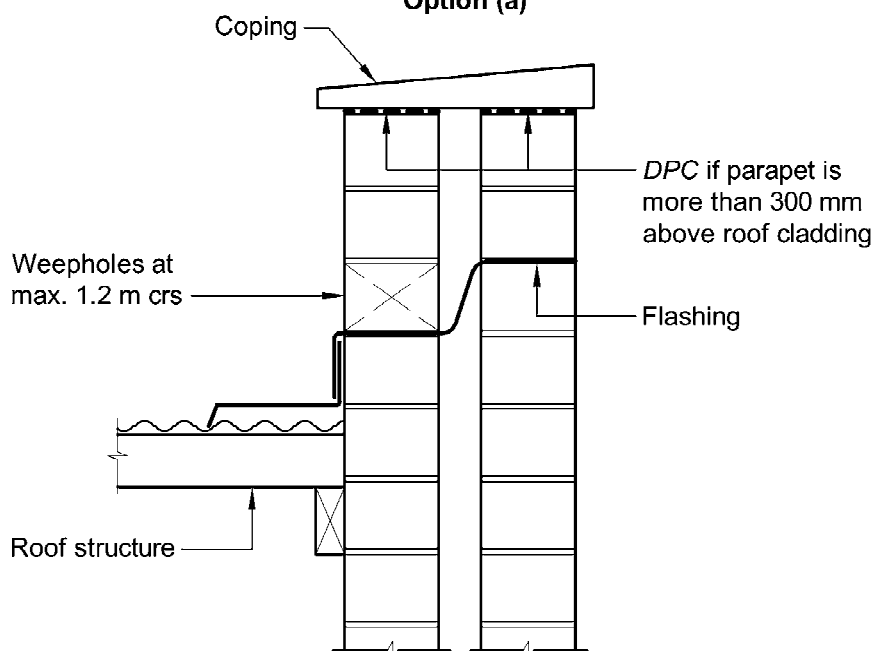


Figure 3.3.4.2

## INSTALLATION OF DPCs AND FLASHINGS FOR PARAPET WALLS





Option (a)



Option (b)

Figure 3.3.4.3
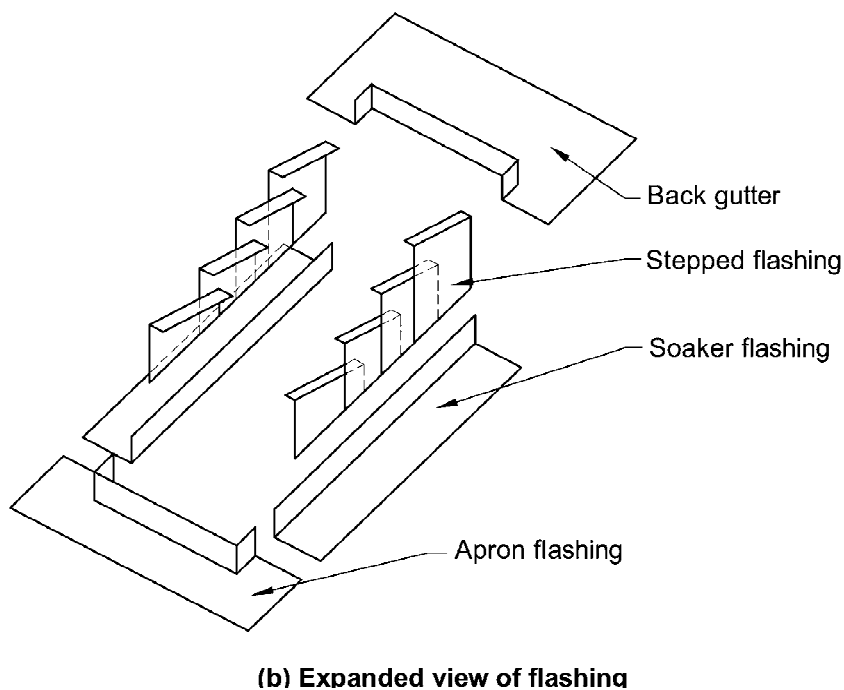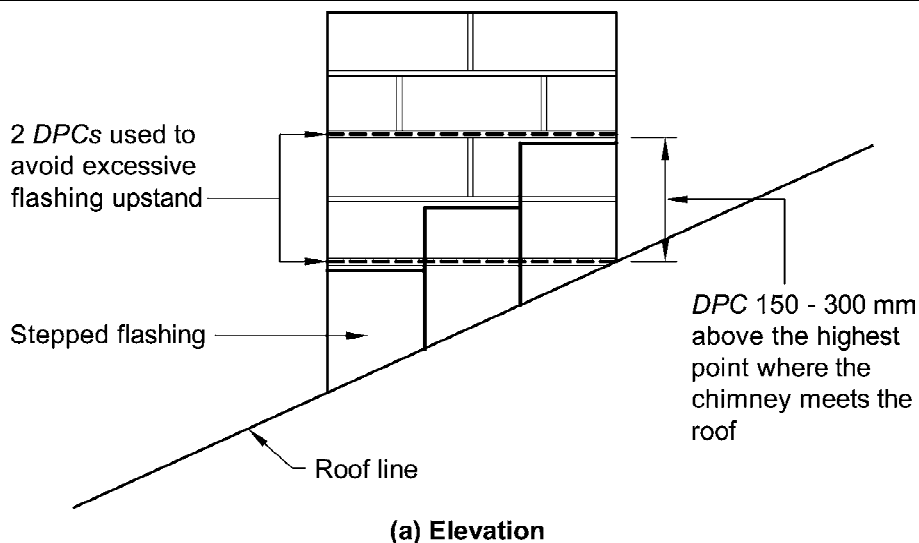
## INSTALLATION OF DPCs AND FLASHINGS FOR CHIMNEYS



## 3.3.4.6 Flashings

*Flashings* materials must comply with AS/NZS 2904 or [Table 3.3.4.1](#) and—

- (a) be built-in as the work proceeds; and

- (b) where electrolytic action could otherwise occur, different materials must be isolated in accordance with [Table 3.5.1.2](#).
- (c) lead flashings must not be used on any roof that is part of a potable water catchment area.

#### STATE AND TERRITORY VARIATIONS

In South Australia delete 3.3.4.6 and insert SA 3.3.4.6 as follows:

##### SA 3.3.4.6 Flashings

- (a) *Flashing* materials (except where used as a *DPC*) must comply with AS/NZS 2904 or [Table 3.3.4.1](#) and—
- be built-in as the work proceeds; and
  - where electrolytic action could otherwise occur, different materials must be isolated in accordance with [Table 3.5.1.2](#).
- (b) Lead *flashings* must not be used on any roof that is part of a potable water catchment area.
- (c) *Flashings* used as *DPCs* must comply with [SA 3.3.4.4](#).

**Table 3.3.4.1 SUITABLE FLASHING MATERIALS FOR CONCEALED AND EXPOSED LOCATIONS**

LOCATION	SUITABLE FLASHING MATERIAL
<b>CONCEALED</b> (e.g. <i>cavity flashing</i> )	<ul style="list-style-type: none"> <li>Uncoated annealed lead having a mass of not less than 10 kg/m<sup>2</sup>.</li> <li>Uncoated copper having a mass of not less than 2.8 kg/m<sup>2</sup> and having a thickness of 0.3 mm to 0.5 mm.</li> <li>Bitumen coated metal (normally aluminium) with a total coated thickness of 0.6 mm to 1 mm.</li> <li>Zinc coated steel with a thickness of not less than 0.6 mm</li> <li>Embossed/Quilted polyethylene sheet with an average thickness of not less than 0.5 mm.</li> </ul>
<b>EXPOSED</b> (e.g. roof to masonry wall <i>flashings</i> )	<ul style="list-style-type: none"> <li>Uncoated annealed lead having a mass of not less than 20 kg/m<sup>2</sup> in lengths not exceeding 1.5 m.</li> <li>Uncoated copper having a mass of not less than 2.8 kg/m<sup>2</sup> and having a thickness of 0.3 mm to 0.5 mm.</li> <li>Bitumen coated metal (normally aluminium) with a total coated thickness of 0.6 mm to 1 mm.</li> <li>Zinc coated steel with a thickness of not less than 0.6 mm.</li> </ul>

Figure 3.3.4.4

## PROTECTION OF OPENINGS IN EXTERNAL WALLS

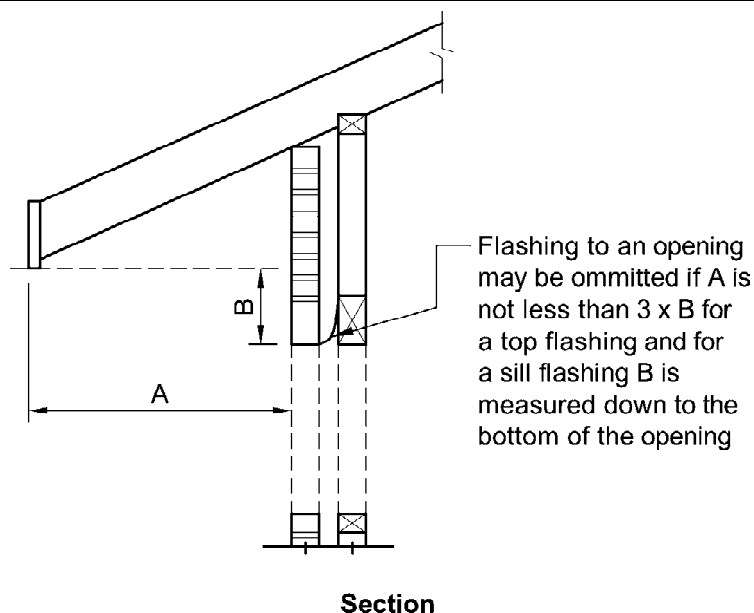


Figure 3.3.4.5

## INSTALLATION OF SILL AND HEAD FLASHINGS

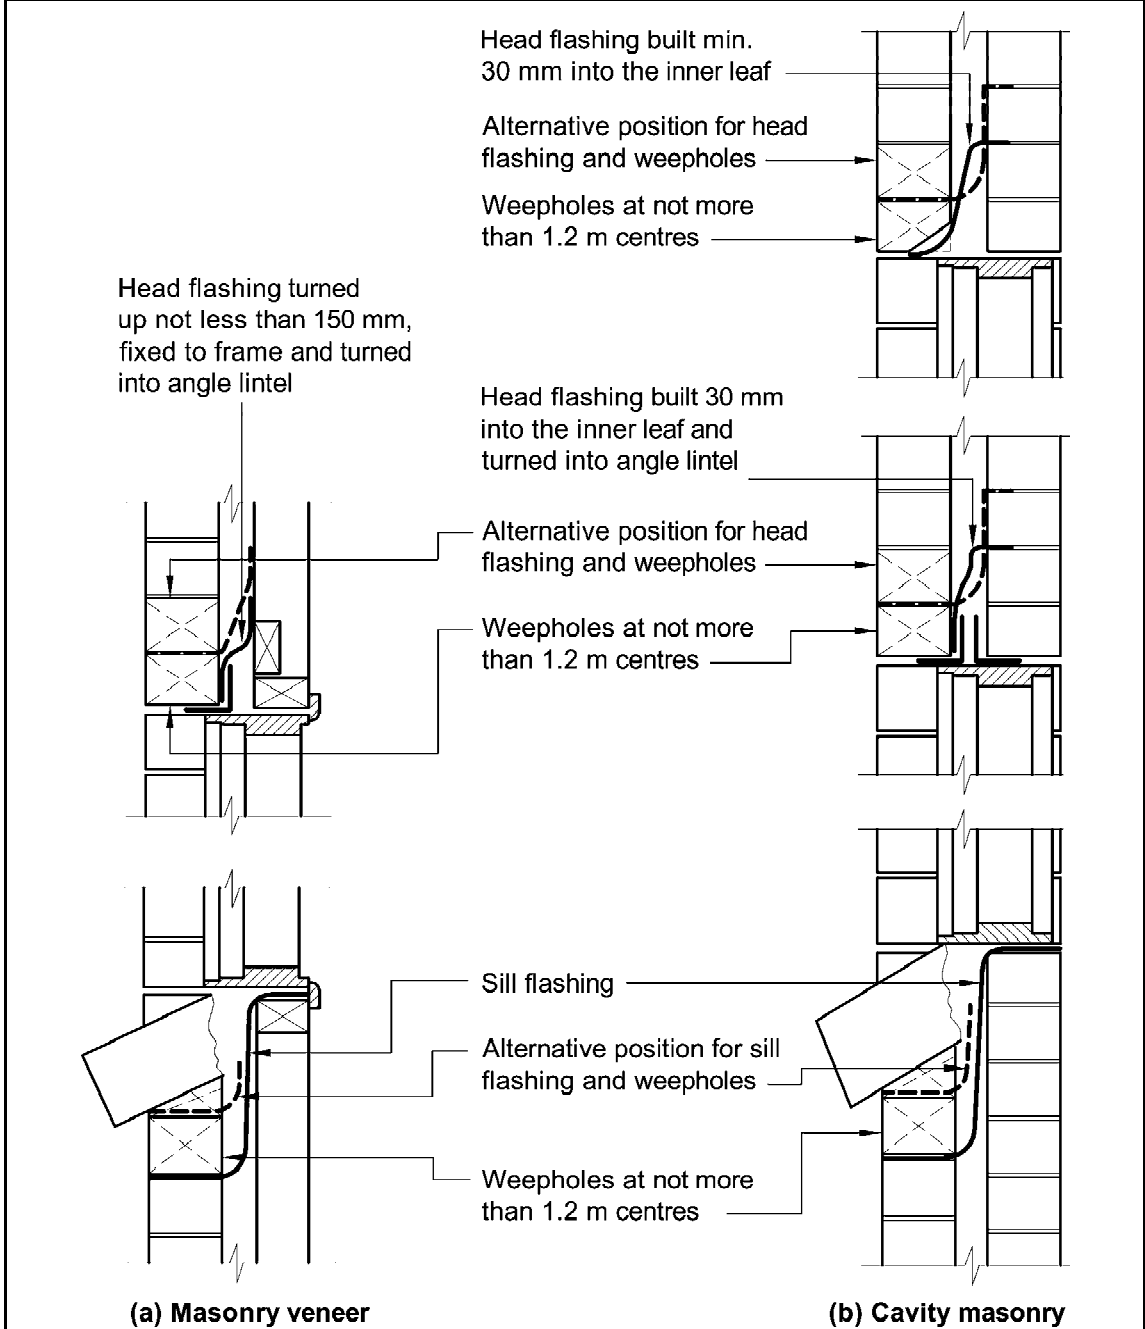


Figure 3.3.4.6

## INSTALLATION OF FLASHINGS AT ROOF/WALL JUNCTIONS


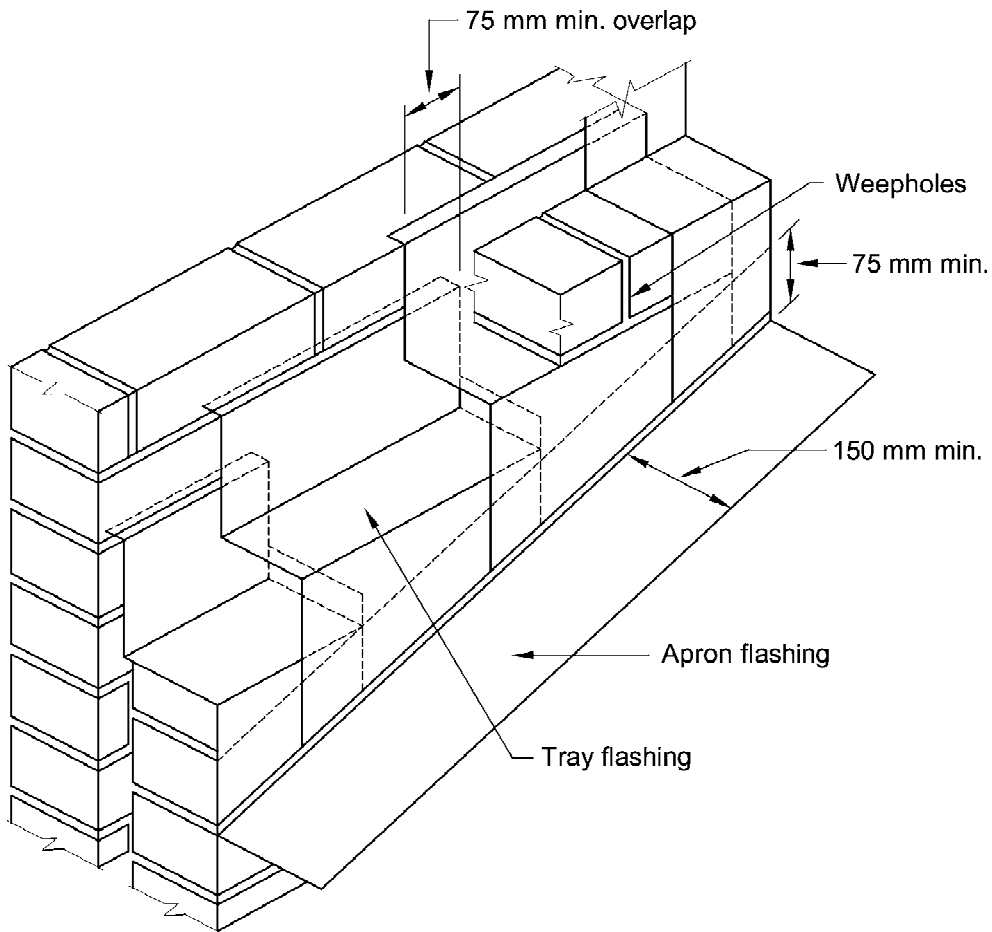


Figure 3.3.4.7

## STEPPED CAVITY FLASHINGS

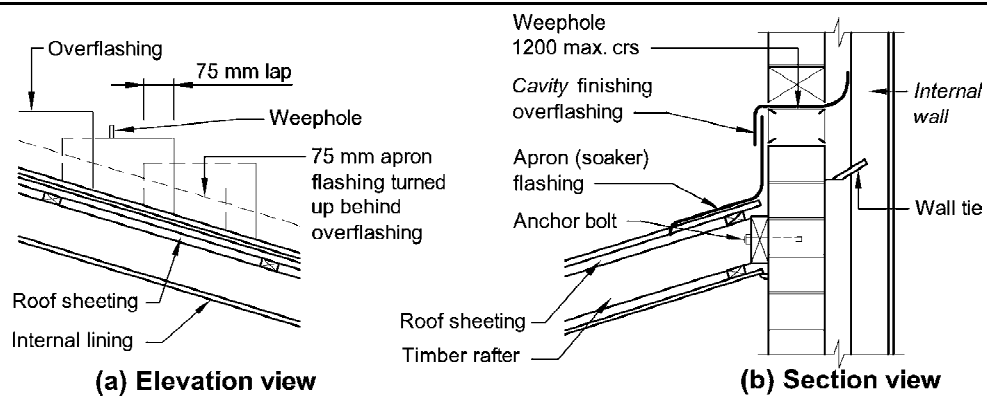

### 3.3.4.7 Location of flashings

A *flashing* must be provided—

- (a) where the *cavity* of a *cavity* masonry or masonry veneer wall is interrupted by a structural element (other than a wall tie), opening or the like; and
- (b) within the *cavity* where a roof abuts a *cavity* wall and an external masonry leaf or veneer becomes a wholly or partly internal wall; and
- (c) from an external masonry leaf or veneer onto an abutting roof; and
- (d) at the base of a *cavity* where—
  - (i) there is no other means of dispersing water from within the *cavity*; and
  - (ii) the external masonry has not been waterproofed in accordance with **3.3.4.12(a)**; and
- (e) from a masonry chimney onto the abutting roof.

### 3.3.4.8 Flashings at the base of cavity walls

A *flashing* at the base of a *cavity* masonry or masonry veneer wall—

- (a) in masonry veneer construction, must extend across the *cavity* and be turned up not less than 150 mm and fixed to the frame; and
- (b) in *cavity* masonry construction, must extend across the *cavity* and be turned up not less than 150 mm and built 30 mm into the inner masonry leaf; and
- (c) must have a continuous fall towards the outer leaf or veneer.

### 3.3.4.9 Sill and head flashing

- (a) A *flashing* above (head *flashing*) and below (sill *flashing*) an opening in a *cavity* wall—
  - (i) must extend not less than 100 mm past each side of the opening; and
  - (ii) must extend across the *cavity* and have a continuous fall towards the outer leaf or veneer.
- (b) A head *flashing*—
  - (i) in masonry veneer construction, must be turned up not less than 150 mm and fixed to the frame; and
  - (ii) in *cavity* masonry construction, must be turned up not less than 150 mm and built 30 mm into the inner leaf (see **Figure 3.3.4.5**).
- (c) A sill or head *flashing* may be omitted where the opening is protected by eaves or the like with a width of not less than three times the distance between the location of the *flashing* and the overhang (see **Figure 3.3.4.4**).

### 3.3.4.10 Flashings at a roof abutting a wall

- (a) For a *cavity* wall, an end or raked apron *flashing* must be installed where the external masonry leaf or veneer abuts a roof and must—
  - (i) follow the roof line, allowing not less than 75 mm upturn to the masonry and 150 mm in width for dressing or scribing onto the roof covering; and

- (ii) have a horizontal overflashing, stepped overflashing or raked overflashing built into the masonry leaf or veneer, except that one continuous *flashing* may be used as both an apron *flashing* or an overflashing; and
  - (iii) for parapets, be installed in accordance with **Figure 3.3.4.2**.
- (b) Where a roof abuts a *cavity* wall, and an external masonry leaf or veneer becomes wholly or partly an *internal wall*, a tray *flashing* must be installed in the *cavity* and—
  - (i) the tray *flashing* may be stepped to follow the rake of the roof provided that each tray *flashing* overlaps the one below by not less than 75 mm; and
  - (ii) the tray *flashing* must cover the vertical leg of the apron *flashing required* by (a) (see **Figure 3.3.4.6**).
- (c) For a single leaf masonry wall, an apron *flashing* onto an abutting roof must be not less than 150 mm in width for dressing or scribing onto the roof covering and must be—
  - (i) stepped to follow the rake of the roof; or
  - (ii) set not less than 30 mm into a groove cut into the masonry parallel and between 100–150 mm above the line of the roof covering.

### 3.3.4.11 Chimney flashings

- (a) *Flashings* to chimneys must consist of an apron, stepped overflashings, soaker *flashings* and a back gutter (see **Figure 3.3.4.3**).
- (b) The apron *flashing* must be turned up the masonry not less than 75 mm and be dressed over the roof covering not less than 150 mm and installed under the soaker *flashing* not less than 75 mm.
- (c) The soaker *flashings* must be turned up the masonry not less than 75 mm and be lapped over the roof covering not less than 150 mm and installed under the back gutter not less than 75 mm.
- (d) The back gutter must be turned up the masonry not less than 75 mm, be lapped under the roof covering not less than 150 mm and extend past the full width of the soaker *flashing*.
- (e) The stepped *flashings* must be built not less than 30 mm into the masonry and must completely cover the vertical leg of the apron *flashings*, soaker *flashings* and back gutter.

### 3.3.4.12 Weatherproofing for single skin masonry walls

- (a) A waterproof coating material must be applied to all external single skin masonry walls in accordance with the following:
  - (i) The coating must extend from the upper most exposed part of the wall—
    - (A) to a level adjacent the internal finished floor level, if the external blockwork overhangs the edge of the slab 10 mm; or
    - (B) 50 mm below the internal floor level if no edge overhang is provided to the blockwork (see **Figure 3.3.4.9**).
  - (ii) Acceptable external waterproof finishes are—
    - (A) three coats of 100% acrylic based exterior quality gloss paint; or
    - (B) one complete coat of cement based paint and two coats of 100% acrylic based exterior quality gloss paint; or
    - (C) clear water repellent, provided the wall is protected by a roof overhang.




- (b) *Windows* must be installed in accordance with **Figure 3.3.4.8**.
- (c) A *DPC* and vapour barrier or damp-proofing membrane must be installed in accordance with **Figure 3.3.4.9**.


**Limitation:**

**3.3.4.12** does not apply to a Class 10 building where in the particular case there is no necessity for compliance.

Figure 3.3.4.8

## TYPICAL WINDOW INSTALLATION DETAILS FOR SINGLE SKIN MASONRY

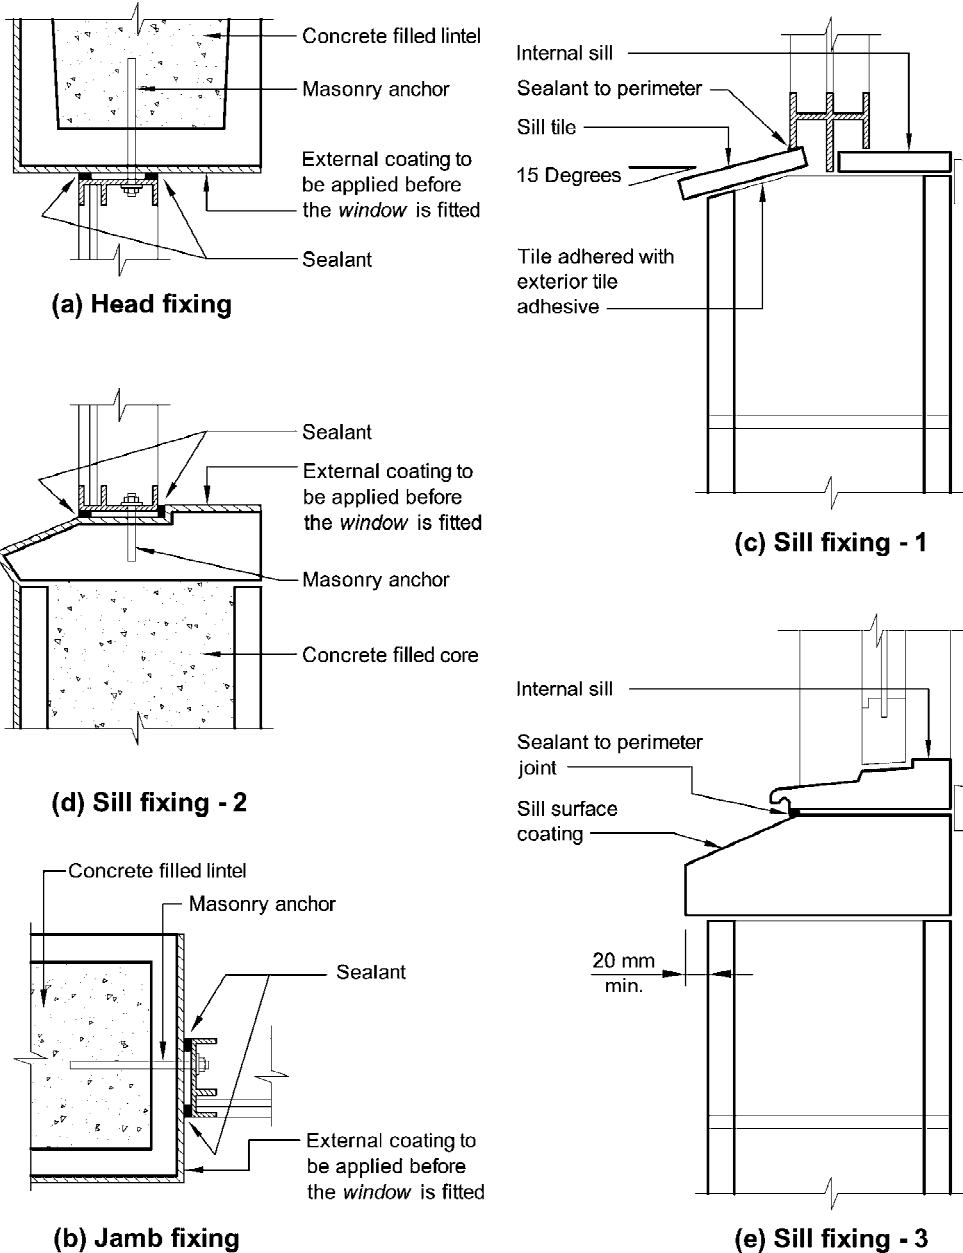

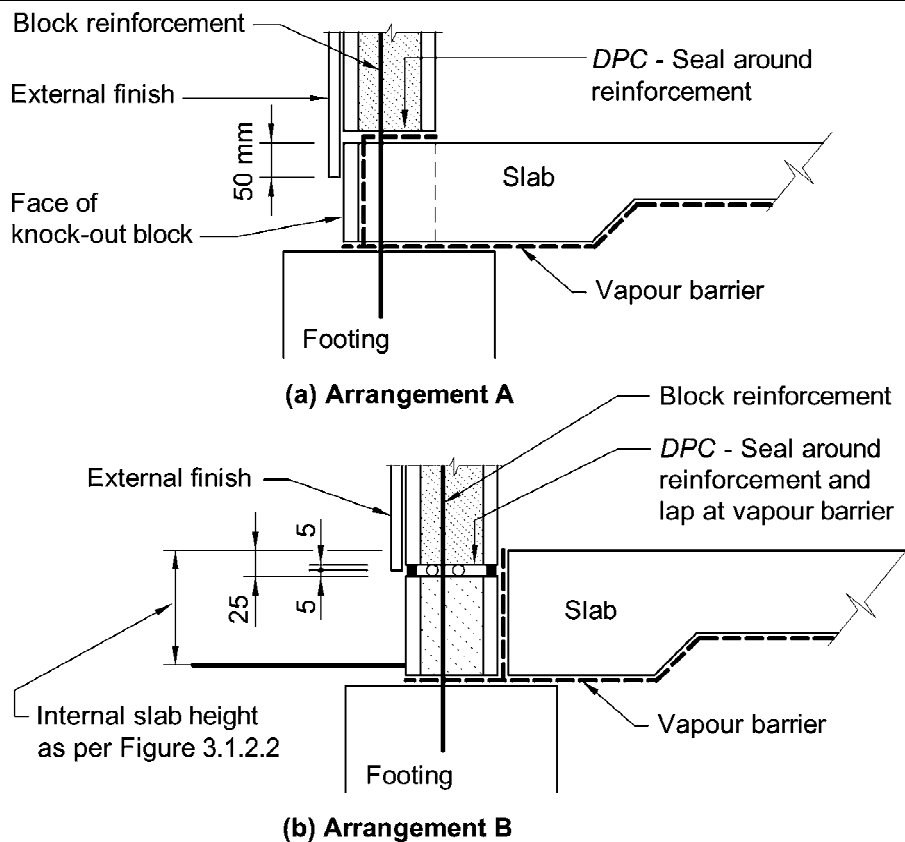**Figure 3.3.4.9****TYPICAL DPC AND WEATHERPROOFING DETAILS FOR SINGLE SKIN MASONRY**

---

## PART 3.3.5 EARTHWALL CONSTRUCTION

---

**This Part has deliberately been left blank.**

# PART 3.4

---

## FRAMING

- 3.4 Explanation of terms
- 3.4.1 Sub-floor ventilation
- 3.4.2 Steel framing
- 3.4.3 Structural steel members

## PART 3.4 CONTENTS

### PART 3.4 FRAMING

#### 3.4.0 Explanation of Terms

3.4.0.1 Explanation of terms

#### 3.4.1 Sub-Floor Ventilation

3.4.1.1 Application

3.4.1.2 Sub-floor ventilation

#### 3.4.2 Steel Framing

3.4.2.0 Acceptable construction manual

3.4.2.1 Application

3.4.2.2 General

3.4.2.3 Steel floor framing

3.4.2.4 \* \* \* \* \*

3.4.2.5 \* \* \* \* \*

3.4.2.6 Installation of services

#### 3.4.3 Timber Framing

3.4.3.0 Acceptable construction manual

3.4.3.1 \* \* \* \* \*

3.4.3.2 \* \* \* \* \*

3.4.3.3 \* \* \* \* \*

3.4.3.4 \* \* \* \* \*

3.4.3.5 \* \* \* \* \*

3.4.3.6 \* \* \* \* \*

3.4.3.7 \* \* \* \* \*

3.4.3.8 \* \* \* \* \*

#### 3.4.4 Structural Steel Members

3.4.4 Explanation of Terms

3.4.4.0 Acceptable construction manuals

3.4.4.1 Application

3.4.4.2 Structural steel members

3.4.4.3 Columns

3.4.4.4 Corrosion protection

## PART 3.4.0 EXPLANATION OF TERMS

## Explanation of terms

## 3.4.0.1

The following diagrams depict framing members and associated terminology used to describe them in the [Housing Provisions](#).

In most cases the terminology is applicable for both steel and timber frame members.


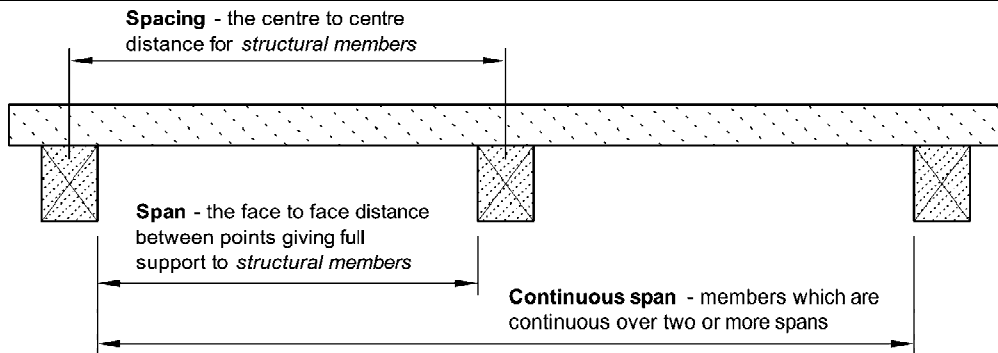
**Figure 3.4.0.1****SPAN AND SPACING TERMS**

Figure 3.4.0.2

## TYPICAL ROOF FRAMING MEMBERS


**Legend:**

1. Top plate
2. Ceiling joist
3. Collar tie
4. Rafter, common
5. Rafter, jack or crown end
6. Rafter, cripple creeper
7. Rafter, creeper
8. Rafter, valley creeper
9. Rafter, hip
10. Rafter, valley
11. Ridgeboard
12. Underpurlin
13. Roof strut
18. Broken hip

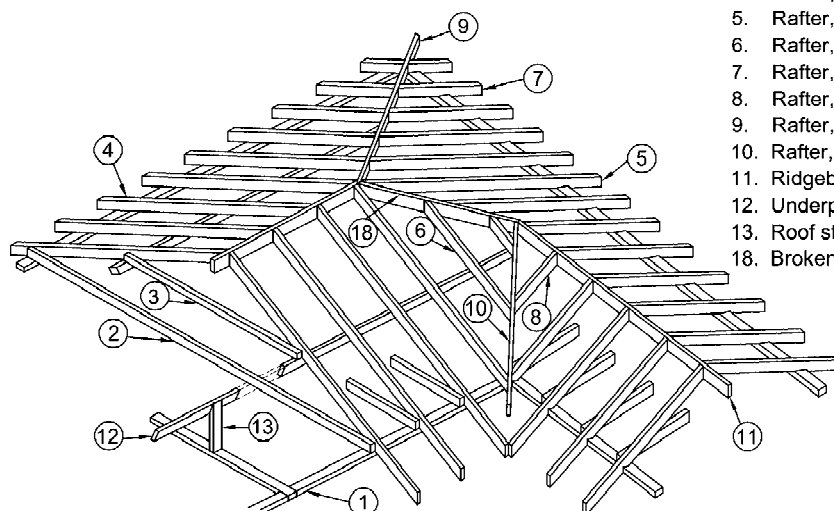

Figure 3.4.0.3

## TYPICAL WALL, FLOOR AND CEILING FRAMING MEMBERS

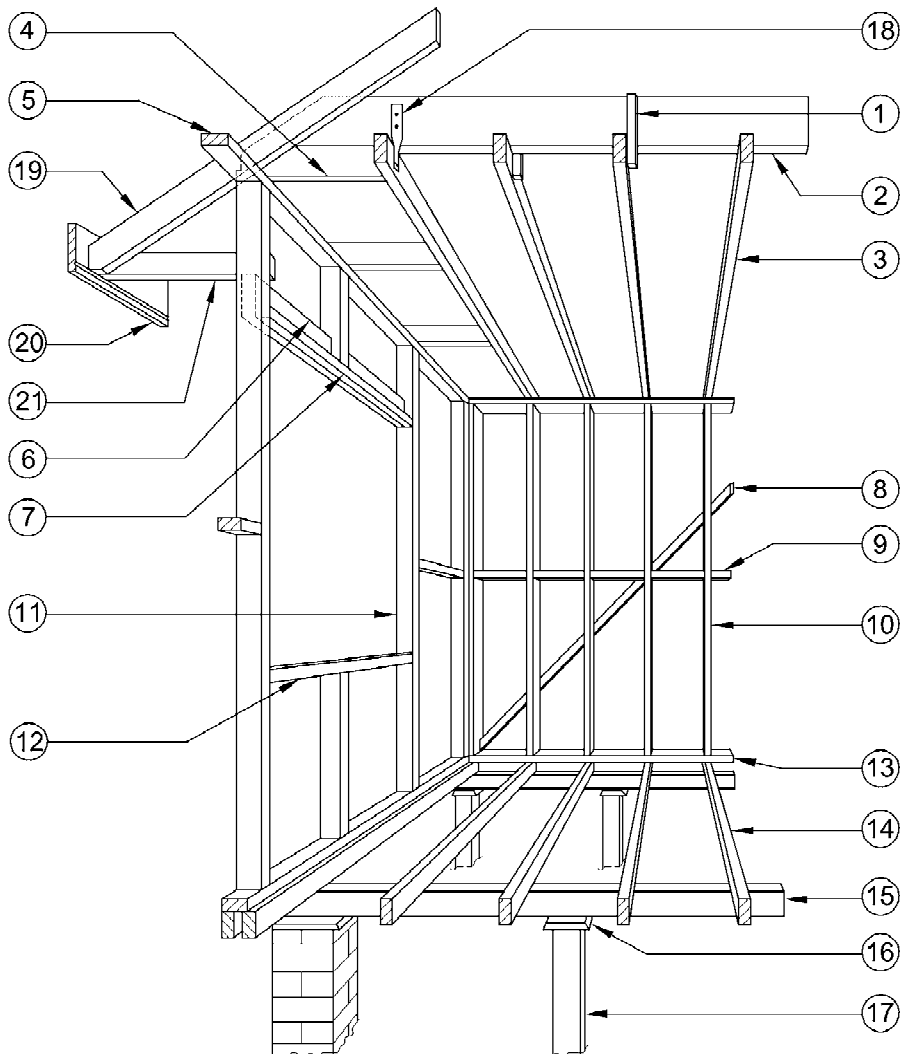

<b>Legend:</b>	1. Cleat	8. Brace	15. Bearer
	2. Hanging beam	9. Nogging	16. Termite shield
	3. Ceiling joist	10. Stud	17. Stump
	4. Jack joist	11. Jamb stud	18. Hoop iron strap
	5. Top wall plate	12. Sill trimmer	19. Rafter
	6. Lintel	13. Bottom wall plate	20. Fascia
	7. Ledger	14. Floor joist	21. Soffit bearer

## PART 3.4.1 SUB-FLOOR VENTILATION

### Appropriate *Performance Requirements*

Where an alternative sub-floor ventilation system is proposed as an *Alternative Solution* to that described in **Part 3.4.1**, that proposal must comply with—

- (a) *Performance Requirement P2.2.3*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### Acceptable construction practice

#### 3.4.1.1 Application

Compliance with this acceptable construction practice satisfies *Performance Requirement P2.2.3* for sub-floor ventilation.

#### 3.4.1.2 Sub-floor ventilation

The sub-floor space between a suspended floor of a building and the ground must be in accordance with the following:

- (a) The sub-floor space must—
  - (i) be cleared of all building debris and vegetation; and
  - (ii) be cross-ventilated by means of openings; and
  - (iii) contain no dead air spaces; and
  - (iv) be graded in accordance with **3.1.2.3**; and
  - (v) have evenly spaced ventilation openings in accordance with **Figure 3.4.1, Diagram a**.
- (b) In double leaf masonry walls, the cross ventilation openings specified in (a) must be provided in both leaves of the masonry, with inner-leaf openings being aligned with outer leaf openings to allow an unobstructed flow of air.
- (c) *Internal walls* constructed in sub-floor spaces must be provided with openings—
  - (i) having an unobstructed area equivalent to that *required* for the adjacent external openings; and
  - (ii) which are evenly distributed throughout such *internal walls*.
- (d) The clearance between the ground surface and the underside of the floor, must be in accordance with **Table 3.4.1.2**.
- (e) The sub-floor ventilation openings in *internal* and *external walls* must be in accordance with **Table 3.4.1.2** for the climatic zones given in **Figure 3.4.1.2**.

- (f) Where ventilation is obstructed by patios, paving or the like, additional ventilation must be provided to ensure that the overall level of ventilation is maintained.
- (g) Where the ground or sub-floor space is excessively damp or subject to frequent flooding, in addition to the requirements of (a) to (f)—
  - (i) the area of sub-floor ventilation *required* in (e) must be increased by 50%; or
  - (ii) a sealed impervious membrane must be provided over the ground; or
  - (iii) durability Class 1 or 2 timbers or H3 preservative treated timbers in accordance with AS 1684 Parts 2, 3 or 4.

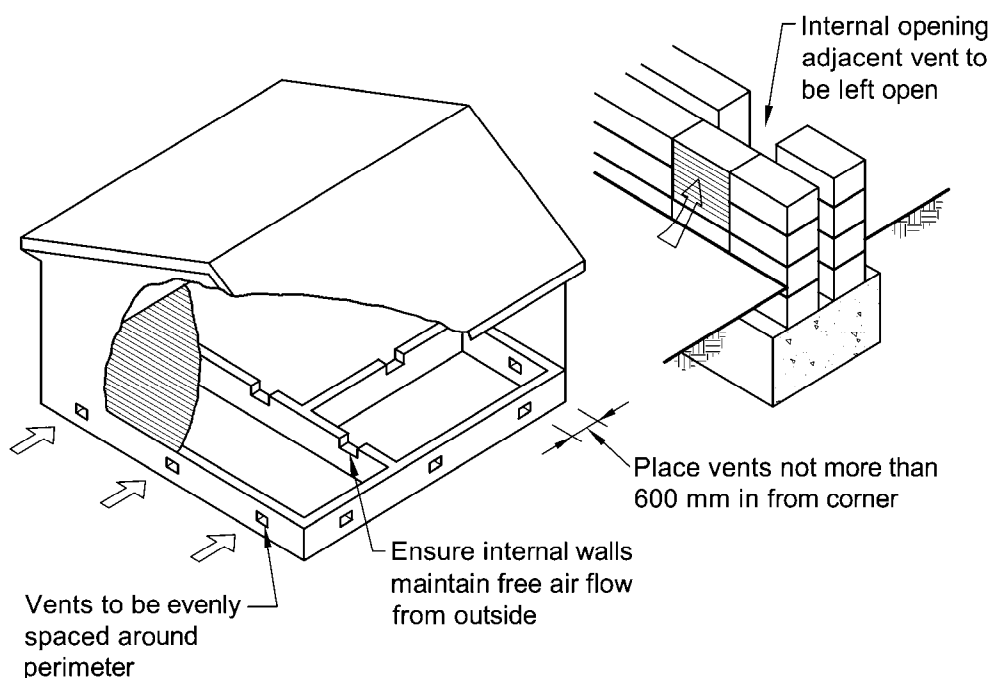
**Figure 3.4.1****TYPICAL SUB-FLOOR VENTILATION DETAILS****Diagram a. Typical Cross Ventilation of Sub-Floor Area**

Figure 3.4.1

## TYPICAL SUB-FLOOR VENTILATION DETAILS

## Note:

- (1) 400 mm clearance *required* only where termite barriers are installed that need to be inspected (see Part 3.1.3); and
- (2) On sloping *sites* the 400 mm clearance *required* by (1) may be reduced to 150 mm within 2 m of *external walls* in accordance with Diagram b.

Diagram b.

## Sub-Floor Clearance Requirements on a Sloping Site

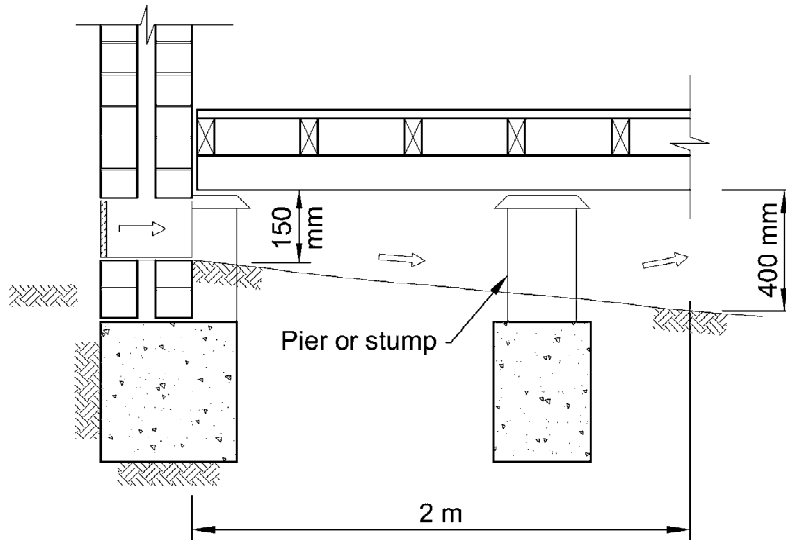


Figure 3.4.1.2

## CLIMATIC ZONES BASED ON RELATIVE HUMIDITY

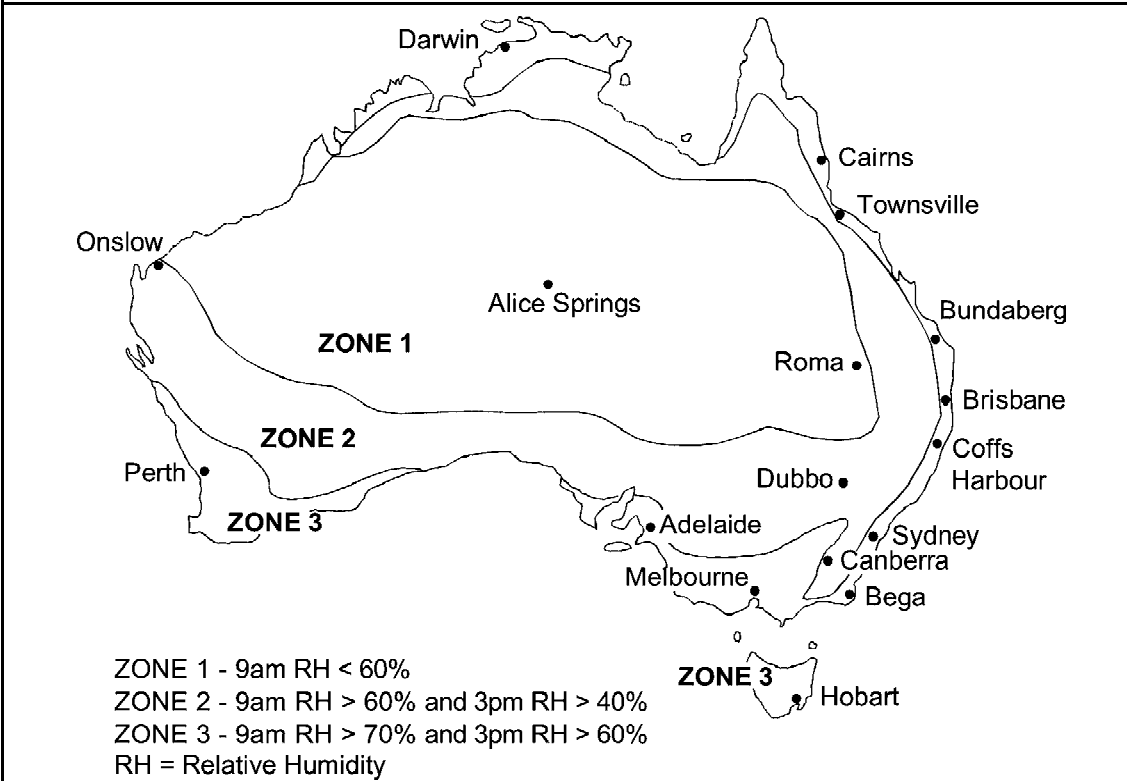


Table 3.4.1.2 SUB-FLOOR VENTILATION AND CLEARANCE

CLIMATE ZONE (see <a href="#">Figure 3.4.1.2</a> )	Minimum sub-floor ventilation (mm <sup>2</sup> /m of wall)		Minimum height from ground surface (mm)	
	No membrane	Ground sealed with impervious membrane	Termite inspection not required	Termite inspection required (see note)
1	2000	1000	150	400
2	4000	2000	150	400
3	6000	3000	150	400

**Note:**

On sloping [sites](#), 400 mm clearance may be reduced to 150 mm within 2 m of [external walls](#) in accordance with [Figure 3.4.1](#) Diagram b.

**Explanatory information:**

The amount of sub-floor ventilation [required](#) for a building is related to the relative humidity likely to be encountered in that location. [Figure 3.4.1.2](#) shows three broad climatic zones

based on the prevailing relative humidity and includes a description of the relative humidity conditions which define each zone. If reliable weather data is available, these descriptions may be useful in determining which zone a particular location is in.

The zones shown in **Figure 3.4.1.2** were determined by analysis of the average relative humidity at 9 am and 3 pm in January and July. The season with the highest relative humidity is used. Generally this will be July for southern Australia and January for northern Australia.

## PART 3.4.2 STEEL FRAMING

### Appropriate *Performance Requirements*

Where an alternative steel framing system is proposed as an *Alternative Solution* to that described in **Part 3.4.2**, that proposal must comply with—

- (a) *Performance Requirement P2.1*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### A. Acceptable construction manual

#### 3.4.2.0

*Performance Requirement P2.1* is satisfied for steel framing if it is designed and constructed in accordance with one of the following manuals:

- (a) AS 4100 — Steel structures.
- (b) AS/NZS 4600 — Cold-formed steel structures.
- (c) NASH — Residential and low-rise steel framing — Part 1 Design criteria.

### Explanatory information:

Design requirements for other materials used in combination with steel framing, including the use of concrete floors, heavy steel support beams etc. are described in **Part 3.11** — Structural design manuals; or **Part 3.4.4** for structural steel members.

### B. Acceptable construction practice

#### 3.4.2.1 Application

Compliance with this acceptable construction practice satisfies *Performance Requirement P2.1* for steel framing, provided—

- (a) the steel framing is designed and constructed in accordance with—
  - (i) AS/NZS 4600; or
  - (ii) NASH — Residential and low-rise steel framing — Part 1 Design criteria; and
- (b) the frame material has a yield stress of not less than 250 MPa.

#### 3.4.2.2 General

- (a) The steel frame must be protected from corrosion in accordance with the following:

- (i) Where the steel frame is within the building *envelope*, in locations—
    - (A) more than 300 m from *breaking surf*; or
    - (B) not in a heavy industrial area; or
  - (ii) Where the steel frame is outside the building *envelope* — in locations—
    - (A) more than 1 km from salt water which is not subject to *breaking surf*, such as a lake or protected bay; or
    - (B) more than 10 km from a coastal area with *breaking surf*; or
    - (C) not in a heavy industrial area,the steel frame must have a minimum coating class in accordance with AS 1397 of Z275 (275 grams of zinc per square metre) or AZ150 (150 grams of aluminium/zinc per square metre).
  - (iii) In areas not specified in (i) or (ii), a higher level of corrosion protection is *required*.
- (b) The frame must be permanently electrically earthed on completion of fixing.

**Explanatory information:**

The steel frame requirements of this Part should be considered in conjunction with steel frame design and construction advice from the manufacturer.

For the purpose of 3.4.2.2, the building *envelope* is deemed to be a space in the building where the steel frame does not have direct contact with the external atmosphere, other than for normal ventilation purposes. Examples of such locations are frames which are clad or lined on both sides or frames in masonry veneer construction. Areas not within the building *envelope* include floor framing members where there is no continuous perimeter sub-floor walling or verandah roof framing members with no ceiling lining.

Cut edges on framing components do not constitute a corrosion problem, as the surface area of the metallic coating on either side of the cut edge is far greater than the surface area of the cut edge itself.

Where hole cutting or cutting of members is *required*, cutting methods that clearly shear or leave clean edges are preferred over those that leave burred edges or swarf.

The adoption of appropriate brick cleaning measures will ensure no damage of any metal or metallic coated components, this would include the shielding of these components during the acid cleaning process. Channels to steel framing should be cleaned of mortar droppings.

Metallic coated steel should not come into contact with green wood containing acidic material or CCA treated timbers unless an impervious non-conductive material is located between the dissimilar elements. The use of kiln or appropriately dried timbers is recommended where contact between the metallic coated steel component and timber is considered.

### 3.4.2.3 Steel floor framing

The following provisions apply to suspended steel floor framing for single-storey and both floors of two-storey construction:

- (a) The two types of suspended floor systems referred to in 3.4.2.3 are—
  - (i) in-plane systems, such as joist-only systems or systems with integral bearers; and
  - (ii) conventional joist-over-bearer systems (see Tables 3.4.2.1 and 3.4.2.2 for acceptable sizes and spacings).



- (b) When used in ground floor construction, all such systems must be installed on stumps, piers or masonry footings complying with [Part 3.2](#). Conventional flooring can be installed on top of the floor frame.
- (c) Fibre cement packers or similarly durable and compatible materials may be used when packing is necessary under suspended flooring systems and must be at least the width of the member to ensure adequate bearing capacity.

**Table 3.4.2.1 SPANS FOR C-SECTION FLOOR JOISTS**

SPAN	SECTION	Maximum joist spacing (mm)	
		450	600
		Maximum span (m)	
Single span	C15012	2.7	2.7
	C15015	3.3	3.0
	C15019	3.6	3.3
	C20015	4.5	3.9
	C20019	4.8	4.2
	C20024	5.1	4.5
Continuous span	C15012	4.2	3.0
	C15015	4.5	4.2
	C15019	4.8	4.5
	C20015	5.4	4.8
	C20019	5.7	5.4
	C20024	6.0	5.7

**Explanatory information:**

The size of C-section steel members are identifiable by their description. For example, a C15012 is 150 mm deep and is made from 1.2 mm thick steel.


**Table 3.4.2.2 SPANS FOR C-SECTION BEARERS**

Steel Section	SINGLE SPAN					CONTINUOUS SPAN				
	Effective bearer spacing (m)					Effective bearer spacing (m)				
	1.8	2.4	3.0	3.6	4.2	1.8	2.4	3.0	3.6	4.2
	MAXIMUM SPAN OF BEARER (m)					MAXIMUM SPAN OF BEARER (m)				
C15015	2.2	2.1	1.9	1.8	1.7	2.7	2.5	2.4	2.3	2.1
C15019	2.4	2.2	2.0	1.9	1.8	2.9	2.7	2.5	2.4	2.2
C20015	2.9	2.7	2.4	2.1	1.8	3.4	2.7	2.4	2.1	1.8
C20019	3.1	2.9	2.7	2.5	2.4	3.8	3.5	3.3	3.2	3.0
C25019	3.6	3.4	3.2	3.0	2.6	4.6	3.8	3.4	3.0	2.6

Table 3.4.2.2 SPANS FOR C-SECTION BEARERS— continued

Steel Section	SINGLE SPAN					CONTINUOUS SPAN				
	Effective bearer spacing (m)					Effective bearer spacing (m)				
	1.8	2.4	3.0	3.6	4.2	1.8	2.4	3.0	3.6	4.2
	MAXIMUM SPAN OF BEARER (m)					MAXIMUM SPAN OF BEARER (m)				
C25024	3.9	3.7	3.4	3.3	3.0	4.8	4.6	4.2	4.1	3.8
<b>Note:</b> For the purpose of this Table: (a) Loads must be evenly distributed along the member. (b) Sections must be stiffened at end supports.										

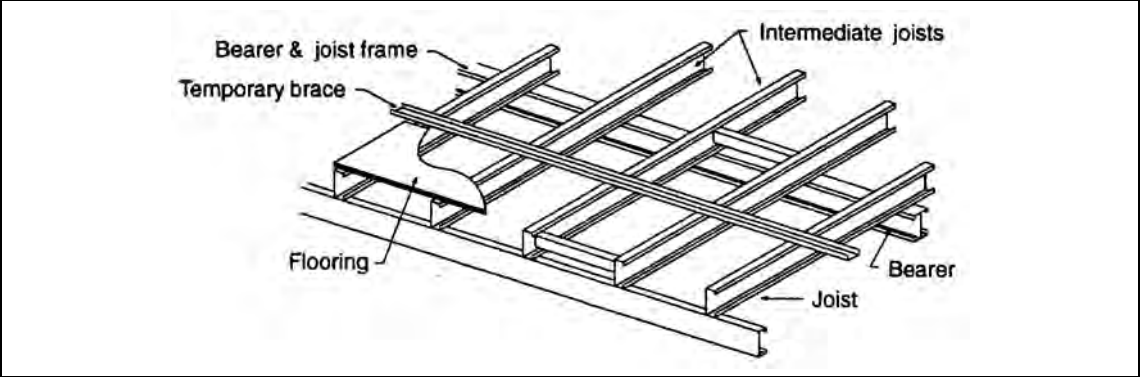Figure 3.4.2.1  
TYPICAL JOIST OVER BEARER FLOORING SYSTEM



3.4.2.4 \* \* \* \* \*

This clause has deliberately been left blank.

3.4.2.5 \* \* \* \* \*

This clause has deliberately been left blank.

3.4.2.6 Installation of services

To maintain the structural integrity of the frame, all ancillary work must be in accordance with the following:




- (a) Service penetrations in floor joists must comply with [Figure 3.4.2.8](#).
- (b) Plumbing pipe-work in steel framed construction must be run in the following ways:
  - (i) Pipe-work must be—
    - (A) run through pre-punched service holes in steel studs; and
    - (B) extra holes, where necessary, must be located near the centre-line of each stud provided—
      - (aa) the structural integrity of the member is not reduced; and

- (bb) the hole is not more than 10% larger than the existing holes.
- (ii) In masonry veneer construction, pipe runs may be located in the [cavity](#) and fixed to the studs with full pipe saddles and self drilling screws properly protected against galvanic corrosion in accordance with [\(v\)](#).
- (iii) In construction where external cladding is attached directly to the steel stud work, piping can be—
  - (A) installed over the ceiling; or
  - (B) suspended under the floor; or
  - (C) installed in accordance with [\(i\)](#).
- (iv) Plumbing fittings may be attached by—
  - (A) timber or steel noggings fitted between studs to support tap sets, baths and sinks; and
  - (B) where a steel nogging is used, the tap set must be isolated to prevent corrosion by a durable non-corrosive material such as timber, cement sheet etc. (see [Figure 3.4.2.7](#)).
- (v) Copper and brass pipes and fittings must be prevented from coming into contact with the steel frame by one of the following methods:
  - (A) Where plumbing services pass through service holes, plastic grommets must be snapped into the service hole.

**Explanatory information:**

The use of grommets also has the effect of securely fixing the pipe to prevent water hammer.

- (B) In other areas where copper pipes may come into contact with metal framing, they must be lagged or isolated with neoprene sheeting or tape.
- (c) Electrical cables must be—
  - (i) run through pre-punched service holes in steel studs (see [Figure 3.4.2.7](#)); or
  - (ii) secured to steel framing with—
    - (A) P clips; or
    - (B) plastic ratchet straps; or
    - (C) half saddles fixed with screws or rivets; and
  - (iii) extra holes, where necessary, must comply with [\(b\)\(i\)\(B\)](#); and
  - (iv) steel frames must be permanently earthed immediately after the frame is erected; and
  - (v) backing plates for switches and power points should be fixed at the appropriate positions with suitable fasteners. Where it is impractical to fix directly onto studwork, steel or timber noggings can be fitted between the studs to provide necessary fixing and support.

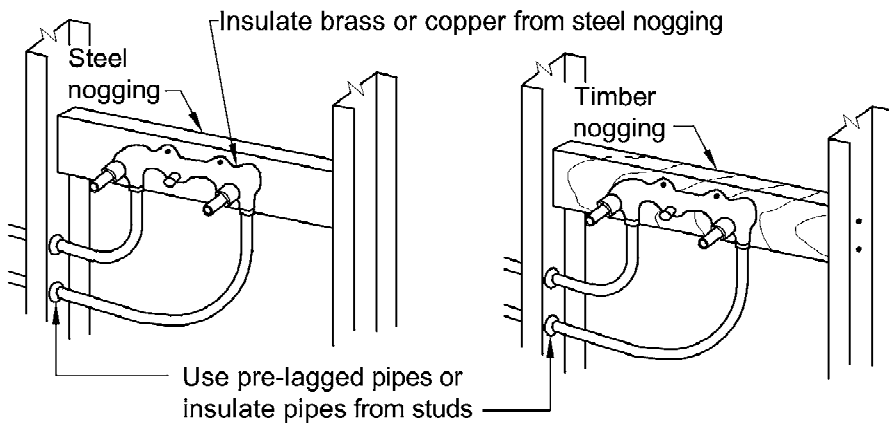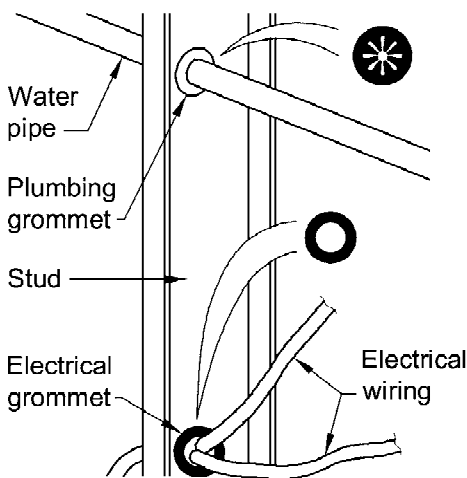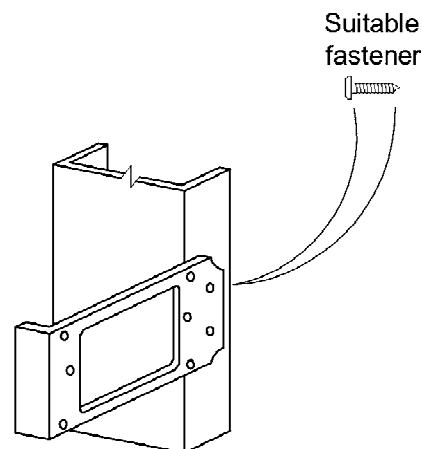**Figure 3.4.2.7****TYPICAL INSTALLATION AND FIXING OF SERVICES****(a) Steel nogging****(b) Timber nogging****(c) Grommet protection****(d) Switch and power point backing plate****Explanatory information:**

There are many different types of steel framing systems available. Each of these systems have unique design and installation requirements. Due to this diversity, there are no generic examples of acceptable construction practice for steel wall and roof framing. Accordingly, the design of these systems must be in accordance with the appropriate acceptable construction manual in [3.4.2.0](#).

Some of the important elements of steel frame design are contained in the following information.

**Wall framing**

Frames are either in rigid or adjustable form. In the case of rigid frames, minor irregularities in flooring are accommodated by packing.

With adjustable frames, the tensioner assembly on the bracing can usually be adjusted to accommodate these irregularities. After tensioning, bracing straps should be securely fixed to each stud and nogging.

Long runs of external walling may have to be temporarily braced, until the roof members have been fixed. This can be carried out by using lengths of steel, timber or roof battens fixed to the top of the studs and secured to the ground or floor, as temporary props.

Further construction stage bracing may be required to be installed before roof cladding commences. This is required to prevent side sway of the building during construction.

Construction bracing should be provided in the following minimum percentage of *required* vertical bracing:

40% single-storey slab-on-ground buildings;

40% upper-storey of buildings with suspended floors; and

50% lower-storey of two storey construction.

#### Roof framing

Trusses and rafters are fixed in accordance with the design details. Generally, the roof members are fixed to the wall structure using conventional building methods.

The fixings may incorporate nails, self-drilling screws, bolts and nuts or shear plate connectors. The fixings should be adequate to ensure that a continuous load path exists from the roof to the foundations for all types of loading including uplift, downward and shear loading.

Temporary roof bracing is generally achieved using one run of roof battens along the full length of the house. It is preferable if the run nearest the roof apex is used for this purpose and fixed as each truss is properly positioned. Next, one run of ceiling battens should be positioned and fitted. This should preferably be the batten run nearest the centre of the building.

Where ceiling battens are not used a bottom chord tie should be installed in accordance with the design details.

Wind bracing should be attached when all trusses have been erected and fixed. Generally all gable roofs and long hipped roofs require bracing in the roof plane. The strap bracing is installed similar to wall bracing and runs from the apex of the roof to the external wall, over the top of at least three trusses or rafters, at approximately 45° to the *external walls*. The bracing is fixed at the ends, tensioned and fixed to each intermediate truss or rafter.

#### Connections for steel framing

The following fasteners and connections are acceptable for the assembly and erection of steel framed houses:

**Bolts:** Bolted connections are used as a means of on-site jointing, particularly where joints are highly loaded and offer a consistent design strength. Bolt design for cold-formed sections is adequately covered in the Australian Standards.

**Rivets:** Rivetted connections (either pre-drilled or self-piercing) are used for both factory and on-site fabrication and have also been used as elements of proprietary joining systems.

**Screw:** Self-drilling screws are widely used as a means of connection in almost every aspect of on-site work during the erection of steel framed houses. They are used for connecting wall frame modules, through to attachment of claddings and internal linings.

**Adhesives:** Adhesives are used in steel framing for attachment of internal linings, including flooring. They are generally used in combination with mechanical fasteners such as self-drilling screws. The screws are primarily used to fasten the linings while the adhesives set, although they continue to act as part of a composite fastening system.


**Clinches:** Clinching involves the connection of two thicknesses of sheet steel by extruding one sheet into the other using a punch and die, in such a way that the two pieces cannot be subsequently separated. A typical clinched joint used in factory fabrication is usually hydraulically activated whereas clinching systems used on-site are typically pneumatic or electrically driven.

**Welds:** Welding (typically Mig) has been the most common form of connection during factory assembly for many years. The welded joint strength can vary and the metallic coating is affected in the weld area, the affected area will require post-painting (cold galvanising).

**Nails:** Hard steel twist nails are used in steel framing for both factory and on-site fabrication. These nails can be used in materials up to 2 mm thick. Nails have also been used for the connection of wall plates to concrete slabs. Where this is done by hand, a timber starter block is normally used. More recently, power actuated nails have been used.

**Figure 3.4.2.8**

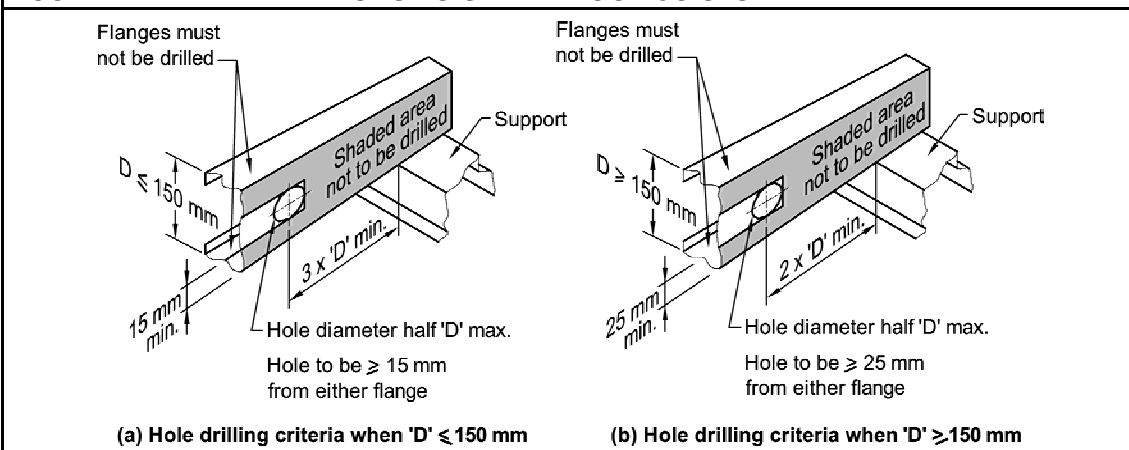**ACCEPTABLE PENETRATIONS TO STEEL FLOOR JOISTS**



## PART 3.4.3 TIMBER FRAMING

### Appropriate *Performance Requirements*

Where an alternative timber framing design is proposed as an *Alternative Solution* to that described in **Part 3.4.3**, that proposal must comply with—

- (a) *Performance Requirement P2.1*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### A. Acceptable construction manual

#### 3.4.3.0

*Performance Requirement P2.1* is satisfied for a timber frame if it is designed and constructed in accordance with one of the following manuals:

- (a) \* \* \* \* \*
- (b) \* \* \* \* \*
- (c) \* \* \* \* \*
- (d) \* \* \* \* \*
- (e) \* \* \* \* \*
- (f) \* \* \* \* \*
- (g) AS 1684.2 — Residential timber-framed construction — Non-cyclonic areas.
- (h) AS 1684.4 — Residential timber-framed construction — Simplified — Non-cyclonic areas.

### STATE AND TERRITORY VARIATIONS

In Queensland after 3.4.3.0(h) insert Qld 3.4.3.0(i) as follows:

#### Qld 3.4.3.0(i) Timber Species

- (i) Timber Species

In addition to subclauses (a) to (h) above, timber used for structural purposes must be a species scheduled for the appropriate use in Schedules A, B or C in Queensland Forest Service of the Department of Primary Industries Construction timbers in Queensland - Properties and specifications for satisfactory performance of construction timbers in Queensland - Class 1 and 10 buildings (Houses, carports, garages, greenhouses and sheds).

**Explanatory information:**

1. Design requirements for other materials used in combination with timber framing, including the use of concrete floors, heavy steel support beams etc. are described in [Part 3.11](#) — Structural design manuals; or [Part 3.4.4](#) — Structural steel members.
2. For additional construction requirements in [high wind areas](#) (ie >N3), see [Part 3.10.1](#).

**B. Acceptable construction practice****3.4.3.1 \* \* \* \* \***

This clause has deliberately been left blank.

**3.4.3.2 \* \* \* \* \***

This clause has deliberately been left blank.

**3.4.3.3 \* \* \* \* \***

This clause has deliberately been left blank.

**3.4.3.4 \* \* \* \* \***

This clause has deliberately been left blank.

**3.4.3.5 \* \* \* \* \***

This clause has deliberately been left blank.

**3.4.3.6 \* \* \* \* \***

This clause has deliberately been left blank.

**3.4.3.7 \* \* \* \* \***

This clause has deliberately been left blank.

**3.4.3.8 \* \* \* \* \***

This clause has deliberately been left blank.



PART 3.4.4 STRUCTURAL STEEL MEMBERS

Appropriate *Performance Requirements*


Where an alternative structural steel member system is proposed as an *Alternative Solution* to that described in **Part 3.4.4**, that proposal must comply with—

- (a) *Performance Requirement P2.1*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

Explanation of Terms

3.4.4

The following terms are used in this Part:

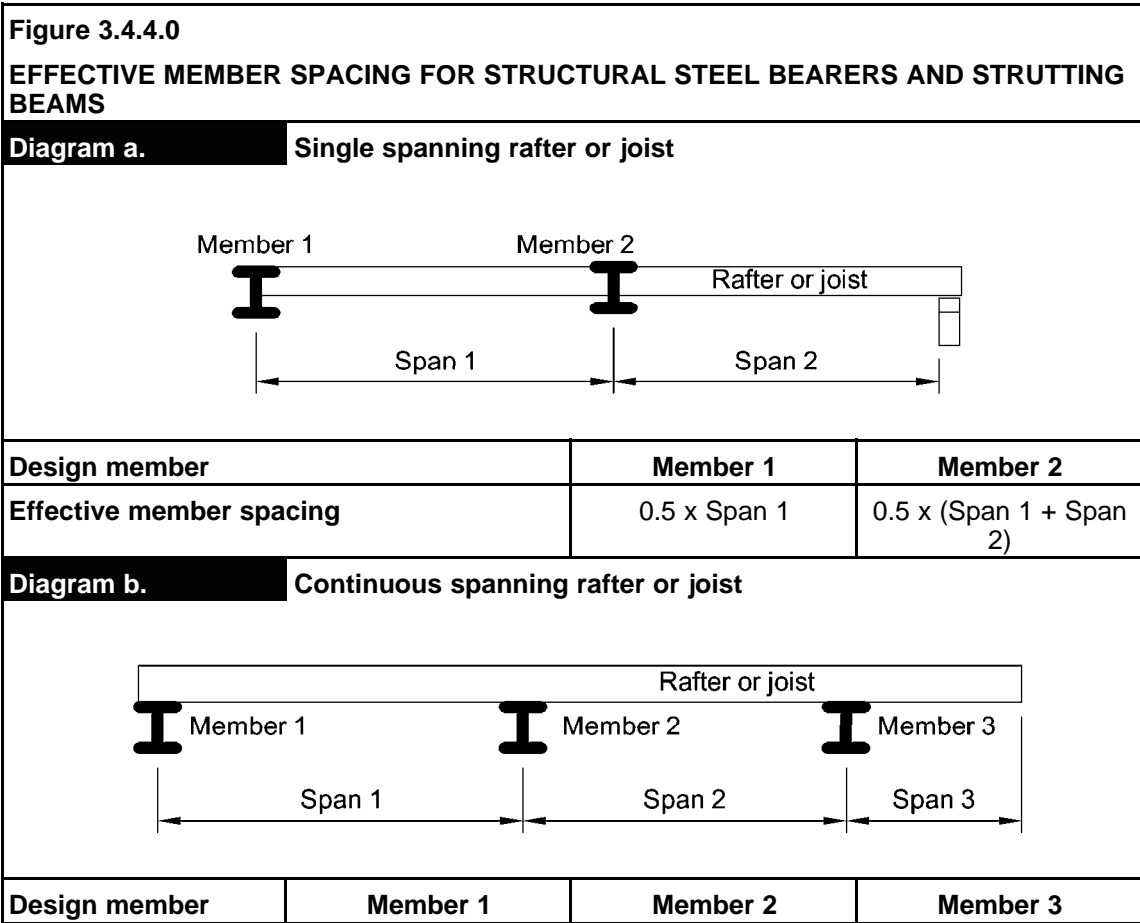

**Figure 3.4.4.0****EFFECTIVE MEMBER SPACING FOR STRUCTURAL STEEL BEARERS AND STRUTTING BEAMS**

<b>Effective member spacing</b>	0.4 x Span 1	0.6 x (Span 1 + Span 2)	0.5 x (Span 2) + Span 3
---------------------------------	--------------	-------------------------	-------------------------

Steel member abbreviations are as follows:

**TFB** means a tapered flange beam.

**UB** means a universal beam.

**RHS** means a rectangular hollow section.

**PFC** means a parallel flange channel.

**TFC** means a tapered flange channel.

**EA** means an equal angle.

**UA** means an unequal angle.

**SHS** means a square hollow section.

**CHS** means a circular hollow section.

**A. Acceptable construction manuals****3.4.4.0**

*Performance Requirement P2.1* is satisfied for structural steel sections if they are designed and constructed in accordance with one of the following manuals:

- (a) AS 4100 — Steel structures.
- (b) AS/NZS 4600 — Cold-formed steel structures.

**Explanatory information:**

Design requirements for other materials used in combination with structural steel members are described in [Part 3.4.2](#), [3.4.3](#) or [Part 3.11](#) — Structural design manuals.

**B. Acceptable construction practice****3.4.4.1 Application**

- (a) Compliance with this acceptable construction practice satisfies [P2.1](#) in respect to structural stability, provided—
  - (i) the building is located in an area with a *design wind speed* of not more than N3; and

**Explanatory information:**

1. Information on *design wind speeds* for particular areas may be available from the *appropriate authority*.
2. A map indicating cyclonic regions of Australia is contained in **Part 3.10.1**.

- (ii) the first dimension of steel sections is installed vertically; and
- (iii) all loads are uniformly distributed (unless otherwise noted or allowed for); and
- (iv) for earthquake design, the building is defined as a design category H1 or H2 domestic structure in accordance with AS 1170.4 (1993); and

**Explanatory information:**

1. This covers all *sites* except those identified by the site investigation as having soft soil (having a soil profile with more than 5 m of soft clay, loose sand, silt or uncontrolled fill) as defined by AS 1170.4 (1993).
2. For earthquake design H3, see **Part 3.10.2**.

- (v) the structural steel member is not subject to snow loads.
- (b) Compliance with **3.4.4.4** satisfies **P2.1** in respect to corrosion protection requirements.

**3.4.4.2 Structural steel members**

- (a) Structural steel members may be used as follows:
  - (i) Bearers supporting a timber floor or non-*loadbearing* stud wall — in accordance with **Figure 3.4.4.1**.
  - (ii) Strutting beams supporting roof and ceiling loads — in accordance with **Figure 3.4.4.2**.
  - (iii) Lintels supporting roof, ceiling, frame and timber floor — in accordance with **Figure 3.4.4.3**.
  - (iv) Columns — in accordance with **3.4.4.3**.
- (b) Structural steel members described in this Part must be protected against corrosion in accordance with **3.4.4.4**.
- (c) Joists, bearers and lintels must be restrained from lateral movement or twisting along their length by fixing rafters or joists to the top flange of the member so that it prevents that member from moving laterally.
- (d) End supports for joists, bearers and lintels must transfer loads to the footings and have a bearing distance as follows:
  - (i) For single spans, the bearing distance must not be less than the width of the member.
  - (ii) For continuous spans, internal bearing must be not less than 2 times the width of the member.

Figure 3.4.4.1

## BEARER SUPPORTING A TIMBER FLOOR AND NON-LOADBEARING STUD WALL

Bearer connection examples

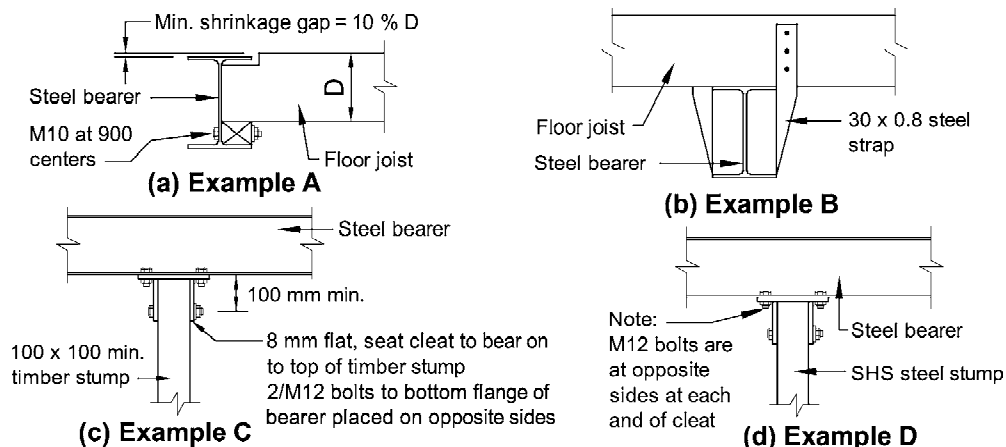


Table a. — Acceptable bearer spans

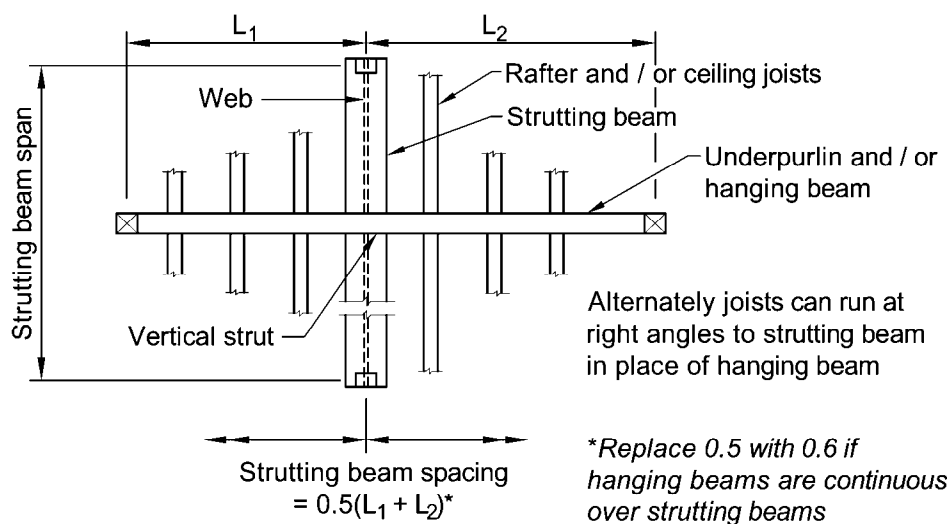
Steel section	SINGLE SPAN					CONTINUOUS SPAN				
	<i>Effective bearer spacing (m)</i>					<i>Effective bearer spacing (m)</i>				
	1.8	2.4	3.0	3.6	4.2	1.8	2.4	3.0	3.6	4.2
	MAXIMUM SPAN OF BEARER (M)					MAXIMUM SPAN OF BEARER (M)				
125TFB	4.1	3.8	3.6	3.4	3.2	4.7	4.3	3.8	3.5	3.2
180UB16.1	5.1	4.7	4.5	4.3	4.1	5.9	5.5	5.2	5.0	4.7
200UB18.2	5.6	5.2	5.0	4.7	4.6	6.5	6.0	5.7	5.5	5.3
250UB25.7	6.8	6.4	6.0	5.8	5.6	7.9	7.4	7.0	6.7	6.4
250x150x9.0 RHS	7.7	7.1	6.7	6.4	6.2	8.8	8.2	7.8	7.4	7.1
250x150x5.0 RHS	6.8	6.3	5.9	5.7	5.5	7.8	7.2	6.8	6.5	6.3
310UB32.0	7.9	7.3	7.0	6.7	6.4	9.1	8.5	8.1	7.7	7.4
125x75x2.0 RHS	3.1	2.8	2.6	2.5	2.4	4.0	3.7	3.5	3.3	3.1
125x75x3.0 RHS	3.5	3.2	3.0	2.8	2.7	4.4	4.1	3.9	3.7	3.5
150x50x2.0 RHS	3.4	3.1	2.8	2.7	2.5	4.2	3.9	3.7	3.5	3.4
150x50x3.0 RHS	3.7	3.4	3.2	3.0	2.9	4.6	4.3	4.1	3.9	3.7
100TFC	3.2	2.9	2.7	2.6	2.4	3.7	3.2	2.8	2.6	2.4
150PFC	4.8	4.5	4.2	4.0	3.9	5.5	5.1	4.9	4.7	4.5
180PFC	5.4	5.1	4.8	4.6	4.4	6.3	5.9	5.6	5.3	5.1
200PFC	5.9	5.5	5.2	5.0	4.8	6.8	6.3	6.0	5.7	5.5
250PFC	7.2	6.7	6.4	6.1	5.9	8.4	7.8	7.4	7.1	6.8
300PFC	8.1	7.6	7.2	6.9	6.6	9.4	8.8	8.3	8.0	7.7

Figure 3.4.4.1

**BEARER SUPPORTING A TIMBER FLOOR AND NON-LOADBEARING STUD WALL****Note:**

1. Steel is base grade.
2. Load must be evenly distributed along the member.
3. For continuous floor bearers, the variation in span length should not be more than 10%.
4. See 3.4.2.3 for provisions that apply to suspended floors in single-storey and ground floor construction of suspended steel floor frames.
5. Effective bearer spacing is a measure of the width of the load area being supported by the member (see Figure 3.4.4.0).

Figure 3.4.4.2

**STRUTTING BEAM SUPPORTING A ROOF AND CEILING****Strutting beam application****Table a. — Acceptable strutting beam spans**

Steel section	STEEL SHEET ROOF					TILED ROOF				
	Strutting beam spacing (m)					Strutting beam spacing (m)				
	1.8	2.4	3.0	3.6	4.2	1.8	2.4	3.0	3.6	4.2
	MAXIMUM SPAN OF STRUTTING BEAM (M)					MAXIMUM SPAN OF STRUTTING BEAM (M)				
125TFB	5.7	5.4	5.1	4.9	4.6	4.9	4.6	4.4	4.2	4.1
150UB14.0	6.4	6.0	5.7	5.4	5.1	5.5	5.2	4.9	4.7	4.5
200UB18.2	7.9	7.4	7.1	6.8	6.5	6.9	6.4	6.1	5.8	5.6
250UB31.4	10.0	9.4	9.0	8.7	8.4	8.8	8.2	7.8	7.5	7.2
310UB46.2	11.9	11.3	10.8	10.5	10.1	10.6	10.0	9.5	9.1	8.8

Figure 3.4.4.2

**STRUTTING BEAM SUPPORTING A ROOF AND CEILING**

<b>100TFC</b>	4.6	4.4	4.2	3.9	3.7	4.0	3.7	3.6	3.4	3.2
<b>150PFC</b>	6.7	6.3	6.0	5.8	5.6	5.8	5.5	5.2	5.0	4.8
<b>200PFC</b>	8.2	7.7	7.4	7.1	6.8	7.2	6.7	6.4	6.1	5.9
<b>250PFC</b>	10.0	9.4	9.0	8.7	8.4	8.8	8.2	7.8	7.5	7.3
<b>300PFC</b>	11.1	10.5	10.1	9.7	9.4	9.8	9.3	8.8	8.4	8.2

**Note:**

1. If point load applied, then it should be located within the middle third of the strutting beam span.
2. Top and bottom flanges of strutting beam must be laterally restrained at the loading point.
3. Strutting beam must be tied down at the support points, in the case of steel sheet roofs.
4. Steel is base grade.

Figure 3.4.4.3

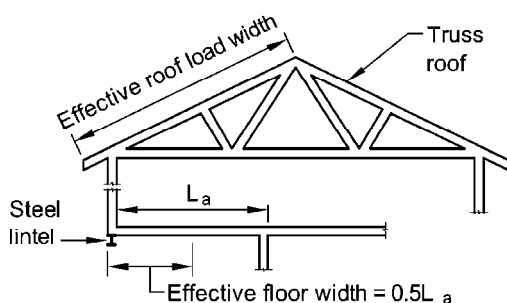
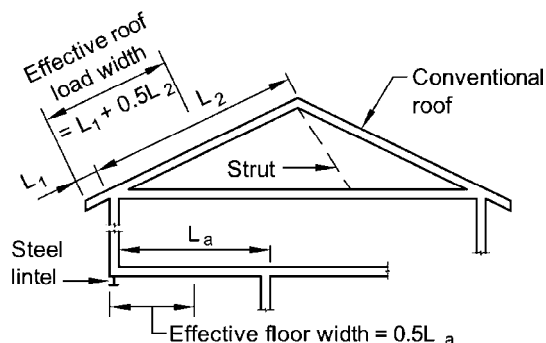
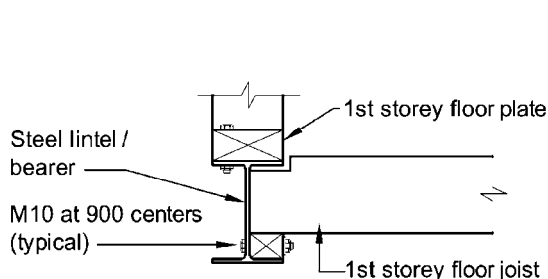
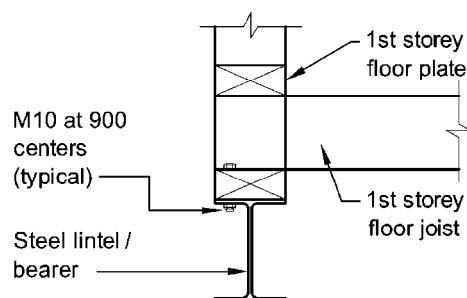
**LINTELS SUPPORTING ROOF, FRAMES AND TIMBER FLOORS****Lintels supporting roof and floors****(a) Floor and truss roof****(b) Floor and conventional roof****(c) Floor - example A****(d) Floor - example B**

Figure 3.4.4.3

## LINTELS SUPPORTING ROOF, FRAMES AND TIMBER FLOORS

Table a. — Acceptable spans for lintels

Steel section	STEEL SHEET ROOF					TILED ROOF				
	<i>Effective load width (m)</i>					<i>Effective load width (m)</i>				
	1.8	2.4	3.0	3.6	4.2	1.8	2.4	3.0	3.6	4.2
	MAXIMUM SPAN OF LINTEL (M)					MAXIMUM SPAN OF LINTEL (M)				
125TFB	3.7	3.4	3.2	3.0	2.8	3.6	3.3	3.0	2.9	2.7
150UB14.0	4.1	3.9	3.7	3.5	3.3	4.0	3.7	3.5	3.3	3.2
200UB25.4	5.6	5.3	5.0	4.8	4.7	5.4	5.1	4.8	4.6	4.5
250UB31.4	6.6	6.2	5.9	5.7	5.5	6.3	6.0	5.7	5.4	5.2
100TFC	2.8	2.6	2.4	2.3	2.1	2.7	2.5	2.3	2.1	2.0
150PFC	4.4	4.1	3.9	3.7	3.6	4.2	3.9	3.7	3.6	3.4
200PFC	5.4	5.0	4.8	4.6	4.4	5.1	4.8	4.6	4.4	4.2
250PFC	6.6	6.2	5.9	5.7	5.5	6.3	6.0	5.7	5.4	5.3
75x75x5EA	1.3	1.2	1.1	—	—	1.3	1.1	—	—	—
90x90x6EA	1.9	1.6	1.5	1.3	1.2	1.7	1.5	1.4	1.3	1.2
100x100x6EA	2.0	1.8	1.6	1.5	1.4	1.9	1.7	1.5	1.4	1.3
125x75x6UA	2.3	2.0	1.8	1.7	1.5	2.2	1.9	1.7	1.6	1.4
150x100x10UA	3.9	3.6	3.2	2.9	2.7	3.7	3.3	3.0	2.8	2.6

## Note:

1. Top flange of lintel must be laterally restrained at the loading points.
2. Load must be evenly distributed along the member, eg joists.
3. Angle lintels — first dimension corresponds to vertical leg, eg 100x75x6UA, 100 mm leg is vertical.
4. For lintels supporting masonry walls, see [Part 3.3.3](#).

## 3.4.4.3 Columns

Columns may support the area provided for in [Table 3.4.4.1](#) provided—

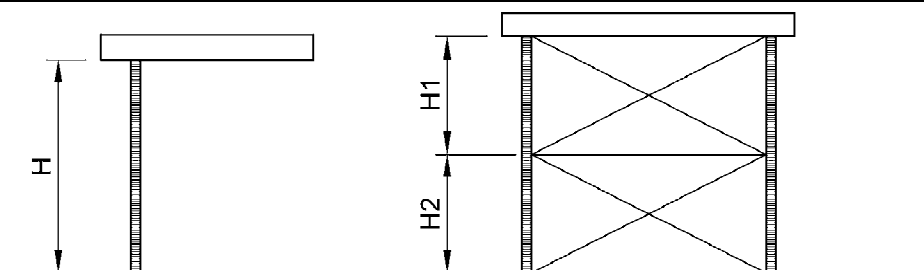
- (a) the effective height of the column is determined in accordance with [Figure 3.4.4.4](#); and
- (b) the floor area to be supported is determined in accordance with [Figure 3.4.4.5](#); and
- (c) the load eccentricity between the centre of the column and the applied vertical loading complies with [Figure 3.4.4.6](#).

**Figure 3.4.4.4****DETERMINING EFFECTIVE COLUMN HEIGHT**

**Note:** For the purposes of this Figure, to determine the column effective height, the actual column height (H) in Diagram a. must be multiplied by a column height factor (F1) in Table a.

**Diagram a.** Column height (H)

**Note:** H = Distance measured from the top of footing to underside of supported beam or bearer, or between intermediate lateral bracing points.

**Table a. Column height factor (F1)**

BASE DETAIL	BRACING SYSTEM	
	Fully Braced <sup>(1)</sup> Construction	Unbraced Construction (cantilever columns) <sup>(2)</sup>
Cast into footing	1.00	2.60
Fixed by bolts to footing or slab	1.20	must not be used
Fixed by intermediate floor or bracing in both directions	1.20	2.60

**Note:**

The flooring system must be fully braced to footing level by—

1. a combination of column bracing sets, and timber or masonry bracing walls; or
2. the provision of cantilever steel columns only (ie no column bracing sets, timber or masonry bracing walls).

**Figure 3.4.4.5****DETERMINING FLOOR AREA SUPPORTED**

**Note:** The total area supported depends on the position of the column in the structure as shown in Diagram a. To calculate the correct area supported by a column, match the column's position with those shown in Diagram a. which shows a plan view of a floor and then calculate the total area supported from Table a.

Diagram a.	AREA SUPPORTED BY COLUMNS (Plan view)	Table a.	AREA SUPPORTED BY COLUMNS
------------	--	----------	---------------------------



Figure 3.4.4.5

## DETERMINING FLOOR AREA SUPPORTED

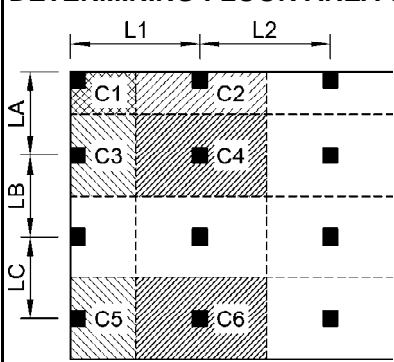
	COLUMN	TOTAL AREA SUPPORTED
	C1	$0.375L1 \times 0.375LA$
	C2	$0.625(L1 + L2) \times 0.375LA$
	C3	$0.375L1 \times 0.625(LA + LB)$
	C4	$0.625(L1 + L2) \times 0.625(LA + LB)$
	C5	$0.375L1 \times (L \text{ cant} + 0.5LC)$
	C6	$0.625(L1 + L2) \times (L \text{ cant} + 0.5LC)$

Figure 3.4.4.6

## ACCEPTABLE LOAD ECCENTRICITY FOR COLUMNS

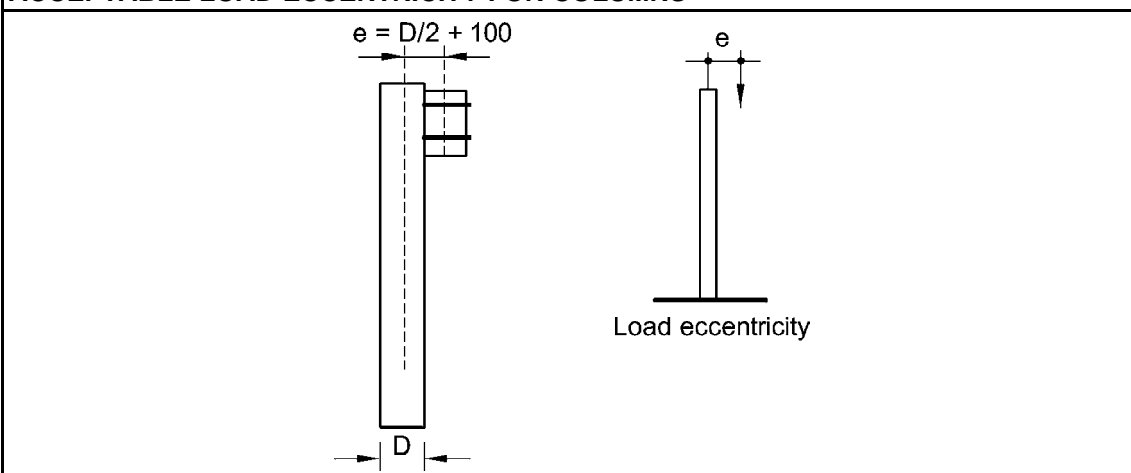


Table 3.4.4.1 COLUMNS

## COLUMNS – SUPPORTING TIMBER FLOOR ONLY

**Note:** Tabulated values are the columns sections to be used.

COLUMN EFFECTIVE HEIGHT (mm)		FLOOR AREA SUPPORTED (m <sup>2</sup> )				
		5	10	15	20	25
CHS C250	600	60.3 x 3.6	88.9 x 4.0	101.6 x 5.0	114.3 x 5.4	139.7 x 5.0
	1200	60.3 x 4.5	88.9 x 4.0	101.6 x 5.0	114.3 x 5.4	139.7 x 5.0
	1800	60.3 x 4.5	88.9 x 4.0	101.6 x 5.0	114.3 x 5.4	139.7 x 5.0
	2400	60.3 x 4.5	88.9 x 4.0	101.6 x 5.0	114.3 x 5.4	139.7 x 5.0
	3600	76.1 x 3.6	101.6 x 4.0	114.3 x 4.5	139.7 x 5.0	139.7 x 5.0

Table 3.4.4.1 COLUMNS— continued

<b>CHS C350</b>	600	60.3 x 2.9	88.9 x 2.6	101.6 x 3.2	114.3 x 3.6	139.7 x 3.5
	1200	60.3 x 2.9	88.9 x 2.6	101.6 x 3.2	114.3 x 3.6	139.7 x 3.5
	1800	60.3 x 2.9	101.6 x 2.6	114.3 x 3.2	114.3 x 3.6	139.7 x 3.5
	2400	76.1 x 2.3	101.6 x 2.6	114.3 x 3.2	139.7 x 3.0	139.7 x 3.5
	3600	88.9 x 2.6	101.6 x 2.6	114.3 x 3.2	139.7 x 3.0	165.1 x 3.0
<b>SHS C350</b>	600	50 x 50 x 2.5	75 x 75 x 2.5	75 x 75 x 4.0	100 x 100 x 4.0	100 x 100 x 4.0
	1200	65 x 65 x 2.0	75 x 75 x 2.5	75 x 75 x 4.0	100 x 100 x 4.0	100 x 100 x 4.0
	1800	65 x 65 x 2.0	75 x 75 x 3.0	100 x 100 x 3.0	100 x 100 x 4.0	100 x 100 x 4.0
	2400	65 x 65 x 2.0	75 x 75 x 3.0	100 x 100 x 3.0	100 x 100 x 4.0	100 x 100 x 5.0
	3600	65 x 65 x 2.5	75 x 75 x 4.0	100 x 100 x 3.0	100 x 100 x 4.0	100 x 100 x 5.0
<b>SHS C450</b>	600	50 x 50 x 2.0	65 x 65 x 2.5	75 x 75 x 3.0	100 x 100 x 2.8	100 x 100 x 3.3
	1200	50 x 50 x 2.0	65 x 65 x 2.5	75 x 75 x 3.0	100 x 100 x 3.0	100 x 100 x 3.3
	1800	50 x 50 x 2.3	75 x 75 x 2.3	75 x 75 x 3.3	100 x 100 x 3.0	100 x 100 x 3.8
	2400	65 x 65 x 2.0	75 x 75 x 2.5	75 x 75 x 3.5	100 x 100 x 3.0	100 x 100 x 3.8
	3600	65 x 65 x 2.3	100 x 100 x 2.0	100 x 100 x 2.8	100 x 100 x 3.8	100 x 100 x 4.0
<b>COLUMNS — SUPPORTING TILE ROOF ONLY</b>						
COLUMN EFFECTIVE HEIGHT (mm)		ROOF AREA SUPPORTED (m <sup>2</sup> )				
		5	10	15	20	25
<b>CHS C250</b>	600	60.3 x 3.6	60.3 x 3.6	76.1 x 3.6	76.1 x 4.5	88.9 x 4.0
	1200	60.3 x 3.6	60.3 x 3.6	76.1 x 3.6	76.1 x 4.5	101.6 x 4.0
	1800	60.3 x 3.6	60.3 x 3.6	76.1 x 3.6	76.1 x 4.5	101.6 x 4.0
	2400	60.3 x 3.6	60.3 x 4.5	76.1 x 3.6	88.9 x 4.0	101.6 x 4.0
	3600	60.3 x 3.6	76.1 x 3.6	76.1 x 4.5	88.9 x 4.0	101.6 x 4.0
<b>CHS C350</b>	600	60.3 x 2.3	60.3 x 2.3	76.1 x 2.3	88.9 x 2.6	101.6 x 2.6
	1200	60.3 x 2.3	60.3 x 2.9	76.1 x 2.3	88.9 x 2.6	101.6 x 2.6
	1800	60.3 x 2.3	60.3 x 2.9	88.9 x 2.6	88.9 x 2.6	101.6 x 2.6
	2400	60.3 x 2.3	76.1 x 2.3	88.9 x 2.6	88.9 x 2.6	101.6 x 2.6
	3600	60.3 x 2.3	76.1 x 2.3	88.9 x 2.6	101 x 2.6	101.6 x 3.2

Table 3.4.4.1 COLUMNS— continued

<b>SHS C350</b>	600	50 x 50 x 2.0	50 x 50 x 2.5	65 x 65 x 2.5	75 x 75 x 2.5	75 x 75 x 3.0
	1200	50 x 50 x 2.0	50 x 50 x 2.5	65 x 65 x 2.5	75 x 75 x 2.5	75 x 75 x 3.0
	1800	50 x 50 x 2.0	65 x 65 x 2.0	65 x 65 x 2.5	75 x 75 x 2.5	75 x 75 x 3.0
	2400	50 x 50 x 2.0	65 x 65 x 2.0	65 x 65 x 2.5	75 x 75 x 2.5	75 x 75 x 4.0
	3600	50 x 50 x 2.5	65 x 65 x 2.5	75 x 75 x 2.5	75 x 75 x 3.0	75 x 75 x 4.0
<b>SHS C450</b>	600	50 x 50 x 1.6	50 x 50 x 2.0	65 x 65 x 2.0	65 x 65 x 2.3	65 x 65 x 2.8
	1200	50 x 50 x 1.6	50 x 50 x 2.0	65 x 65 x 2.0	65 x 65 x 2.3	65 x 65 x 2.8
	1800	50 x 50 x 1.6	65 x 65 x 1.6	65 x 65 x 2.0	65 x 65 x 2.5	75 x 75 x 2.5
	2400	50 x 50 x 1.6	50 x 50 x 2.5	65 x 65 x 2.3	75 x 75 x 2.3	75 x 75 x 2.8
	3600	50 x 50 x 2.0	65 x 65 x 2.0	75 x 75 x 2.3	100 x 100 x 2.0	100 x 100 x 2.3

### 3.4.4.4 Corrosion protection

Structural steel members that are not built into a masonry wall must be protected against corrosion in accordance with [Table 3.4.4.2](#).

#### Explanatory information:

Corrosion protection of structural steel members that are built into masonry walls is covered in [Table 3.3.3.2](#).

Table 3.4.4.2 PROTECTIVE COATINGS FOR STEELWORK

ENVIRONMENT	LOCATION	MINIMUM PROTECTIVE COATING	
		General structural steel members	
<b>MODERATE</b>  More than 1 km from <i>breaking surf</i> or more than 100 m from salt water not subject to <i>breaking surf</i> or non-heavy industrial areas	<b>INTERNAL</b>	No protection required in a permanently dry location (see Note 6)	
	<b>EXTERNAL</b>	<b>Option 1.</b> 2 coats alkyd primer; or <b>Option 2.</b> 2 coats alkyd gloss <b>Option 3.</b> Hot dip galvanise 300 g/m <sup>2</sup> min <b>Option 4.</b> Hot dip galvanise 100 g/m <sup>2</sup> min plus— (a) 1 coat solvent based vinyl primer; or (b) 1 coat vinyl gloss or alkyd.	
<b>SEVERE</b>  Within 1 km from <i>breaking surf</i> or within 100 m of salt water not subject to <i>breaking surf</i> or heavy industrial areas	<b>INTERNAL</b>	<b>Option 1.</b> 2 coats alkyd primer <b>Option 2.</b> 2 coats alkyd gloss	
	<b>EXTERNAL</b>	<b>Option 1.</b> Inorganic zinc primer plus 2 coats vinyl gloss finishing coats <b>Option 2.</b> Hot dip galvanise 300g/m <sup>2</sup> <b>Option 3.</b> Hot dip galvanise 100 g/m <sup>2</sup> min plus— (a) 2 coats solvent based vinyl primer; or (b) 2 coats vinyl gloss or alkyd.	

**Notes:**

1. Heavy industrial areas means industrial environments around major industrial complexes. There are only a few such regions in Australia, examples of which occur around Port Pirie and Newcastle.
2. The outer leaf and *cavity* of an external masonry wall of a building, including walls under open carports are considered to be external environments. A part of an internal leaf of an external masonry wall which is located in the roof space is considered to be in an internal environment.
3. Where a paint finish is applied the surface of the steel work must be hand or power tool cleaned to remove any rust immediately prior to painting.
4. All zinc coatings (including inorganic zinc) require a barrier coat to stop conventional domestic enamels from peeling.
5. Refer to the paint manufacturer where decorative finishes are required on top of the minimum coating specified in the table for protection of the steel against corrosion.

Table 3.4.4.2 PROTECTIVE COATINGS FOR STEELWORK—continued

ENVIRONMENT	LOCATION	MINIMUM PROTECTIVE COATING
		General structural steel members
6. Internal locations subject to moisture, such as in close proximity to kitchen or bathroom exhaust fans are not considered to be in a permanently dry location and protection as specified for external locations is <i>required</i> .		
7. For applications outside the scope of this table, seek specialist advice.		

# PART 3.5

---

## ROOF AND WALL CLADDING

- 3.5.1 Roof Cladding
- 3.5.2 Gutters and Downpipes
- 3.5.3 Wall Cladding

## **PART 3.5 CONTENTS**

---

### **PART 3.5 ROOF AND WALL CLADDING**

#### **Explanatory Information**

#### **3.5.1 Roof cladding**

- 3.5.1.0 Acceptable construction manuals
- 3.5.1.1 Application
- 3.5.1.2 Roof tiling
- 3.5.1.3 Metal sheet roofing

#### **3.5.2 Gutters and downpipes**

- 3.5.2.0 Acceptable construction manual
- 3.5.2.1 Application
- 3.5.2.2 Materials
- 3.5.2.3 Selection of guttering
- 3.5.2.4 Installation of gutters
- 3.5.2.5 Downpipes — size and installation

#### **3.5.3 Wall Cladding**

- 3.5.3.1 Application
- 3.5.3.2 Timber weatherboard cladding
- 3.5.3.3 Fibre cement planks and weatherboard cladding
- 3.5.3.4 Fibre-cement sheet wall cladding
- 3.5.3.5 Eaves and soffit linings
- 3.5.3.6 Flashings to wall openings

---

## PART 3.5 EXPLANATORY INFORMATION

---

### **Explanatory information:**

These provisions relate to installing systems to waterproof roofs, walls and wall openings.

It should be noted that other construction methods may be used to achieve the same results as specified in this Part provided they comply with the appropriate [Performance Requirement](#).



## PART 3.5.1 ROOF CLADDING

### Appropriate *Performance Requirements*

Where an alternative roof cladding is proposed as an *Alternative Solution* to that described in **Part 3.5.1**, that proposal must comply with—

- (a) *Performance Requirement P2.1*; and
- (b) *Performance Requirement P2.2.2*; and
- (c) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### A. Acceptable construction manuals

#### 3.5.1.0

*Performance Requirements P2.1* and *P2.2.2* are satisfied for roof cladding if it complies with one of the following:

- (a) AS 2049 — Roof tiles, and AS 2050 — Installation of roof tiles.
- (b) AS 1562.1 — Design and installation of sheet roof and wall cladding — Metal.
- (c) AS/NZS 4256 Pts 1, 2, 3 and 5; and AS/NZS 1562.3 — Plastic sheet roofing.
- (d) AS/NZS 1562.2 — Design and installation of sheet roof and wall cladding — Corrugated fibre-reinforced cement.
- (e) ASTM D3018-90 — Asphalt shingles.
- (f) AS/NZS 4200 — Installation of pliable membrane and underlay.

### B. Acceptable construction practice

#### 3.5.1.1 Application

Compliance with this acceptable construction practice satisfies *Performance Requirements P2.1* and *P2.2.2* for roof cladding, provided—

- (a) the building is located in an area with a *design wind speed* of not more than N3; and

#### Explanatory information:

1. Information on *design wind speeds* for particular areas may be available from the *appropriate authority*.
2. A map indicating cyclonic regions of Australia is contained in **Part 3.10.1**.

- (b) roof tiles are installed in accordance with **3.5.1.2**; and


- (c) metal sheet roofing is installed in accordance with **3.5.1.3**.

### 3.5.1.2 Roof tiling

- (a) Roof tiles, complying with AS 2049, must be installed, fixed and flashed in accordance with the relevant provisions of this Part.
- (b) Roof tiles on roofs with a pitch of not less than 15 degrees and not more than 35 degrees must be fixed in accordance with **Figure 3.5.1.1**.
- (c) Fixings for roof battens and batten sizes must comply with **Part 3.4.3**.
- (d) All tiled roof *flashings*, ridge and hip tiles must be installed in accordance with **Figure 3.5.1.2**.
- (e) Lead *flashings* must not be used on any roof that is part of a potable water catchment area.
- (f) Sarking must be installed under tiled roofs in accordance with **Table 3.5.1.1b**.
- (g) Where sarking is installed, an anti-ponding device/board must—
  - (i) be provided—
    - (A) on roofs with pitches of less than 20°; and
    - (B) on all roof pitches where there are no eaves overhang; and
  - (ii) be fixed along the eaves line from the top of the fascia back up the rafter with a clearance of approximately 50 mm below the first batten.
- (h) All water discharged from a gutter/valley or downpipe onto a tiled roof must be prevented from inundating or penetrating the tiling by the provision of—
  - (i) a spreader pipe; or
  - (ii) a flashing; or
  - (iii) sarking installed with a minimum width of 1800 mm either side from the point of discharge and extended down to the eaves gutter.

**Figure 3.5.1.1**
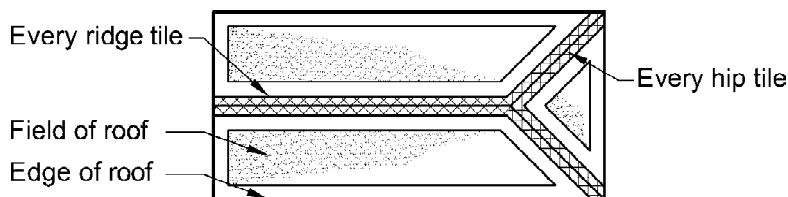
#### MINIMUM MECHANICAL FASTENING FOR TILES AND ANCILLARIES







**DESIGN WIND SPEED NOT MORE THAN N3**

Wind classification	Tile installation		Ancillary installation
	Edge of roof	Field of roof	Ridge, hip and barge tiles
<b>less than N2</b>	Mechanically fasten each full tile in second course and then every second tile in every course, or every tile in each alternative course.		Mechanically fasten each tile
<b>N2—N3</b>	Mechanically fasten each full tile in second course	Mechanically fasten each second full tile in every course	

**Note:**

1. Mechanical fastening can be achieved with either nails, screws, clips or flexible pointing materials complying with AS 2050.
2. For the purposes of this Figure, "edge of roof" is a 1.2 m wide band bounded by the eaves, ridge, hips and barge measured towards the "field of roof".

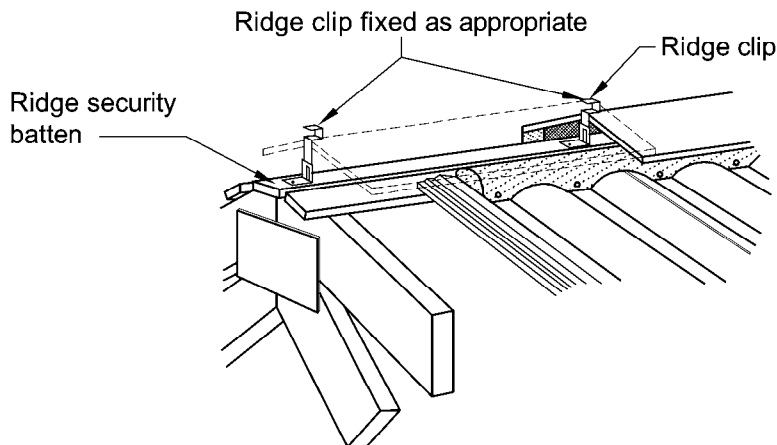**Figure 3.5.1.2****TILED ROOF FLASHING AND OTHER DETAILS****Diagram a. Mechanical fastening-ridge clip (Also see [Figure 3.5.1.1](#))**

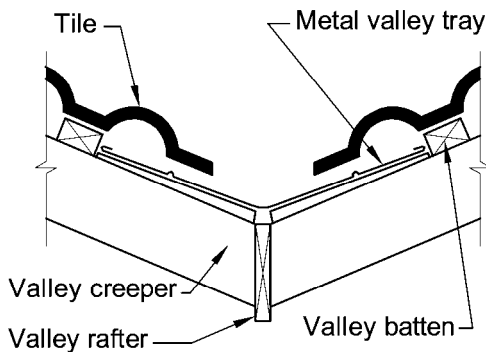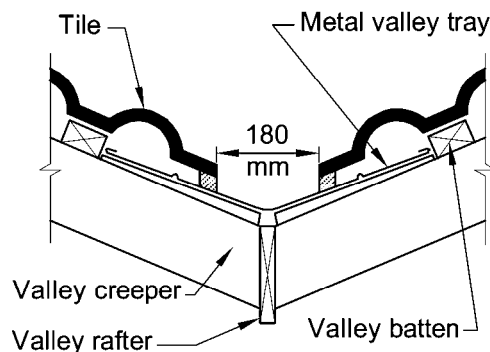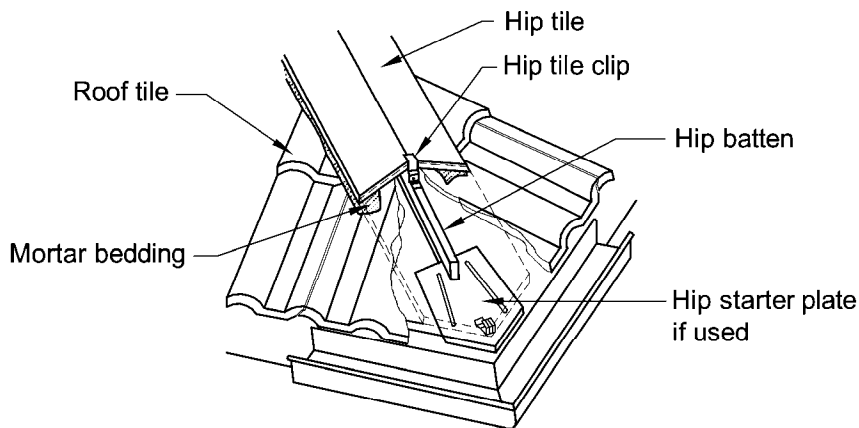**Figure 3.5.1.2****TILED ROOF FLASHING AND OTHER DETAILS****Diagram b. Dry valley****Standard arrangement****Diagram c. Bedded and pointed valley****Arrangement for high rainfall areas****Diagram d. Fastening of hip tiles****3.5.1.3 Metal sheet roofing**

- (a) The design and installation of metal sheet roofing must comply with the relevant provisions of this Part.
- (b) Metal sheet roofing must be protected from corrosion in accordance with [Table 3.5.1.1a](#).

**Table 3.5.1.1a ACCEPTABLE CORROSION PROTECTION FOR SHEET ROOFING**

ROOF ENVIRONMENT	METAL COATING IN ACCORDANCE WITH AS 1397	
	Metallic coated steel	Metallic and organic coating
Moderate		

Table 3.5.1.1a ACCEPTABLE CORROSION PROTECTION FOR SHEET ROOFING— continued

ROOF ENVIRONMENT	METAL COATING IN ACCORDANCE WITH AS 1397	
	Metallic coated steel	Metallic and organic coating
More than 1 km from <i>breaking surf</i> or more than 100 m from salt water not subject to <i>breaking surf</i> , or not within heavy industrial areas	(a) Z450 galvanised (b) AZ150 zinc/aluminium	(a) Z275 galvanised (b) AZ150 zinc/aluminium
<b>Severe</b> Within 1 km of <i>breaking surf</i> or within 100 m from salt water not subject to <i>breaking surf</i> , or within heavy industrial areas	AZ200	Not suitable

Table 3.5.1.1b SARKING REQUIREMENTS FOR TILED ROOFS

Roof—degrees of pitch	Maximum rafter length without sarking (mm)
$\geq 18 < 20$	4500
$\geq 20 < 22$	5500
$\geq 22$	6000
<b>Note:</b> The maximum rafter length is measured from the topmost point of the rafter downwards. Where the maximum rafter length is exceeded, sarking must be installed over the remainder of the rafter length.	

- (c) Where different metals are used in a roofing system, including cladding, *flashings*, fasteners, downpipes etc, they must be compatible with each other (to prevent corrosion due to an adverse chemical reaction) as described in [Table 3.5.1.2](#) and—
- (i) no lead materials can be used upstream from zinc-aluminium coated materials; and
  - (ii) no copper materials can be used upstream from galvanised coated materials.
- (d) Metal sheet roofing must—
- (i) be fixed at spacings in accordance with [Figure 3.5.1.5](#); and
  - (ii) use fastening devices made of a compatible metal to the roofing in accordance with [3.5.1.3\(c\)](#); and
  - (iii) when using both clipped and pierced fastening systems—
    - (A) employ an anti-capillary feature in the side lap of the sheet, to prevent capillary action drawing moisture into the lap and allowing the lap to drain (achieved by not over tightening the sheet fixings, see [Figure 3.5.1.3](#)); and
    - (B) wherever possible have the sheets laid so that the side lap is facing away from prevailing weather.

**Table 3.5.1.2 ACCEPTABILITY OF CONTACT BETWEEN DIFFERENT ROOFING MATERIALS**

Notes:

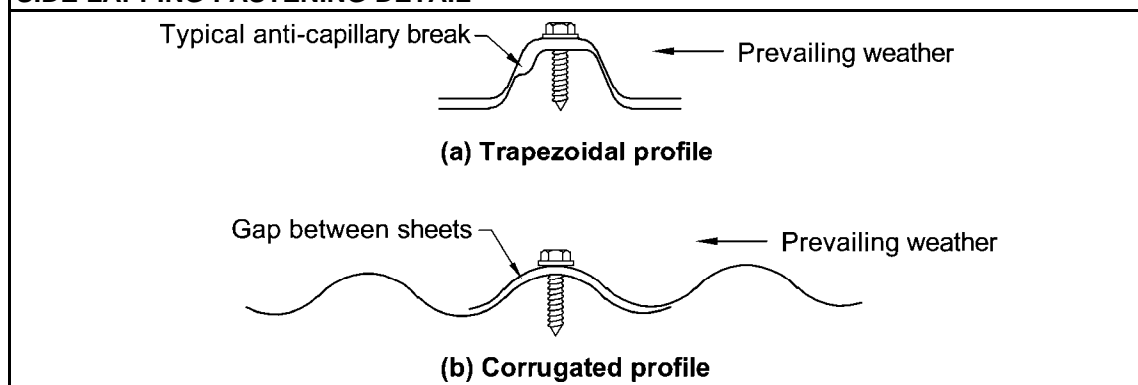
1. No — means the metal cannot be used in association with the other metal.

2. Yes — means the metal can be used in association with the other metal.

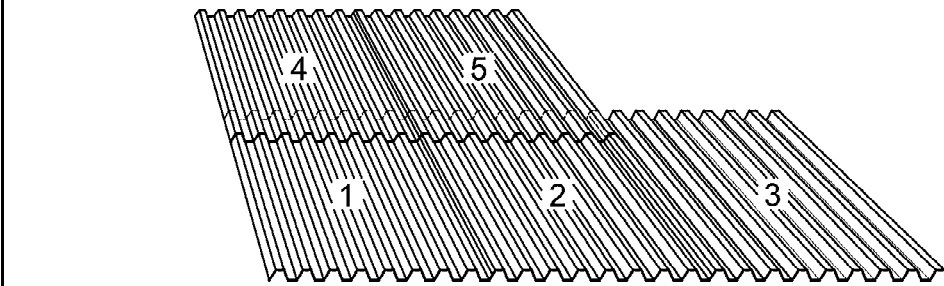
CLADDING MATERIAL	ACCESSORY OR FASTENER MATERIAL							
	Stainless steel		Zinc-coated steel and Zinc		Zinc/Aluminium coated steel		Lead	
	Atmosphere Classification (S = Severe and M = Moderate environment as Per Table 3.5.1.1)							
	S	M	S	M	S	M	S	M
Copper and copper alloys	No	Yes	No	No	No	No	No	Yes
Stainless steel (300 series)	Yes	Yes	No	No	No	No	No	Yes
Zinc-coated steel and zinc	No	Yes	Yes	Yes	Yes	Yes	No	Yes
Zinc/aluminium coated steel	No	Yes	Yes	Yes	Yes	Yes	No	No
Lead	Yes	Yes	No	Yes	No	No	Yes	Yes

**Figure 3.5.1.3**

**SIDE LAPPING FASTENING DETAIL**



- (e) Sheets must be—
- (i) laid wherever possible using complete lengths from ridge to eaves; or
  - (ii) where a complete length cannot be laid—
    - (A) each run should be laid in specific sequence (see [Figure 3.5.1.4](#)) from bottom to top before moving on to the next run; and
    - (B) the distance for end lapping where sheets meet is—
      - (aa) for roof slopes between 5–15 degrees (1:12–1:4) — a lap of 200 mm; and
      - (bb) for roof slopes above 15 degrees (1:4) — a lap of 150 mm; and
  - (iii) stop ended (ie each valley turned up 60 degrees) at the ridge line of each length.



**Figure 3.5.1.4****SHEET LAYING SEQUENCE**

- (f) Metal sheet roofing must comply with the pitch and span limitations between roofing supports as shown in [Figure 3.5.1.5](#).

**Figure 3.5.1.5****MAXIMUM SPAN AND FIXING FOR METAL SHEET ROOFING**

**Note:** The end span of some trapezoidal roofing systems may need to be reduced to 1.5 m (see proprietary information).

**Diagram a.** **Typical profiles** — Pitch is appropriate for a sheet run up to 25 m in length

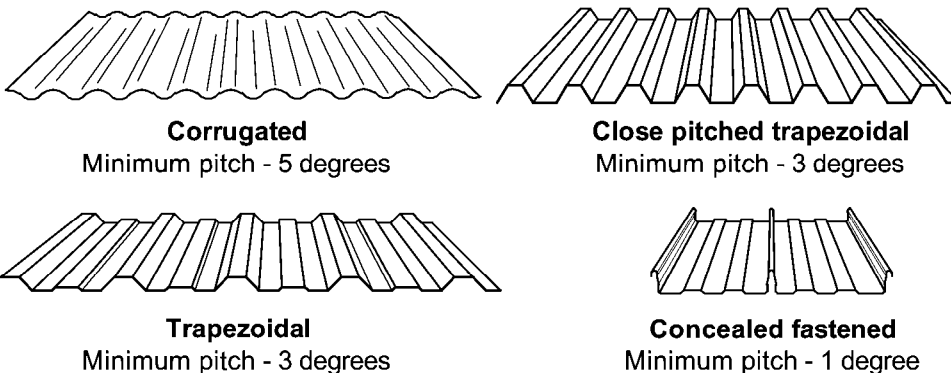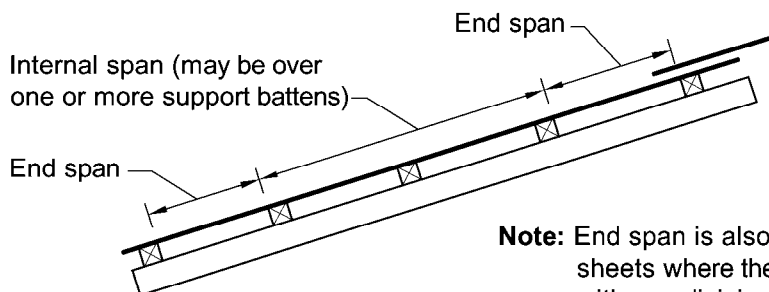**Diagram b.** **End and internal roof spans**

**Note:** End span is also the end of sheets where they overlap with an adjoining sheet.

**Note:** End span is also the end of sheets where they overlap with an adjoining sheet.

Figure 3.5.1.5

## MAXIMUM SPAN AND FIXING FOR METAL SHEET ROOFING

PROFILE	BASE METAL THICKNESS	END SPAN	INTERNAL SPAN	FIXING (crest fastening)	
	(mm)	(mm)	(mm)	END SPAN	INTERNAL SPANS
Corrugated	0.42	950	1200	Every second rib	Every third rib
Close pitched trapezoidal	0.42	1900	2400	Every rib	Every second rib
Trapezoidal	0.42	1350	1700	Every rib	
Concealed fasteners	0.48	1800	2100	Every rib	

- (g) Sheet metal roof *flashings* and cappings must comply with the following:
- (i) Roof *flashings* and cappings must be purpose made, machine-folded sheet metal sections of materials compatible with all up and downstream metal roof covering materials in accordance with **3.5.1.3(c)**.
  - (ii) The type of fasteners for *flashings* and cappings must comply with **3.5.1.3(d)**.
  - (iii) The fastener fixing frequency for transverse *flashings* and cappings must comply with **Table 3.5.1.3**.


Table 3.5.1.3 FASTENER FREQUENCY FOR TRANSVERSE FLASHINGS AND CAPPINGS

ROOF TYPE	FIXING FREQUENCY	FASTENER TYPE
Concealed fastened roofs	Every rib	Rivets and self drilling screws
Pierced fastened roofs	Every 2nd rib	Self drilling screws or rivets
Corrugated roofs	Every 4th rib	Self drilling screws or rivets

- (iv) Joints in *flashing* and cappings must be not less than 25 mm, fastened at intervals not more than 40 mm and lapped in the direction of the fall of the roof.
- (v) Wall and step *flashings* must be fastened into masonry walls with galvanised or zinc/aluminium sheet metal wedges at each end of each length and at intermittent intervals of not more than 500 mm and must overlap by not less than 75 mm in the direction of flow.
- (vi) Lead *flashings* must not be used with prepainted steel or zinc/aluminium steel or on any roof if the roof is part of a potable (drinking) water catchment area.
- (vii) Anti capillary breaks must be installed in accordance with **Figure 3.5.1.6** and be—
  - (A) for flat surfaces — 10 mm/30 degree fold; and
  - (B) all other surfaces — 10 mm/90 degree or 135 degree fold.



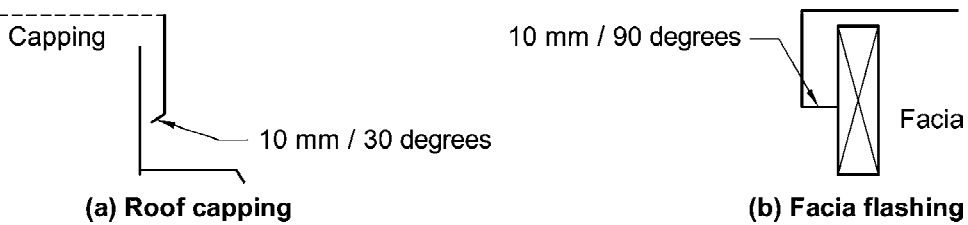Figure 3.5.1.6

**ANTI CAPILLARY BREAKS**

(viii) Acceptable *flashing* configurations are shown in [Figure 3.5.1.7](#).

Figure 3.5.1.7

**ACCEPTABLE FLASHING DETAILS**

Diagram a.

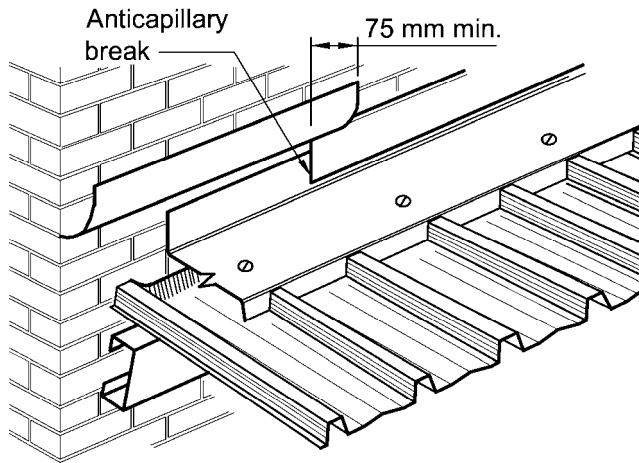
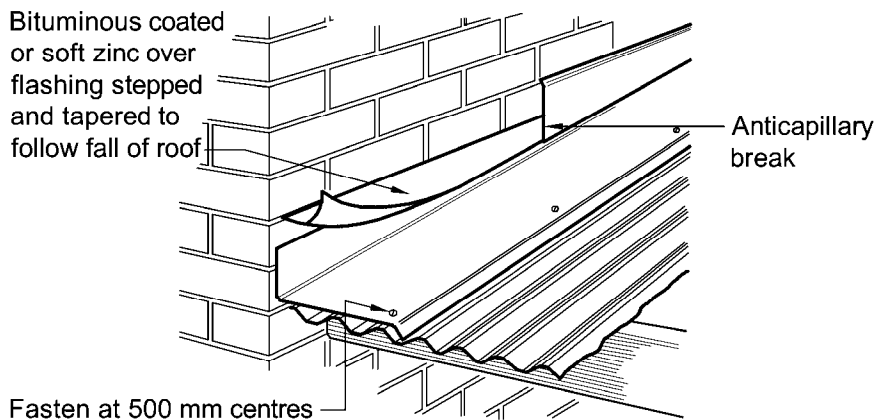
**Parapet flashing**

Diagram b.

**Parapet and end wall flashing**

(h) *Flashing* of penetrations must comply with the following:

(i) Collar *flashings* must permit the total drainage of the area above the penetration.

- (ii) On the completion of installation, the roof structure must be restored to its original strength by installing roof trimmers and soaker supports as necessary.
- (iii) The type of fasteners for *flashings* and cappings must comply with 3.5.1.3(d).
- (iv) Lead *flashings* must not be used with prepainted steel or zinc/aluminium steel or on any roof if the roof is part of a potable water catchment area.
- (v) Acceptable *flashings* for penetrations are shown in Figure 3.5.1.8.
- (vi) Clearance for heating appliance roof support members must be in accordance with Part 3.7.3.

Figure 3.5.1.8

## TYPICAL ROOF PENETRATION FLASHING DETAILS

Diagram a. PVC aprons

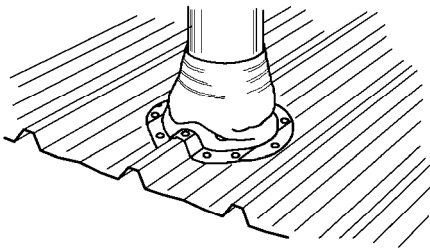


Diagram b. Collar flashings


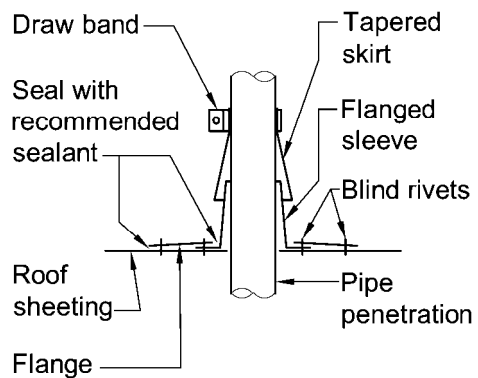


Diagram c. Large penetrations — using apron

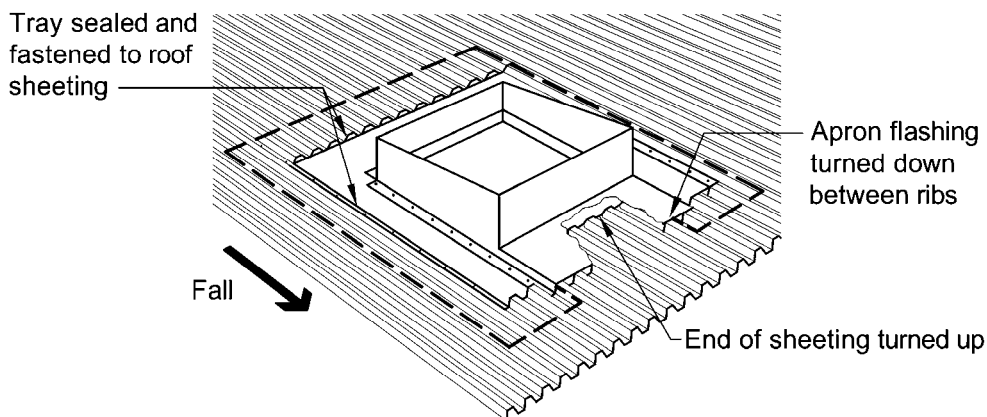

## PART 3.5.2 GUTTERS AND DOWNPIPES

### Appropriate *Performance Requirements*:

Where an alternative gutter and downpipe system is proposed as an *Alternative Solution* to that described in **Part 3.5.2**, that proposal must comply with—

- (a) *Performance Requirement P2.2.1*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### A. Acceptable construction manual

#### 3.5.2.0

*Performance Requirement P2.2.1* is satisfied for gutters and downpipes if they are designed and constructed in accordance with AS/NZS 3500.3 — Stormwater drainage, or AS/NZS 3500.5 — Domestic installations, Section 5 — Stormwater drainage.

### B. Acceptable construction practice

#### 3.5.2.1 Application

Compliance with this acceptable construction practice satisfies *Performance Requirement P2.2.1* for gutters and downpipes provided—

- (a) the roof drainage system is connected to a stormwater drainage system that complies with **Part 3.1.2**; and
- (b) the roof drainage system is designed so that any overflow during heavy rain periods is prevented from flowing back into the building.

### Explanatory information:

1. The requirement to install drainage systems from roofs and sub-soil drains should be confirmed with the *appropriate authority*. These provisions need only be applied when drainage systems are necessary.
2. Information on drainage requirements outside the allotment can be obtained from the *appropriate authority*.

#### 3.5.2.2 Materials

Gutters, downpipes and *flashings* must—

- (a) be manufactured in accordance with AS/NZS 2179.1 for metal; and

- (b) be manufactured in accordance with AS 1273 for UPVC components; and
- (c) be compatible with all upstream roofing materials in accordance with [3.5.1.3\(c\)](#); and
- (d) not contain any lead if used on a roof forming part of a potable water catchment area.

### 3.5.2.3 Selection of guttering

The size of guttering must—

- (a) be in accordance with [Table 3.5.2.2](#); and
- (b) be suitable to remove rainwater falling at the appropriate rainfall intensity listed in [Table 3.5.2.1](#) as follows—
  - (i) for eaves gutters — 20 year *average recurrence interval*; or
  - (ii) for internal box and valley gutters — 100 year *average recurrence interval*.

### 3.5.2.4 Installation of gutters

- (a) Gutters must be installed with a fall of not less than—
  - (i) 1:500 for eaves gutters, unless fixed to metal fascias; and
  - (ii) 1:100 for box gutters.
- (b) Eaves gutters must be supported by brackets securely fixed at stop ends and at not more than 1.2 m centres.
- (c) Valley gutters on a roof with a pitch—
  - (i) more than 12.5 degrees — must have width of not less than 400 mm and be wide enough to allow the roof covering to overhang not less than 150 mm each side of the gutter; or
  - (ii) not more than 12.5 degrees — must be designed as a box gutter.
- (d) Where high-fronted gutters are installed, provision must be made to avoid any overflow back into the roof or building structure by incorporating overflow measures or the like.

### 3.5.2.5 Downpipes — size and installation

Downpipes must—

- (a) not serve more than 12 m of gutter length for each downpipe; and

#### Explanatory information:

A maximum 12 m gutter length served by each downpipe is to ensure effective fall and adequate capacity to discharge all water anticipated during a heavy rain period.

- (b) be located as close as possible to valley gutters and, if the downpipe is more than 1.2 m from a valley, provision for overflow must be made to the gutter; and
- (c) be selected in accordance with the appropriate eaves gutter section as shown in [Table 3.5.2.2](#).

Table 3.5.2.1 RAINFALL INTENSITIES

Locality	5 minute rainfall intensity (mm/h)		Locality	5 minute rainfall intensity (mm/h)	
	<i>Average recurrence interval, once in—</i>			<i>Average recurrence interval, once in—</i>	
	20 years	100 years		20 years	100 years
<b><u>ACT</u></b>			<b><u>SA</u></b>		
Canberra	137	194	Adelaide	123	186
			Mt Gambier	108	168
<b><u>NSW</u></b>			Murray Bridge	117	181
Albury	135	191	Port Augusta	124	189
Broken Hill	130	181	Port Pirie	125	201
Goulburn	145	197	Yorktown	118	197
Kiama	224	283			
Newcastle	181	233	<b><u>WA</u></b>		
Orange	152	214	Albany	142	217
Sydney	214	273	Broome	252	343
Tweed Heads	245	303	Bunbury	148	215
Wollongong	233	294	Derby	254	343
			Geraldton	132	173
<b><u>VIC</u></b>			Kalgoorlie	116	180
Ballarat	127	184	Perth	146	214
Benalla	133	187	Port Hedland	233	332
Geelong	118	172	Tom Price	164	222
Horsham	120	174			
Lakes Entrance	124	179	<b><u>TAS</u></b>		
Melbourne	127	186	Burnie	118	191
Mildura	125	174	Flinders Island	128	184
Stawell	127	185	Hobart	99	155
			Launceston	101	150
<b><u>QLD</u></b>			Queenstown	118	183
Brisbane	251	333	St. Marys	205	266
Bundaberg	241	318			
Cairns	282	368	<b><u>NT</u></b>		
Cape York	301	388	Alice Springs	139	204
Cloncurry	172	228	Darwin	285	366

Table 3.5.2.1 RAINFALL INTENSITIES— continued

Locality	5 minute rainfall intensity (mm/h)		Locality	5 minute rainfall intensity (mm/h)	
	<i>Average recurrence interval</i> , once in—			<i>Average recurrence interval</i> , once in—	
	20 years	100 years		20 years	100 years
Innisfail	254	323	Katherine	230	304
Mackay	273	363			
Mt Isa	169	223			
Noosa	253	320			
Rockhampton	248	336			
Toowoomba	189	251			
Townsville	260	346			
Weipa	293	370			

Table 3.5.2.2 GUTTER AND DOWNPIPE SELECTION

Table a. Gutter sizes for various rainfall intensities and roof catchment areas per downpipe					
Design Rainfall Intensity (mm/h) (as per Table 3.5.2.1)	Roof Catchment Area per Downpipe — m <sup>2</sup>				
	30	40	50	60	70
	Size of gutter required to drain roof catchment area into one (1) downpipe (A, B, C, D, E and F defined in Table b.)				
90	A or C	A or C	A or C	A or C	A or C
120	A or C	A or C	A or C	A or C	A or D
140	A or C	A or C	A or C	A or D	B or E
160	A or C	A or C	A or C	A or E	B or E
175	A or C	A or C	A or D	B or E	E
200	A or C	A or C	A or D	B or E	F
225	A or C	A or C	A or B	E	F
255	A or C	A or D	B or E	E	F
275	A or C	A or D	B or E	F	F
325	A or C	B or E	F	F	F
425	A or C	E	F	F	F

Table b. Gutter sizes for various rainfall intensities		
Gutter Type (as per Table a.)	Gutter description	Minimum Cross Sectional Area mm <sup>2</sup>
A	Medium rectangular gutter	6500

**Table b. Gutter sizes for various rainfall intensities**

Gutter Type (as per Table a.)	Gutter description	Minimum Cross Sectional Area mm <sup>2</sup>
<b>B</b>	Large rectangular gutter	7900
<b>C</b>	115 mm D gutter	5200
<b>D</b>	125 mm D gutter	6300
<b>E</b>	150 mm D gutter	9000
<b>F</b>	Gutter must be designed in accordance with AS/NZS 3500.3.2 or Section 5 of AS/NZS 3500.5	

**Table c. Downpipe selection**

Downpipe Section	Gutter Sections — (as per Table b.)				
	A	B	C	D	E
<b>75 mm dia.</b>	Yes	Yes	Yes	Yes	No
<b>100 mm x 50 mm</b>	Yes	Yes	Yes	Yes	Yes
<b>90 mm dia.</b>	Yes	Yes	Yes	Yes	Yes
<b>100 mm x 75 mm</b>	Yes	Yes	Yes	Yes	Yes

**Legend:** Yes—downpipe is suitable for the eaves gutter selection; and  
 No—downpipe is not suitable for the eaves gutter selection.

**Explanatory information:**

Stormwater drainage systems specified in the [Housing Provisions](#) are not designed to remove all of the water during exceptionally heavy rain, especially in tropical areas. Accordingly, it is necessary to design and install the system so that when overflowing occurs any water is directed away in a manner which ensures it does not pond against, or enter into, the building.

This may be achieved by using overflow measures, oversized gutters and downpipes, locating the gutter so that it is below the top edge of the fascia or the installation of rainwater heads with overflows.

The installation of downpipes, especially near valley gutters, are designed to ensure rainwater from areas on the roof that have concentrated water flows perform adequately. If downpipe spacings are to be increased, allowance for overflow should be considered.

Consideration needs to be given to box gutters, valley gutters etc. located above the internal areas of a building and eaves gutters where overflowing rainwater can flow over the eaves lining and back into the building. In these situations if adequate overflow controls cannot be implemented there may be a need to increase the size and capacity of drainage components to remove all water anticipated during heavy rain periods.

There are many options available to designers using the requirements of the [Housing Provisions](#). The designer will need to choose an overflow system that will cope with the expected rain intensity, ie in heavy downpours a slotted gutter may be inadequate.

## PART 3.5.3 WALL CLADDING

### Appropriate *Performance Requirements*:

Where an alternative wall cladding is proposed as an *Alternative Solution* to that described in **Part 3.5.3**, that proposal must comply with—

- (a) *Performance Requirement P2.1*; and
- (b) *Performance Requirement P2.2.2*; and
- (c) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### Acceptable construction practice

#### 3.5.3.1 Application

Compliance with this acceptable construction practice satisfies *Performance Requirements P2.1* and **P2.2.2** for wall cladding provided—

- (a) the building is located in an area with a *design wind speed* of not more than N3; and

#### Explanatory information:

1. Information on *design wind speeds* for particular areas may be available from the *appropriate authority*.
2. A map indicating cyclonic regions of Australia is contained in **Part 3.10.1**.
3. For wall cladding in areas with a *design wind speed* of more than N3 refer to the appropriate design manual listed in **Part 3.11**.

- (b) wall cladding is installed in accordance with—
  - (i) **3.5.3.2** for timber weatherboard cladding; and
  - (ii) **3.5.3.3** for fibre cement planks and weatherboard cladding; and
  - (iii) **3.5.3.4** for fibre cement sheet and plywood sheet cladding; and
- (c) fibre cement sheet eaves are installed in accordance with **3.5.3.5**; and
- (d) openings in cladding are flashed in accordance with **3.5.3.6**.

#### 3.5.3.2 Timber weatherboard cladding

Timber cladding must be installed as follows:

- (a) Splayed timber weatherboards must be fixed in accordance with **Figure 3.5.3.1** and with a lap not less than—
  - (i) 30 mm for hardwood, cypress and treated pine; and
  - (ii) 20 mm for western red cedar; and










- (iii) 25 mm for baltic pine.
- (b) Profiled timber boards must be—
  - (i) fixed with the overlap and groove closely fitted; and
  - (ii) with tongue and groove profile, fixed tongue edge up.
- (c) Spacing of fixings must be—
  - (i) one nail per board at each stud at not more than 650 mm centres measured along the board; and
  - (ii) nailed so that they do not penetrate the tip or thinner edge of the board beneath, ie for 30 mm lap, nail 35 mm from the butt (see [Figure 3.5.3.1](#)).
- (d) Nails used to fix timber cladding must comply with the following:
  - (i) Where nails are punched and filled prior to painting, with standard steel bullet-head nails.
  - (ii) Uncoated copper or steel nails must not be used for western red cedar (silicon bronze, monel metal, stainless steel or hot-dipped galvanised are suitable).
  - (iii) In all other cases, nails must be hot-dipped galvanised flat head or bullet head.
- (e) Acceptable nail sizes are—
  - (i) for hardwood and cypress frames — 50x2.8 mm plain shank; and
  - (ii) for softwood frames — 50x3.15 mm annular threaded.

### 3.5.3.3 Fibre cement planks and weatherboard cladding

Fibre cement plank and weatherboard cladding must be installed as follows:

- (a) 7.5 mm (minimum) fibre cement planks and weatherboards must be—
  - (i) manufactured in accordance with AS/NZS 2908.2 or ISO 8336; and
  - (ii) fixed with a lap of not less than 25 mm (see [Figure 3.5.3.1](#)).
- (b) 7.5 mm (minimum) fibre cement planks and weatherboards must be fixed in accordance with [Figure 3.5.3.1](#) with a stud spacing of not more than 600 mm.
- (c) Acceptable fixings for 7.5 mm fibre cement planks and weatherboards are—
  - (i) for timber studs — 40x2.8 mm galvanised fibre-cement nails; and
  - (ii) for steel studs — 8–18x35 mm self embedding head screws (see [Figure 3.5.3.1](#)).

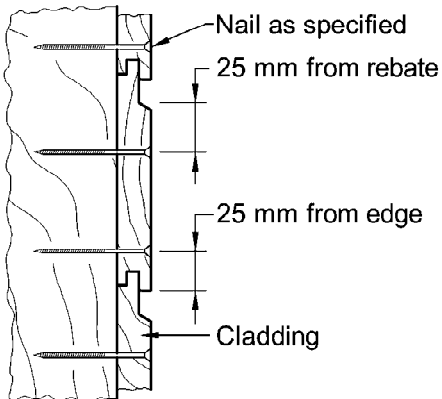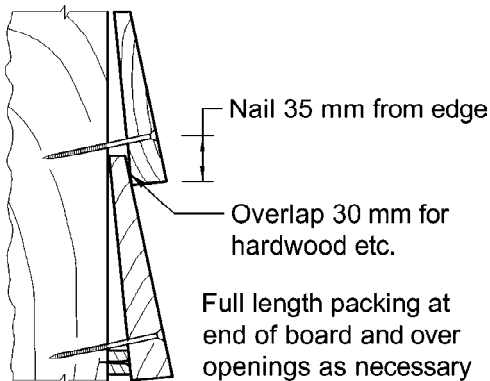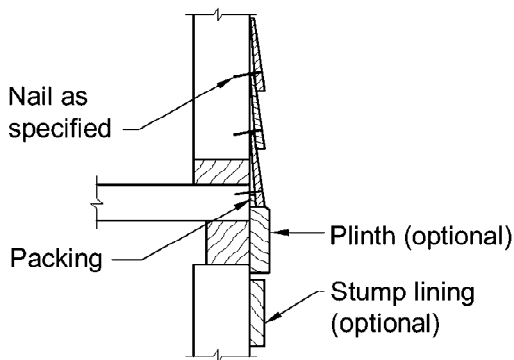**Figure 3.5.3.1****FIXING OF WALL CLADDING****Diagram a.****Timber Cladding****(a) (i) Shiplap weather board****(a) (ii) Splayed weather board****(a) (iii) Section at lower part of weatherboard building****Diagram b.****Fibre Cement Planks And Weatherboards****(b) (i) Timber stud nailing****(b) (ii) Timber stud clip****(b) (iii) Steel stud screwing****(b) (iv) Steel stud clip**

### 3.5.3.4 Fibre-cement sheet wall cladding


- (a) Fibre-cement sheets must comply as follows:
- (i) Fibre-cement sheets used as external wall cladding must be fixed in accordance with [Table 3.5.3.1](#) and [Figure 3.5.3.2](#).
  - (ii) Where the external cladding also acts as structural sheet bracing, the lesser of the stud and fixing spacings for both applications must be used.
  - (iii) External fibre-cement sheets and claddings must comply with AS/NZS 2908.2 or ISO 8336.

**Table 3.5.3.1 STUD AND WALL SPACINGS FOR 6mm FIBRE-CEMENT SHEET WALL CLADDING**

<i>Design wind speed</i>	STUD SPACING		NAIL SPACING (2.8 mm fibre-cement nails)			
	Within 1.2 m of ends of building	Elsewhere	Within 1.2 m of ends of building		Elsewhere	
			Body	Edges	Body	Edges
<b>N1</b>	600	600	300	200	300	200
<b>N2</b>	600	600	200	200	300	200
<b>N3</b>	450	600	200	200	200	200

**Figure 3.5.3.2**
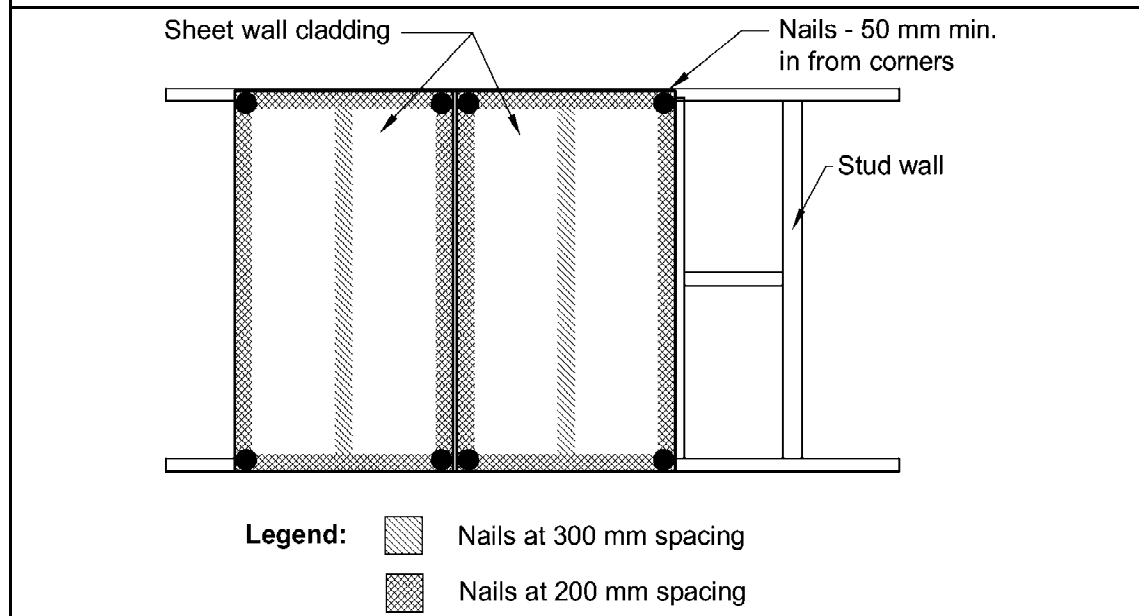
#### SHEET FIXING DETAIL



- (b) Structural plywood external cladding must comply as follows:
- (i) Structural plywood cladding must comply with AS/NZS 2269.

- (ii) Where structural plywood acts as cladding and combined structural bracing it must comply with [Table 3.5.3.2](#).
- (iii) Sheets, not more than 9 mm thick must be fixed using 2.8/3.5×30 mm long galvanised clouts or flat head nails spaced at—
  - (A) 150 mm centres along sheet edges; and
  - (B) 300 mm for intermediate fixings; and
- (iv) Sheets thicker than 9 mm must be fixed with 2.8 or 3.5 mm galvanised clouts or flat head nails with a length calculated using the following formula:  
 MIN NAIL LENGTH L = PL + 10 Da  
 Where PL = Plywood thickness and  
 Da = Diameter of nail
- (v) The fixings must be located not less than 9 mm from the edge of the sheet.

#### Explanatory information:

The above formula is applied as follows:

For 12 mm plywood and 2.8 mm diameter nail.

L = 12 + 28 mm; therefore the nail length must be 40 mm.

**Table 3.5.3.2 MINIMUM STRUCTURAL PLYWOOD THICKNESS FOR COMBINED BRACING AND EXTERNAL CLADDING (mm)**

Plywood stress grade	Stud spacing (mm)					
	Plywood face grain parallel to studs			Plywood face grain at right angles to studs		
	450	600	900	450	600	900
<b>F8</b>	9	12	16	7	9	12
<b>F11</b>	8	12	16	6	8	12
<b>F14</b>	7	12	16	6	7	12

#### 3.5.3.5 Eaves and soffit linings

External fibre cement sheets and linings used as eaves and soffit linings must—


- (a) comply with AS/NZS 2908.2 or ISO 8336; and
- (b) be fixed in accordance with [Table 3.5.3.3](#) and [Figure 3.5.3.3](#) using—
  - (i) 2.8×30 mm Fibre cement nails; or
  - (ii) No. 8 Wafer head screws (for 4.5 mm and 6 mm sheets only); or
  - (iii) No. 8 Self embedding head screws (for 6 mm sheets only).

**Table 3.5.3.3 TRIMMER AND FASTENER SPACINGS FOR 4.5 AND 6 mm FIBRE-CEMENT EAVES AND SOFFIT LININGS**

Maximum eaves width	<i>Design wind speed</i>	Maximum trimmer spacings (mm)		Maximum fastener spacings (mm)	
		Within 1200 mm of the external corners of the building	Remainder of sheet	Within 1200 mm of the external corners of the building	Remainder of sheet
600	N1	600	900	200	300
	N2	600	800	200	300
	N3	500	700	200	300
1200	N1	600	750	200	300
	N2	600	700	200	300
	N3	500	650	200	300

**Figure 3.5.3.3**

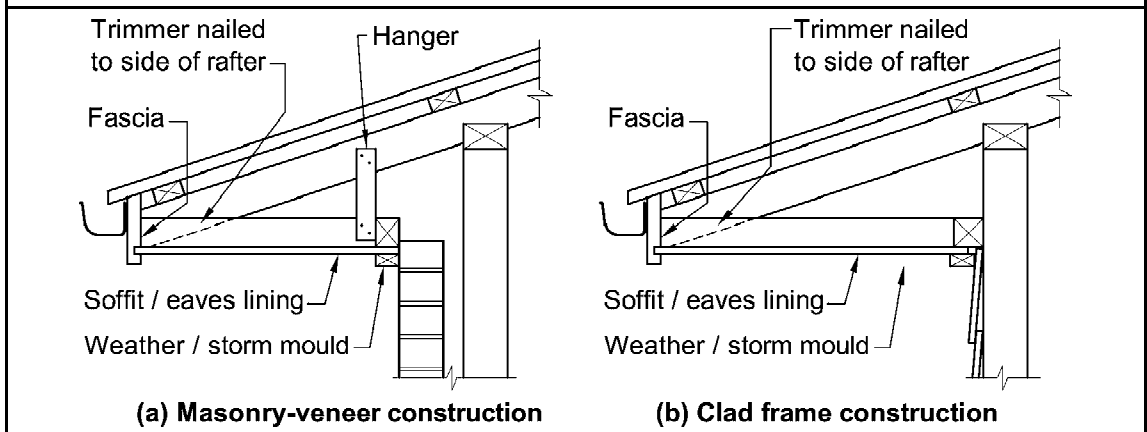**EAVES TRIMMER DETAIL**




### 3.5.3.6 Flashings to wall openings

Openings in *external wall* cladding exposed to the weather must be flashed as follows:

- All openings must be adequately flashed using materials that comply with AS/NZS 2904.
- Flashings* must be securely fixed at least 25 mm under the cladding and extend over the ends and edges of the framing of the opening (see [Figure 3.5.3.4](#)).

Figure 3.5.3.4
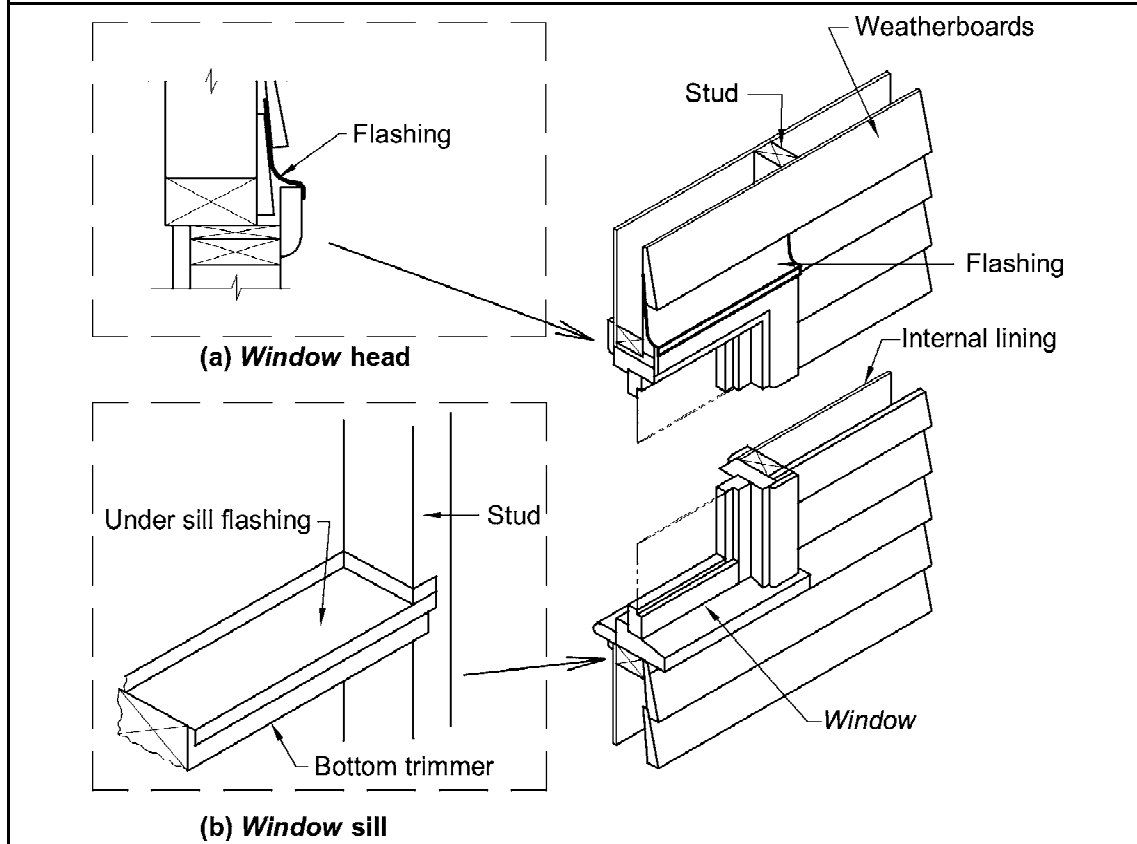
## TYPICAL WINDOW FLASHING DETAIL



PART **3.6**

---

# GLAZING

## 3.6 Glazing

## **PART 3.6 CONTENTS**

### **PART 3.6 GLAZING**

#### **3.6**

#### **Glazing**

- 3.6 Definitions
- 3.6.0 Acceptable construction manuals
- 3.6.1 Application
- 3.6.2 Glazing sizes and installation
- 3.6.3 Fully framed glazing installed in perimeter of buildings
- 3.6.4 Human impact safety requirements
  - 3.6.4.1 Doors
  - 3.6.4.2 Door side panels
  - 3.6.4.3 Full height framed glazed panels
  - 3.6.4.4 Glazed panels, other than doors or side panels, on the perimeter of rooms
  - 3.6.4.5 Bathroom, ensuite and spa room glazing
  - 3.6.4.6 Visibility of glazing



## PART 3.6 GLAZING

### Appropriate *Performance Requirements*:

Where an alternative glazing system is proposed as an *Alternative Solution* to that described in **Part 3.6**, that proposal must comply with—

- (a) *Performance Requirement P2.1*; and
- (b) *Performance Requirement P2.2.2*; and
- (c) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### Definitions

#### 3.6

The following definitions are used in this Part:

**Perimeter of building** means the external envelope of a building.

**Unobstructed opening** means a glazed area that a person could mistake for an open doorway or clearway and walk into the glazed panel.

### A. Acceptable construction manuals

#### 3.6.0

- (a) *Performance Requirements P2.1* and *P2.2.2* are satisfied for glazing and *windows* if designed and constructed in accordance with AS 2047 for the following glazed assemblies in an *external wall*:
  - (i) *Windows* excluding those listed in **(b)**.
  - (ii) Sliding doors with a frame.
  - (iii) Adjustable louvres.
  - (iv) *Window* walls with one piece framing.
- (b) *Performance Requirement P2.1* is satisfied for glazing if designed and constructed in accordance with AS 1288 for all glazed assemblies not covered by **(a)** and the following glazed assemblies:
  - (i) All glazed assemblies not in an *external wall*.
  - (ii) Hinged doors, including French doors and bi-fold doors.
  - (iii) Revolving doors.

- (iv) Fixed louvres.
- (v) Skylights, roof lights and [windows](#) in other than the vertical plane.
- (vi) Sliding doors without a frame.
- (vii) [Windows](#) constructed on site and architectural one-off [windows](#), which are not design tested in accordance with AS 2047.
- (viii) Second-hand [windows](#), re-used [windows](#), recycled [windows](#) and replacement [windows](#).
- (ix) Heritage [windows](#).
- (x) Glazing used in balustrades and sloping overhead glazing.

#### Explanatory information:

1. The reference to heritage [windows](#) in **3.6.0(b)(ix)** is intended to apply to [windows](#) in heritage buildings. The method of determining a heritage building is normally covered by the relevant State or Territory authority.
2. When satisfying [Performance Requirement P2.2.2](#) "Weatherproofing", **Part 3.6** only contains the acceptable construction manual AS 2047 for [windows](#). If AS 1288 is used as an acceptable construction manual for glazing in an [external wall](#), it is still necessary to satisfy **P2.2.2**.

### B. Acceptable construction practice

#### 3.6.1 Application

Compliance with this acceptable construction practice satisfies [Performance Requirement P2.1](#) for glazing, provided—

- (a) the building is located in an area with a [design wind speed](#) of not more than N3; and

#### Explanatory information:

1. Information on [design wind speeds](#) for particular areas may be available from the [appropriate authority](#).
  2. For glazing in [high wind areas](#) refer to **Part 3.10.1**.
- (b) glass is of a type recognised by AS 1288; and
  - (c) safety glazing is legibly marked in accordance with AS 1288; and
  - (d) glazing used in balustrades complies with AS 1288; and
  - (e) safety glazing is made visible in accordance with **3.6.4.6**; and
  - (f) the glazing is not for the following assemblies in an [external wall](#):
    - (i) [Windows](#) excluding those listed in **(g)**.
    - (ii) Sliding doors with a frame.
    - (iii) Adjustable louvres.
    - (iv) [Window](#) walls with one piece framing; and

- (g) the glazing is for all assemblies not covered by (f) and the following glazed assemblies:
- (i) All glazed assemblies not in an *external wall*.
  - (ii) Hinged doors, including French doors and bi-fold doors.
  - (iii) Revolving doors.
  - (iv) Fixed louvres.
  - (v) Skylights, roof lights and *windows* in other than the vertical plane.
  - (vi) Sliding doors without a frame.
  - (vii) *Windows* constructed on site and architectural one-off *windows*, which are not design tested in accordance with AS 2047.
  - (viii) Second-hand *windows*, re-used *windows*, recycled *windows* and replacement *windows*.
  - (ix) Heritage *windows*.

**Explanatory information:**

This acceptable construction practice applies to the selection of glass only and does not include the installation of *windows* or framed glazed doors. This is due to *window* systems relying on the design and testing of structural system members to withstand wind loads (eg; mullions, transoms, and meeting rails and stiles) and the perimeter frame design, sealants and gaskets to resist water penetration.

### 3.6.2 Glazing sizes and installation

Glazing used in buildings must comply with the following:

- (a) Glazing used in the *perimeter of buildings* and supported on all sides must comply with the appropriate provisions listed in **3.6.3**.
- (b) Glazing used in areas where the potential for human impact could occur must comply with the appropriate provisions listed in **3.6.4**.
- (c) For 3 mm monolithic annealed glass, the maximum area must not be more than 0.85 m<sup>2</sup>.
- (d) For 3 mm annealed glass used in Insulated Glass Units (IGU), the maximum area must not be more than 1.36 m<sup>2</sup>.

**Explanatory information:**

An Insulated Glass Unit consists of two or more panes of glass spaced apart and factory sealed with dry air or special gases in the cavity. The term is often abbreviated to IGU.

- (e) All exposed edges must have sharp edges removed.

**Explanatory information:**

The selection of glass thickness relies not just on limit state wind loads but on a number of geometric criteria that include the influence of aspect ratio and slenderness factors. These factors are taken into account in **Tables 3.6.1** to **3.6.3**.

### 3.6.3 Fully framed glazing installed in perimeter of buildings

Fully framed (supported on all sides) ordinary annealed glass (including annealed patterned glass) installed in the *perimeter of buildings* must comply with—

- (a) if the building is located in an area with a wind class not exceeding N1 – [Table 3.6.1](#); or
- (b) if the building is located in an area with a wind class not exceeding N2 – [Table 3.6.2](#); or
- (c) if the building is located in an area with a wind class not exceeding N3 – [Table 3.6.3](#).

#### Explanatory information:

1. For other types of perimeter glazing including toughened, wired, laminated and unframed glazing refer to AS 1288.
2. For ordinary annealed patterned glass thickness measurement refer to AS 1288.

**Table 3.6.1 GLASS THICKNESS FOR WIND CLASS NOT EXCEEDING N1: ORDINARY ANNEALED GLASS**

		EDGE 1 (mm)									
		300	450	600	750	900	1050	1200	1350	1500	1650
EDGE 2 (mm)	300	3	3	3	3	3	3	3	3	3	3
	450	3	3	3	3	3	3	3	3	3	3
	600	3	3	3	3	3	3	3	3	4	4
	750	3	3	3	3	3	3	4	4	4	4
	900	3	3	3	3	3	4	4	4	4	4
	1050	3	3	3	3	4	4	4	4	4	4
	1200	3	3	3	4	4	4	4	4	4	4
	1350	3	3	3	4	4	4	4	4	4	4
	1500	3	3	4	4	4	4	4	4	4	4
	1650	3	3	4	4	4	4	4	4	4	4
	1800	3	3	4	4	4	4	4	4	4	4
	1950	3	4	4	4	4	4	4	4	4	4
	2100	3	4	4	4	4	4	4	4	4	4
	2250	3	4	4	4	4	4	4	4	4	4
	2400	3	4	4	4	4	4	4	4	4	4
	2550	3	4	4	4	4	4	4	4	4	4
	2700	3	4	4	4	4	4	4	4	4	4

**Table 3.6.2 GLASS THICKNESS FOR WIND CLASS NOT EXCEEDING N2: ORDINARY ANNEALED GLASS**

		EDGE 1 (mm)									
		300	450	600	750	900	1050	1200	1350	1500	1650
EDGE 2 (mm)	300	3	3	3	3	3	3	3	3	3	3
	450	3	3	3	3	3	3	3	3	3	3
	600	3	3	3	3	3	3	3	3	4	4
	750	3	3	3	3	3	3	4	4	4	4
	900	3	3	3	3	3	4	4	4	4	4
	1050	3	3	3	3	4	4	4	4	4	4
	1200	3	3	3	4	4	4	4	4	4	4
	1350	3	3	3	4	4	4	4	4	4	4
	1500	3	3	4	4	4	4	4	4	4	4
	1650	3	3	4	4	4	4	4	4	4	4
	1800	3	3	4	4	4	4	4	4	4	4
	1950	3	4	4	4	4	4	4	4	4	4
	2100	3	4	4	4	4	4	4	4	4	5
	2250	3	4	4	4	4	4	4	4	4	5
	2400	3	4	4	4	4	4	4	4	4	5
	2550	3	4	4	4	4	4	4	4	5	5
	2700	3	4	4	4	4	4	4	4	5	5

**Table 3.6.3 GLASS THICKNESS FOR WIND CLASS NOT EXCEEDING N3: ORDINARY ANNEALED GLASS**

		EDGE 1 (mm)									
		300	450	600	750	900	1050	1200	1350	1500	1650
EDGE 2 (mm)	300	3	3	3	3	3	3	3	3	3	3
	450	3	3	3	3	3	3	3	3	3	3
	600	3	3	3	3	3	3	3	3	4	4
	750	3	3	3	3	3	3	4	4	4	4
	900	3	3	3	3	3	4	4	4	4	4
	1050	3	3	3	3	4	4	4	4	4	4
	1200	3	3	3	4	4	4	4	4	4	4
	1350	3	3	3	4	4	4	4	4	4	5
	1500	3	3	4	4	4	4	4	4	5	5
	1650	3	3	4	4	4	4	4	5	5	5
	1800	3	3	4	4	4	4	4	5	5	5
	1950	3	4	4	4	4	4	5	5	5	5
	2100	3	4	4	4	4	4	5	5	5	6
	2250	3	4	4	4	4	4	5	5	5	6
	2400	3	4	4	4	4	4	5	5	6	6
	2550	3	4	4	4	5	5	5	5	6	6
	2700	3	4	4	4	5	5	5	5	6	6

### 3.6.4 Human impact safety requirements

The thickness and type of glazing installed in areas of a building that have a high potential for human impact (an area of a building frequented by the occupants during everyday activities in which a person could fall into or against the glazed panel) must comply as follows:

- Doors — in accordance with [3.6.4.1](#).
- Door side panels — in accordance with [3.6.4.2](#).
- Full height glass panels — in accordance with [3.6.4.3](#).
- Glazed panels, other than doors or side panels, on the perimeter of rooms — in accordance with [3.6.4.4](#).
- Bathrooms, ensuite and spa room glazing — in accordance with [3.6.4.5](#).
- Visibility of glazing — in accordance with [3.6.4.6](#).

#### 3.6.4.1 Doors

Glass in doors must be Grade A safety glazing material in accordance with [Table 3.6.5](#) and [Figure 3.6.1](#), except that—

- (a) unframed doors, other than those incorporated in shower screens or bath enclosures, must be glazed with toughened safety glass with a minimum nominal thickness of 10 mm or laminated toughened safety glass with a minimum total thickness of 10 mm; and
- (b) individual pieces of ordinary annealed glass incorporated in leadlights may be used, to a maximum area of 0.05 m<sup>2</sup> with a minimum nominal thickness of 3 mm; and

#### Explanatory information:

Larger areas of ordinary annealed glass in leadlights are not permitted regardless of glass thickness.

- (c) for annealed and annealed decorated glass panels in doors—
  - (i) for 3 mm and 4 mm annealed glass, the maximum area must not be more than 0.1 m<sup>2</sup> with a maximum panel width of 125 mm; and
  - (ii) for 5 mm and 6 mm annealed glass, the maximum area must not be more than 0.26 m<sup>2</sup> with a maximum panel width of 300 mm; and
- (d) for annealed glass in fully framed panels with a thickness of 10 mm or more, with or without bevelled edges, the maximum area must not be more than 0.5 m<sup>2</sup>; and
- (e) doors in bathrooms, ensuites and spa rooms must be glazed in accordance with 3.6.4.5.

### 3.6.4.2 Door side panels

- (a) All framed glass (except leadlight panels) in side panels with their nearest vertical sight line less than 300 mm from the nearest edge of the doorway opening must be Grade A safety glazing material in accordance with Table 3.6.5 and Figure 3.6.1, except that—
  - (i) where the lowest visible sight line is 1.2 m or more above the highest abutting finished floor level, ordinary annealed glass in accordance with Table 3.6.4 may be used; or
  - (ii) where the lowest visible sight line is less than 1.2 m above the highest abutting finished floor level, ordinary annealed glass in accordance with Table 3.6.4, with an area of not more than 0.5 m<sup>2</sup>, may be used; or
  - (iii) where the side panel consists of glass louvres with exposed edges or where the louvres are installed less than 500 mm above the highest abutting finished floor level—
    - (A) for blade widths not more than 230 mm with blade lengths not more than 1 m, Grade A toughened safety glazing not less than 5 mm thick must be used; and
    - (B) for blade widths more than 230 mm, Grade A toughened safety glazing not less than 10 mm thick must be used.
- (b) Framed glass panels with the nearest vertical sight line not less than 300 mm from the nearest edge of the door opening are not considered to be side panels for the purposes of (a).

**Table 3.6.4 MAXIMUM AREAS OF ORDINARY ANNEALED GLASS IN SIDE PANELS**

Minimum nominal thickness (mm)	Maximum area of pane (m <sup>2</sup> )
3	0.8
4	1.4

Table 3.6.4 MAXIMUM AREAS OF ORDINARY ANNEALED GLASS IN SIDE PANELS— continued


Minimum nominal thickness (mm)	Maximum area of pane (m <sup>2</sup> )
5	2.2
6	3.3

### 3.6.4.3 Full height framed glazed panels

- (a) A glazed panel located in a building so that it is capable of being mistaken for an *unobstructed opening* must be glazed with—
- Grade A safety glazing material in accordance with Table 3.6.5; or
  - ordinary annealed glass complying with Table 3.6.5 provided the glazed area is not more than 0.9 m<sup>2</sup>.
- (b) Glazed panels are not considered an *unobstructed opening* where any of the following apply:
- The clear opening width is not more than 500 mm.
  - The lowest sight line of the opening is not less than 500 mm above the highest abutting finished floor level.
  - The glass is made apparent by means of transoms, colonial bars, other components of the glazing system, permanent motifs or other decorative treatment on or etched into the glass, of sufficient magnitude to be readily apparent, or the glass is opaquely coloured or patterned to indicate its presence.
  - A chair rail or handrail not less than 40 mm thick, or the like, is provided at a height of 865 mm above the adjoining ground level.
  - The difference in floor level on either side of the panel is greater than 500 mm.

Figure 3.6.1

#### IDENTIFICATION OF GLAZING REQUIREMENTS FOR DOORS AND SIDE PANELS

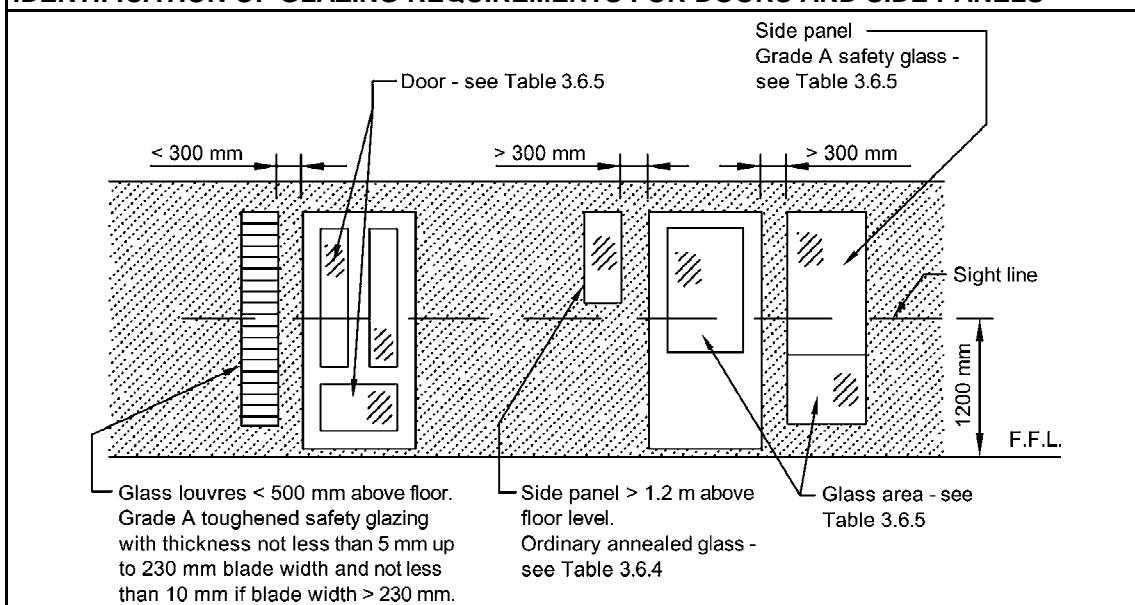




**Table 3.6.5 MAXIMUM AREAS OF GLAZING MATERIAL FOR FRAMED GLASS DOORS, FRAMED GLASS SIDE PANELS, AND OTHER FRAMED GLAZED PANELS**

Type of glass	Minimum nominal thickness (mm)	Maximum area of pane (m <sup>2</sup> )
Patterned or clear ordinary annealed glass	5	0.3
	6	0.9
Grade A Toughened and toughened laminated safety glass	3	1
	4	2
	5	3
	6	4
Grade A laminated safety glass	5.38	2.2
	6.38	3
	8.38	5

**3.6.4.4 Glazed panels, other than doors or side panels, on the perimeter of rooms**

All framed glazing where the lowest sight line of the glazing panel is less than 500 mm from the highest abutting finished floor level (see [Figure 3.6.2](#)) must be—

- Grade A safety glazing material in accordance with [Table 3.6.5](#); or
- ordinary annealed glass not less than 5 mm nominal thickness provided that the area of the glazing panel is not more than 1.2 m<sup>2</sup>.

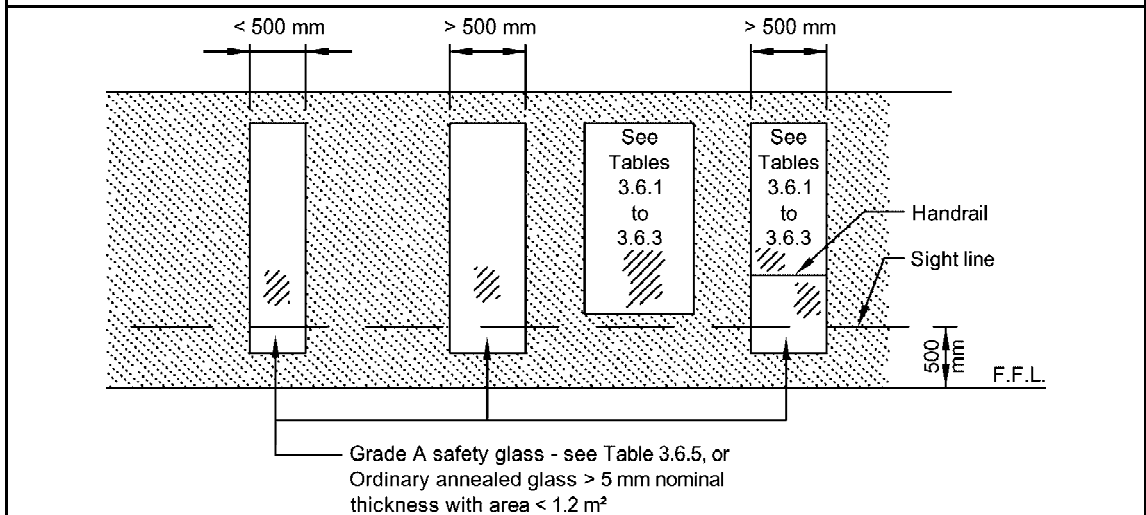**Figure 3.6.2****IDENTIFICATION OF GLAZING REQUIREMENTS FOR GLAZED PANELS**

### 3.6.4.5 Bathroom, ensuite and spa room glazing

- (a) All glazing in bathrooms, ensuites, spa rooms or the like, including shower doors, shower screens, bath enclosures, and associated [windows](#), where the lowest sight line is less than 2.0 m above the highest abutting finished level of the floor, bottom of the bath, or shower base, must—
- (i) for framed panels, be glazed with—
    - (A) Grade A safety glazing material in accordance with [Table 3.6.5](#); or
    - (B) Grade B safety glazing material in accordance with [Table 3.6.6](#) (see also [Figure 3.6.3](#)); or
  - (ii) for panels or doors with any edge exposed, be toughened safety glass in accordance with [Table 3.6.5](#) with a minimum nominal thickness of 5 mm.
- (b) [Windows](#) referred to in (a), may incorporate annealed glass panels of not less than 4 mm thickness, provided that they are not more than 0.1 m<sup>2</sup> in area.
- (c) Ordinary annealed glass, including mirror, may be used provided a fixed vanity or bench with a height of not less than 760 mm, depth of not less than 300 mm and extending the full width of the glass or mirror is located in front of the glass or mirror.


#### Explanatory information:

Care should be taken when using showers fitted with safety wired glass, safety organic-coated glass, and laminated safety glass products that are liable to damage from thermal shock. Thermal shock occurs from hot water from the shower hitting the shower screen during cold weather.

**Table 3.6.6 MAXIMUM AREAS OF GRADE B SAFETY GLAZING MATERIALS FOR SHOWER DOORS, SHOWER SCREENS AND BATH ENCLOSURES**

Type of glass	Standard nominal thickness (mm)	Maximum area of pane (m <sup>2</sup> )	Area (Fig. 3.6.3)
Safety wired glass	Greater than or equal to 6	2.5	A, B, C
Safety organic coated glass	3	1	A, B, C, D
	4	1.5	
	5	2	
	Greater than or equal to 6	3	

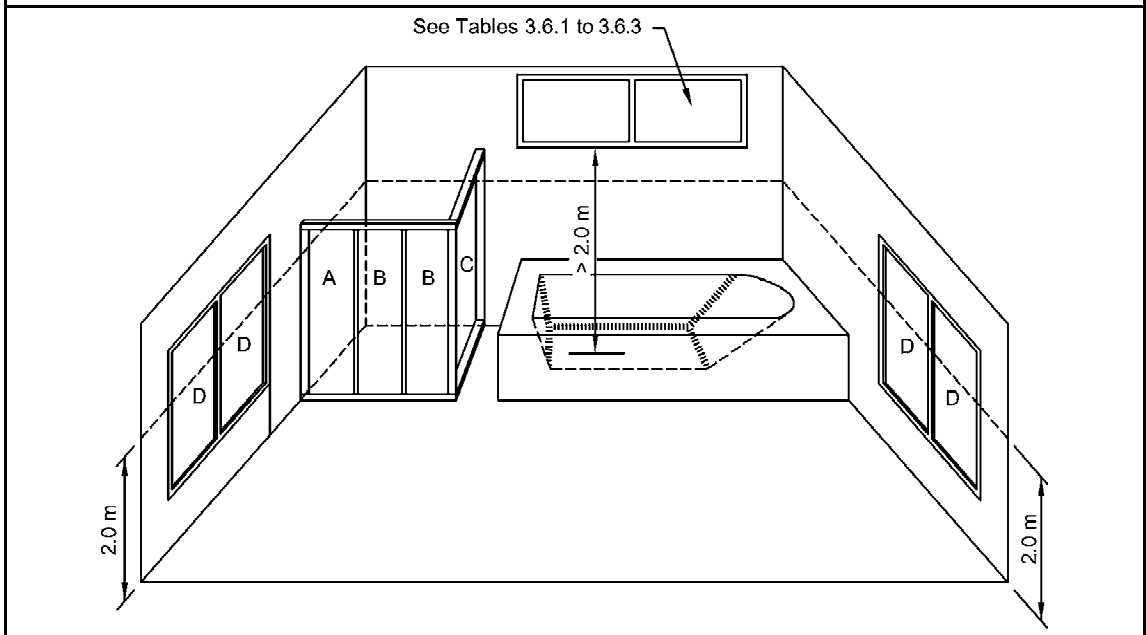Figure 3.6.3

**IDENTIFICATION OF GLAZING REQUIREMENTS FOR BATHROOMS, ENSUITES AND SPA ROOMS****3.6.4.6 Visibility of glazing**

- (a) If the presence of glazing in a door, side panel or panel capable of being mistaken for a doorway or opening is not made apparent in accordance with [3.6.4.3\(b\)\(iii\)](#), the glass must be marked to make it readily visible in accordance with [\(b\)](#).
- (b) Marking must be in the form of an opaque band not less than 20 mm in height located so that—
  - (i) the upper edge is not less than 700 mm above the floor; and
  - (ii) the lower edge is not more than 1.2 m above the floor.

**Explanatory information:**

1. Making the glass visible by marking is not a substitute for the use of safety glazing in accordance with this Part.
2. A broken line or patterns may be an acceptable form of marking provided it meets the criteria set out in [3.6.4.6\(b\)](#).

- (c) A band or marking is not *required* where any of the following applies:
  - (i) The height of the glazing is not more than 1 m in any part.
  - (ii) The width of the glazing panel is not more than 500 mm in any part.
  - (iii) There is no glazing within 700 mm of the floor.
  - (iv) The glazing is provided with not less than one fixed glazing bar which must—
    - (A) be firmly attached to the styles to locate and protect each face of the glass; and

- (B) be located with its upper edge not less than 500 mm and its bottom edge not more than 1 m above the floor; and
- (C) have a face width not less than 40 mm.

# PART 3.7

---

## FIRE SAFETY

- 3.7.1 Fire Separation
- 3.7.2 Smoke Alarms
- 3.7.3 Heating Appliances
- 3.7.4 Bushfire Areas
- 3.7.5 Alpine Areas

## **PART 3.7 CONTENTS**

### **PART 3.7 FIRE SAFETY**

#### **3.7.1 Fire separation**

- 3.7.1.1 Application
- 3.7.1.2 General concession — non-combustible materials
- 3.7.1.3 External walls of Class 1 buildings
- 3.7.1.4 Measurement of distances
- 3.7.1.5 Construction of external walls
- 3.7.1.6 Class 10a buildings
- 3.7.1.7 Allowable encroachments
- 3.7.1.8 Separating walls
- 3.7.1.9 Fire hazard properties
- 3.7.1.10 Roof lights

#### **3.7.2 Smoke alarms**

- 3.7.2.1 Application
- 3.7.2.2 Requirements for smoke alarms
- 3.7.2.3 Location — Class 1a buildings
- 3.7.2.4 Location — Class 1b buildings
- 3.7.2.5 Lighting to assist evacuation — Class 1b buildings

#### **3.7.3 Heating appliances**

- 3.7.3.0 Acceptable construction manuals
- 3.7.3.1 Application
- 3.7.3.2 Open fireplace construction
- 3.7.3.3 Chimney construction
- 3.7.3.4 Installation of insert fireplaces and flues
- 3.7.3.5 Installation of free standing heating appliances

#### **3.7.4 Bushfire areas**

- 3.7.4.0 Acceptable construction manuals
- 3.7.4.1 Application
- 3.7.4.2 Categories of bushfire attack
- 3.7.4.3 Construction requirements

#### **3.7.5 Alpine areas**

- 3.7.5.1 Application
- 3.7.5.2 External doorways
- 3.7.5.3 External ramps
- 3.7.5.4 Discharge of external doorways providing a means of egress
- 3.7.5.5 External trafficable structures

## PART 3.7.1 FIRE SEPARATION

### Appropriate *Performance Requirements*:

Where an alternative fire separation design is proposed as an *Alternative Solution* to that described in **Part 3.7.1**, that proposal must comply with—

- (a) *Performance Requirement P2.3.1*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### Acceptable construction practice

#### 3.7.1.1 Application

Compliance with this acceptable construction practice satisfies *Performance Requirement P2.3.1* for fire separation.

#### 3.7.1.2 General concession — non-combustible materials

The following materials, though *combustible* or containing *combustible* fibres, may be used wherever a *non-combustible* material is *required* in the *Housing Provisions*—

- (a) plasterboard; and
- (b) perforated gypsum lath with a normal paper finish; and
- (c) fibrous-plaster sheet; and
- (d) fibre-reinforced cement sheeting; and
- (e) pre-finished metal sheeting having a *combustible* surface finish not exceeding 1 mm thick and where the *Spread-of-Flame Index* of the product is not more than 0; and
- (f) bonded laminated materials where—
  - (i) each laminate is *non-combustible*; and
  - (ii) each adhesive layer is not more than 1 mm thick; and
  - (iii) the total thickness of adhesive layers is not more than 2 mm; and
  - (iv) the *Spread-of-Flame Index* and the *Smoke-Developed Index* of the laminated material as a whole does not exceed 0 and 3 respectively.

#### 3.7.1.3 External walls of Class 1 buildings

An *external wall* of a Class 1 building, and any openings in that wall, must comply with **3.7.1.5** if the wall is less than—

- (a) 900 mm from an allotment boundary other than the boundary adjoining a road alignment or other public space; or

- (b) 1.8 m from another building on the same allotment other than an appurtenant Class 10 building or a detached part of the same Class 1 building.

#### 3.7.1.4 Measurement of distances


- (a) The distance from any point on an *external wall* of a building to an allotment boundary or another building is the distance to that point measured along a line at right angles from the allotment boundary or *external wall* of the other building which intersects that point without being obstructed by a wall complying with 3.7.1.5.
- (b) Where a wall within a specified distance is *required* to be constructed in a certain manner, only that part of the wall (including any openings) within the specified distance need be constructed in that manner.
- (see Figure 3.7.1.1 and 3.7.1.2a)
- (c) Where the distance measured is between buildings of different heights, the distance must be taken from the *external wall* with the highest elevation measured at right angles to a point that intersects a vertical projection above the adjacent wall (see Figure 3.7.1.2b).

**Figure 3.7.1.1**
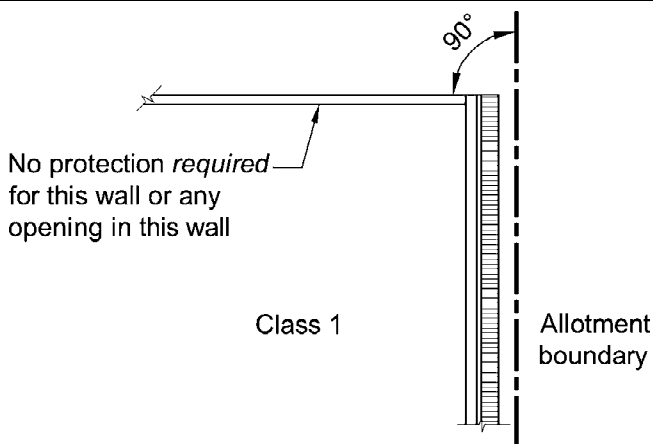
#### WALLS AT RIGHT ANGLES TO THE BOUNDARY

##### Notes:

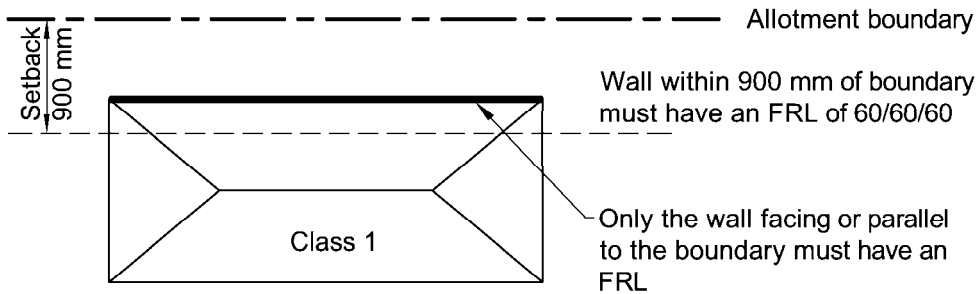
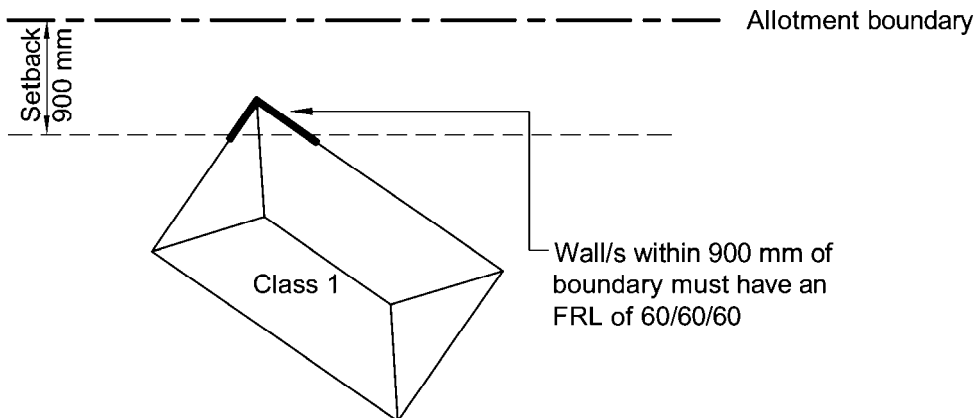
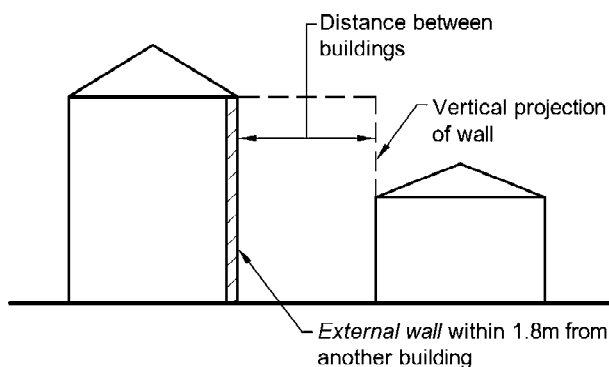
1. No protection *required* for the wall at right angles or more to the boundary.
2. For protection of encroachments refer 3.7.1.7.





**Figure 3.7.1.2a****MEASUREMENT OF DISTANCES (Plan view)**

**Note:** Setback distance is measured at right angles to the boundary.

**Diagram a. Full wall protection****Diagram b. Part walls protection****Figure 3.7.1.2b****MEASUREMENT OF DISTANCE — BUILDINGS OF DIFFERENT HEIGHTS****Class 1 buildings on same allotment**

### 3.7.1.5 Construction of external walls

- (a) *External walls* (including gables) *required* to be *fire-resisting* (referred to in 3.7.1.3 or 3.7.1.6) must extend to the underside of a *non-combustible* roof covering or *non-combustible* eaves lining (See Figure 3.7.1.3) and must—
- (i) have an FRL of not less than 60/60/60 when tested from the outside; or
  - (ii) be of masonry-veneer construction in which the external masonry veneer is not less than 90 mm thick; or
  - (iii) be of masonry construction not less than 90 mm thick.

#### Explanatory information:

The intent of the typical construction details shown in Figure 3.7.1.3 is to ensure that combustible materials (external or internal) are not directly exposed to fire at the junction of the wall and non-combustible roof, eaves lining, guttering and the like. Other forms of construction may also be acceptable provided that they achieve this intent.

See Figure 3.7.1.10 and 3.8.6.3 for internal *separating wall* construction under one common roof.


- (b) Openings in *external walls required* to be *fire-resisting* (referred to in 3.7.1.3 or 3.7.1.6) must be protected by—
- (i) non-openable fire *windows* or other construction with an FRL of not less than –/60/–; or
  - (ii) *self-closing* solid core doors not less than 35 mm thick.
- (c) Sub-floor vents, roof vents, weepholes, control joints, construction joints and penetrations for pipes, conduits and the like need not comply with (b).
- (d) Concessions for non-*habitable room windows*.

Despite the requirements in (b), in a non-*habitable room*, a *window* that faces the boundary of an adjoining allotment may be not less than 600 mm from that boundary or, where the *window* faces another building on the same allotment, not less than 1200 mm from that building provided that—

- (i) in a bathroom, laundry or toilet, the opening has an area of not more than 1.2 m<sup>2</sup>; or
- (ii) in a room other than referred to in (i), the opening has an area of not more than 0.54 m<sup>2</sup> and—
  - (A) the *window* is steel-framed, there are no opening sashes and it is glazed in wired glass; or
  - (B) the opening is enclosed with translucent hollow glass blocks.

**Figure 3.7.1.3****TYPICAL CONSTRUCTION OF EXTERNAL WALLS****Notes:**

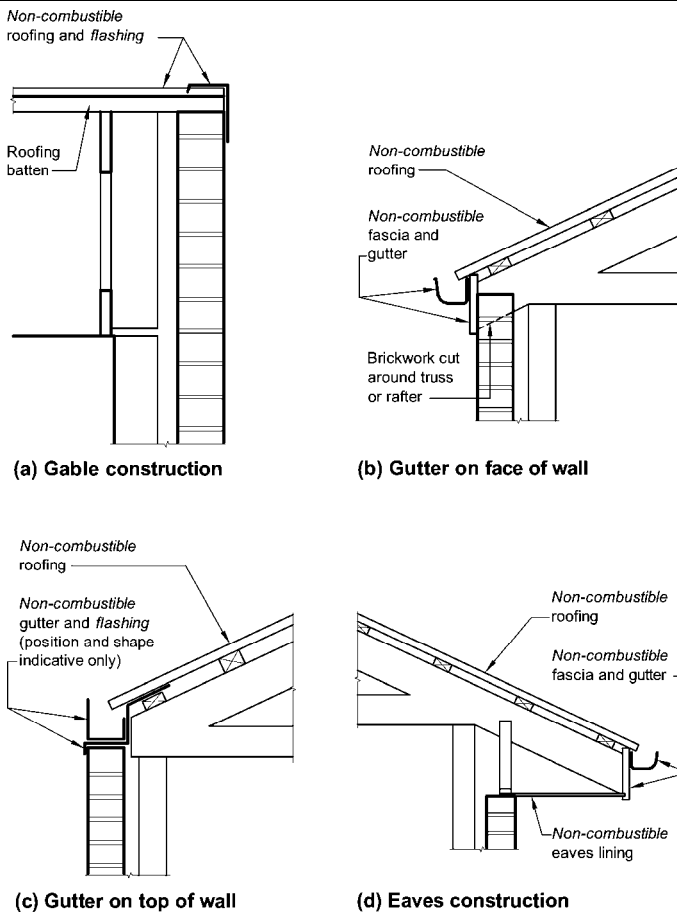1. The *external wall* is deemed to extend to the underside of *non-combustible* roof covering, or *non-combustible* eaves lining, when constructed as shown.
2. Where sarking is installed it must be located so that ponding of water is avoided between the fascia and the first roofing batten.
3. The location of flashing and framing is indicative only.

**3.7.1.6 Class 10a buildings**

- (a) Where a Class 10a building is located between a Class 1 building and the allotment boundary, other than the boundary adjoining a road alignment or other public space, the Class 1 building must be protected by one of the following methods shown in [Figure 3.7.1.4](#).
- (b) Where a Class 10a building is located between a Class 1 building to which it is appurtenant and another building on the same allotment, the Class 1 building must be protected by one of the methods shown in [Figure 3.7.1.5](#).

- (c) Where two or more Class 10a buildings on the same allotment are appurtenant to different Class 1 buildings, the Class 10a buildings must be separated in accordance with one of the methods shown in [Figure 3.7.1.6](#).

Figure 3.7.1.4

### PROTECTION OF CLASS 1 BUILDINGS — CLASS 10a BETWEEN CLASS 1 AND THE ALLOTMENT BOUNDARY

#### Legend:



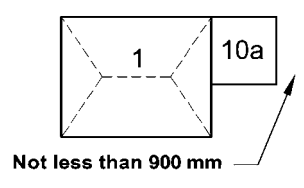
Wall with an FRL of  
60/60/60



Allotment boundary


#### a. 900 mm from allotment boundary

The Class 10a building is not less than 900 mm from the allotment boundary, other than the boundary adjoining a road alignment or other public space.




#### b. *External wall* to Class 10a building with FRL

An *external wall* of the Class 10a building which is less than 900 mm from an allotment boundary, other than the boundary adjoining a road alignment or other public space, complies with [3.7.1.5](#).



#### c. *External wall* to Class 10a building with FRL

An *external wall* of the Class 10a building which is less than 900 mm from the Class 1 building complies with [3.7.1.5](#).



#### d. 900 mm separation between buildings

The Class 1 building is not less than 900 mm from the Class 10a building.

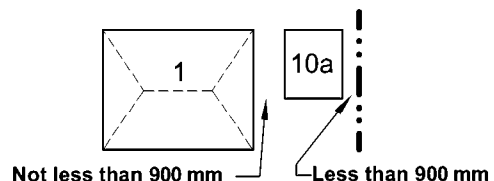


Figure 3.7.1.4

**PROTECTION OF CLASS 1 BUILDINGS — CLASS 10a BETWEEN CLASS 1 AND THE ALLOTMENT BOUNDARY**

Legend:

Wall with an FRL of  
60/60/60

Allotment boundary

**e. Class 1 building with FRL to *external wall***

An *external wall* of the Class 1 building which is less than 900 mm from the Class 10a building complies with 3.7.1.5.





Figure 3.7.1.5

**PROTECTION OF CLASS 1 BUILDINGS — CLASS 10a BETWEEN CLASS 1 AND OTHER BUILDINGS ON ALLOTMENT**

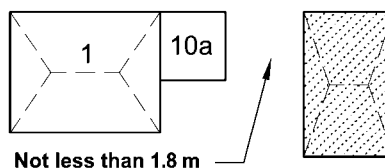
Legend:

Wall with a FRL of  
60/60/60Other Class building  
on allotment**a. 1.8 m from other building on allotment**

The Class 10a building is not less than 1.8 m from the other building.

**b. *External wall* to Class 10a building with FRL**

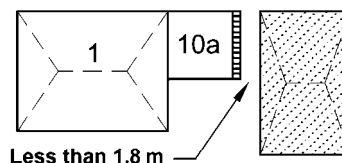An *external wall* of the Class 10a building which is less than 1.8 m from the other building complies with 3.7.1.5.

**c. *External wall* to Class 10a building with FRL**

An *external wall* of the Class 10a building which is less than 1.8 m from the Class 1 building complies with 3.7.1.5.

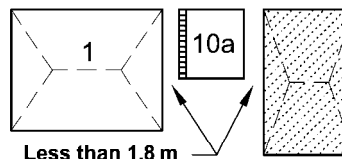


Figure 3.7.1.5

**PROTECTION OF CLASS 1 BUILDINGS — CLASS 10a BETWEEN CLASS 1 AND OTHER BUILDINGS ON ALLOTMENT**

Legend:



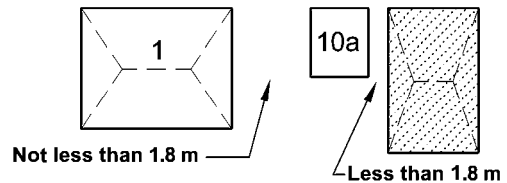
Wall with a FRL of  
60/60/60



Other Class building  
on allotment

**d. 1.8 m separation between Class 1 and 10a**

The Class 1 building is not less than 1.8 m from the Class 10a building.

**e. Class 1 building with FRL to *external wall***

An *external wall* of the Class 1 building which is less than 1.8 m from the Class 10a building complies with 3.7.1.5.

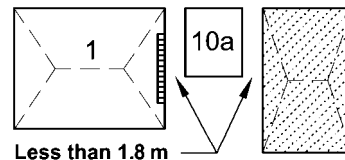


Figure 3.7.1.6

**PROTECTION OF CLASS 1 BUILDINGS — SEPARATION OF CLASS 10a BUILDINGS ON AN ALLOTMENT**

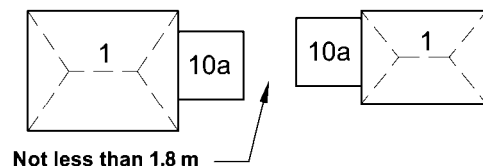
Legend:



Wall with a FRL of 60/60/60

**a. 1.8 m between Class 10a buildings**

Each 10a must be separated from each other by a distance of not less than 1.8 m.

**b. *External wall* to Class 10a building with FRL**

Each 10a must be separated from each other by *external walls* complying with 3.7.1.5.

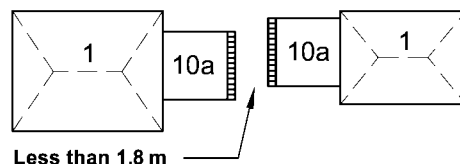
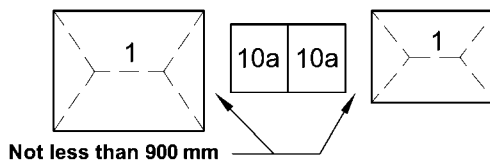



Figure 3.7.1.6

**PROTECTION OF CLASS 1 BUILDINGS — SEPARATION OF CLASS 10a BUILDINGS ON AN ALLOTMENT****Legend:****Wall with a FRL of 60/60/60****c. 900 mm separation between Class 10a and Class 1 buildings**

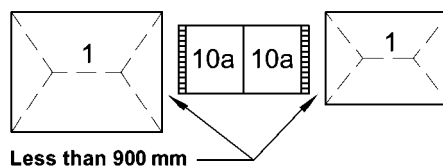
Each 10a must be separated from each Class 1 building by a distance of not less than 900 mm.

**d. External wall to Class 10a buildings with FRL**

Each 10a must be separated from each Class 1 building by *external walls* complying with 3.7.1.5.

**e. Class 10a buildings with FRL to separating wall**

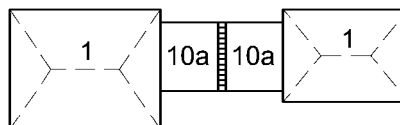Each 10a must be separated by a wall complying with 3.7.1.8.




(d) A carport is exempt from (a), (b) and (c) if—


- (i) it has two or more sides open and not less than one third of its perimeter open and, for the purposes of this clause, a side is considered to be open if the roof covering adjacent to that side is not less than 500 mm from another building or allotment boundary; and
- (ii) it has a polycarbonate or *non-combustible* roof covering and any ceiling lining and wall cladding, including gables, is also *non-combustible* (see Figure 3.7.1.7); and

Figure 3.7.1.7

## IDENTIFYING AN OPEN CARPORT

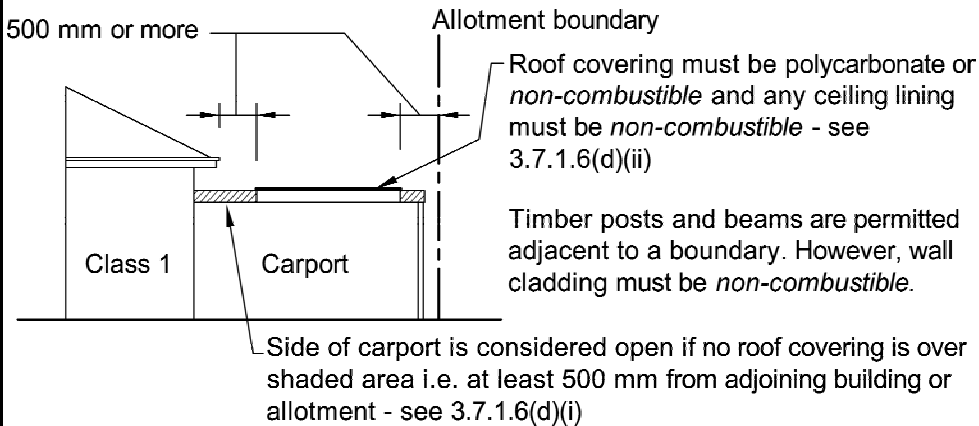

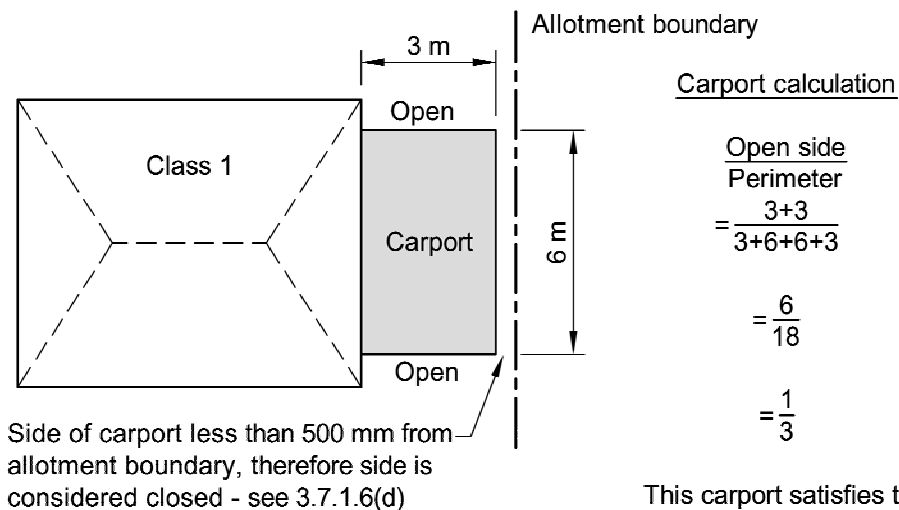(a) Example A




(b) Example B

- (iii) it does not provide direct vertical support to any part of the Class 1 building; and
- (iv) in the case where it has a common roof structure with the Class 1 building and the carport does not have a ceiling (see [Figure 3.7.1.8](#)), the opening between the top of the wall of the Class 1 building and the underside of the roof covering is infilled with—
  - (A) a *non-combustible* material; or
  - (B) construction clad with *non-combustible* material on the carport side.



Figure 3.7.1.8

## REQUIREMENTS FOR NON-COMBUSTIBLE INFILL PANELS TO CARPORT

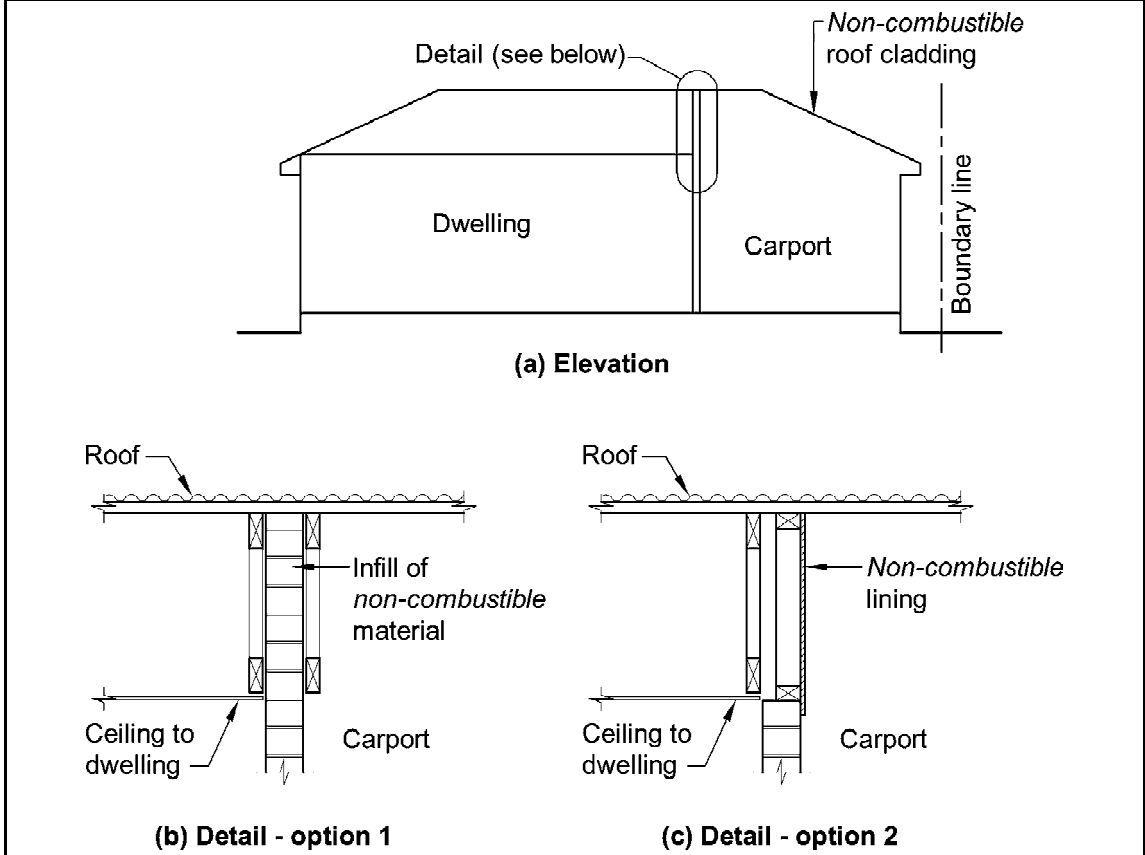


- (e) Class 10a buildings must not significantly increase the risk of spread of fire between Class 2 to 9 buildings.

## 3.7.1.7 Allowable encroachments

- (a) An encroachment is any construction between the *external wall* of the building and the allotment boundary other than a boundary adjoining a road or other public space, or the *external walls* of two buildings on the same allotment and relates to any *external wall* of—
- a Class 10a building *required* to comply with 3.7.1.5; or
  - a Class 1 building.
- (b) The encroachments allowed within 900 mm of an allotment boundary or within 1.8 m of another building on the same allotment are—
- fascias, gutters and downpipes; and
  - eaves with *non-combustible* roof cladding and *non-combustible* lining; and
  - flues, chimneys, pipes, domestic fuel tanks, cooling or heating appliances or other services; and
  - light fittings, electricity or gas meters, aerials or antennas; and


- (v) pergolas, sun blinds or water tanks; and
- (vi) unroofed terraces, landings, steps and ramps, not more than 1 m in height.
- (c) Encroachments listed in (b)(i), if *combustible*, (b)(ii) and (b)(iii) must not be built within 450 mm of an allotment boundary nor be built within 900 mm of the *external wall* or associated encroachments of another building on the same allotment. (see **Figure 3.7.1.9**)

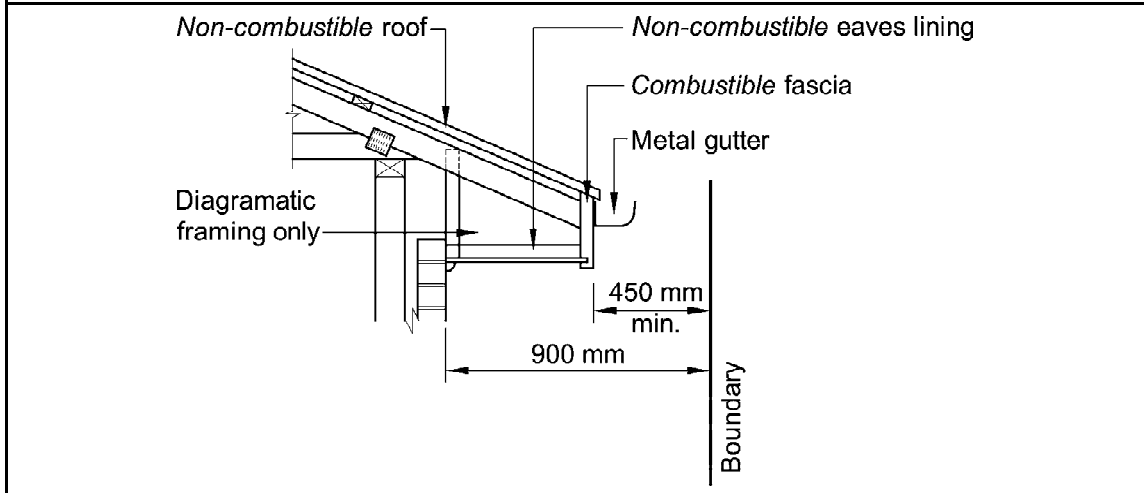**Figure 3.7.1.9****ALLOWABLE ENCROACHMENTS FOR NON-COMBUSTIBLE CONSTRUCTION****3.7.1.8 Separating walls**

- (a) A *separating wall* between Class 1 buildings, or a wall that separates a Class 1 building from a Class 10a building which is not appurtenant to that Class 1 building must have an FRL of not less than 60/60/60 and—
  - (i) commence at the footings or ground slab (see **Figure 3.7.1.10**); and
  - (ii) extend—
    - (A) if the building has a *non-combustible* roof covering, to the underside of the roof covering (see **Figure 3.7.1.10** and **Figure 3.7.1.11**); or
    - (B) if the building has a *combustible* roof covering, to not less than 450 mm above the roof covering (see **Figure 3.7.1.10**).
- (b) A *separating wall* of *lightweight construction* must be tested in accordance with **Specification C1.8** of the BCA Volume One.

Figure 3.7.1.10

## SEPARATING WALL CONSTRUCTION

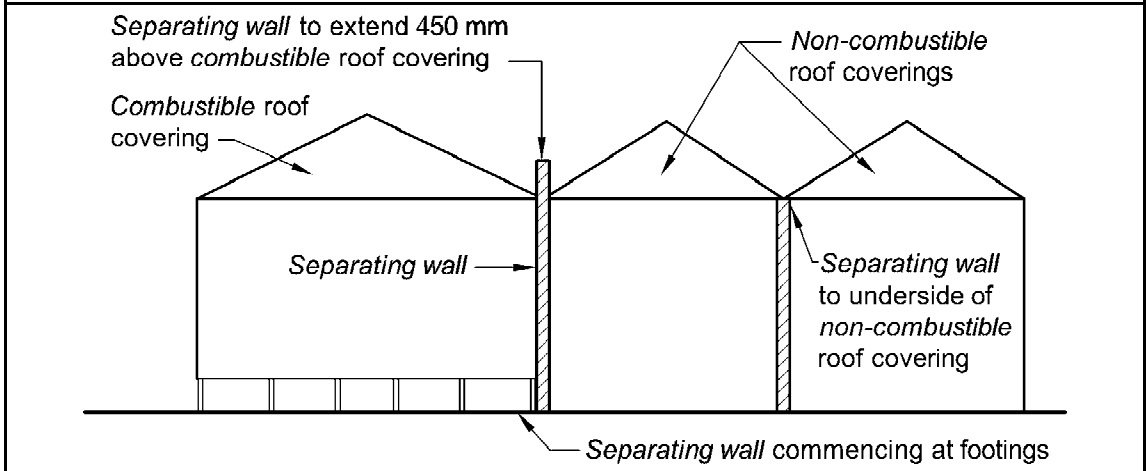

- (c) A *separating wall* complying with (a)(ii)(A)—
- (i) must not be crossed by timber or other *combustible* building elements except for roof battens with dimensions of 75x50 mm or less, or roof sarking; and
  - (ii) must have any gap between the top of the wall and the underside of the roof covering packed with mineral fibre or other suitable *fire-resisting* material.
- (d) Where a building has a masonry veneer *external wall*, any gap between the *separating wall* and the external masonry veneer must be—
- (i) not more than 50 mm; and
  - (ii) packed with a mineral fibre or other suitable fire resistant material with the packing arranged to maintain any weatherproofing requirements of **Part 3.3.4**.
- (e) Eaves, verandahs and similar spaces that are open to the roof space and are common to more than one Class 1 dwelling must be separated by a *non-combustible* vertical lining (see **Figure 3.7.1.11** Diagram b).
- (f) Any service opening, other than those listed in (g), (h) and (i), in a *separating wall* must have construction with an FRL of not less than -/60/60.
- (g) If an electrical wire or cable penetrates a *separating wall*—
- (i) the service and building element at the penetration must be identical with a prototype assembly which has been tested in accordance with AS 4072.1 and AS 1530.4 and achieved an FRL of not less than -/60/60; or
  - (ii) the service must be installed so that—
    - (A) the opening is neatly formed, cut or drilled and no closer than 50 mm to any other service; and
    - (B) the opening is no larger in cross-section than—
      - (aa) 2000 mm<sup>2</sup> if only a single cable is accommodated and the gap between the cable and the wall is no wider than 15 mm; or
      - (bb) 500 mm<sup>2</sup> in any other case; and

- (C) any gap between the service and the wall is packed with mineral fibre or other suitable fire resistant material.
- (h) If an electrical switch, outlet, socket or the like is accommodated in a *separating wall*—
  - (i) the service and building element at the penetration must be identical with a prototype assembly which has been tested in accordance with AS 4072.1 and AS 1530.4 and achieved an FRL of not less than -/60/60; or
  - (ii) the service must be installed so that—
    - (A) the opening or recess must not—
      - (aa) be located opposite any point within 300 mm horizontally or 600 mm vertically of any opening or recess on the opposite side of the wall; or
      - (bb) extend beyond half the thickness of the wall; and
    - (B) any gap between the service and the wall is packed with mineral fibre or other suitable fire resistant material.
- (i) Other than where a tested system is used in accordance with (h)(i), if an electrical switch, socket, outlet or the like is accommodated in a hollow *separating wall* (such as a stud wall, masonry *cavity* wall or a wall of hollow blockwork), the *cavity* immediately behind the service must be framed and packed with mineral fibre or other suitable fire resistant material (see [Figure 3.7.1.11](#) Diagram c).

#### Explanatory information:

It is important that any opening in a *separating wall* between Class 1 buildings not allow the free passage of fire between the buildings. On the other hand, many designs would require the installation of openings for electrical cables and outlets in these walls. [3.7.1.8\(f\)](#) therefore allows such openings provided they have an FRL of at least -/60/60 or comply with the details set out in [3.7.1.8\(g\)](#), [\(h\)](#) and [\(i\)](#).

### 3.7.1.9 Fire hazard properties

The fire hazard properties of materials used in a Class 1 building, including common floor or ceiling spaces with a Class 10 building, must comply with the following:

- (a) *Sarking-type materials* used in the roof must have a *flammability index* not greater than 5.
- (b) Flexible ductwork used for the transfer of products initiating from a heat source that contains a flame must comply with the fire hazard properties set out in AS 4254.

### 3.7.1.10 Roof lights

*Combustible* roof lights, skylights or the like installed in a roof or part of a roof *required* to have a *non-combustible* covering must—


- (a) have an aggregate area not more than 20% of the roof or part of the roof; and
- (b) be not less than—
  - (i) 900 mm from—
    - (A) the allotment boundary other than the boundary adjoining a road alignment or other public space; and
    - (B) the vertical projection of a *separating wall* extending to the underside of the roof covering; and

- (ii) 1.8 m from any roof light or the like in another building on the allotment other than an appurtenant building or a detached part of the same building. (See [Figure 3.7.1.12](#)).


Figure 3.7.1.11

## SEPARATING WALL CONSTRUCTION—UNDERSIDE OF NON-COMBUSTIBLE ROOF CLADDING
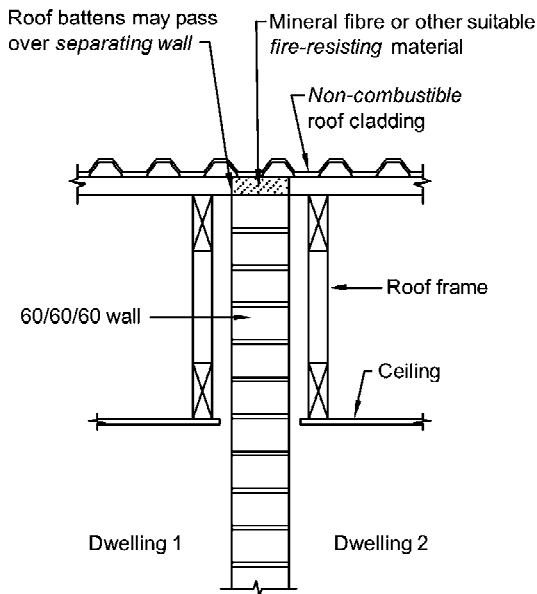
## Diagram a.



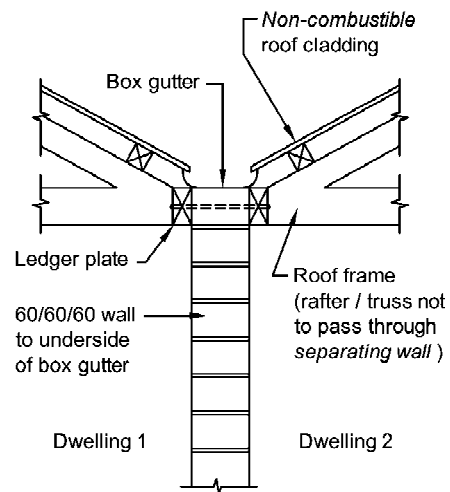(a) Wall parallel to roof frame



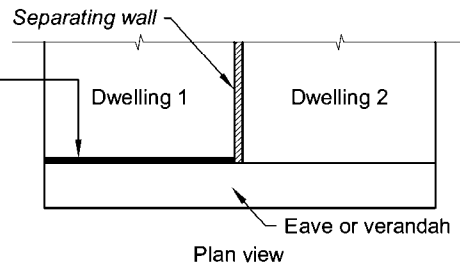
(b) Wall at right-angles to roof frame

Figure 3.7.1.11

**SEPARATING WALL CONSTRUCTION—UNDERSIDE OF NON-COMBUSTIBLE ROOF CLADDING****Diagram b.**

**OPTION 1** *Non-combustible* vertical lining installed between roof space of one Class 1 and the common eaves or verandah space

Elements crossing the *non-combustible* vertical lining must comply with Clause 3.7.1.8(c)(i)

**(c) Separation of dwelling and eaves / verandahs**

**OPTION 2** *Non-combustible* vertical lining installed in common eaves or verandah space

Elements crossing the *non-combustible* vertical lining must comply with Clause 3.7.1.8(c)(i)

Note: The *non-combustible* vertical lining need only be installed on one side of a rafter, truss or supporting framework, provided that it forms a continuous barrier with the *separating wall*


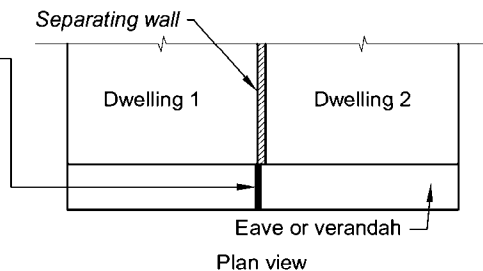
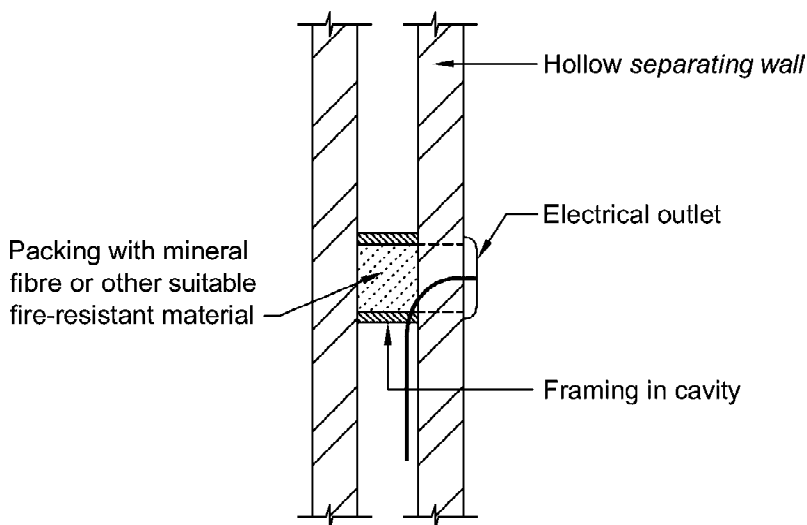
**(d) Separation of eave / verandah****Diagram c.**

Figure 3.7.1.12

## LOCATION OF COMBUSTIBLE ROOF LIGHTS

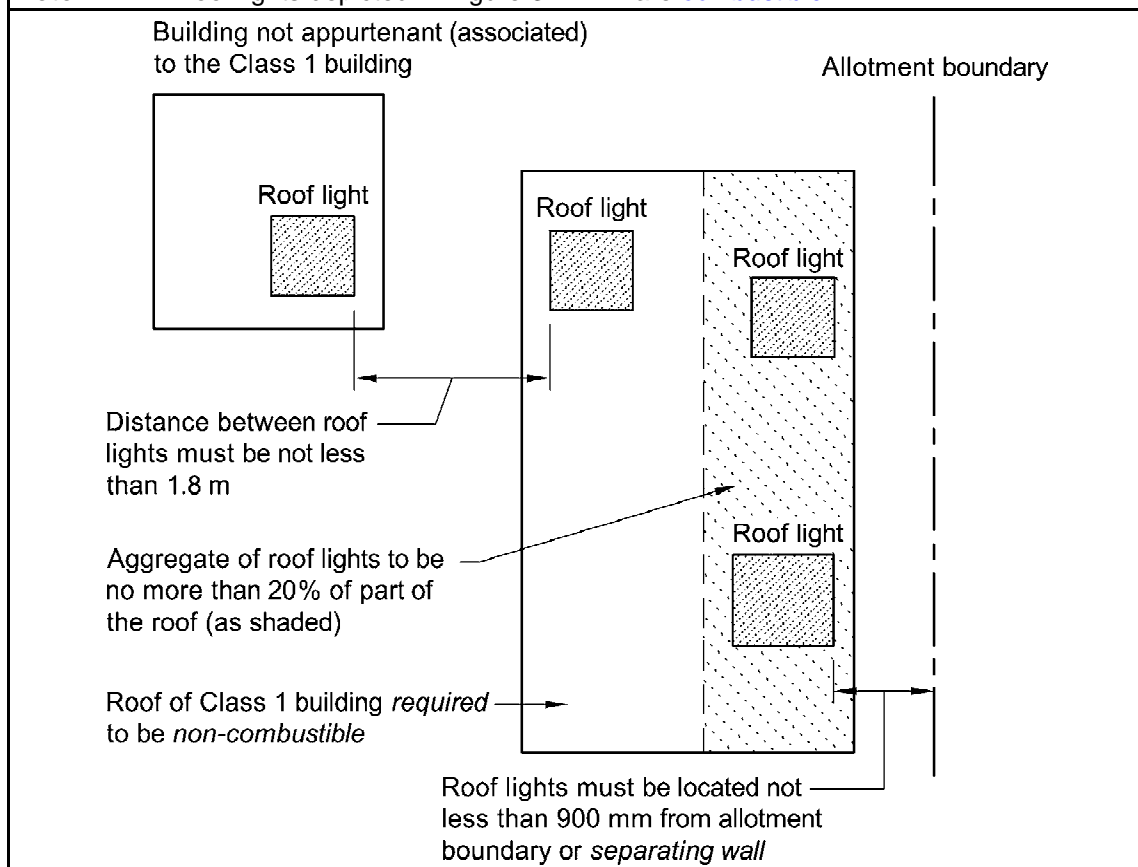**Note:** Roof lights depicted in Figure 3.7.1.12 are *combustible*.



## PART 3.7.2 SMOKE ALARMS

### Appropriate *Performance Requirements*

Where an alternative smoke alarm system is proposed as an *Alternative Solution* to that described in **Part 3.7.2**, that proposal must comply with—

- (a) *Performance Requirement P2.3.2*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### Acceptable construction practice

#### 3.7.2.1 Application

Compliance with this acceptable construction practice satisfies *Performance Requirement P2.3.2* for smoke alarms.

#### 3.7.2.2 Requirements for smoke alarms

- (a) Smoke alarms must be installed in—
  - (i) Class 1a buildings in accordance with **3.7.2.3**; and
  - (ii) Class 1b buildings in accordance with **3.7.2.4** and **3.7.2.5**.
- (b) Smoke alarms must comply with AS 3786.
- (c) Smoke alarms must be connected to the consumer mains power where consumer power is supplied to the building.

#### 3.7.2.3 Location — Class 1a buildings

Smoke alarms must be installed in a Class 1a building on or near the ceiling in—

- (a) any storey containing bedrooms—
    - (i) between each part of the dwelling containing bedrooms and the remainder of the dwelling; and
    - (ii) where bedrooms are served by a hallway, in that hallway, and
  - (b) any other storey not containing bedrooms.
- (see **Figure 3.7.2.1**, Diagram a and **Figure 3.7.2.2**)

#### 3.7.2.4 Location — Class 1b buildings

In a Class 1b building, smoke alarms must be installed on or near the ceiling—

- (a) in every bedroom; and



- (b) in every corridor or hallway associated with a bedroom, or if there is no corridor or hallway, in an area between the bedrooms and the remainder of the building; and
  - (c) on each other storey.
- (see [Figure 3.7.2.1](#), Diagram b and [Figure 3.7.2.2](#))

### 3.7.2.5 Lighting to assist evacuation — Class 1b buildings

In a Class 1b building, a system of lighting must be installed to assist evacuation of occupants in the event of a fire, and—

- (a) be activated by the smoke alarm *required* by [3.7.2.4\(b\)](#); and
- (b) consist of—
  - (i) a light incorporated within the smoke alarm; or
  - (ii) the lighting located in the corridor, hallway or area served by the smoke alarm.

#### Explanatory information:

The lighting *required* by [3.7.2.5](#) may consist of the artificial lighting which may already be installed in a corridor, hallway or area, provided that lighting is activated by the smoke alarm.

**Figure 3.7.2.1**

#### LOCATION OF SMOKE ALARM

Legend: ● Smoke alarm

☐ ● Smoke alarm with evacuation lighting (as *required* by [3.7.2.5\(b\)\(i\)](#))

#### Diagram a. Class 1a buildings

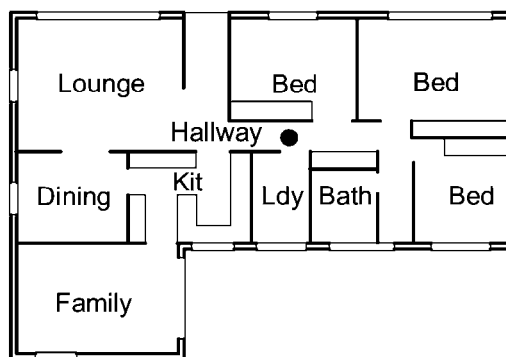


Figure 3.7.2.1

## LOCATION OF SMOKE ALARM

Legend: ● Smoke alarm

☐ Smoke alarm with evacuation lighting (as *required* by 3.7.2.5(b)(i))

Diagram b. Class 1b buildings


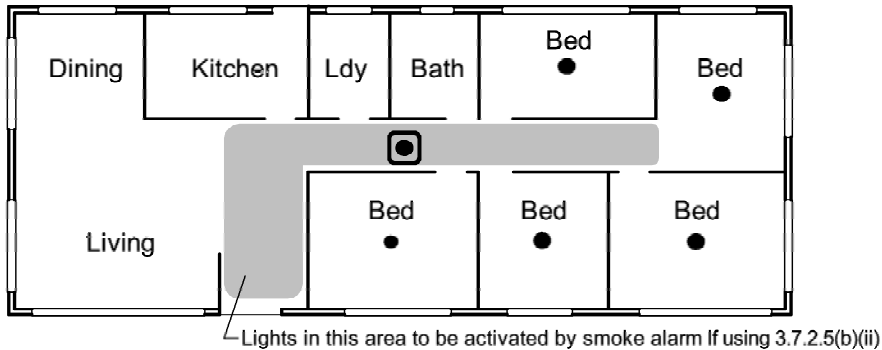


Figure 3.7.2.2

## LOCATION OF SMOKE ALARMS ON DIFFERENT STOREYS

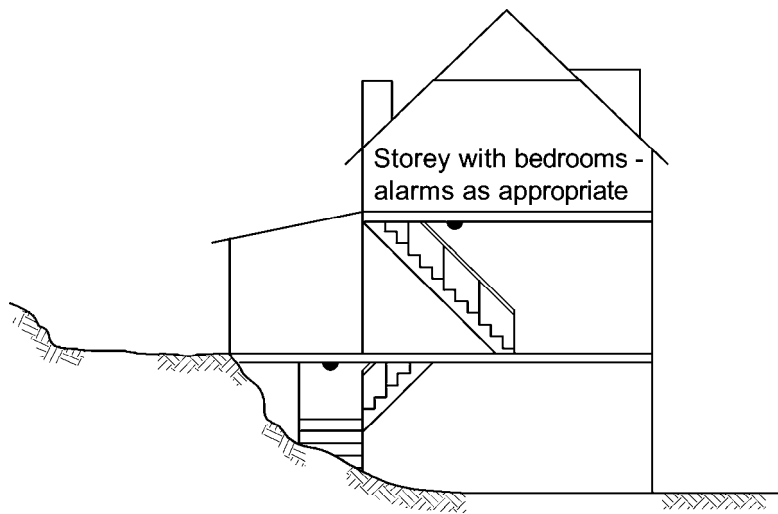

(a) Smoke alarms installed on each storey not containing bedrooms — located in the area of the stairway

## Explanatory information:

## 1. HOW DOES A SMOKE ALARM WORK ?

There are two types of smoke alarms.

## 1.1 Photoelectric:

This type of smoke alarm uses a light source and photocell. As the smoke enters the detection chamber it interferes with the light beam which in turn causes the alarm to sound.

## 1.2 Ionisation:

A small amount of radioactive material is used to create an electrical current which travels through ionised air. When smoke enters the detection chamber it impedes the flow of current and causes the alarm to sound.

## 2. LOCATION OF SMOKE ALARMS

When deciding on the position of smoke alarms it is important to remember that they are intended to detect smoke before it reaches the sleeping occupants of a building.

The ensuing alarm is designed to wake the occupants and give them time to evacuate the building.

### 2.1 Added flexibility when considering detector location

As mentioned earlier, the introduction of the *Performance Requirement* gives the *appropriate authority* flexibility when considering the location of smoke alarms.

For instance, in Class 1a buildings if the *Deemed-to-Satisfy Provision* states that the smoke alarm should be located in the hallway, and there is a bathroom adjacent this location (that will potentially cause nuisance alarms) the *appropriate authority* could accept the alarm being installed in the bedroom as a suitable option using the performance clause.

This approach should also be adopted when considering sleep-outs or similar type residential buildings that are not connected to the remainder of the building by a hallway or other enclosed structure. In these situations the alarm could be located in the room itself.

### 2.2 Protection of sleeping areas in Class 1a buildings

The *deemed-to-satisfy provisions* require that a smoke alarm be located “between each area containing bedrooms and the remainder of the dwelling”.

In some dwellings the bedrooms are located in a common area and connected by a hallway. In this instance the alarm should be located as shown in *Figure 3.7.2.1*, Diagram a.

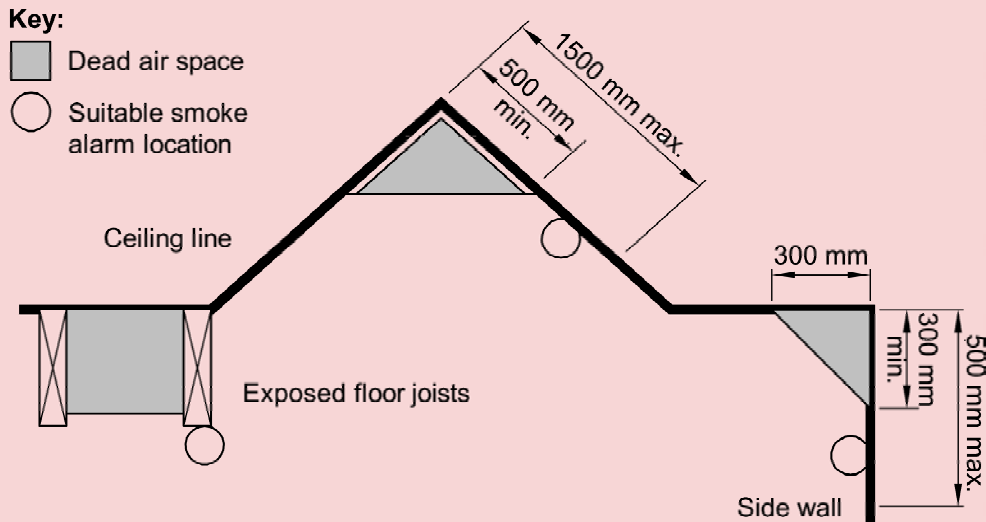
### 2.3 Location of the smoke alarm on other storeys

A smoke alarm is also required on each other storey that is not already provided with a smoke alarm. It should be noted that smoke alarms are required to be installed in other storeys even if those storeys consist of only carparking, bathrooms, laundries and the like. “Storey” in this context differs from the definition contained in BCA Volume One which excludes such spaces from being considered as storeys.

The favoured location for this alarm will be in the path of travel people will most likely take to evacuate the building. This will ensure an alarm will be raised before smoke makes the common exit path impassable.

e.g. If the bedrooms are on the first floor, then an alarm should be positioned near the area of the inter-connecting stair at ground level.

If the other storey is not connected to the remainder of the building (for instance a ground floor garage) then the alarm should be centrally located in the lower area. However, it may be reasonable, using a performance approach, not to install smoke alarms where the storey is predominantly open, such as the basement level of a highset house on stumps that is used for carparking or laundry purposes.



## 2.4 Installation of smoke alarms

Smoke alarms should be installed on or near the ceiling with special care being taken to avoid dead air spaces.

A dead air space is an area in which trapped hot air will prevent smoke from reaching the alarm. This space generally occurs at the apex of cathedral ceilings, the corner junction of walls and ceilings, between exposed floor joists etc. (see Diagram 1).

If it is impractical to mount the smoke alarm on the ceiling then it may be located on the wall. The recommended position is between 300 mm and 500 mm off the ceiling (see Diagram 1).

The distance from the apex of a cathedral ceiling to the top of the alarm should be between 500 mm and 1500 mm.

## 3. NUISANCE ALARMS

Smoke alarms are extremely sensitive and may detect smoke and moisture created by common household activities (such as burnt toast or steam from a bathroom).

Accordingly, to reduce the likelihood of nuisance alarms, the smoke alarm should not be located near cooking appliances and bathrooms. However, if it is necessary to locate alarms in these positions, an ionisation type alarm is more suitable near bathrooms, while a photoelectric alarm may be used near cooking appliances.

## 4. INTERCONNECTION OF SMOKE ALARMS

Some types of alarm are capable of interconnection to the other alarms so that if one alarm sounds then the other alarms are also activated adding an enhanced level of safety. There is no requirement in the BCA that smoke alarms be interconnected.

## PART 3.7.3 HEATING APPLIANCES

### Appropriate *Performance Requirements*

Where an alternative heating appliance is proposed as an *Alternative Solution* to that described in **Part 3.7.3**, that proposal must comply with—

- (a) *Performance Requirement P2.3.3*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### A. Acceptable construction manuals

#### 3.7.3.0

*Performance Requirement P2.3.3* is satisfied for a heating appliance if it is installed in accordance with one of the following manuals:

- (a) \* \* \* \* \*
- (b) Domestic solid-fuel burning appliances are installed in accordance with AS/NZS 2918.

### STATE AND TERRITORY VARIATIONS

**3.7.3.0(b) has been replaced in Tasmania as follows:**

#### 3.7.3.0(b)

- (b) Domestic solid-fuel burning appliances comply with AS/NZS 4013 and are installed in accordance with AS/NZS 2918.
- (c) Boilers and pressure vessels are installed in accordance with AS/NZS 1200.

### B. Acceptable construction practice

#### 3.7.3.1 Application

Compliance with this acceptable construction practice satisfies *Performance Requirement P2.3.3* for heating appliances.

#### 3.7.3.2 Open fireplace construction



An open fireplace must be constructed as follows (also see **Figure 3.7.3.1**):

- (a) All masonry must be constructed in accordance with **Part 3.3**.
- (b) The front hearth must be constructed of stone, concrete, masonry or similar material so that—

- (i) it extends not less than 300 mm beyond the front of the fireplace opening and not less than 150 mm beyond each side of that opening; and
  - (ii) its upper surface does not slope away from the back hearth.
- (c) The base of the back hearth must be constructed of stone, concrete, masonry or similar material and any *combustible* flooring or framing members must be situated not less than 150 mm from its upper surface.
- (d) The fireplace rear and side walls up to a height of 300 mm above the underside of the arch or lintel—
  - (i) must be constructed in 2 separate leaves of solid masonry with an overall thickness not less than 180 mm thick, excluding any *cavity*; and
  - (ii) must not consist of concrete block masonry in the construction of the inner leaf; and
  - (iii) must be constructed of masonry units with a net volume, excluding cored and similar holes, not less than 75% of their gross volume, measured on the overall rectangular shape of the units, and with an actual thickness of not less than 100 mm.
- (e) The fireplace must be constructed on footings complying with [3.2.5.5](#).

Figure 3.7.3.1
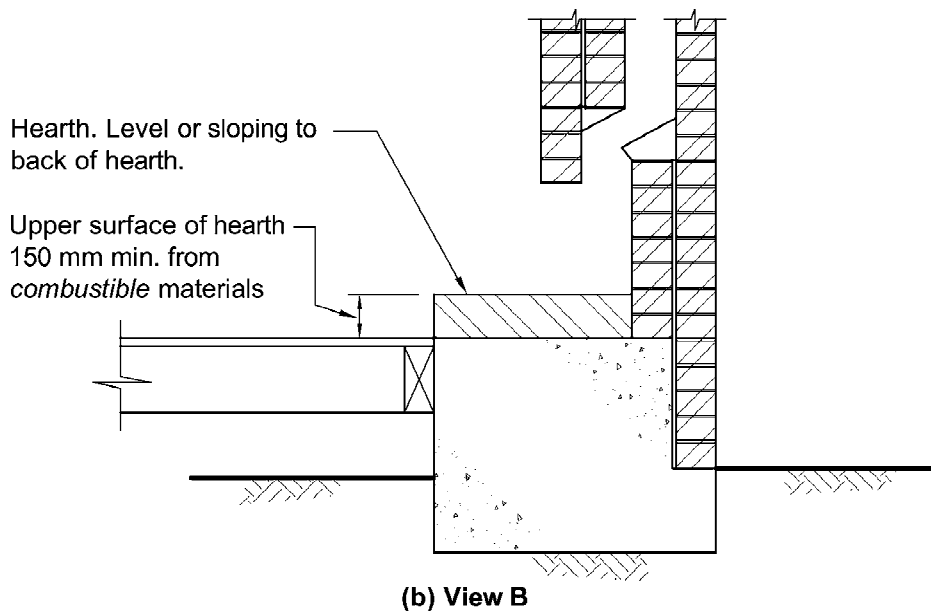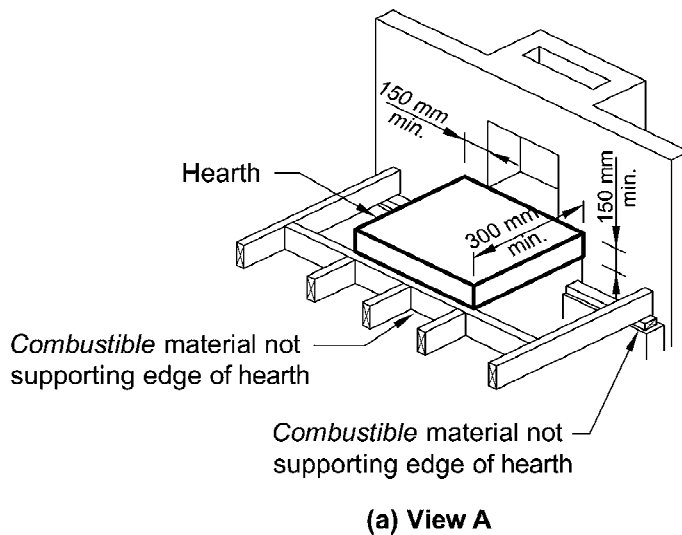
## FIRE PLACE CLEARANCE FROM COMBUSTIBLE MATERIALS



## 3.7.3.3 Chimney construction

The construction of a chimney must comply with [Part 3.3](#) and the following:


- The walls of the chimney above the level referred to in [3.7.3.2\(d\)](#) must be lined internally to a thickness of not less than 10 mm with composition mortar parging.
- The chimney or flue must terminate not less than 300 mm above the highest part of the building within a horizontal distance of 3.6 m of the chimney or flue (see [Figure 3.7.3.2](#)).

**Explanatory information:**

The requirements of this Part are to be read in conjunction with the building sealing requirements in [Part 3.12.3](#). However, it should be noted that [Part 3.12.3](#) does not apply in all States and Territories.

**Figure 3.7.3.2****SECTION SHOWING HEIGHT AND POSITION OF CHIMNEY**

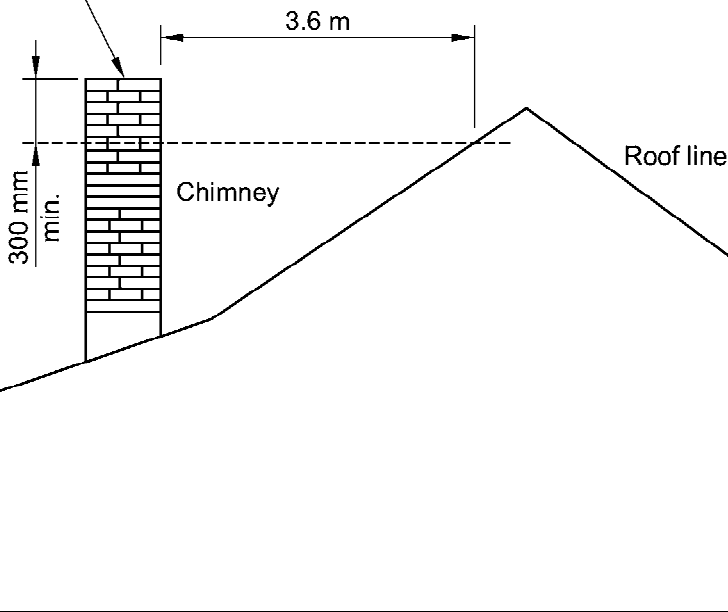Chimney termination height  
- 300 mm min. above the  
highest part of the building  
within 3.6 m

**3.7.3.4 Installation of insert fireplaces and flues**


An insert fireplace and flue must comply with the following:

- The insert fireplace must be tested and passed the tests required by AS/NZS 2918.
- The insert fireplace must be fitted into a masonry fireplace (including chimney) constructed in accordance with [Part 3.3](#).
- The flue must be double skin and have been tested and pass the tests required by AS/NZS 2918.



Figure 3.7.3.3

## TYPICAL INSTALLATION OF FIRE PLACE FLUE INSERTS

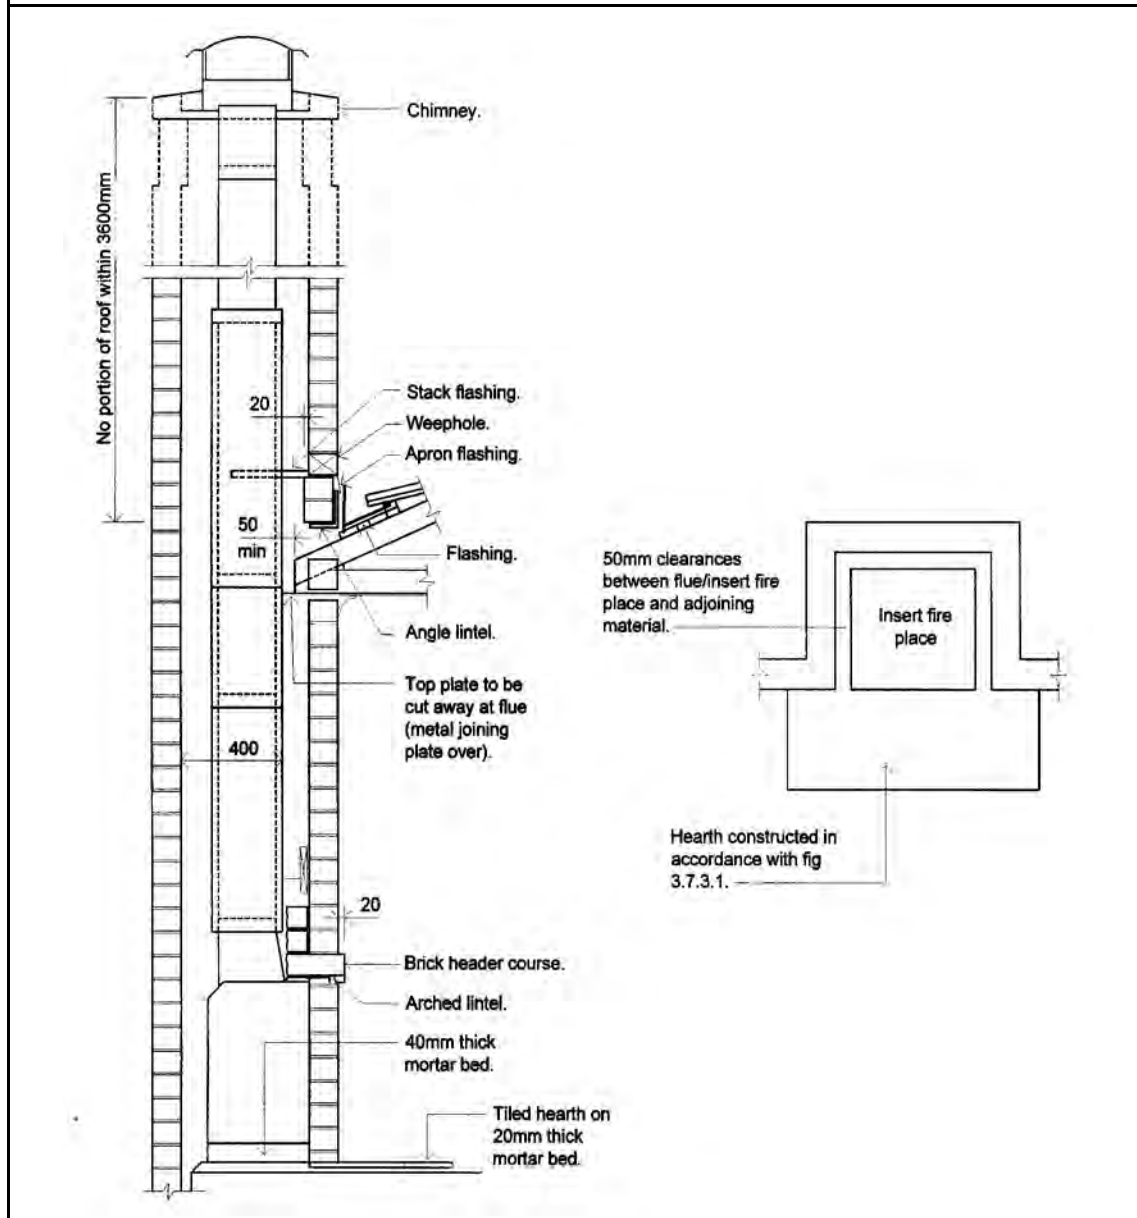

- (d) There must be a clearance of 50 mm between the outer flue and adjacent materials.
- (e) The flue must terminate in accordance with [Figure 3.7.3.2](#).
- (f) The hearth must be constructed in accordance with [3.7.3.2\(b\)](#), [\(c\)](#) and [\(e\)](#).

### 3.7.3.5 Installation of free standing heating appliances

The installation of a free standing heating appliance must comply with the following:

- (a) The appliance must—

- (i) be installed with safety clearances determined by testing in accordance with AS/NZS 2918; or
  - (ii) be located not less than 1.2 m from adjoining walls (other than a masonry wall); or
  - (iii) have a heat shield between the adjoining wall (other than a masonry wall) and the heating appliance in accordance with [Figure 3.7.3.4](#).
- (b) Where a heat shield is used, it must be installed in accordance with [Figure 3.7.3.4](#) and it must be not less than 90 mm thick masonry constructed in accordance with [Part 3.3](#).
- (c) The heating appliance must be installed on a hearth—
- (i) complying with [3.7.3.2\(b\)](#) and [\(c\)](#), except that the hearth must extend 400 mm from the appliance in accordance with [Figure 3.7.3.4](#); or
  - (ii) where a heat shield is installed, in accordance with [Figure 3.7.3.4](#).
- (d) The flue must—
- (i) have been tested and passed the tests required by AS/NZS 2918; and
  - (ii) be installed in accordance with [Figure 3.7.3.5](#); and
  - (iii) terminate in accordance with [Figure 3.7.3.2](#).
- (e) Flue types or installation of flues in areas not specifically covered by [Figures 3.7.3.4](#) and [3.7.3.5](#) must be installed in accordance with AS/NZS 2918.


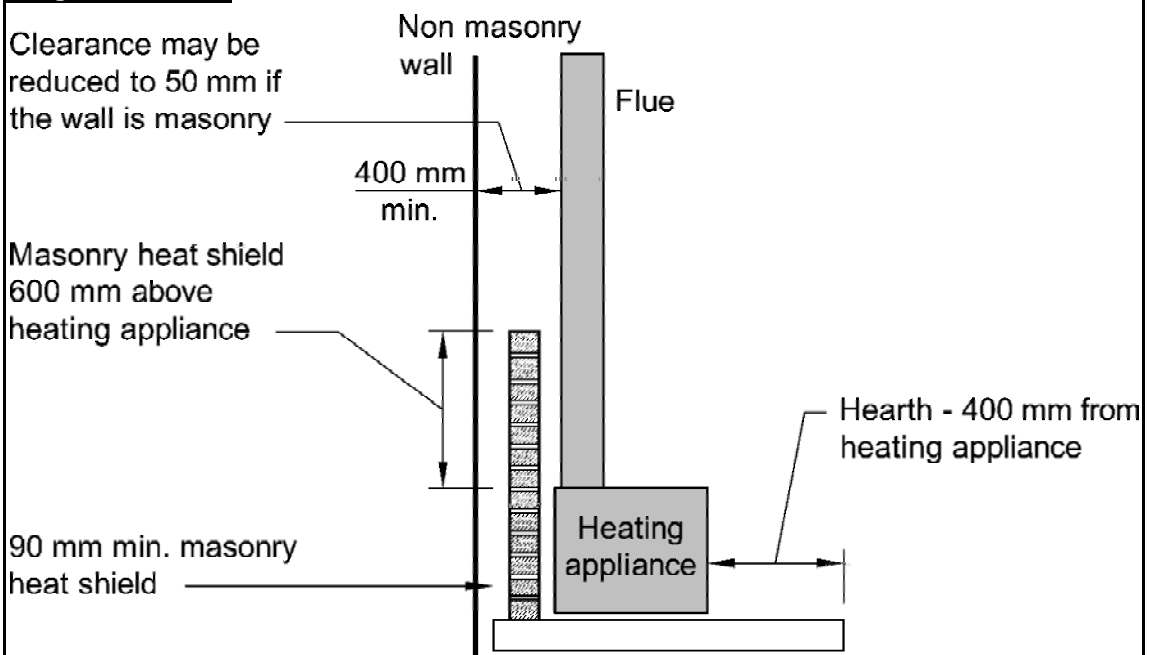
**Figure 3.7.3.4****ACCEPTABLE LOCATION OF FREE STANDING HEATING APPLIANCES****Diagram a.****ELEVATION**

Figure 3.7.3.4

## ACCEPTABLE LOCATION OF FREE STANDING HEATING APPLIANCES


Diagram b.

PLAN VIEW

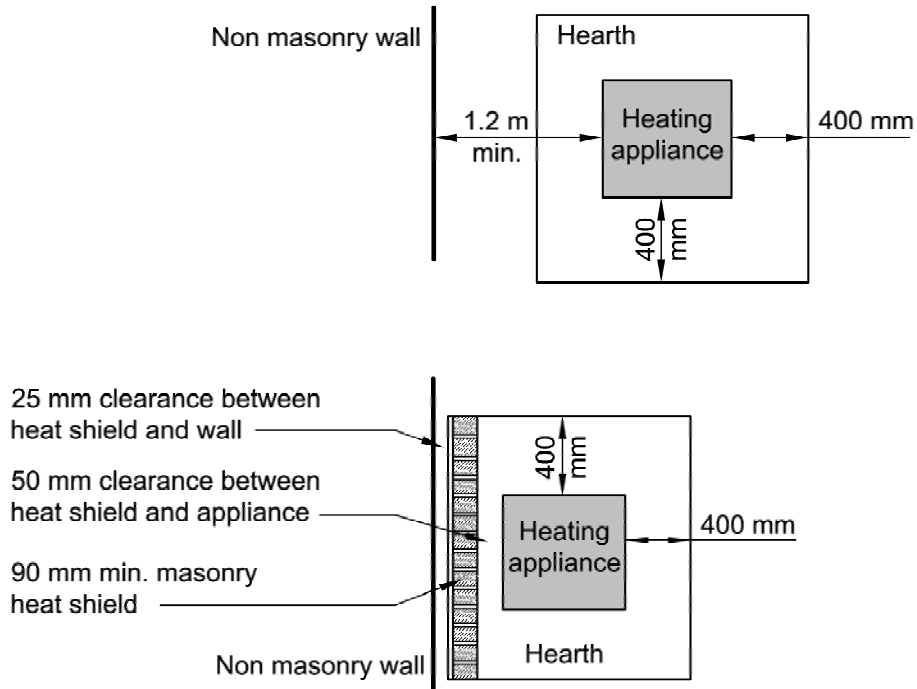

**Figure 3.7.3.5****ACCEPTABLE FLUE INSTALLATION DETAILS**

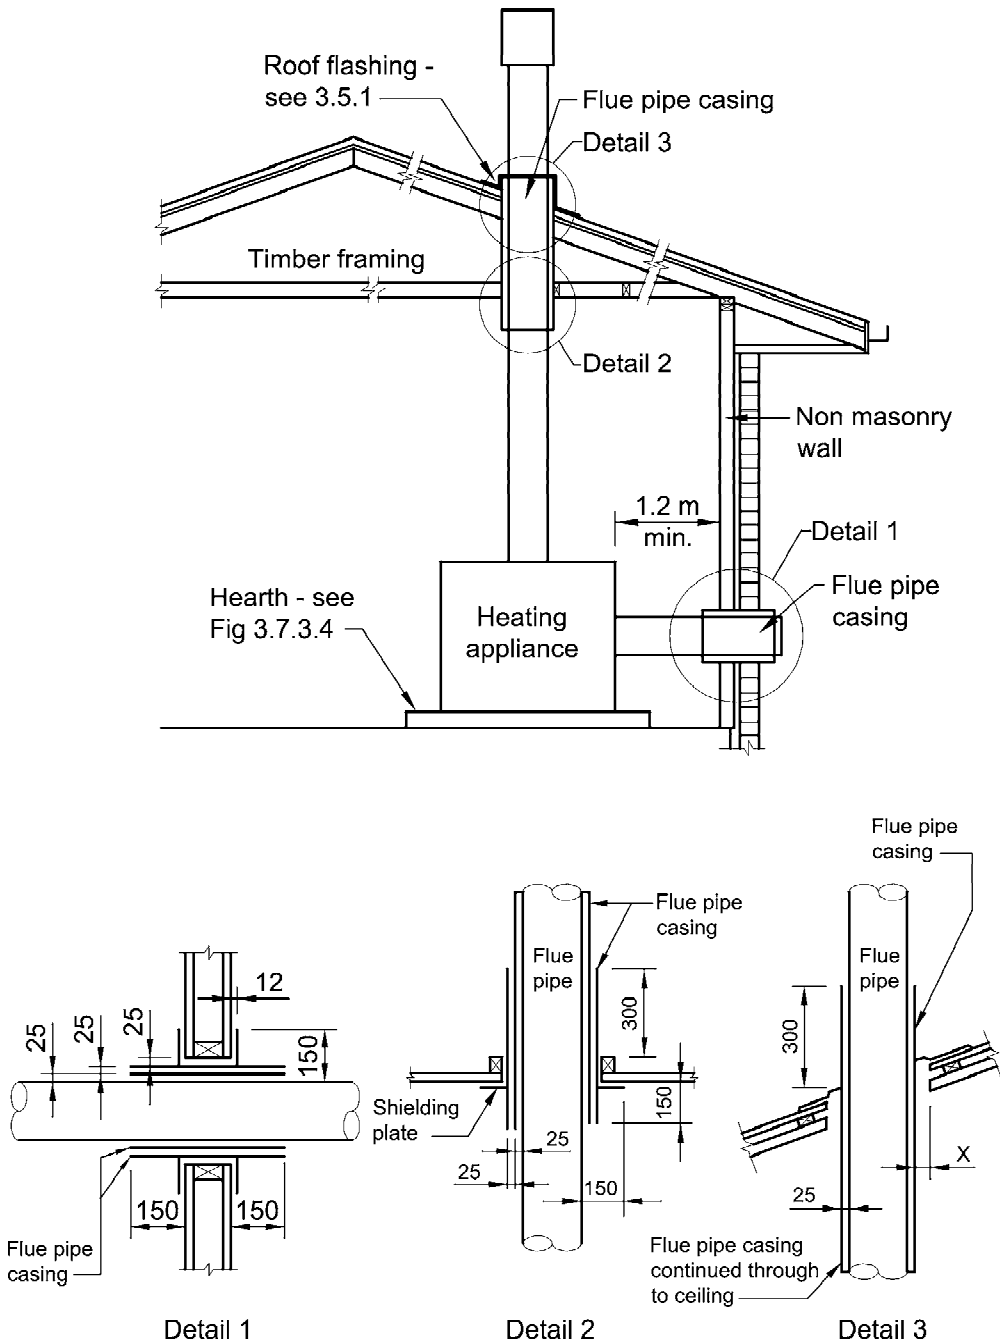**Note:** Flue pipe size — 150 mm maximum (for other sizes see AS/NZS 2918)



## PART 3.7.4 BUSHFIRE AREAS

### Appropriate *Performance Requirements*

Where an alternative bushfire protection design is proposed as an *Alternative Solution* to that described in **Part 3.7.4**, that proposal must comply with—

- (a) *Performance Requirement P2.3.4*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### A. Acceptable construction manuals

#### 3.7.4.0

*Performance Requirement P2.3.4* is satisfied for a Class 1 building located in a *designated bushfire prone area* if it is constructed in accordance with AS 3959 — Construction of buildings in bushfire-prone areas.

### STATE AND TERRITORY VARIATIONS

#### 3.7.4.0 is replaced with the following clause in New South Wales:

*Performance Requirement P2.3.4* is satisfied for a Class 1 building in a *designated bushfire prone area* if it is constructed in accordance with the following:

- (a) AS 3959, except for Section 2 "Site Bushfire Attack Assessment" which is replaced by the site assessment methodology of Appendix 3 of Planning for Bushfire Protection; or
- (b) the requirements of (a) above as modified by the development consent following consultation with the NSW Rural Fire Service under section 79BA of the Environmental Planning and Assessment Act 1979; or
- (c) the requirements of (a) above as modified by development consent with a bushfire safety authority issued under section 100B of the Rural Fires Act 1997 for the purposes of integrated development.

**3.7.4.0 does not apply in South Australia.**

### B. Acceptable construction practice

#### 3.7.4.1 Application

Compliance with this acceptable construction practice for Class 1 buildings constructed in a *designated bushfire prone area* satisfies *Performance Requirement P2.3.4*.

## STATE AND TERRITORY VARIATIONS

**3.7.4.1 is replaced by the following clause in South Australia:**

Compliance with this acceptable construction practice satisfies *Performance Requirement P2.3.4* for—

- (a) Class 1 buildings; and
  - (b) Class 10 buildings that adjoin a Class 1 building,
- that are constructed in a *designated bushfire prone area*.

**3.7.4.2 Categories of bushfire attack**

The category of bushfire attack for a *site* must be determined in accordance with AS 3959.

**Explanatory information:**

AS 3959 contains a methodology for assessment of the category of bushfire attack for a *site*. The categories are determined by considering the predominant vegetation type, the distance between the *site* and the predominant vegetation, and the average slope of the land between the *site* and the predominant vegetation. The categories of bushfire attack are low, medium, high and extreme.

For the category of low bushfire attack, the degree of bushfire attack is considered insufficient to warrant specific construction requirements.

## STATE AND TERRITORY VARIATIONS

**3.7.4.2 is replaced with the following clause in New South Wales:**

The category of bushfire attack for a *site* must be determined in accordance with Appendix 3 of Planning for Bushfire Protection except—

- (a) as modified by the development consent following consultation with the NSW Rural Fire Service under section 79BA of the Environmental Planning and Assessment Act 1979; or
- (c) as modified by development consent with a bush fire safety authority issued under section 100B of the Rural Fires Act 1997 for the purposes of integrated development.

**3.7.4.2 is replaced by the following clause in South Australia:**

Where a *site* is located in a *designated bushfire prone area*, the category of bushfire attack that applies to the *site* is:

- (a) for areas identified as general bushfire risk areas in South Australian Development Plans, the low category of bushfire attack; and
- (b) for areas identified as medium bushfire risk areas in South Australian Development Plans, the medium category of bushfire attack; and
- (c) for areas identified as high bushfire risk areas in South Australian Development Plans, the category of bushfire attack assessed for the *site* in accordance with the requirements of AS 3959.

**Explanatory information:**

AS 3959 contains a methodology for assessment of the category of bushfire attack for a [site](#). The categories are determined by considering the predominant vegetation type, the distance between the [site](#) and the predominant vegetation, and the average slope of the land between the [site](#) and the predominant vegetation.

**3.7.4.3 Construction requirements**

- (a) A Class 1 building must be constructed using the acceptable methods listed in [Table 3.7.4.1](#) for the category of bushfire attack for the [site](#).
- (b) For the purposes of [Part 3.7.4](#), fire-retardant-treated timber is timber that has been tested to AS/NZS 3837 and meets the following parameters after having been subjected to the regime of ASTM D2898 Method B:
  - (i) Ignition does not occur when the material is exposed to an irradiance level of 10 kW/m<sup>2</sup>.
  - (ii) The maximum heat release rate is not greater than 100 kW/m<sup>2</sup> and the average heat release rate for 10 minutes following ignition is not greater than 60 kW/m<sup>2</sup> when the material is exposed to an irradiance level of 25 kW/m<sup>2</sup>.
- (c) Where the timber is protected from the weather as described in Appendix C of AS 1684.2 and AS 1684.3, the timber need not be subjected to the regime of ASTM D2898 Method B before being tested to AS/NZS 3837.

**Explanatory information:**

External timbers are regarded as protected if they are covered by a roof (or similar structure) at 30° or greater to the vertical (see [Figure 3.7.4.5](#)) and they are well detailed and maintained (ie painted or stained and kept well ventilated).

Some timbers used in building construction may be capable of meeting the parameters identified in [3.7.4.3\(b\)](#) without having to be subjected to fire retardant treatment.

**STATE AND TERRITORY VARIATIONS****Add subclause (d) New South Wales as follows:**

- (d) Subclauses (a), (b) and (c) may be modified—
  - (i) by the development consent following consultation with the NSW Rural Fire Service under section 79BA of the Environmental Planning and Assessment Act 1979; or
  - (ii) for development consent with a bush fire safety authority issued under section 100B of the Rural Fires Act 1997 for the purposes of integrated development.

**3.7.4.3(a) is replaced in South Australia by the following:**

- (a)
  - (i) A Class 1 building, and a Class 10 building that adjoins a Class 1 building that is [required](#) to comply with **SA 3.7.4.3**, must be constructed using the acceptable methods listed in **Table SA 3.7.4.1** for the category of bushfire attack for the [site](#).
  - (ii) For the purposes of **Table SA 3.7.4.1** seasoned or dry hardwood timber (as defined in AS 1720.2) with a minimum density at 12% moisture content of 650 kg/m<sup>3</sup> may be used in lieu of fire-retardant-treated timber.

**Table 3.7.4.1 CONSTRUCTION FOR MEDIUM, HIGH AND EXTREME CATEGORIES OF BUSHFIRE ATTACK**

FLOORING SYSTEMS	
<b>1. Medium bushfire attack category</b>	
(a)	Concrete slab on ground.
(b)	Suspended concrete floor.
(c)	Framed floor with all joists and/or bearers not less than 600 mm above finished ground level.
(d)	Framed floor where any joist and/or bearer is less than 600 mm above finished ground level, where—
(i)	any timber bearers, joists or flooring are of fire-retardant-treated timber; or
(ii)	the sub-floor space is fully enclosed with a wall complying with the requirements of this table for an <a href="#">external wall</a> ; or
(iii)	the sub-floor space is fully enclosed with <a href="#">non-combustible</a> sheet material that extends not less than 400 mm above finished ground level and to the bottom of the wall cladding material. If fibre-reinforced cement sheets are used for this purpose, the sheets must have a minimum thickness of 6 mm (see <a href="#">Figure 3.7.4.1</a> ).
<b>2. High bushfire attack category</b>	
	As per requirements for category of medium bushfire attack.
<b>3. Extreme bushfire attack category</b>	
	As per requirements for category of medium bushfire attack except that, in the case of a framed floor, where any bearer or joist is greater than 600 mm above finished ground level and the floor is not enclosed, the bearer, joists and flooring must be fire-retardant-treated timber or sheathed underneath with <a href="#">non-combustible</a> material.
SUPPORTING POSTS, COLUMNS, STUMPS, PIERS AND POLES (except in sub-floor spaces enclosed by one of the methods described in FLOORING SYSTEMS 1(d)(iii))	
<b>1. Medium bushfire attack category</b>	
(a)	<a href="#">Non-combustible</a> material.
(b)	Fire-retardant-treated timber for not less than 400 mm above finished ground level.
(c)	Timber mounted on metal stirrups with a clearance of not less than 75 mm above finished ground or paving level (see <a href="#">Figure 3.7.4.2</a> ).
<b>2. High bushfire attack category</b>	
	As per requirements for category of medium bushfire attack.
<b>3. Extreme bushfire attack category</b>	
	As per requirements for category of medium bushfire attack except that all timber shall be fire-retardant-treated timber.
EXTERNAL WALLS	
<b>1. Medium bushfire attack category</b>	
(a)	Masonry, concrete or earthwall construction for the external leaf.
(b)	Framed wall with—



Table 3.7.4.1 CONSTRUCTION FOR MEDIUM, HIGH AND EXTREME CATEGORIES OF BUSHFIRE ATTACK— continued

<ul style="list-style-type: none"> <li>(i) <i>sarking-type material</i> having a <i>Flammability Index</i> of not more than 5; or</li> <li>(ii) an insulation material conforming with the appropriate standard for that material.</li> </ul> <p>(c) Timber logs with all joints between the logs gauge-planed and sealed.</p> <p>(d) <i>Combustible</i> sheet cladding provided that the cladding within 400 mm of the finished ground or paving level is covered by, or substituted with—</p> <ul style="list-style-type: none"> <li>(i) <i>non-combustible</i> sheet material; or</li> <li>(ii) fire-retardant-treated timber.</li> </ul>
<p><b>2. High bushfire attack category</b></p> <p>As per requirements for category of medium bushfire attack, except that—</p> <ul style="list-style-type: none"> <li>(a) PVC cladding must not be used; and</li> <li>(b) timber wall cladding must be of fire-retardant-treated timber.</li> </ul>
<p><b>3. Extreme bushfire attack category</b></p> <p>As per requirements for category of high bushfire attack.</p>
<p><b>WINDOWS</b></p>
<p><b>1. Medium bushfire attack category</b></p> <p>The openable part of a <i>window</i>, including louvres, must be screened with corrosion-resistant steel, bronze or aluminium mesh with a maximum aperture size of 1.8 mm.</p>
<p><b>2. High bushfire attack category</b></p> <p>As per requirements for category of medium bushfire attack, except that—</p> <ul style="list-style-type: none"> <li>(a) where timber is used, it must be fire-retardant-treated timber, except where protected by <i>non-combustible</i> shutters; and</li> <li>(b) where leadlight <i>windows</i> are used, they must be protected by shutters made of <i>non-combustible</i> material or of toughened glass; and</li> <li>(c) aluminium mesh must not be used in the <i>window</i> screens.</li> </ul>
<p><b>3. Extreme bushfire attack category</b></p> <p>As per requirements for category of high bushfire attack except that if the <i>windows</i> are not protected by <i>non-combustible</i> shutters, they shall be glazed with toughened glass.</p>
<p><b>EXTERNAL DOORS</b></p>
<p><b>1. Medium bushfire attack category</b></p> <p>External doors must be fitted with—</p> <ul style="list-style-type: none"> <li>(a) weather strips or draught excluders to prevent the build-up of burning debris beneath the door; and</li> <li>(b) tight-fitting screen doors with corrosion-resistant steel, bronze or aluminium mesh with a maximum aperture size of 1.8 mm.</li> </ul>

Table 3.7.4.1 CONSTRUCTION FOR MEDIUM, HIGH AND EXTREME CATEGORIES OF BUSHFIRE ATTACK— continued

<p><b>2. High bushfire attack category</b></p>
<p>As per requirements for category of medium bushfire attack, except that—</p> <ul style="list-style-type: none"> <li>(a) aluminium mesh must not be used in the screen door; and</li> <li>(b) if leadlight glazing panels are used in the door, they must be protected by shutters made from <i>non-combustible</i> material or of toughened glass.</li> </ul>
<p><b>3. Extreme bushfire attack category</b></p>
<p>As per requirements for category of high bushfire attack, except that—</p> <ul style="list-style-type: none"> <li>(a) timber doors must be fire-retardant-treated timber or have a <i>non-combustible</i> covering on the exterior surface; or</li> <li>(b) doors must be protected by <i>non-combustible</i> shutters; or</li> <li>(c) doors must be solid-core having a minimum thickness of 35 mm.</li> </ul>
<p><b>VENTS AND WEEPHOLES</b></p>
<p><b>1. Medium bushfire attack category</b></p>
<p>Vents and weepholes must be protected with spark guards made from corrosion-resistant steel, bronze or aluminium mesh with a maximum aperture size of 1.8 mm.</p>
<p><b>2. High bushfire attack category</b></p>
<p>As per requirements for category of medium bushfire attack, except that aluminium mesh must not be used in the spark guards.</p>
<p><b>3. Extreme bushfire attack category</b></p>
<p>As per requirements for category of high bushfire attack.</p>
<p><b>ROOF COVERING, EAVES AND FASCIAS</b></p>
<p><b>1. Medium bushfire attack category</b></p>
<ul style="list-style-type: none"> <li>(a) Timber shakes or shingles must not be used for the roof covering.</li> <li>(b) Sheet roofing must be metal or fibre-reinforced cement.</li> <li>(c) Gaps under corrugations or ribs of sheet roofing must be sealed or protected at the wall or fascia line by—             <ul style="list-style-type: none"> <li>(i) fully sarking the roof; or</li> <li>(ii) providing corrosion-resistant steel or bronze mesh with a maximum aperture size of 1.8 mm, profiled metal sheet, neoprene seal or compressed mineral wool.</li> </ul> </li> <li>(d) Rib caps and ridge capping on sheet roofing must be preformed or the gaps between the capping and the sheeting sealed or protected in accordance with (c).</li> <li>(e) The roof/wall junction must be sealed by—             <ul style="list-style-type: none"> <li>(i) the use of fascia and eaves lining; or</li> <li>(ii) sealing the gaps between the rafters at the line of the wall with a <i>non-combustible</i> material (see <b>Figure 3.7.4.3</b>).</li> </ul> </li> <li>(f) Tiled roofs must be fully sarked, including the ridge, and the sarking must be located directly beneath the tiling battens.</li> </ul>

Table 3.7.4.1 CONSTRUCTION FOR MEDIUM, HIGH AND EXTREME CATEGORIES OF BUSHFIRE ATTACK— continued

(g) Any <i>sarking-type material</i> used in the roof must have a <i>Flammability Index</i> of not more than 5.
<b>2. High bushfire attack category</b>
As per requirements for category of medium bushfire attack, except that—
(a) all roof sheeting must be <i>non-combustible</i> and sarked; and
(b) timber eaves lining and joining strips must be of fire-retardant-treated timber (see <a href="#">Figure 3.7.4.3</a> ); and
(c) fascias must be <i>non-combustible</i> or of fire-retardant-treated timber (see <a href="#">Figure 3.7.4.3</a> ).
<b>3. Extreme bushfire attack category</b>
As per requirements for category of high bushfire attack, except that—
(a) fibre-reinforced cement or aluminium sheet must not be used for roof sheeting or fascias; and
(b) aluminium must not be used for eaves linings.
<b>ROOF LIGHTS</b>
<b>1. Medium bushfire attack category</b>
(a) Roof light penetrations and associated shafts through the roof space must be sealed with a <i>non-combustible</i> sleeve or lining (see <a href="#">Figure 3.7.4.4</a> ).
(b) A roof light may consist of thermoplastic sheet in a metal frame, provided that the diffuser at ceiling level is of wired or toughened glass in a metal frame.
(c) Openings in ventilated roof lights must be provided with corrosion-resistant steel or bronze mesh having a maximum aperture size of 1.8 mm.
<b>2. High bushfire attack category</b>
As per requirements for category of medium bushfire attack, except that roof light glazing must be of wired glass. Thermoplastic material or toughened glass must not be used.
<b>3. Extreme bushfire attack category</b>
As per requirements for category of high bushfire attack.
<b>ROOF VENTILATORS</b>
<b>1. Medium bushfire attack category</b>
All components of roof ventilators, including rotary ventilators, must be of <i>non-combustible</i> material and have ventilation openings protected by corrosion-resistant steel or bronze mesh having a maximum aperture size of 1.8 mm.
<b>2. High bushfire attack category</b>
As per requirements for category of medium bushfire attack.
<b>3. Extreme bushfire attack category</b>
As per requirements for category of medium bushfire attack.

Table 3.7.4.1 CONSTRUCTION FOR MEDIUM, HIGH AND EXTREME CATEGORIES OF BUSHFIRE ATTACK— continued

ROOF-MOUNTED EVAPORATIVE COOLING UNITS	
<b>1. Medium bushfire attack category</b>	
All openings into the cooling unit must be protected by corrosion-resistant steel or bronze mesh with a maximum aperture size of 1.8 mm.	
<b>2. High bushfire attack category</b>	
As per requirements for category of medium bushfire attack, except that the outer case of the evaporative cooling unit must be of <i>non-combustible</i> material.	
<b>3. Extreme bushfire attack category</b>	
As per requirements for category of high bushfire attack.	
GUTTERS AND DOWNPIPES	
<b>1. Medium bushfire attack category</b>	
Materials or devices used to stop leaves collecting in gutters must have a <i>Flammability Index</i> of not more than 5.	
<b>2. High bushfire attack category</b>	
As per requirements for category of medium bushfire attack.	
<b>3. Extreme bushfire attack category</b>	
As per requirements for category of medium bushfire attack.	
SERVICE PIPES (water and gas)	
<b>1. Medium bushfire attack category</b>	
Piping for water and gas supplies must—	
(a) be buried to a depth of not less than 300 mm below finished ground level; or	
(b) be of metal.	
<b>2. High bushfire attack category</b>	
As per requirements for category of medium bushfire attack.	
<b>3. Extreme bushfire attack category</b>	
As per requirements for category of medium bushfire attack.	
VERANDAHS AND DECKS	
<b>1. Medium bushfire attack category</b>	
(a) Slab-on-ground or suspended concrete slab.	
(b) Any supporting posts or columns must comply with the requirements of this table for supporting posts, columns stumps, piers and poles.	
(c) Any supporting walls must comply with the requirements of this table for <i>external walls</i> .	
(d) Where sheeted or tongue and grooved solid flooring is used, the flooring system must comply with the requirements of this table for flooring systems.	
(e) Where spaced timber deck flooring is used—	
(i) the gap between the timber deck flooring must be not less than 5 mm; and	

Table 3.7.4.1 CONSTRUCTION FOR MEDIUM, HIGH AND EXTREME CATEGORIES OF BUSHFIRE ATTACK— continued

<ul style="list-style-type: none"> <li>(ii) to facilitate access for extinguishment, the perimeter of the area beneath the deck must not be enclosed or access to the space beneath the deck impeded; and</li> <li>(iii) the timber deck flooring must be separated from the remainder of the building in a manner that will not spread fire into the building.</li> </ul>
<b>2. High bushfire attack category</b>
As per requirements for category of medium bushfire attack, except that if spaced timber deck flooring is used, fire-retardant-treated timber must be used for the decking material.
<b>3. Extreme bushfire attack category</b>
As per requirements for category of high bushfire attack, except that all materials (including any balustrades) must be <i>non-combustible</i> or if timber is used, it must be fire-retardant-treated.

## STATE AND TERRITORY VARIATION

Table 3.7.4.1 is replaced in South Australia for low, medium, high and extreme categories of bushfire attack by Table SA 3.7.4.1 as follows:

Table SA 3.7.4.1

FLOORING SYSTEMS
<b>1. Low bushfire attack category</b>
<ul style="list-style-type: none"> <li>(a) Concrete slab on ground.</li> <li>(b) Suspended concrete floor.</li> <li>(c) A framed floor, the underside of which is greater than 600 mm above ground level must have the sub-floor space completely protected by—               <ul style="list-style-type: none"> <li>(i) a <i>non-combustible</i> sheet material; or</li> <li>(ii) a wall complying with AS 3959; or</li> <li>(iii) a vertical <i>non-combustible</i> sheet material that extends around the perimeter of the floor from the underside of the lowest framing member to ground level; or</li> <li>(iv) if fibre reinforced cement sheets are used as a <i>non-combustible</i> sheet material they must have a minimum thickness of 6 mm.</li> </ul> </li> <li>(d) Framed floor where any joist and/or bearer is less than 600 mm above finished ground level where (Refer <a href="#">Figure 3.7.4.1</a>)—               <ul style="list-style-type: none"> <li>(i) any timber bearers, joists or flooring are of fire-retardant-treated timber; or</li> <li>(ii) the sub-floor space is fully enclosed with a wall complying with the medium bushfire attack category requirements of this table for an <i>external wall</i>; or</li> <li>(iii) the sub-floor space is fully enclosed with <i>non-combustible</i> sheet material that extends not less than 400 mm above finished ground level and to the bottom of the wall cladding material. If fibre reinforced cement sheets are used for this purpose, the sheets must have a minimum thickness of 6 mm.</li> </ul> </li> </ul>
<b>2. Medium bushfire attack category</b>
As per requirements for low bushfire attack category.
<b>3. High bushfire attack category</b>

Table SA 3.7.4.1— continued

As per requirements for low bushfire attack category.

#### 4. Extreme bushfire attack category

As per requirements for low bushfire attack category.

### SUPPORTING POSTS, COLUMNS, STUMPS PIERS AND POLES (except in sub-floor spaces enclosed by one of the methods described in FLOORING SYSTEMS 1(d))

#### 1. Low bushfire attack category

- (a) *Non-combustible* material.
- (b) Fire-retardant-treated timber for not less than 400 mm above finished ground level.
- (c) Timber mounted on metal stirrups with a clearance of not less than 75 mm above finished ground or paving level (Refer [Figure 3.7.4.2](#)).

#### 2. Medium bushfire attack category

As per requirements for low bushfire attack category.

#### 3. High bushfire attack category

As per requirements for low bushfire attack category.

#### 4. Extreme bushfire attack category

As per requirements for low bushfire attack category except that all timber must be fire-retardant-treated timber.

### EXTERNAL WALLS

#### 1. Medium bushfire attack category

- (a) Masonry, concrete or earthwall construction for the external leaf.
- (b) Framed wall with—
  - (i) *sarking-type material* having a *Flammability Index* of not more than 5; or
  - (ii) an insulation material conforming with the appropriate standard for that material.
- (c) Timber logs with all joints between the logs gauge-planed and sealed.
- (d) Wall cladding of *non-combustible* material or fire retardant timber must be provided within 400 mm of finished ground level, paving level or any balcony or deck with solid flooring.

#### 2. High bushfire attack category

As per requirements for medium bushfire attack category, except that—

- (a) PVC cladding must not be used; and
- (b) timber wall cladding must be of fire-retardant treated timber.

#### 3. Extreme bushfire attack category

As per requirements for high bushfire attack category.

### WINDOWS

Refer to [Table 3.7.4.1](#).

### EXTERNAL DOORS

Table SA 3.7.4.1— continued

Refer to [Table 3.7.4.1](#).

## VENTS AND WEEPHOLE

### 1. Low bushfire attack category

Vents to sub-floor spaces must be protected with spark guards made from corrosion resistant steel, bronze or aluminium mesh with a maximum aperture size of 1.8 mm.

### 2. Medium bushfire attack category

Vents to sub-floor spaces and weepholes must be protected with spark guards made from corrosion resistant steel, bronze or aluminium mesh with a maximum aperture size of 1.8 mm.

### 3. High bushfire attack category

As per requirements for medium bushfire attack category, except that aluminium mesh must not be used in the spark guards.

### 4. Extreme bushfire attack category

As per requirements for high bushfire attack category.

## ROOF COVERING, EAVES AND FASCIAS

### 1. Medium bushfire attack category

- (a) Timber shakes or shingles must not be used for the roof covering.
- (b) Sheet roofing must be metal or fibre-reinforced cement.
- (c) Gaps under corrugations or ribs of sheet roofing must be sealed or protected at the wall or fascia line by—
  - (i) fully sarking the roof; or
  - (ii) providing corrosion-resistant steel or bronze mesh with a maximum aperture size of 1.8 mm, profiled metal sheet, neoprene seal or compressed mineral wool.
- (d) Rib caps and ridge capping on sheet roofing must be preformed or the gaps between the capping and the sheeting sealed or protected in accordance with (c).
- (e) The roof/wall junction must be sealed in accordance with [Figure 3.7.4.3](#) by—
  - (i) the use of fascia and eaves lining; or
  - (ii) sealing the gaps between the rafters at the line of the wall with a [non-combustible](#) material.
- (f) Tiled roofs must be fully sarked, including the ridge, and the [sarking-type material](#) must be located directly beneath the tiling battens.
- (g) Penetrations through the roof cladding for vent pipes and the like must be sealed with [non-combustible](#) collar or fire-retardant sealant.
- (h) Any [sarking-type material](#) used in the roof must have a [Flammability Index](#) of not more than 5.

### 2. High bushfire attack category

As per requirements for medium bushfire attack category, except that—

- (a) all roof sheeting must be [non-combustible](#) and sarked; and

Table SA 3.7.4.1— continued

(b) timber eaves lining and joining strips must be of fire-retardant-treated timber; and
(c) fascias must be <i>non-combustible</i> or of a fire-retardant-treated timber.
<b>3. Extreme bushfire attack category</b>
As per requirements for high bushfire attack category except that—
(a) fibre reinforced cement or aluminium sheet must not be used for roof sheeting or fascias; and
(b) aluminium must not be used for eaves linings.
<b>ROOF LIGHTS</b>
Refer to <a href="#">Table 3.7.4.1</a> .
<b>ROOF VENTILATORS</b>
Refer to <a href="#">Table 3.7.4.1</a> .
<b>ROOF-MOUNTED EVAPORATIVE COOLING UNITS</b>
Refer to <a href="#">Table 3.7.4.1</a> .
<b>GUTTERS AND DOWNPIPES</b>
Refer to <a href="#">Table 3.7.4.1</a> .
<b>SERVICE PIPES (water and gas)</b>
Refer to <a href="#">Table 3.7.4.1</a> .
<b>VERANDAHS AND DECKS</b>
<b>1. Low bushfire attack category</b>
(a) Slab on ground or suspended concrete slab.
(b) Any supporting posts or columns must comply with the requirements of this table for supporting posts, column stumps, piers and poles.
(c) Any supporting walls must comply with the medium bushfire attack category requirements of this table for <i>external walls</i> .
(d) Where sheeted or tongued and grooved solid flooring is used, the flooring system must comply with the requirements of this table for flooring systems.
(e) Where a timber deck is used—
(i) the gap between the timber deck flooring must not be less than 5 mm; and
(ii) to facilitate access for extinguishment, the perimeter of the deck must not be enclosed or access to the space beneath the deck impeded; and
(iii) The timber deck flooring must be separated from the remainder of the building in a manner that will not spread the fire into the building.
<b>2. Medium bushfire attack category</b>
As per the requirements for low bushfire attack category.
<b>3. High bushfire attack category</b>
As per requirements for low bushfire attack category, except that—



Table SA 3.7.4.1— continued

- (i) any supporting walls must comply with the high bushfire attack category requirements of this table for *external walls*; or
- (ii) if spaced timber deck flooring is used, fire-retardant-treated timber must be used for the decking material.

#### 4. Extreme bushfire attack category

As per requirements for low bushfire attack category, except that—

- (i) any supporting walls must comply with the extreme bushfire attack category requirements of this table for *external walls*; or
- (ii) all materials (including any balustrades) must be *non-combustible* or if timber is used it must be fire-retardant-treated.

Figure 3.7.4.1

#### PROTECTION OF SUB-FLOOR SPACES WITH LESS THAN 600 MM CLEARANCE

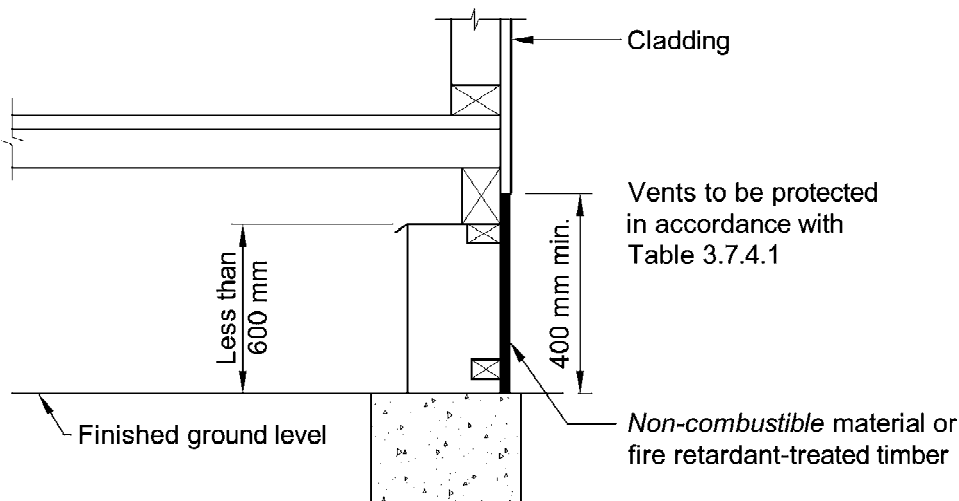


Figure 3.7.4.2

## METAL STIRRUP CLEARANCE

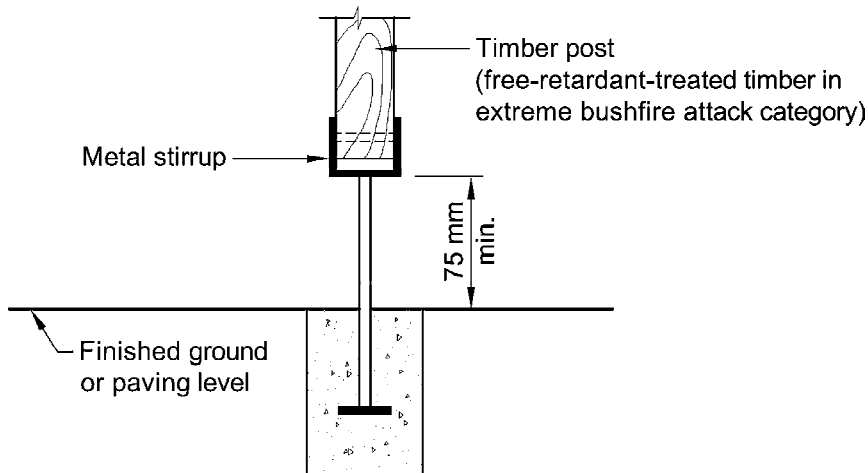


Figure 3.7.4.3

## SEALING OF ROOF/WALL JUNCTION

Diagram A.

Seal between rafters



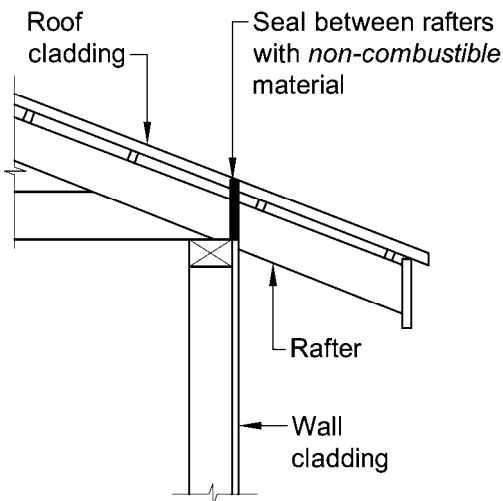


Diagram B.

Seal with eaves lining and fascia

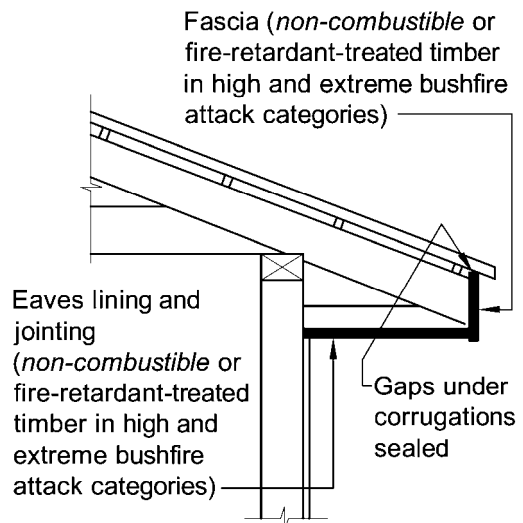

**Figure 3.7.4.4**  
**ROOF LIGHTS**

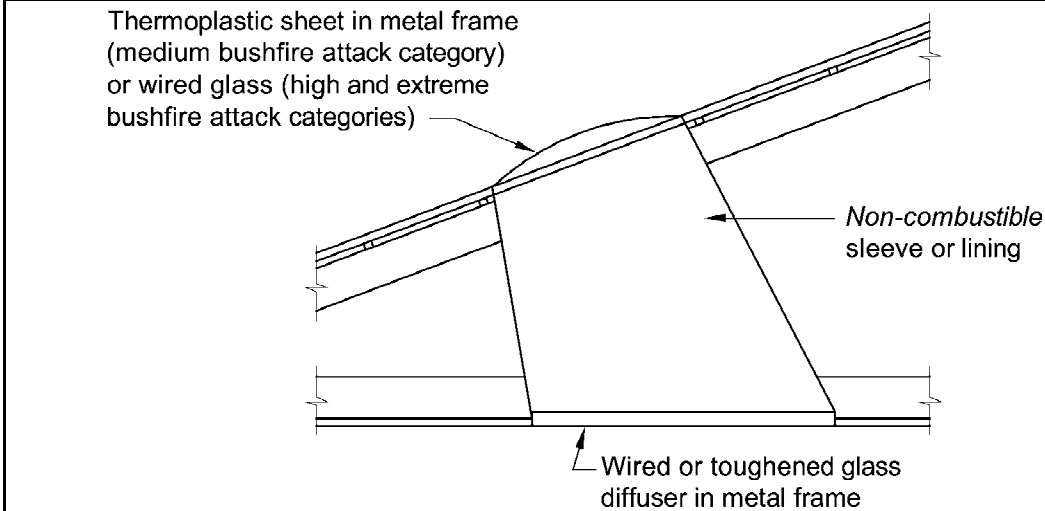


**Explanatory information:**

**Sub-floor spaces:** The method of treating sub-floor spaces is determined by whether sufficient access is available for extinguishment of burning debris that may accumulate beneath the floor. A height of 600 mm has been selected as providing reasonable access for that purpose.

**Fully sarked roofs:** Where roofing systems are fully sarked, it may be necessary to provide ventilation to prevent moisture condensation from occurring in the roof space. If vents are provided, care needs to be taken to ensure that sparks and embers cannot enter the roof space via the openings.

**Termite risk management:** If the subject building is *required* to be provided with termite risk management measures, particular care should be taken to ensure that the construction requirements of this Part do not compromise such measures. Details for enclosure of sub-floor spaces and for the protection of *combustible* wall cladding near ground level in particular, may provide a means for concealed access to the building by subterranean termites.

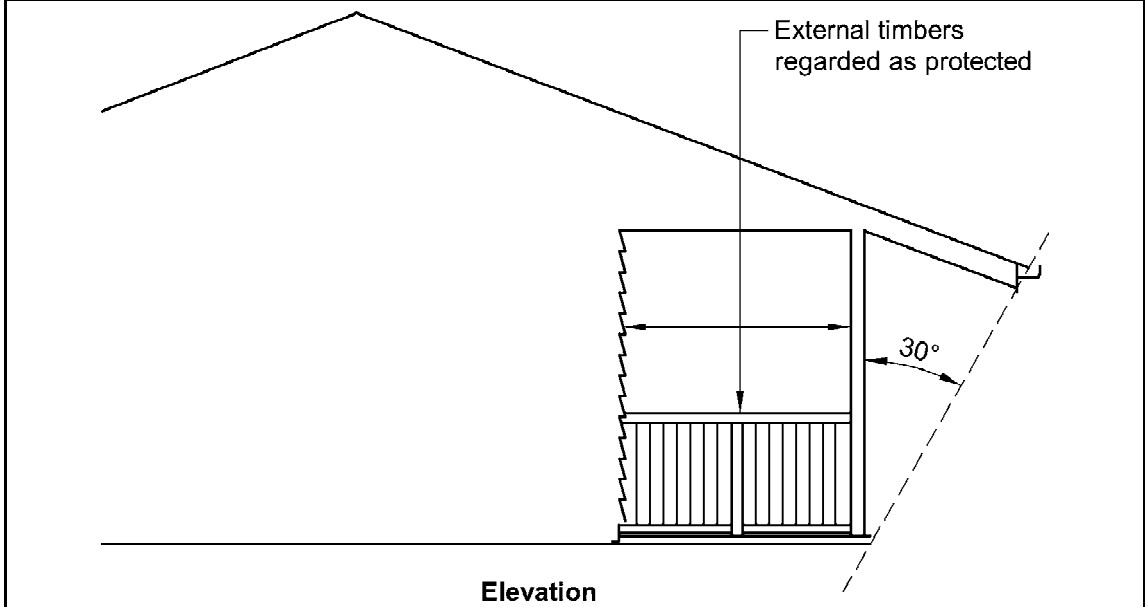**Figure 3.7.4.5****EXTERNAL TIMBERS REGARDED AS PROTECTED**

## PART 3.7.5 ALPINE AREAS

### Appropriate *Performance Requirements*:

Where an alternative *alpine area* egress design is proposed as an *Alternative Solution* to that described in **Part 3.7.5**, that proposal must comply with—

- (a) *Performance Requirement P2.3.5*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### Acceptable construction practice

#### 3.7.5.1 Application

Compliance with this acceptable construction practice for buildings which are located in *alpine areas* (see **Figure 3.7.5.2**) satisfies *Performance Requirement P2.3.5*.

#### 3.7.5.2 External doorways

An external door in a building constructed in an *alpine area*, which may be subject to a build-up of snow must—

- (a) open inwards; and
- (b) be marked “OPEN INWARDS” on the inside face of the door in letters not less than 75 mm high and in a colour contrasting with that of the background; and
- (c) if it serves a corridor or stairway, be positioned in an alcove or recess with—
  - (A) no horizontal dimension of the alcove or recess less than twice the width of the door; and
  - (B) the door positioned to open against a wall such that the distance from any part of its swing to the nearest point of entry of the stairway or corridor is not less than the width of the door.

#### 3.7.5.3 External ramps

An external ramp serving an external doorway must have a gradient not steeper than 1:12.

#### 3.7.5.4 Discharge of external doorways providing a means of egress

A building in an *alpine area* must be constructed so that—

- (a) for any *external walls* more than 3.6 m above the natural ground level, the distance of that part of the building from the allotment boundary (other than a road alignment) must be not less than 2.5 m plus 100 mm for each 300 mm or part by which that part of the *external wall* exceeds a height of 3.6 m; and

- (b) an external doorway may discharge into a court between wings of a building provided the wings are at least 6 m apart; and
- (c) where an external doorway discharges opposite a barrier or embankment which is more than 900 mm above the threshold of that doorway, the distance between the threshold and the barrier is not less than twice the height of the barrier or 6 m, whichever is the lesser (see [Figure 3.7.5.3](#)).


### 3.7.5.5 External trafficable structures


External stairways, ramps, access bridges or other trafficable structures serving the building must have—

- (a) a floor surface that consists of steel mesh or other suitable material if it is used as a means of egress; and
- (b) any [required](#) balustrade or other barrier constructed so that its sides are not less than 75% open.

**Figure 3.7.5.1**

**DESIGN FOR SAFE EGRESS IN ALPINE AREAS — MINIMUM DIMENSIONS OF ALCOVE OR RECESS AT EXTERNAL DOORWAY**

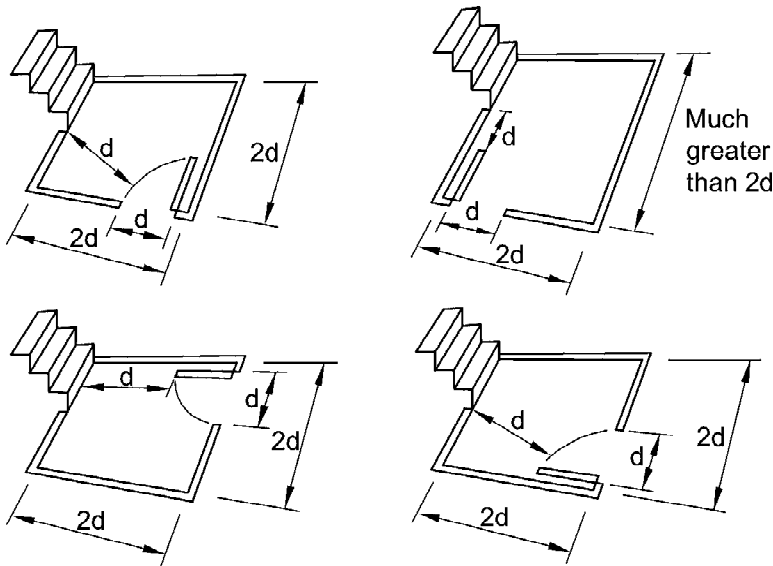

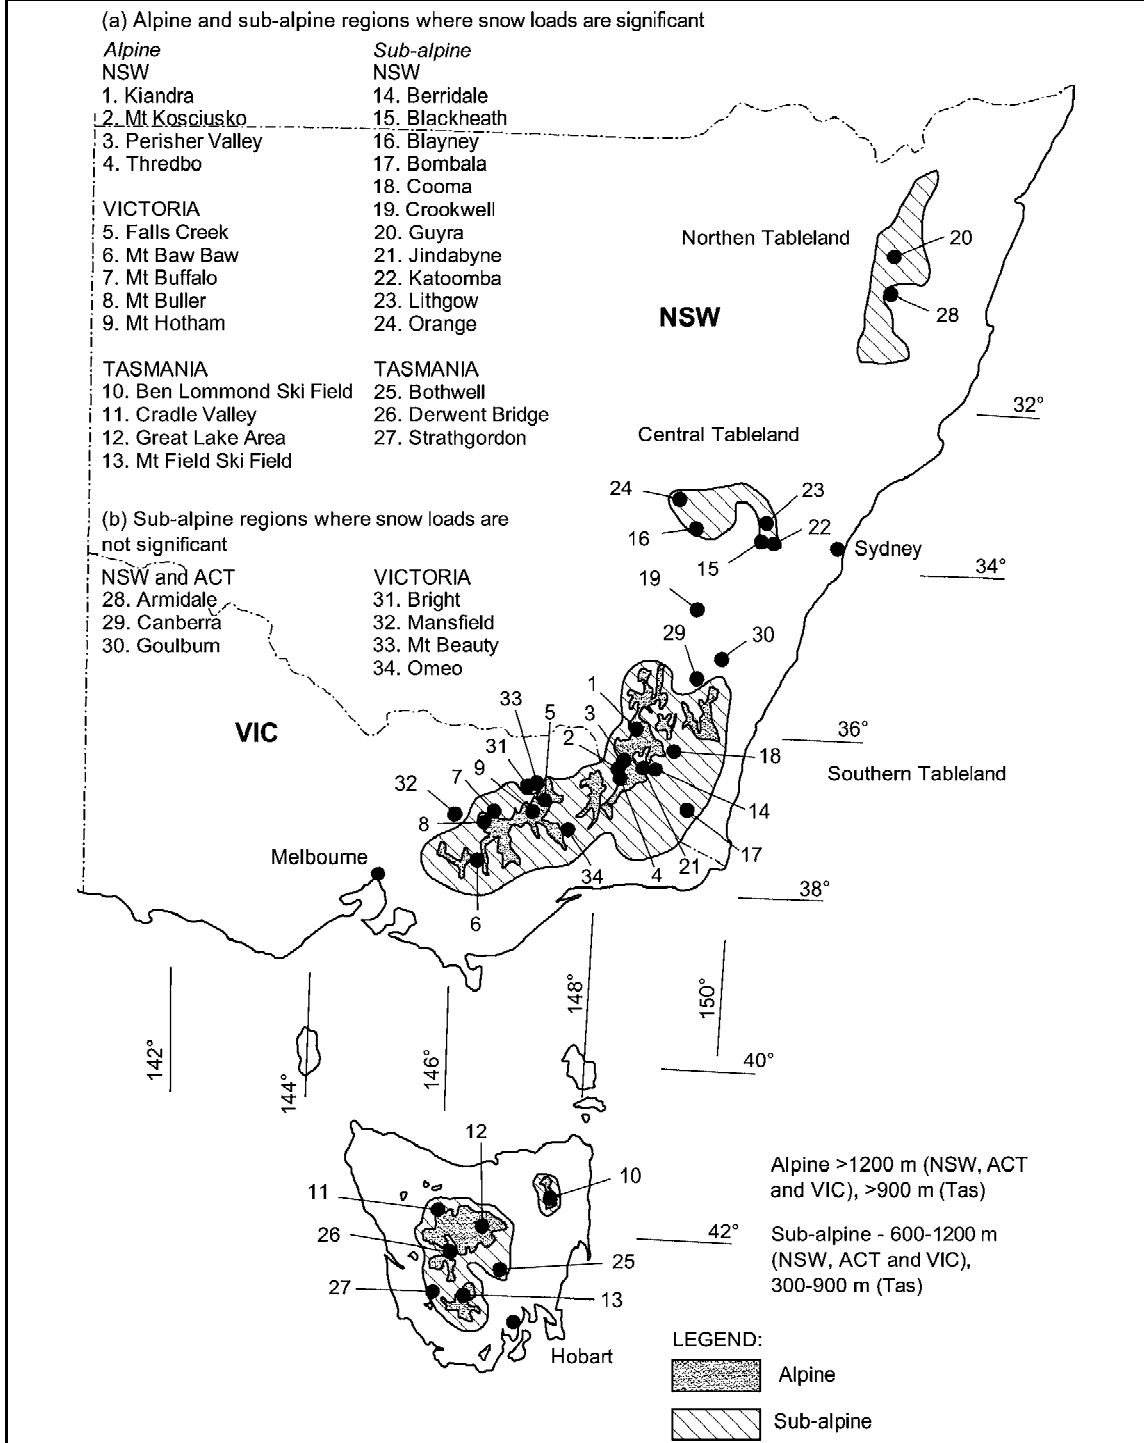**Figure 3.7.5.2****ALPINE AREAS**


**Explanatory information:**

Alpine and sub-*alpine areas* are located in ACT, NSW, Victoria and Tasmania.

*Alpine areas* are areas 1200 m or more above Australian Height Datum (AHD) for NSW, ACT and Victoria, and 900 m or more above AHD for Tasmania, as shown in **Figure 3.7.5.2**.

Significant snowfalls (snowfalls which result in an average snow accumulation on the ground of 175 mm or greater) may occur in the sub-*alpine areas* shown in **Figure 3.7.5.2**. **Part 3.7.5** does not apply to those areas because, unlike *alpine areas*, successive snowfalls are not likely to accumulate.

It is noted that in the ACT, the Canberra area is designated as a sub-alpine region where snow loads are not considered significant.

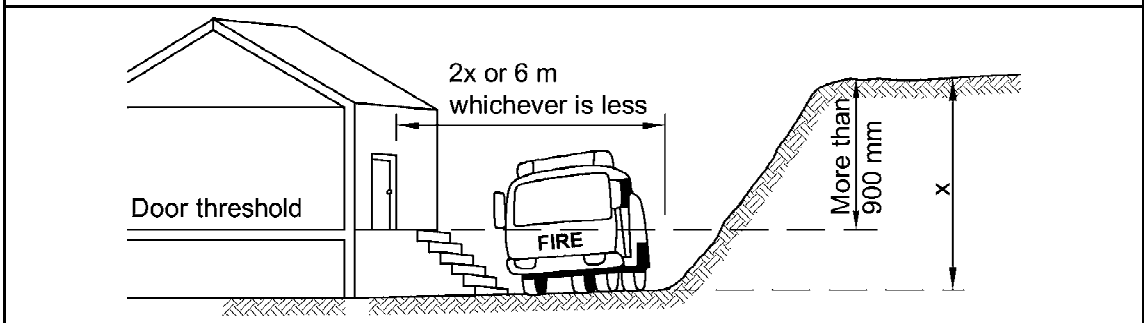**Figure 3.7.5.3****DESIGN FOR SAFE EGRESS IN ALPINE AREAS — DISCHARGE OF EXTERNAL DOORWAY**



# PART 3.8

---

## HEALTH AND AMENITY

- 3.8.1 Wet Areas
- 3.8.2 Room Heights
- 3.8.3 Facilities
- 3.8.4 Light
- 3.8.5 Ventilation
- 3.8.6 Sound Insulation

## PART 3.8 CONTENTS

### PART 3.8 HEALTH AND AMENITY

#### 3.8.1 Wet areas

- 3.8.1 Definitions
- 3.8.1.0 Acceptable construction manual
- 3.8.1.1 Application
- 3.8.1.2 Wet areas
- 3.8.1.3 Materials — waterproof
- 3.8.1.4 Materials — water resistant substrates
- 3.8.1.5 Materials — water resistant surface materials
- 3.8.1.6 Preformed shower bases
- 3.8.1.7 Baths and spas
- 3.8.1.8 Flashings
- 3.8.1.9 Penetrations
- 3.8.1.10 Wet area floors
- 3.8.1.11 Wall sheeting or render
- 3.8.1.12 Substrate surface preparation for application of membrane in shower areas
- 3.8.1.13 Stepdown showers
- 3.8.1.14 Falls in shower floors
- 3.8.1.15 Bath end walls abutting a shower
- 3.8.1.16 Bond breaker installation for bonded membranes
- 3.8.1.17 Vertical membrane termination
- 3.8.1.18 Hob construction
- 3.8.1.19 Enclosed showers without hobs or setdowns
- 3.8.1.20 Unenclosed showers
- 3.8.1.21 Membrane to drainage connection
- 3.8.1.22 Installation of internal membranes
- 3.8.1.23 Installation of an external membrane
- 3.8.1.24 Base termination of vertical flashing
- 3.8.1.25 Drainage riser connection
- 3.8.1.26 Door jambs and architraves on tiled floors
- 3.8.1.27 Shower screens

#### 3.8.2 Room heights

- 3.8.2.1 Application
- 3.8.2.2 Ceiling heights

#### 3.8.3 Facilities

- 3.8.3.1 Application
- 3.8.3.2 Required facilities
- 3.8.3.3 Construction of sanitary compartments

#### 3.8.4 Light

- 3.8.4.1 Application

3.8.4.2 Natural lighting

3.8.4.3 Artificial lighting

**3.8.5 Ventilation**

3.8.5.0 Acceptable construction manual

3.8.5.1 Application

3.8.5.2 Ventilation requirements

3.8.5.3 Location of sanitary compartments

**3.8.6 Sound insulation**

3.8.6.1 Application

3.8.6.2 Sound insulation requirements

3.8.6.3 General installation requirements for walls

3.8.6.4 Services

## PART 3.8.1 WET AREAS

### Appropriate *Performance Requirements* :

Where an alternative system for protecting *wet areas* in a building is proposed to that described in **Part 3.8.1**, that proposal must comply with—

- (a) *Performance Requirement P2.4.1*; and
- (b) the relevant *Performance Requirement* determined in accordance with **1.0.10**.

### Definitions:

#### 3.8.1 Definitions used in this Part are as follows:

**Bond breaker** means a system that prevents the *membrane* bonding to the substrate, bedding or lining.

**Drainage flange** means a flange connected to a waste pipe, at the point at which it passes through the floor substrate, to prevent leakage and which enables tile bed drainage into the waste pipe.

**Drainage riser** means a waste pipe between the *floor waste* and the drainage system.

**Flashing** means a strip or sleeve of impervious material dressed, fitted or built-in, or a liquid-applied product, to provide a barrier to moisture movement, or to divert the travel of moisture, or to cover a joint where water would otherwise penetrate.

**Flashing, perimeter** means a *flashing* used at the floor-wall junction.

**Flashing, vertical** means a *flashing* used at wall junctions within shower areas.

**Floor waste** means a grated inlet within a graded floor intended to drain the floor surface.

**Hob** means the upstand at the perimeter to a shower area.

**Insert bath** means a bath, where the bath lip is installed onto a horizontal plinth or surface.

**Maximum retained water level** means the point where surface water will start to overflow out of the shower area.

**Membrane** means a barrier impervious to moisture.

#### Explanatory information:

A barrier may be a single or multi-part system.

**Membrane, external** means a *membrane* that is installed behind the wall sheeting or render. Usually external membranes are preformed trays or sheet material systems.

**Membrane, internal** means a *membrane* that is installed to the face of the wall sheeting or render. Usually internal membranes are liquid systems applied in situ.

**Prefinished wall panels** means predecorated sheets or thermosetting laminated sheets that are designed for use as the final wall finish of the wet area.

**Shower area** means the area affected by water from a shower, including a shower over a bath.

**Shower area, enclosed** means the area enclosed by walls or screens including hinged or sliding doors that control the spread of water to within the enclosure but excludes—

- (a) a shower fitted with a frameless or semi frameless *shower screen*, shower curtain or the like; and
- (b) a shower fitted over a bath with a screen less than 1500 mm long.

**Shower area, unenclosed** means the area that is open on one or more sides, extending in an arc on the open sides, 1500 mm from the shower connection at the wall.

**Shower base** means a preformed, prefinished *vessel* installed as the finished floor of a shower compartment, and which is provided with a connection point to a sanitary drainage system. Shower bases are commonly made of plastics, composite materials, vitreous enamelled pressed steel, or stainless steel.

**Shower screen** means the panels, doors or windows enclosing or partially enclosing a *shower area*.

**Shower tray** means an internal or external liquid or sheet *membrane* system used to waterproof the floor and the wall/floor junctions of a *shower area*.

**Vessel** means an open, pre-formed, pre-finished concave receptacle capable of holding water for residential use, usually for the purpose of washing, including a basin, sink, bath, laundry tub and the like.

**Waterproofing system** means a combination of elements that are required to achieve a waterproof barrier as required by this Part, including, substrate, *membrane*, bond breakers, sealants, finishes and the like.

#### Explanatory information:

A *waterproofing system* for a bathroom floor may include lining it with a material in accordance with **Clause 3.8.1.3(a)**, **(b)** or **(d)** or by using a *waterproof* flexible sheet flooring material in accordance with **Clause 3.8.1.3(c)**.

**Water resistant (WR)** means the property of a system or material that restricts moisture movement and will not degrade under conditions of moisture.

**Waterstop** means a vertical extension of the *waterproofing system* forming a barrier to prevent the passage of moisture in the floor.

**Wet area** means an area within a building supplied with water from a water supply system and includes bathrooms, showers, laundries and sanitary compartments. Excludes kitchens, bar areas, kitchenettes or domestic food and beverage preparation areas.

### A. Acceptable construction manual

#### 3.8.1.0

*Performance Requirement P2.4.1* is satisfied for *wet areas* in Class 1 and 10 buildings if they are waterproof or *water resistant* in accordance with AS 3740 — Waterproofing of wet areas in residential buildings.

## STATE AND TERRITORY VARIATIONS

**3.8.1.0 does not apply in South Australia and is replaced in South Australia with the following clause.**

*Performance Requirements P2.4.1* and **SA 3.1** are satisfied for *wet areas* in Class 1 and 10 buildings if they are waterproofed in accordance with AS 3740 and the additional requirements of Minister's Specification SA F1.7.

**B. Acceptable construction practice****3.8.1.1 Application**

Compliance with this acceptable construction practice satisfies *Performance Requirement P2.4.1* for *wet areas* provided the *wet area*-

- (a) is protected in accordance with the appropriate requirements of **3.8.1.2** to **3.8.1.27**; and
- (b) complies with the appropriate details described in **Figures 3.8.1.1** to **3.8.1.16**.

## STATE AND TERRITORY VARIATIONS

**3.8.1.1 does not apply in South Australia and is replaced in South Australia with *SA 3.2.1*.**

**3.8.1.2 Wet Areas**

*Wet areas* within a building must be waterproof or *water resistant* in accordance with **Table 3.8.1.1**.

SUPERSEDED

Table 3.8.1.1 WATERPROOFING AND WATER RESISTANCE REQUIREMENTS FOR BUILDING ELEMENTS IN WET AREAS

Vessels or area where the fixture is installed	Floors and horizontal surfaces	Walls	Wall junctions and joints	Penetrations
Enclosed shower with hob	Waterproof entire enclosed shower area, including hob. (see Figure 3.8.1.1)	Waterproof to not less than 150 mm above the shower floor substrate or not less than 25 mm above the maximum retained water level which ever is the greater with the remainder being water resistant to a height of not less than 1800 mm above the finished floor level. (see Figure 3.8.1.1)	Waterproof internal and external corners and horizontal joints within a height of 1800 mm above the floor level with not less than 40 mm width either side of the junction. (see Figure 3.8.1.1)	Waterproof all penetrations.
Enclosed shower without hob	Waterproof entire enclosed shower area including waterstop.	Waterproof to not less than 150 mm above the shower floor substrate with the remainder being water resistant to a height of not less than 1800 mm above the finished floor level. (see Figure 3.8.1.1)	Waterproof internal and external corners and horizontal joints within a height of 1800 mm above the floor level with not less than 40 mm width either side of the junction. (see Figure 3.8.1.1)	Waterproof all penetrations.

SUPERSEDED

Table 3.8.1.1 WATERPROOFING AND WATER RESISTANCE REQUIREMENTS FOR BUILDING ELEMENTS IN WET AREAS— continued

Vessels or area where the fixture is installed	Floors and horizontal surfaces	Walls	Wall junctions and joints	Penetrations
Enclosed shower with step down	Waterproof entire enclosed shower area including the step down.	Waterproof to not less than 150 mm above the shower floor substrate or not less than 25 mm above the maximum retained water level whichever is the greater with the remainder being water resistant to a height of not less than 1800 mm above the finished floor level. (see Figure 3.8.1.1)	Waterproof internal and external corners and horizontal joints within a height of 1800 mm above the floor level with not less than 40 mm width either side of the junction. (see Figure 3.8.1.1)	Waterproof all penetrations.
Enclosed shower with preformed shower base	N/A	Water resistant to a height of not less than 1800 mm above finished floor level. (see Figure 3.8.1.1)	Waterproof internal and external corners and horizontal joints within a height of 1800 mm above the floor level with not less than 40 mm width either side of the junction. (see Figure 3.8.1.1)	Waterproof all penetrations.
Unenclosed showers	Waterproof entire unenclosed shower area.	Waterproof to not less than 150 mm above the shower floor substrate or not less than 25 mm above the maximum retained water level with the remainder being water resistant to a height of not less than 1800 mm above the finished floor level. (see Figure 3.8.1.1)	Waterproof internal and external corners and horizontal joints within a height of 1800 mm above the floor level with not less than 40 mm width either side of the junction. (see Figure 3.8.1.1)	Waterproof all penetrations.



SUPERSEDED

Table 3.8.1.1 WATERPROOFING AND WATER RESISTANCE REQUIREMENTS FOR BUILDING ELEMENTS IN WET AREAS— continued

Vessels or area where the fixture is installed	Floors and horizontal surfaces	Walls	Wall junctions and joints	Penetrations
Areas outside the shower area for concrete and compressed fibre cement sheet flooring	Water resistant to entire floor.	N/A	Waterproof all wall/floor junctions. Where a flashing is used the horizontal leg must be not less than 40 mm.	N/A
Areas outside the shower area for timber floors including particleboard, plywood and other timber based flooring materials	Waterproof entire floor.	N/A	Waterproof all wall/floor junctions. Where a flashing is used the horizontal leg must be not less than 40 mm.	N/A
Areas adjacent to baths and spas for concrete and compressed fibre cement sheet flooring	Water resistant to entire floor.	Water resistant to a height of not less than 150 mm above the vessel and exposed surfaces below the vessel lip to floor level. (see Figure 3.8.1.2)	Waterproof edges of the vessel and junction of bath enclosure with floor. Where the lip of the bath is supported by a horizontal surface, this area must be waterproof for showers over bath and water resistant for all other cases. (see Figure 3.8.1.2)	Waterproof all tap and spout penetrations where they occur in a horizontal surface.

SUPERSEDED

Table 3.8.1.1 WATERPROOFING AND WATER RESISTANCE REQUIREMENTS FOR BUILDING ELEMENTS IN WET AREAS— continued


Vessels or area where the fixture is installed	Floors and horizontal surfaces	Walls	Wall junctions and joints	Penetrations
Areas adjacent to baths and spas (see note 1) for timber floors including particleboard, plywood and other timber based flooring materials	Waterproof entire floor.	Water resistant to a height of not less than 150 mm above the vessel and exposed surfaces below the vessel lip to floor level. (see Figure 3.8.1.3)	Waterproof edges of the vessel and junction of bath enclosure with floor. Where the lip of the bath is supported by a horizontal surface, this area must be waterproof for showers over bath and water resistant for all other cases. (see Figure 3.8.1.3)	Waterproof all tap and spout penetrations where they occur in a horizontal surface.
Inserted baths	N/A for floor under bath. Waterproof entire shelf area, incorporating waterstop under the bath lip and project not less than 5 mm above the tile surface. (see Figure 3.8.1.8(c))	N/A for wall under bath. Waterproof to not less than 150 mm above the lip of the bath.	N/A for wall under bath.	Waterproof all tap and spout penetrations where they occur in a horizontal surface.
Walls adjoining other vessels (e.g. sinks, laundry tubs and basins)	N/A	Water resistant to a height of not less than 150 mm above the vessel if the vessel is within 75 mm of the wall. (see Figure 3.8.1.5)	Where the vessel is fixed to a wall, waterproof edges for extent of vessel.	Waterproof all tap and spout penetrations where they occur in a horizontal surface.
Laundries and WCs	Water resistant to entire floor.	Waterproof all wall/floor junctions to not less than 25 mm above the finished floor level, sealed to floor.	Waterproof all wall/floor junctions, where a flashing is used the horizontal leg must be not less than 40 mm.	N/A

SUPERSEDED

Table 3.8.1.1 WATERPROOFING AND WATER RESISTANCE REQUIREMENTS FOR BUILDING ELEMENTS IN WET AREAS— continued


Vessels or area where the fixture is installed	Floors and horizontal surfaces	Walls	Wall junctions and joints	Penetrations
<b>Notes:</b> 1. If a shower is included above a bath, refer to the requirements for <i>shower area</i> walls and penetrations. 2. N/A means not applicable.				

SUPERSEDED

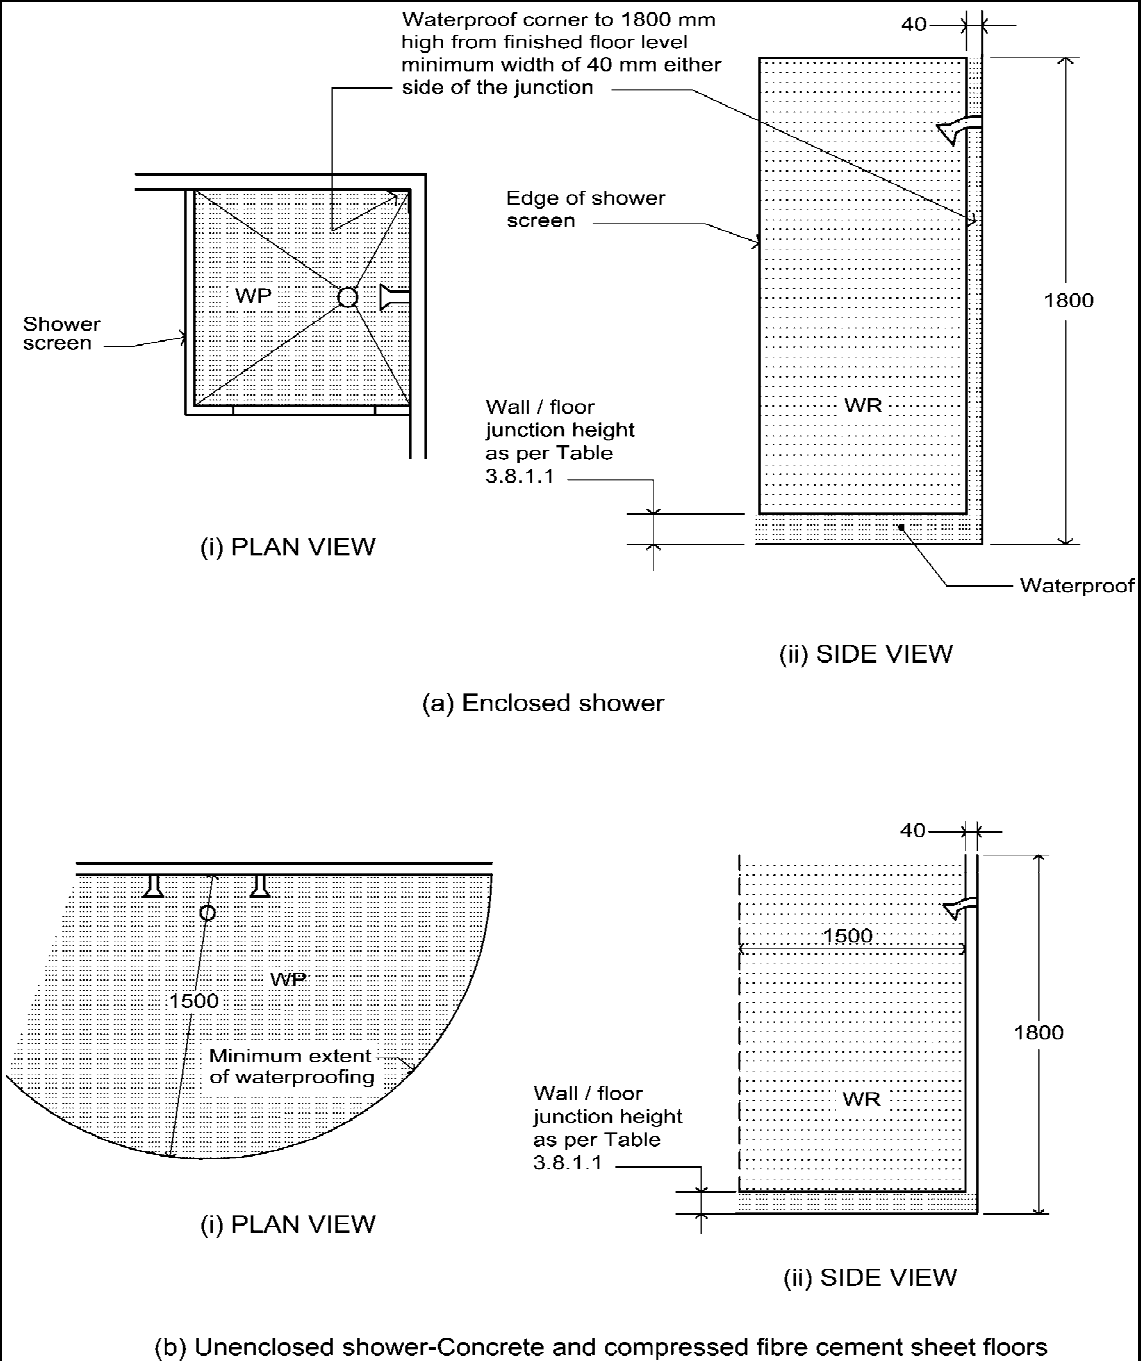**Figure 3.8.1.1****EXTENT OF TREATMENT FOR SHOWER AREAS — CONCRETE AND COMPRESSED FIBRE CEMENT SHEET FLOORS**


**Figure 3.8.1.2**

**UNENCLOSED SHOWERS ABOVE BATHS — AREA PROTECTED FOR CONCRETE AND COMPRESSED FIBRE CEMENT SHEET FLOORING**

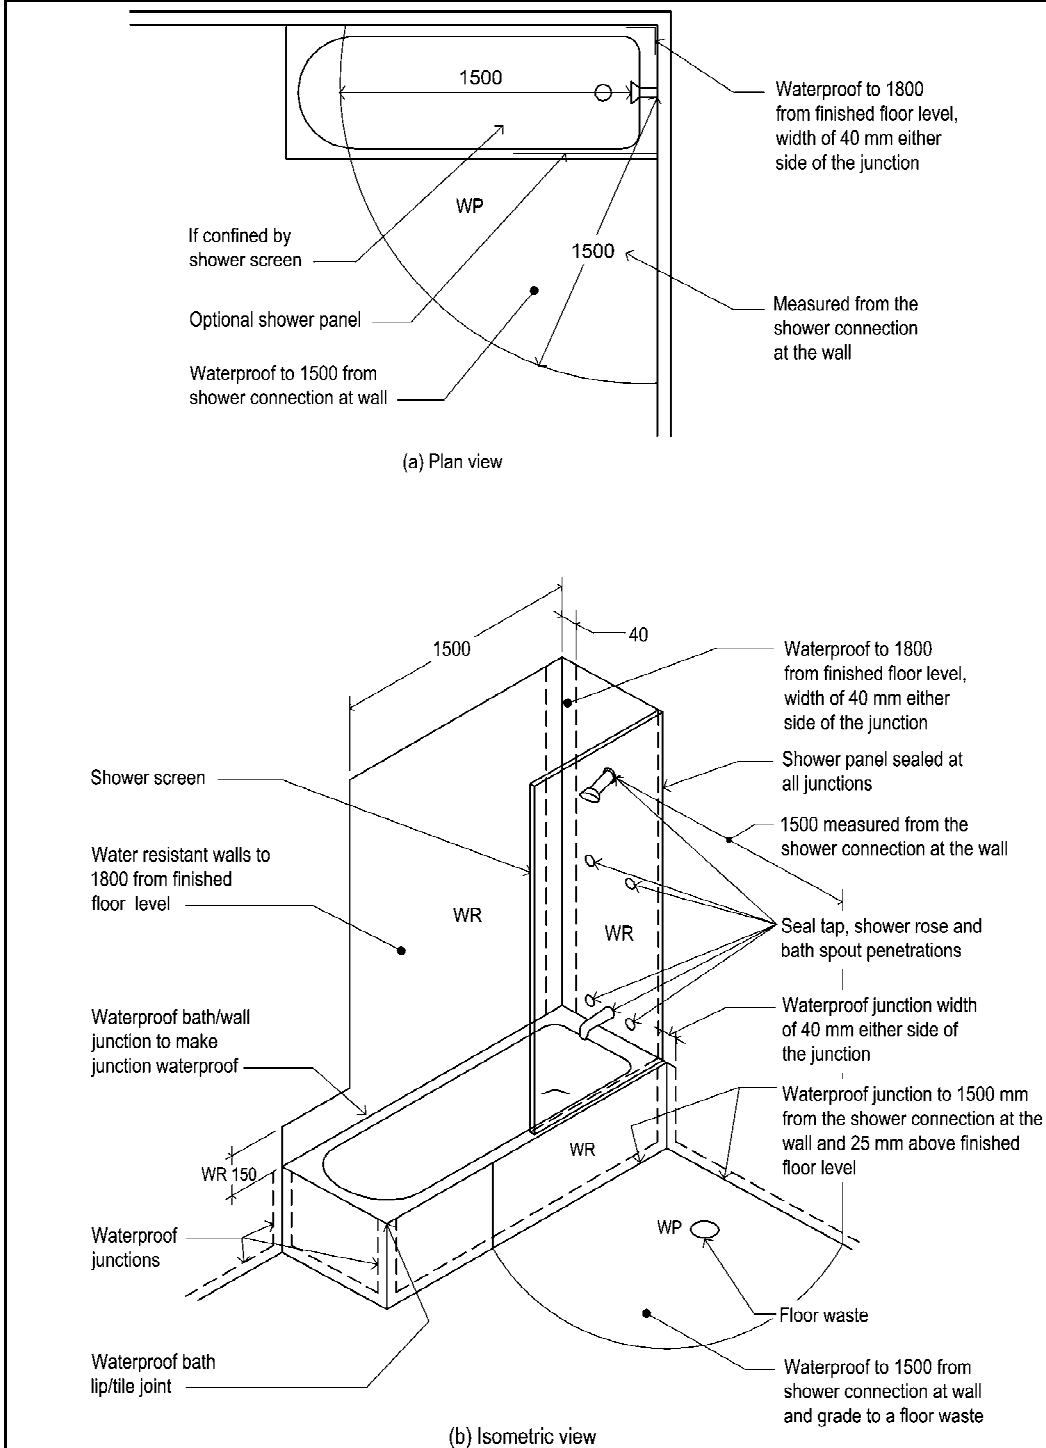


**Figure 3.8.1.3**

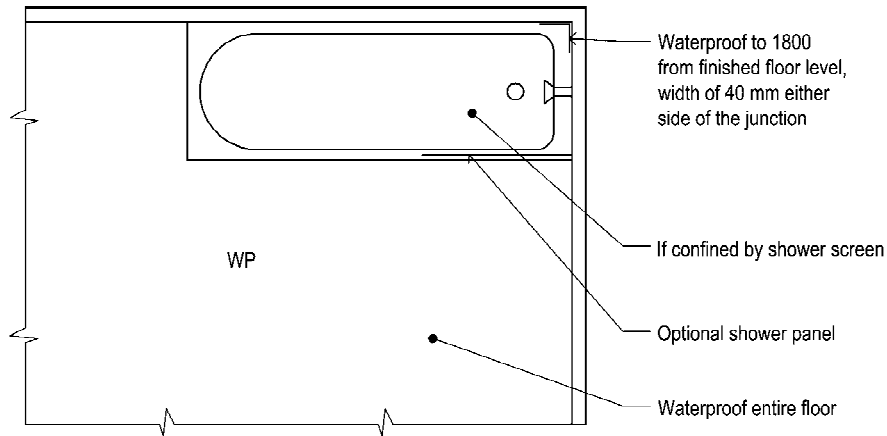**UNENCLOSED SHOWERS ABOVE BATHS — AREA PROTECTED FOR TIMBER FLOORS INCLUDING PARTICLEBOARD, PLYWOOD AND OTHER FLOOR MATERIALS**




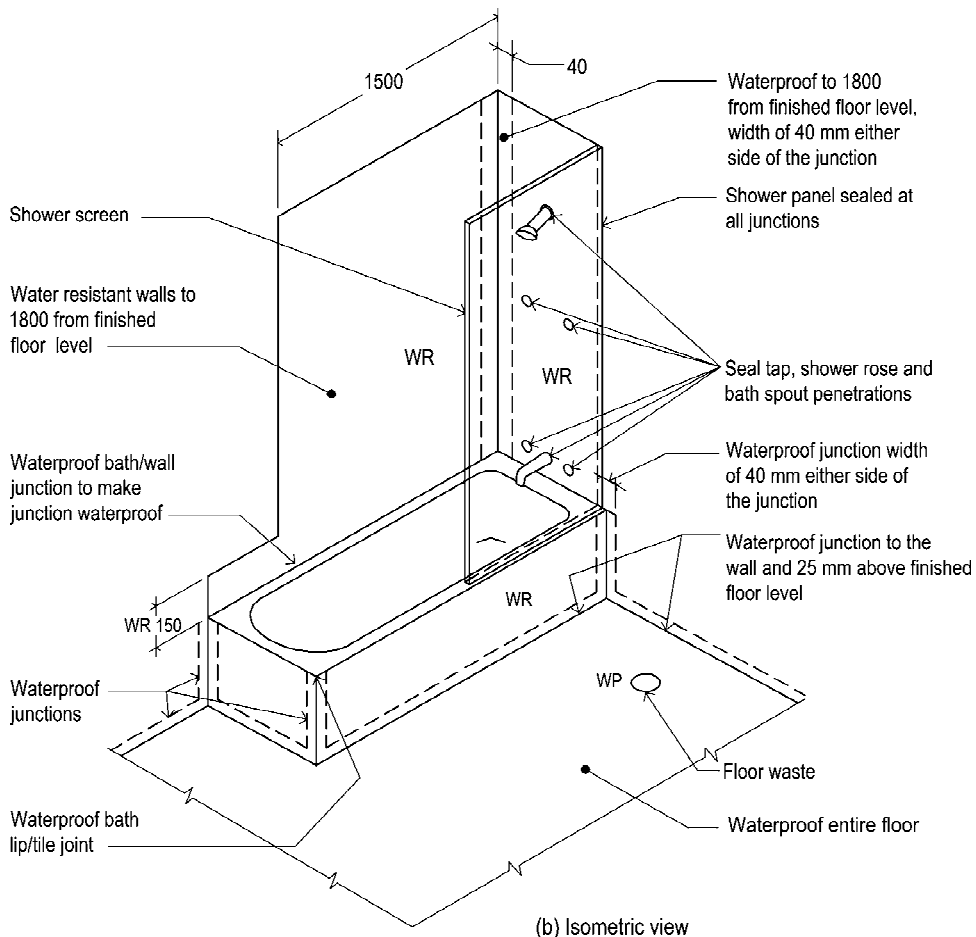(a) Plan view




(b) Isometric view

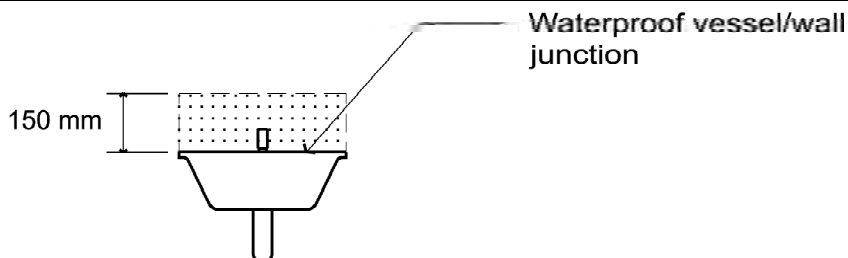Figure 3.8.1.5

**BATH AND VESSEL ABUTTING WALL — AREAS TO BE PROTECTED**

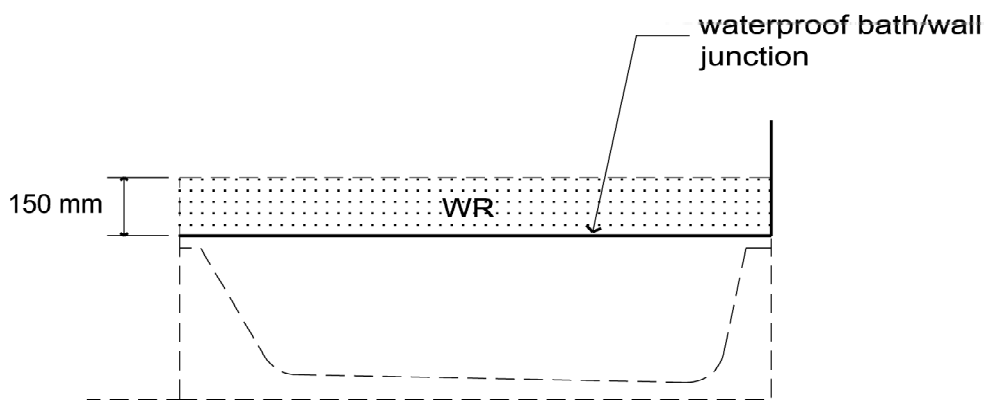(a) Vessel abutting wall



(b) wall/bath junction

**3.8.1.3 Materials — waterproof**

For the purpose of this Part, the following materials used in *waterproofing systems* are deemed to be waterproof:

- (a) Stainless steel.
- (b) Copper — material not less than 99.9% copper.
- (c) Waterproof flexible sheet flooring material with sealed joints.
- (d) Membranes meeting the requirements of AS/NZS 4858.

**3.8.1.4 Materials — water resistant substrates**

For the purposes of this Part, the following materials used in a *waterproofing system* in conjunction with *water resistant* surface materials in accordance with 3.8.1.5 are deemed to be *water resistant*:

- (a) For walls:
  - (i) Concrete in accordance with AS 3600, treated to resist moisture movement.

- (ii) Cement render, treated to resist moisture movement.
  - (iii) Compressed fibre cement sheeting manufactured in accordance with AS/NZS 2908.2.
  - (iv) [Water resistant](#) plasterboard sheeting.
  - (v) Masonry in accordance with AS 3700, treated to resist moisture movement.
- (b) For floors:
- (i) Concrete in accordance with AS 3600 or AS 2870.
  - (ii) Compressed fibre cement sheeting manufactured in accordance with AS/NZS 2908.2.
  - (iii) Compressed fibre cement sheeting manufactured in accordance with AS/NZS 2908.2 and supported on a structural floor.
  - (iv) Flooring grade particleboard sheeting.
  - (v) Structural plywood manufactured in accordance with AS/NZS 2269 and installed in accordance with AS 1684.2, AS 1684.3 or AS 1684.4.

### 3.8.1.5 Materials – water resistant surface materials

For the purposes of this Part, the following surface materials are deemed to be [water resistant](#):

- (a) For walls:
- (i) Thermosetting laminate.
  - (ii) Pre-decorated compressed fibre cement sheeting manufactured in accordance with AS 2908.2.
  - (iii) Tiles when used in conjunction with a substrate listed in [3.8.1.4](#).
  - (iv) [Water resistant](#) flexible sheet wall material with sealed joints when used in conjunction with a substrate listed in [3.8.1.4](#).
  - (v) Sanitary grade acrylic linings.
- (b) For floors, when used in conjunction with a substrate listed in [3.8.1.4](#):
- (i) Tiles.
  - (ii) [Water resistant](#) flexible sheet flooring material with sealed joints.



#### Explanatory information:

Sheet vinyl or linoleum would satisfy the requirement of [3.8.1.5\(b\)\(ii\)](#).

### 3.8.1.6 Preformed shower bases

- (a) Shower bases must be supported to prevent distortion or cracking, and must be recessed into the wall to allow the [water resistant](#) surface materials to pass down inside the perimeter rebate of the [shower base](#) (See [Figure 3.8.1.6](#) and [Figure 3.8.1.7](#)).
- (b) The integrity of the structure must be maintained when the [shower base](#) is installed.

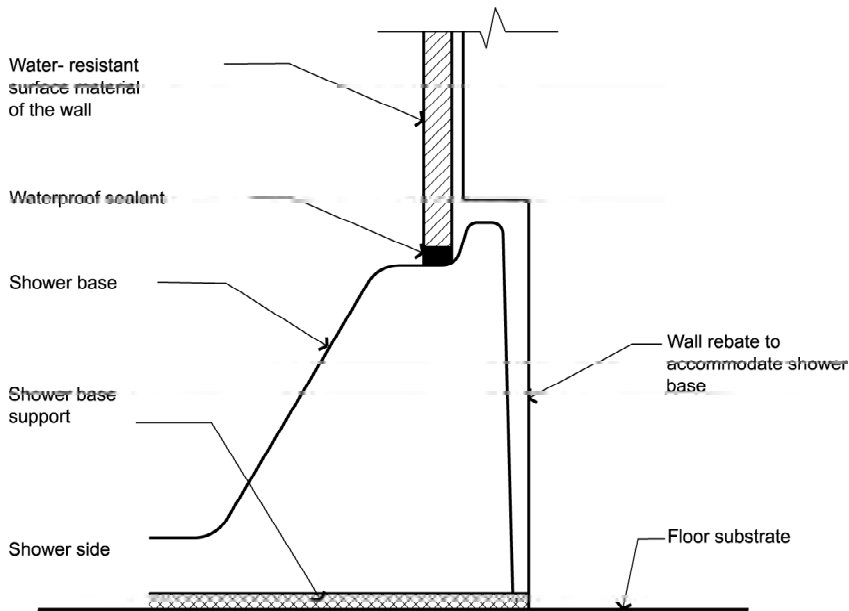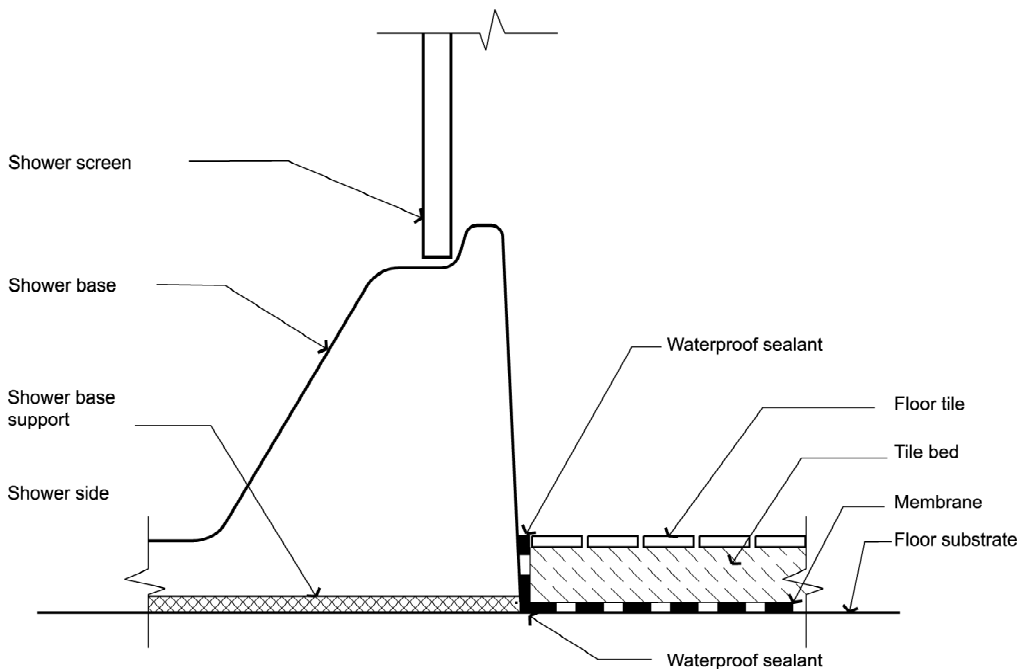

**Figure 3.8.1.6****TYPICAL PREFORMED SHOWER BASE WALL/FLOOR JUNCTION****Figure 3.8.1.7****TYPICAL PREFORMED SHOWER BASE/FLOOR JUNCTION ON TIMBER FLOORS, INCLUDING PARTICLEBOARD, PLYWOOD AND OTHER TIMBER MATERIALS**


### 3.8.1.7 Baths and Spas

- (a) Baths and spas must be supported to prevent distortion and cracking.
- (b) Baths and spas recessed into the wall must be installed to allow the *water resistant* surface materials of the wall to pass down inside the rim of the bath or spa (see [Figure 3.8.1.8](#)).
- (c) The integrity of the structure must be maintained when the bath or spa is installed.

**Figure 3.8.1.8**

#### TYPICAL BATH JUNCTIONS

**Diagram a** Bath/wall junction - recessed

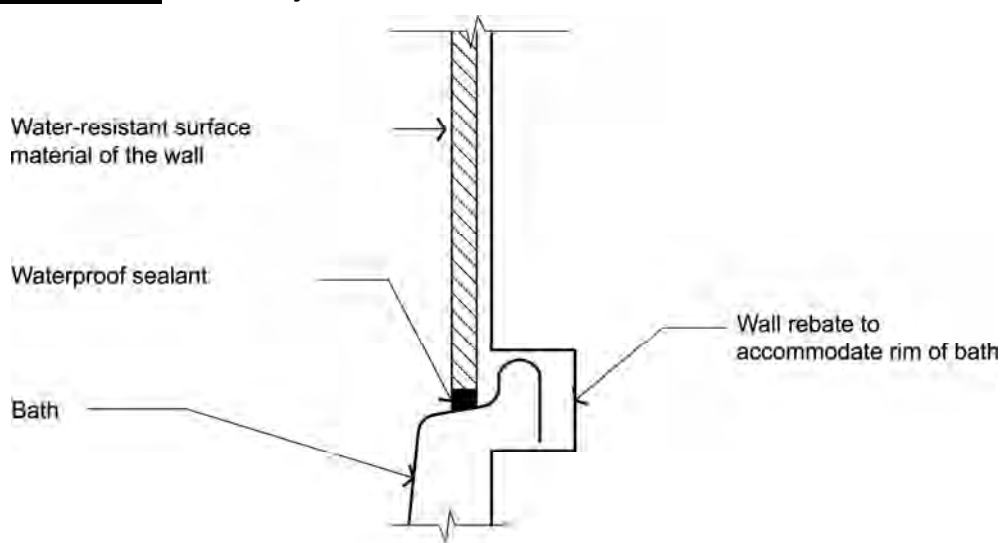

**Diagram b** Bath/wall junction - battened

Figure 3.8.1.8

## TYPICAL BATH JUNCTIONS


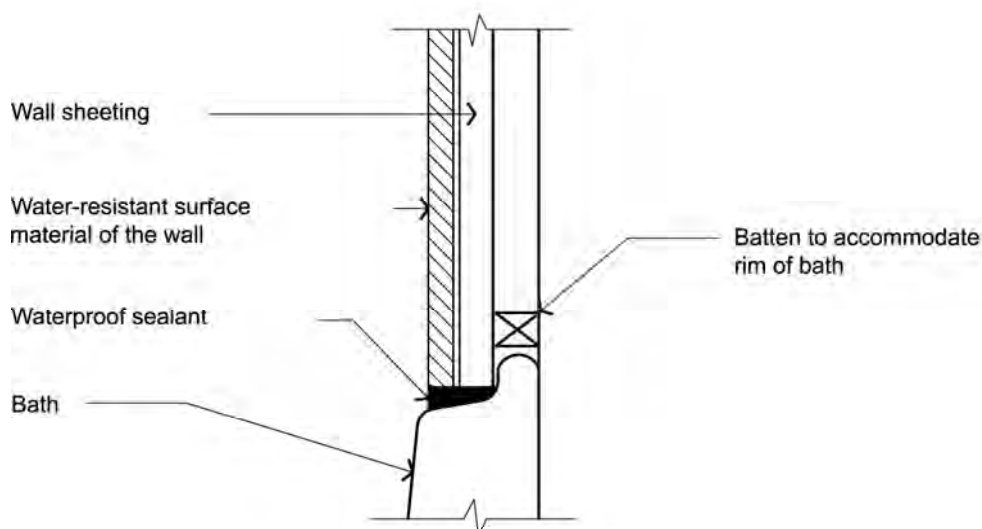


Diagram c

## Bath/shelf junction

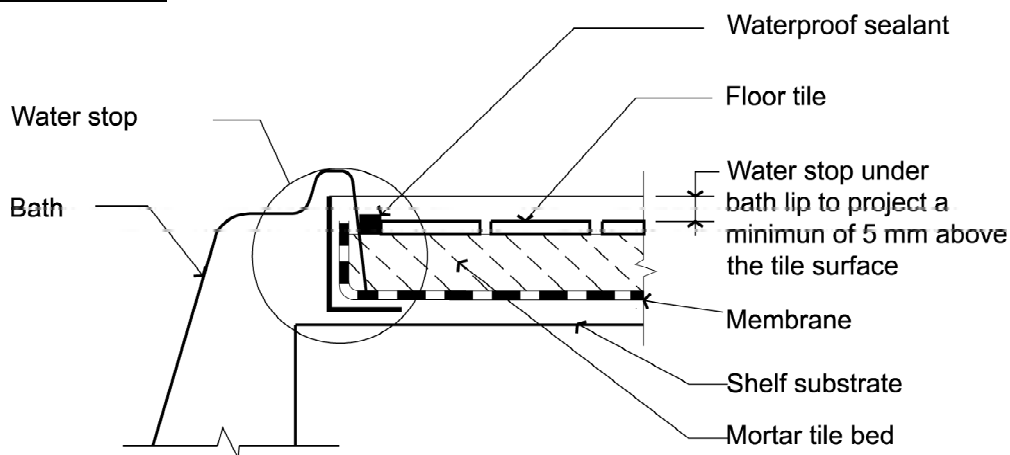

## 3.8.1.8 Flashings


*Flashings* must be installed in accordance with [Table 3.8.1.1](#) and the following:

- (a) Perimeter *flashing* to wall/floor junctions must have a vertical leg of not less than 25 mm above the finished floor level, except across doorways, and the horizontal leg must have a width of not less than 50 mm.
- (b) Where a *water resistant* substrate is used in conjunction with a *water resistant* surface material, a waterproof sealant must be installed after the finishes have been applied at the wall/floor junction.
- (c) Perimeter *flashings* at floor level opening must comply with the following:


- (i) Where the whole *wet area* floor is waterproof, at floor level openings, a *waterstop* must be installed that has a vertical leg finishing flush with the top of the finished floor level with the floor *membrane* being terminated to create a waterproof seal to the *waterstop* and to the perimeter *flashing* (see **Figure 3.8.1.9**).
- (ii) In any other case, at floor level openings a *waterstop* must be installed that has a vertical leg finishing flush with the top of the finished floor level and waterproofed to the perimeter *flashing*.

Figure 3.8.1.9
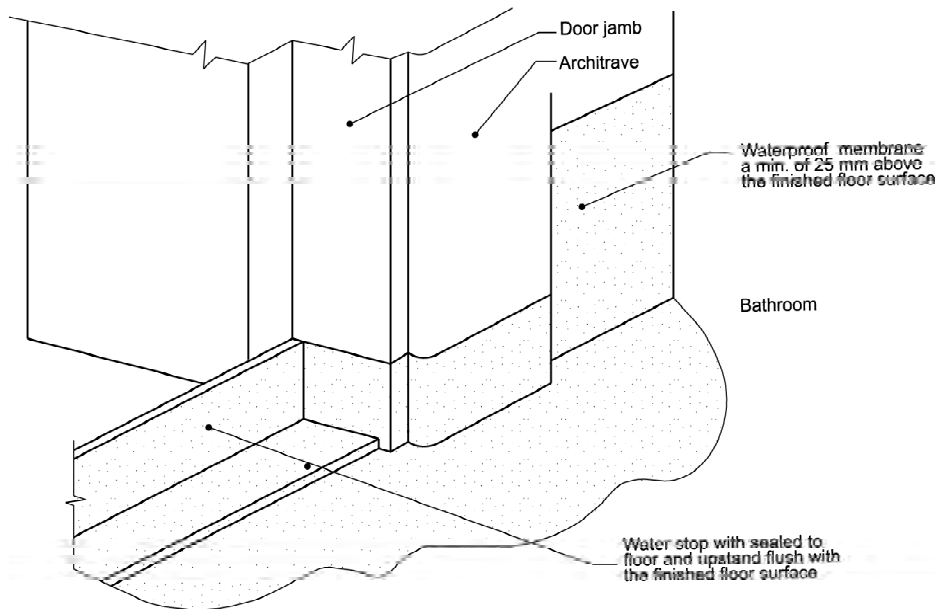
## TYPICAL BATHROOM DOOR DETAILS FOR WHOLE BATHROOM WATERPROOFING



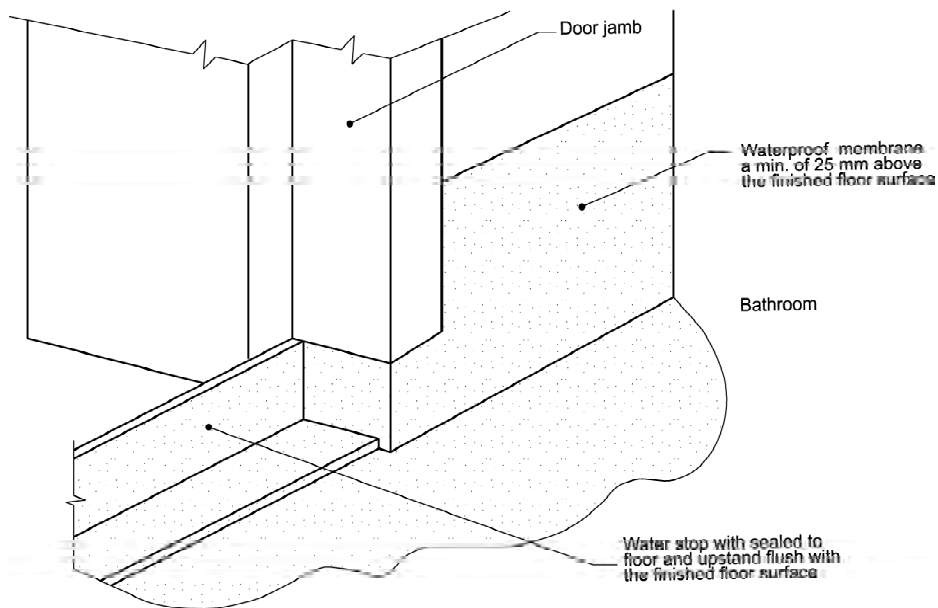(a) After installation of architrave



(b) Prior to installation of architrave

- (d) Vertical *flashing*, either external or internal, must terminate not less than 1800 mm above the finished floor level.

**Explanatory information:**

Vertical *flashing* may be used as follows:

1. External vertical *flashing* may be used with external *membrane* systems and installed behind the wall sheeting or render. They must have legs of sufficient width to allow the wall sheeting or render to overlap by not less than 32 mm.
2. Internal vertical *flashing* may be used with both external and internal *membrane* systems provided each leg has a minimum overlap of 40 mm to the wall sheeting or render and where used with—
  - (i) internal membranes, must extend vertically from the shower tray; and
  - (ii) external membranes, must overlap the top edge of the floor *waterproofing system* by not less than 20 mm; and
  - (iii) preformed shower bases or baths, must extend to the bottom edge of the wall sheeting or render.

**3.8.1.9 Penetrations**

- (a) Penetrations of *shower areas* must comply with the following:
  - (i) Penetrations for taps, shower nozzles and the like must be waterproofed by sealing with proprietary flange systems or sealants.
  - (ii) When sealing the tap body to the wall, the spindle housing must be able to be removed to enable replacement of the washer without damaging the seal.
  - (iii) Any penetration of the mechanical fixings or fastenings through surface materials must be waterproofed.
- (b) Tap penetrations on horizontal surfaces surrounding baths and spas must be waterproofed by sealing with proprietary flange systems or by sealing the tap body to the substrate.

**3.8.1.10 Wet area floors**

Where a *floor waste* is installed, the floor must be constructed so that water flows to the waste without ponding.

**Explanatory information:**

1. The ratio of fall achieved in a floor may vary depending on the following:
  - (a) The finished height requirements at doorways.
  - (b) The height of *vessels* or fittings.
  - (c) The dimensions of the tiles used — adequate falls become more difficult to achieve as the size of the tiles used increases.
  - (d) The area of the floor to be drained.
  - (e) The requirements of people with a disability.
2. The recommended ratio of fall within showers is between 1:60 and 1:80.
3. The recommended ratio of fall in other areas is between 1:80 and 1:100.
4. In some cases the fall in the floor finishes in the same area may vary.
5. Where falls steeper than 1:100 are not achievable, the effectiveness of the floor drainage should be confirmed to ensure that water does not remain on the finished floor

in a manner that can adversely affect the health or amenity of the building occupants or deteriorate building elements.

#### 3.8.1.11 Wall sheeting or render

- (a) Where wall sheeting or render is used with an external *membrane* system in a shower area, it must—
  - (i) not extend into the floor tile bed; or
  - (ii) be waterproof to prevent moisture movement by capillary action.
- (b) Where *water resistant* plasterboard is used, all cut edges that have the potential to be affected by moisture must be waterproofed, including the bottom edge over a preformed shower base.

#### 3.8.1.12 Substrate surface preparation for application of membrane in shower areas

- (a) The area must be clean and dust free.
- (b) Indentations and imperfections must be kept to a minimum and repaired where necessary.

#### 3.8.1.13 Stepdown showers

The highest finished floor level of the *shower area* must be stepped down not less than 25 mm lower than the finished floor level outside the shower (see [Figure 3.8.1.10](#))

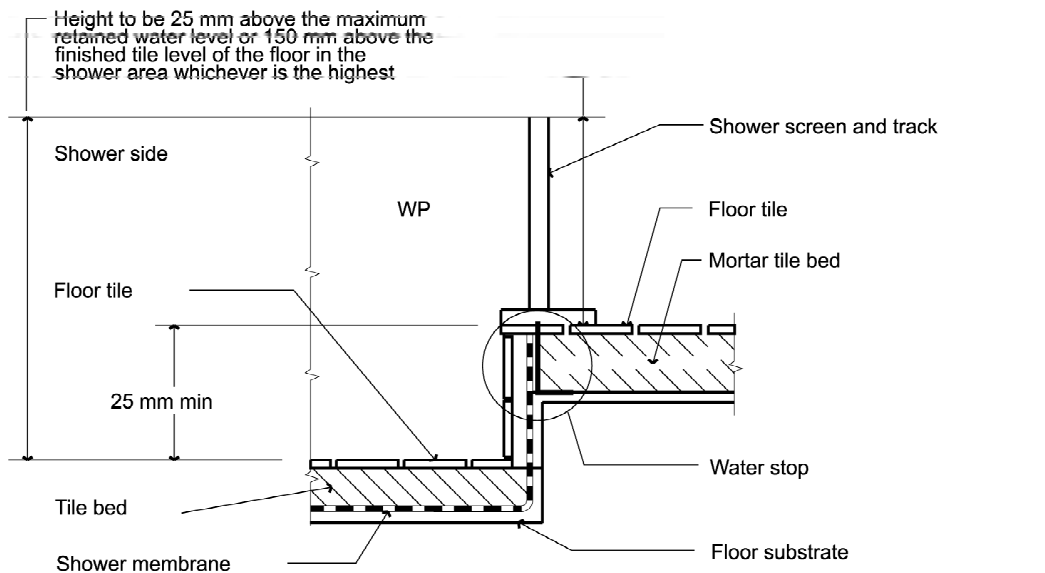
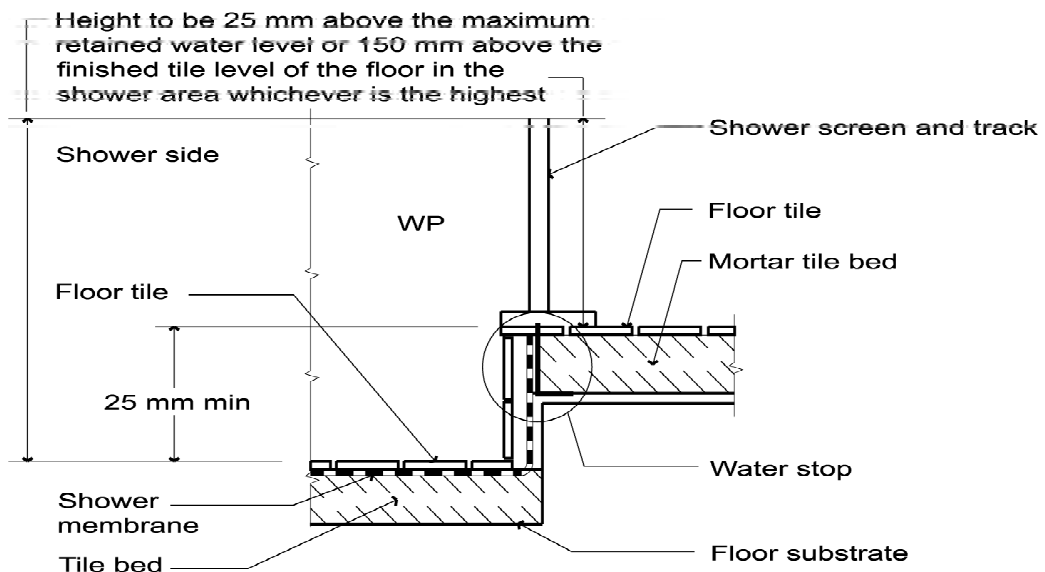
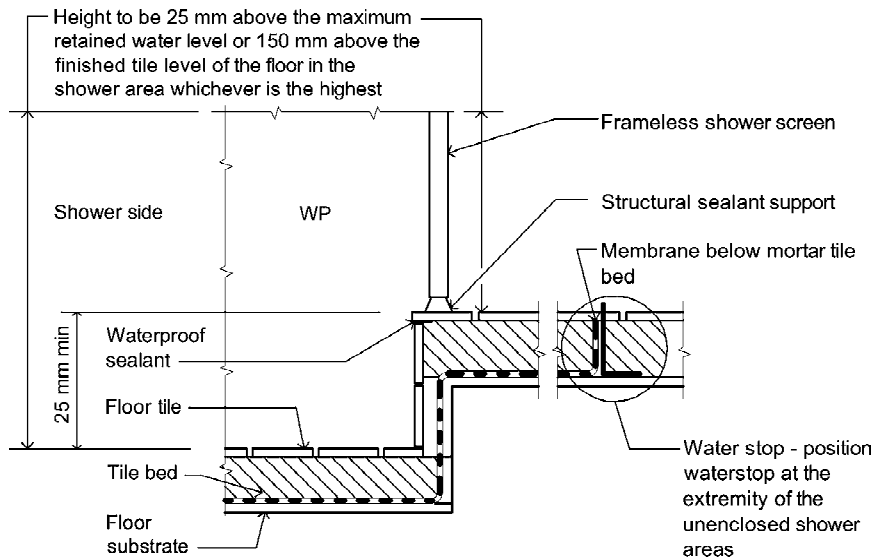
**Figure 3.8.1.10****TYPICAL STEPPED DOWN SHOWER CONSTRUCTION****(a) Enclosed shower-Membrane below tile bed****(b) Enclosed shower-Membrane above tile bed**

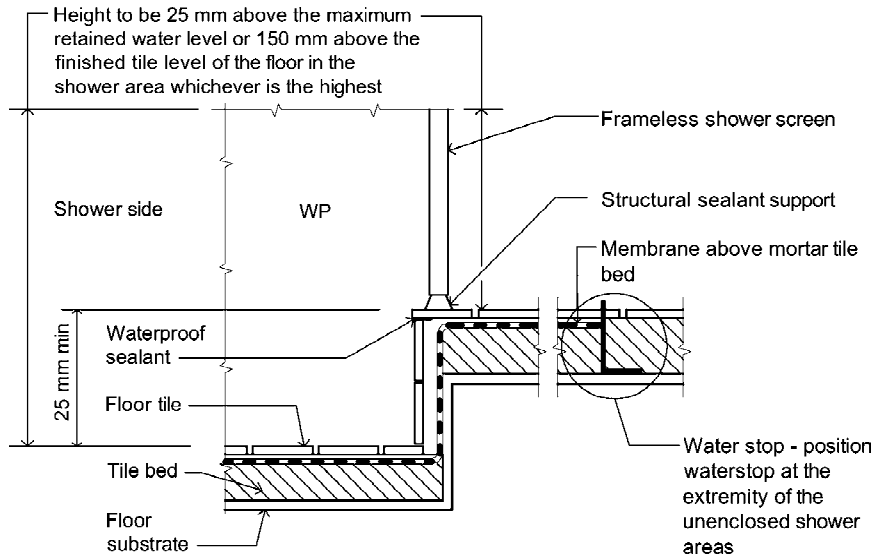


Figure 3.8.1.10 (continued)

## TYPICAL STEPPED DOWN SHOWER CONSTRUCTION



(c) Unenclosed shower-Membrane below tile bed



(d) Unenclosed shower-Membrane above tile bed

## 3.8.1.14 Falls in shower floors

The entire [shower area](#) must be constructed so that water flows to the waste without ponding.

**Explanatory information:**

1. The ratio of fall achieved in a floor may vary depending on the following:
  - (a) The finished height requirements at doorways.
  - (b) The height of fixtures or fittings.
  - (c) The dimensions of the tiles used (adequate falls become more difficult to achieve as the size of the tiles used increases).
  - (d) The area of the floor to be drained.
  - (e) The requirements of people with disabilities.
2. The recommended ratio of fall within showers is between 1:60 and 1:80.
3. The recommended ratio of fall in other areas is between 1:80 and 1:100.
4. In some cases the fall in the floor finishes in the same area may vary.
5. Where falls steeper than 1:100 are not achievable, the effectiveness of the floor drainage should be confirmed to ensure that water does not remain on the finished floor in a manner that can adversely affect the health or amenity of the building occupants or deteriorate building elements.

**3.8.1.15 Bath end walls abutting a shower**

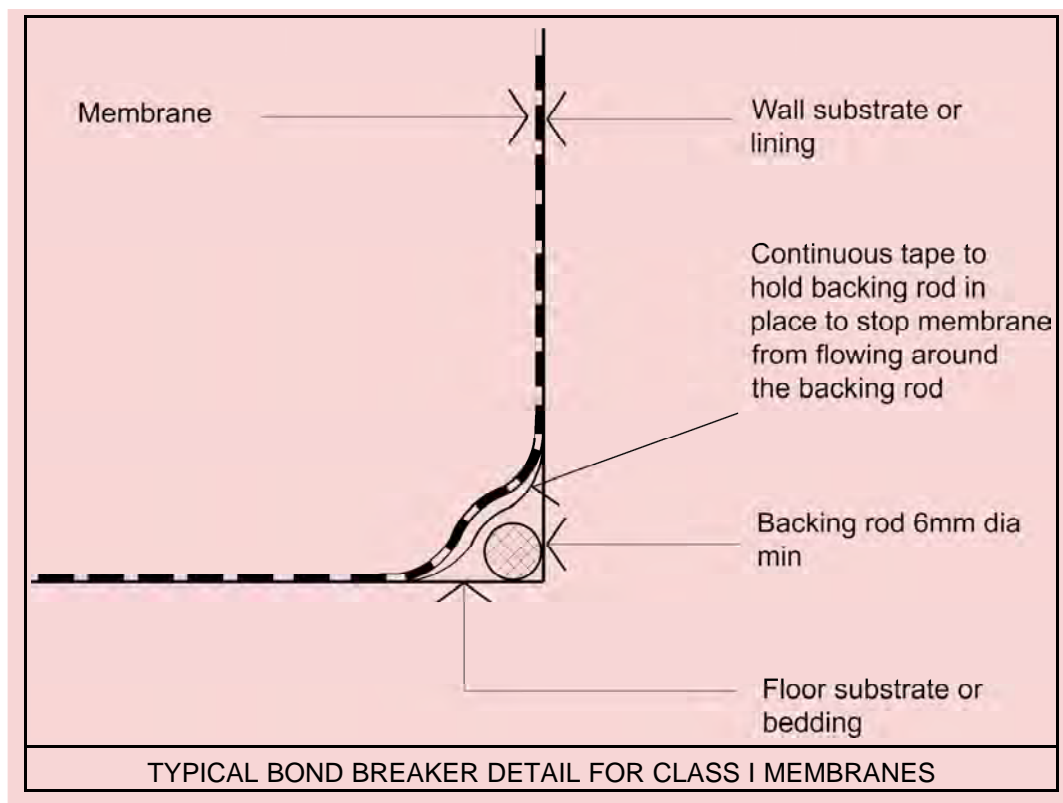
Where a bath end wall is within a *shower area*, it must be treated as a *shower area* wall.

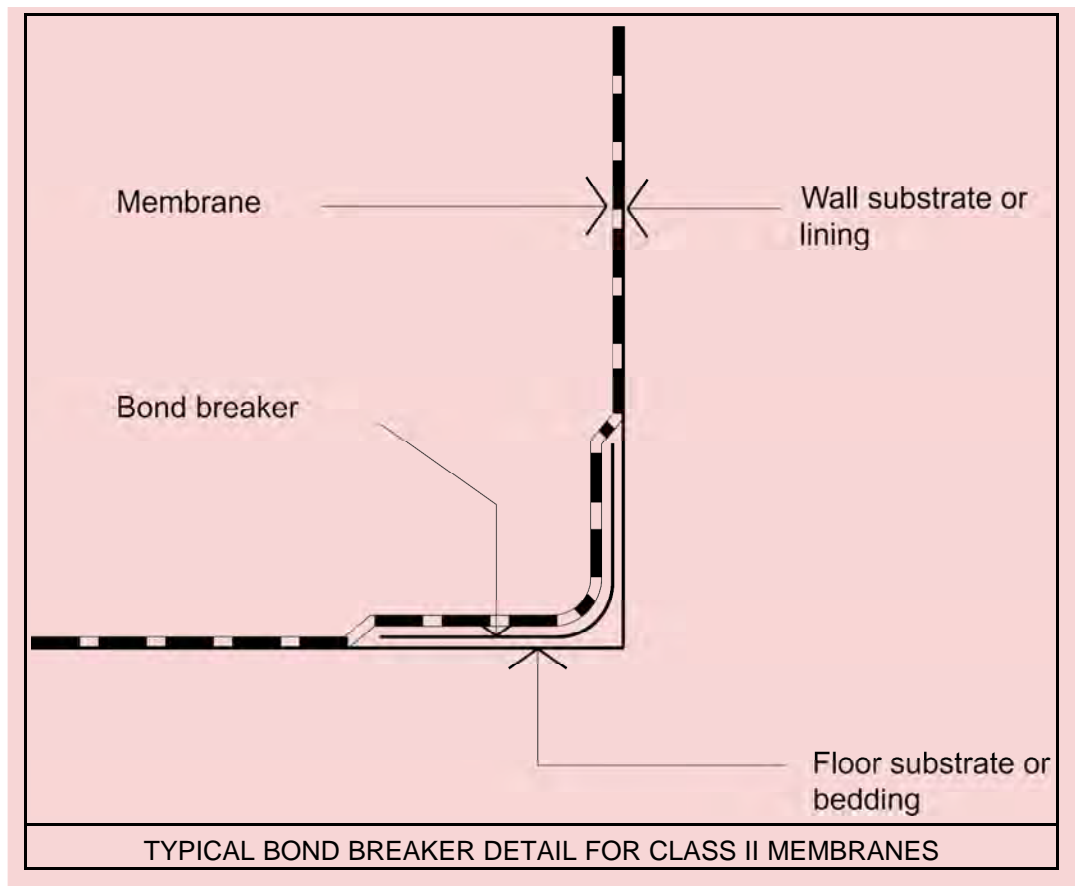
**3.8.1.16 Bond breaker installation for bonded membranes**

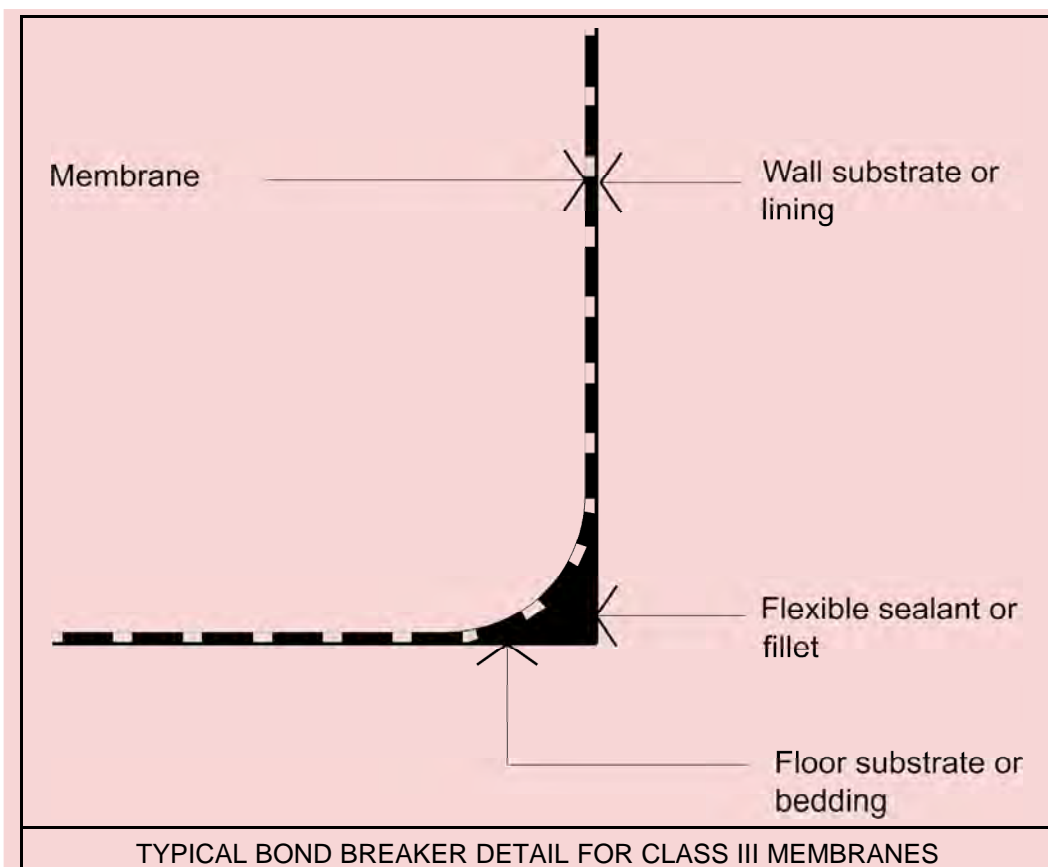
- (a) *Bond breakers* must be installed at all wall/floor, *hob*/wall junctions and at movement joints where the membrane is bonded to the substrate.
- (b) *Bond breakers* must be of the type compatible with the flexibility class of the *membrane* to be used.

**Explanatory information:**

Typical details for *bond breaker* types are given in the following Figures.







1. *Bond breakers* for Class I membranes (low extensibility) allow the *membrane* to flex rather than stretch.
2. *Bond breakers* for Class II membranes (medium extensibility) allow the *membrane* to stretch. If a tape is used as a bond breaker, either the *membrane* must not bond to the tape or the tape must have elastic properties similar to the *membrane*.
3. *Bond breakers* for Class III membranes (high extensibility) allow the *membrane* to have an even thickness.

### 3.8.1.17 Vertical membrane termination

The *membrane* must be applied over the floor substrate and up the vertical face of the wall as follows:

- (a) For showers with *hobs* or stepdowns—
  - (i) not less than a height of 150 mm above the finished tile level of the floor; or
  - (ii) 25 mm above the maximum retained water level,
 whichever is the greater.
- (b) For hobless showers, not less than a height of 150 mm above the finished tile level of the floor.
- (c) For vertical *flashing* in *shower areas*, as *required* by 3.8.1.8.

### 3.8.1.18 Hob construction

- (a) **Hobs** must be constructed of masonry, concrete or similar materials.
- (b) Autoclaved aerated concrete may be used for internal **membrane** systems for **hobs** provided—
  - (i) it is not used for external **membrane** systems; and
  - (ii) it must be primed.
- (c) All gaps, joints and intersections of the **hob** substrate must be made flush before application of the **membrane**.
- (d) **Hobs** must be adequately secured to the floor and sealed against the wall prior to applying an internal **membrane**.
- (e) Timber must not be used for **hob** construction.


### 3.8.1.19 Enclosed showers without hobs or setdowns

At the extremity of the **shower area**, a **waterstop** must be positioned so that its vertical leg finishes—

- (a) where a **shower screen** is to be installed, not less than 5 mm above the finished floor level (see **Figure 3.8.1.11**); and
- (b) where the **waterstop** intersects with a wall or is joined, the junction must be waterproof.

**Figure 3.8.1.11**
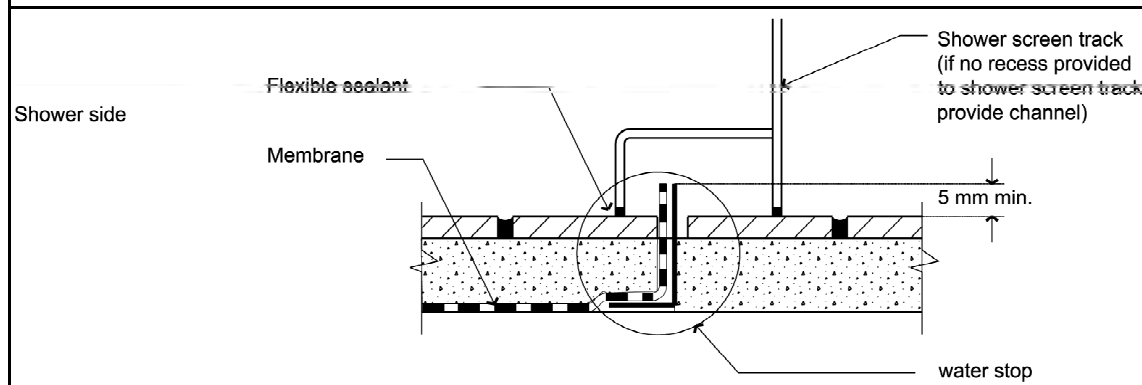
#### TYPICAL HOBLESS CONSTRUCTION




### 3.8.1.20 Unenclosed showers

- (a) Unenclosed showers must be constructed as follows—
  - (i) At the extremity of the shower, a **waterstop** must be installed so that its vertical leg will finish—
    - (A) flush with the floor level (see **Figure 3.8.1.12**); and
    - (B) where the **waterstop** intersects with a wall or is joined, the junction must be waterproof; or
  - (ii) the whole **wet area** floor must be waterproofed and drained to a **floor waste** as for the shower area.

- (b) In the case of (a)(ii), at doorways, where the height of the tiling angle needs to be adjusted for tiling purposes, the angle must be fixed with a sealant compatible with the waterproofing *membrane* without damaging the *waterproofing system*.

Figure 3.8.1.12
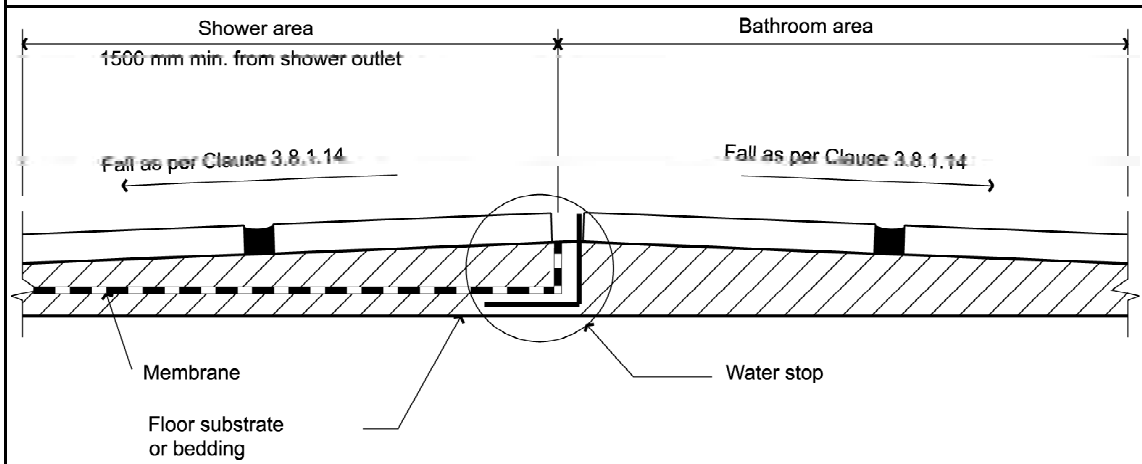
## TYPICAL TERMINATION OF MEMBRANE AT EXTENT OF SHOWER AREA



## 3.8.1.21 Membrane to drainage connection

- (a) *Membrane* drainage connections in concrete floors must comply with one of the following:
- (i) The *drainage riser* must be trimmed to the floor level of the concrete substrate or screed with all internal burrs removed and the waterproofing *membrane* terminated not less than 20 mm into the riser.
  - (ii) A *drainage flange* must be installed with the waterproofing *membrane* terminated at or in the *drainage flange* to provide a waterproof connection (see Figure 3.8.1.13).

**Explanatory information:**

Drainage flanges may be either cast into the concrete slab or fixed to the top surface of the concrete slab or the tile bed.

- (iii) Where a prefabricated *shower tray* is used, provision must be made to drain the tile bed and provide a waterproof connection to the drain.
- (b) *Membrane* drainage connections in other floors must comply with one of the following:
- (i) The *drainage riser* must be fixed to the floor substrate and the waterproofing *membrane* terminated not less than 20 mm into the riser.
  - (ii) A *drainage flange* must be installed with the waterproofing *membrane* terminated at or in the *drainage flange* to provide a waterproof connection (see Figure 3.8.1.13).


**Explanatory information:**

*Drainage flanges* may be either set into the floor or fixed to the top surface of the floor substrate or the tile bed.

- (iii) Where a prefabricated *shower tray* is used, provision must be made to drain the tile bed and provide a waterproof connection to the drain.

Figure 3.8.1.13
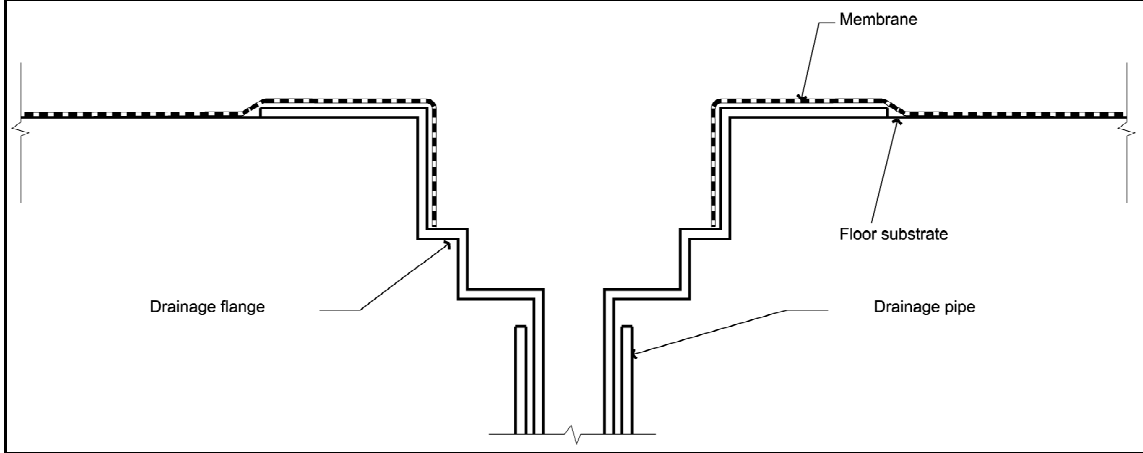
## TYPICAL MEMBRANE TERMINATION AT DRAINAGE OUTLET



(c) *Floor wastes* must—

- (i) be of sufficient height to suit the thickness of the tile and tile bed at the outlet position.
- (ii) include provision to drain the tile bed unless the *floor waste* is incorporated as part of the *drainage flange* in which case the *drainage flange/floor waste* must drain the tile bed where the waterproof *membrane* is below the tile bed.


## 3.8.1.22 Installation of internal membranes

(a) Where a shower has a hob—

- (i) the *membrane* must be brought over the top of the *hob*, down the outside face and terminate not less than 50 mm onto the floor (see [Figure 3.8.1.14](#)); and


Figure 3.8.1.14
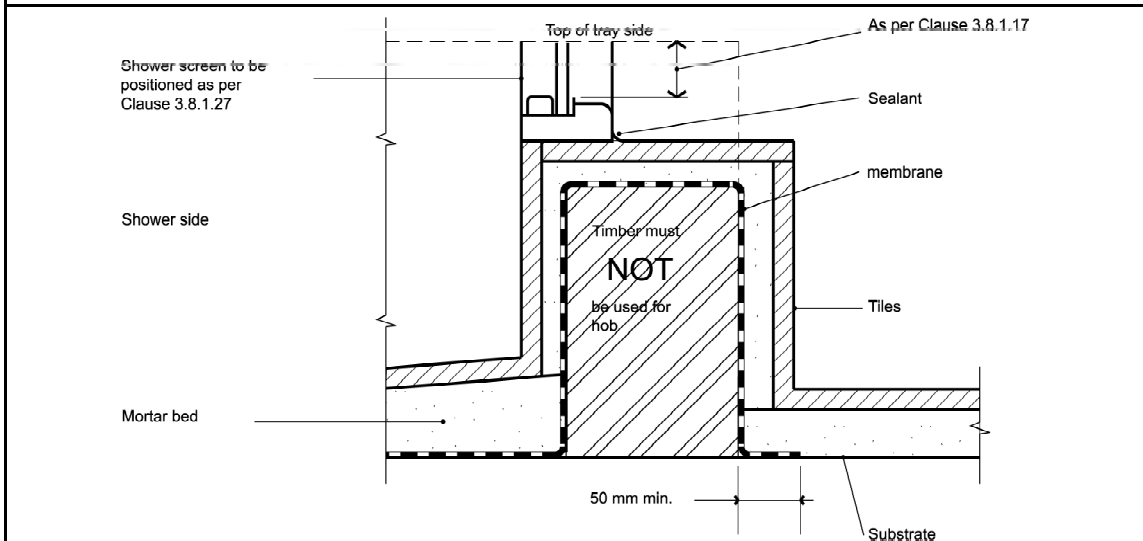
## TYPICAL HOB CONSTRUCTION – INTERNAL MEMBRANE





- (ii) the *membrane* must comply with **Figure 3.8.1.15** for an internal shower tray.

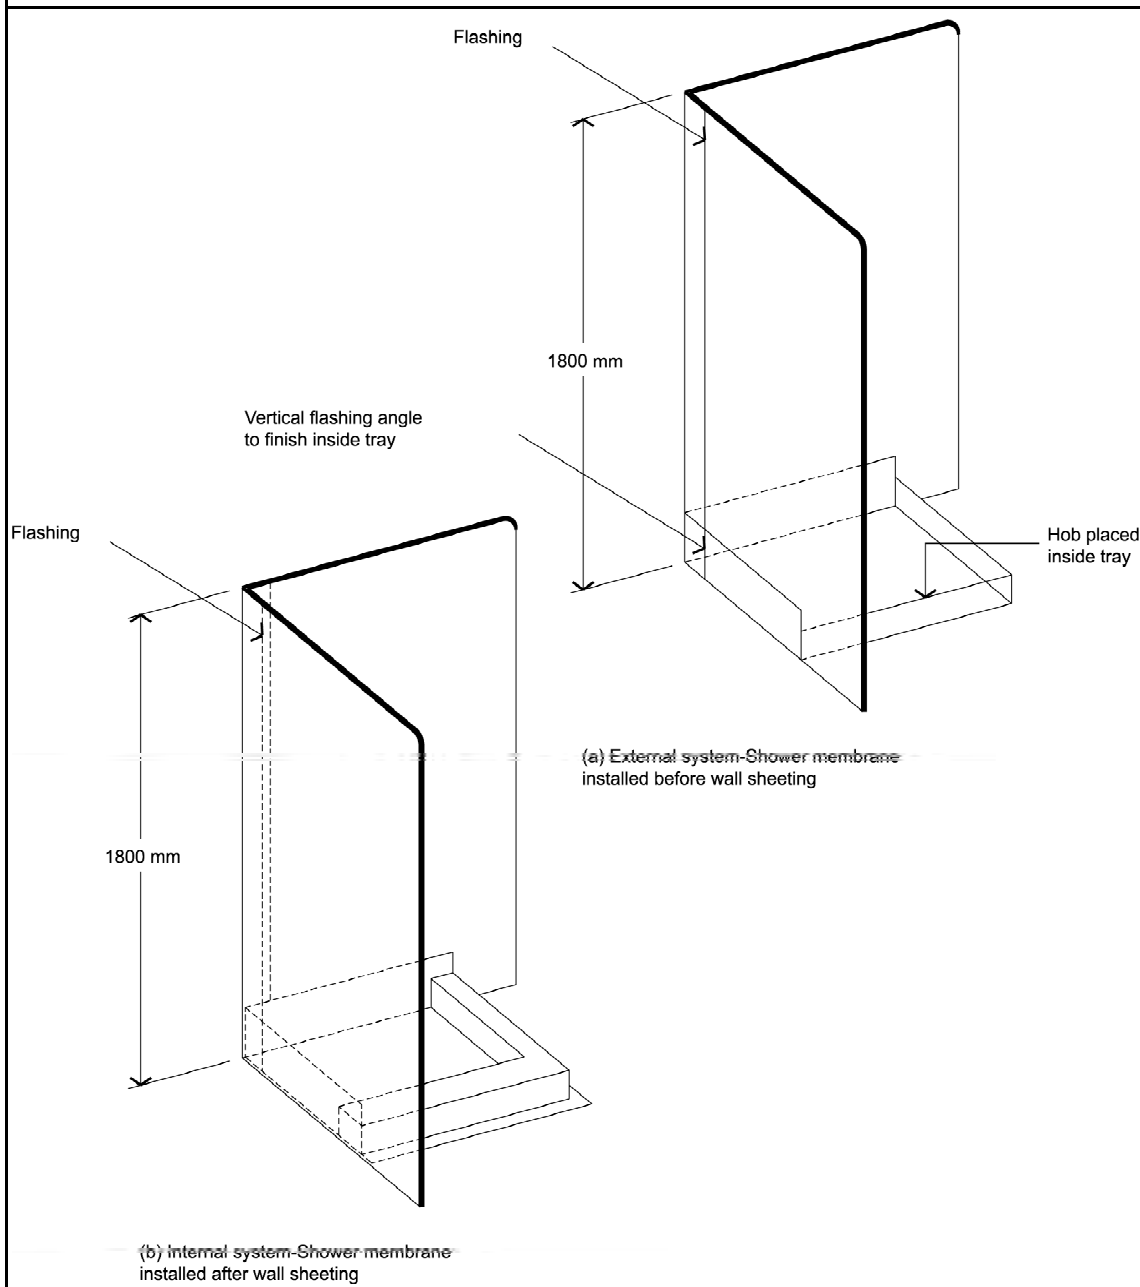**Figure 3.8.1.15****TYPICAL SHOWER CONSTRUCTION**


- (b) Where the shower has a *waterstop*, the *membrane* must be brought to the top of the finished floor, except where it is under a *shower screen* where it must terminate not less than 5 mm above the finished tile surface (see **Figures 3.8.1.11** and **3.8.1.12**).

### 3.8.1.23 Installation of an external membrane

- (a) Where the **membrane** is fabricated from a flexible material—
  - (i) the top edges must be fixed to the wall; and
  - (ii) fixing penetrations must be not less than 100 mm above the finished tile level of the shower area; and
  - (iii) all fixings must be compatible with the **membrane** and be non-corrosive.
- (b) For showers with **hobs**, the **hob** must be included within the finished size of the shower **membrane** and the **membrane** must finish at the underside of the tile that forms the top of the **hob** (see **Figure 3.8.1.16**).

**Figure 3.8.1.16**
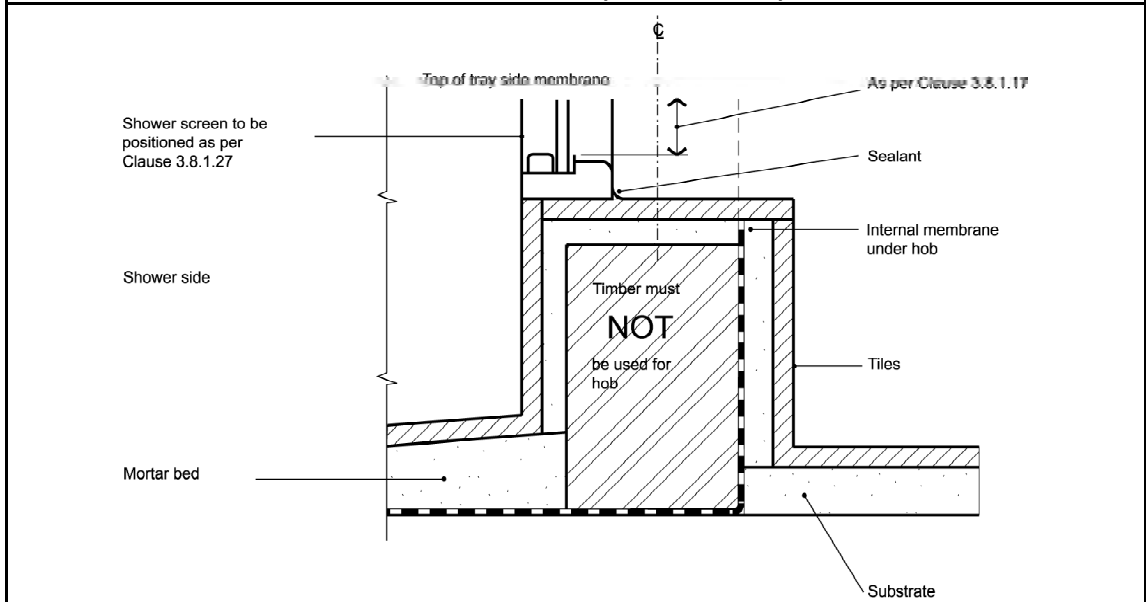
## TYPICAL HOB CONSTRUCTION – EXTERNAL (PREFORMED) MEMBRANE



### 3.8.1.24 Base termination of vertical flashing

Vertical **flashing** in internal corners must overlap the **membrane** or extend into the tray by not less than 25 mm.

### 3.8.1.25 Drainage riser connection

- (a) Where a preformed *shower tray* is used, the *drainage riser* must be connected to the tray with a waterproof joint.
- (b) Where an in situ *shower tray* is used, the *membrane* must—
  - (i) extend not less than 20 mm into the *drainage riser* or drainage flange; and
  - (ii) be able to form a permanent waterproof seal to the *drainage riser* or *drainage flange* (see **Figure 3.8.1.13**).

### 3.8.1.26 Door jambs and architraves on tiled floors

Where the bottom of door jambs do not finish above the floor tiling, the portion of the door frame and architrave below the floor tiling must be waterproofed to provide a continuous seal between the perimeter *flashing* and the *waterstop*.

**Explanatory information:**

Where possible the door jamb and architrave should be installed above the floor tiling.

### 3.8.1.27 Shower screens

- (a) For an enclosed shower, the *shower screen* must be designed and installed to prevent water escaping from the shower enclosure.
- (b) For a shower with a *hob*, the *shower screen* must be installed flush with the *shower area* side of the *hob* or overhang into the shower area.
- (c) For a shower with a stepdown, the *shower screen* must be installed flush with the finished vertical surface of the stepdown of the shower area.
- (d) For a shower without a *hob* or stepdown, the *shower screen* must incorporate or be mounted on an inverted channel, positioned over the top of the *waterstop* that defines the shower area.
- (e) For bath end walls and dividing walls abutting a shower, the *shower screen* must be positioned so that the bottom edge within the *shower area* is either flush with the outside edge of the bath or overhanging into the *shower area*.

**Explanatory information:**

A self-draining sub-sill is considered to be part of the *shower screen*.

## PART 3.8.2 ROOM HEIGHTS

### Appropriate *Performance Requirements*:

Where an alternative ceiling height is proposed as an *Alternative Solution* to that described in **Part 3.8.2**, that proposal must comply with—

- (a) *Performance Requirement P2.4.2*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### Acceptable construction practice

#### 3.8.2.1 Application

Compliance with this acceptable construction practice satisfies *Performance Requirement P2.4.2* for room heights.


#### 3.8.2.2 Ceiling heights

Ceiling heights (see **Figure 3.8.2.1**) must be not less than—

- (a) in a *habitable room* excluding a kitchen — 2.4 m; and
- (b) in a kitchen — 2.1 m; and
- (c) in a corridor, passageway or the like — 2.1 m; and
- (d) in a bathroom, shower room, laundry, *sanitary compartment*, airlock, pantry, storeroom, garage, car parking area or the like — 2.1 m; and
- (e) in a room or space with a sloping ceiling or projections below the ceiling line within—
  - (i) a *habitable room*—
    - (A) in an attic — a height of not less than 2.2 m for at least two-thirds of the floor area of the room or space; and
    - (B) in other rooms — a height of not less than 2.4 m over two-thirds of the floor area of the room or space; and
  - (ii) a non-*habitable room* — a height of not less than 2.1 m for at least two-thirds of the floor area of the room or space,and when calculating the floor area of a room or space, any part that has a ceiling height of less than 1.5 m is not included; and
- (f) in a stairway — 2.0 m measured vertically above the nosing line.

**Figure 3.8.2.1**

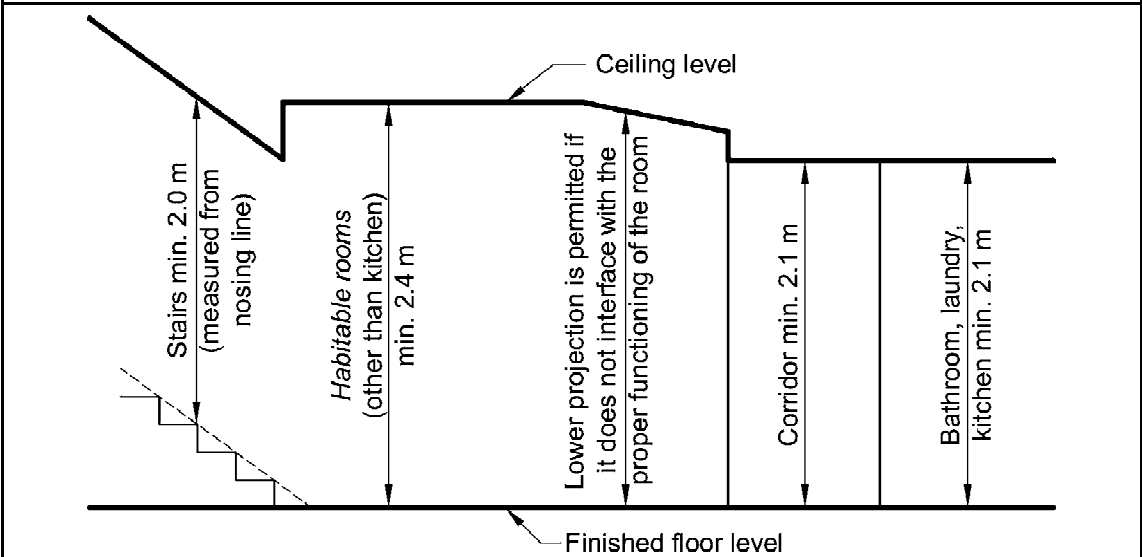**MEASUREMENT OF ACCEPTABLE CEILING HEIGHTS**



## PART 3.8.3 FACILITIES

### Appropriate *Performance Requirements*:

Where an alternative arrangement for facilities is proposed as an *Alternative Solution* to that described in **Part 3.8.3**, that proposal must comply with—

- (a) *Performance Requirement P2.4.3*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### Acceptable construction practice

#### 3.8.3.1 Application

Compliance with this acceptable construction practice satisfies *Performance Requirement P2.4.3* for facilities.

#### 3.8.3.2 Required facilities

- (a) A Class 1 building must be provided with—
  - (i) a kitchen sink and facilities for the preparation and cooking of food; and
  - (ii) a bath or shower; and
  - (iii) clothes washing facilities, comprising at least one washtub and space in the same room for a washing machine; and
  - (iv) a closet pan and washbasin.
- (b) If any of the facilities in (a) are detached from the main building, they must be set aside for the exclusive use of the occupants of the building.

### Explanatory information:

A kitchen sink or washbasin must not be counted as a laundry washtub.


#### 3.8.3.3 Construction of sanitary compartments

The door to a fully enclosed *sanitary compartment* must—

- (a) open outwards; or
  - (b) slide; or
  - (c) be readily removable from the outside of the compartment,
- unless there is a clear space of at least 1.2 m, measured in accordance with **Figure 3.8.3.3**, between the closet pan within the *sanitary compartment* and the doorway.

Figure 3.8.3.3
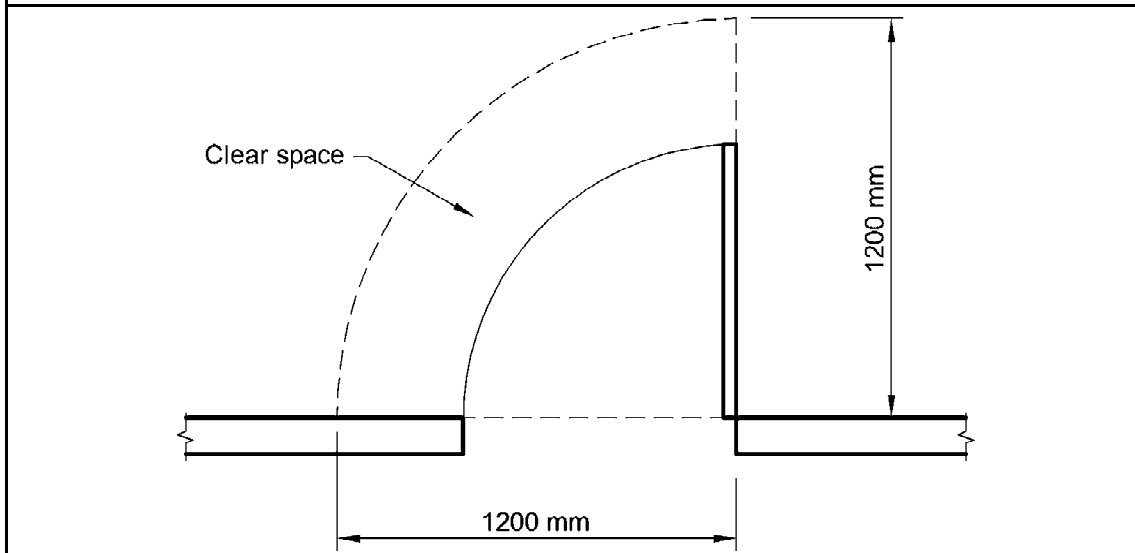
## CONSTRUCTION OF SANITARY COMPARTMENTS

**Explanatory information:**

3.8.3.3 requires means of removing an unconscious occupant from a fully enclosed *sanitary compartment*. If the enclosure has gaps that are large enough to allow access for a person into the *sanitary compartment*, the compartment is not considered enclosed for the purpose of this clause.

## STATE AND TERRITORY VARIATIONS

**Part 3.8.3.4 is added as follows in Tasmania.**

**Installation of closet fixtures**

- (a) If a sufficient sewerage system is not available, an authorised alternative means of disposal of sewage, may be installed.
- (b) If sanitary facilities are not water-flushed, the following provisions apply.
  - (i) A pit latrine, an incinerating toilet, a chemical toilet, a removable pan or a non-flushing urinal must not be within 2 m of a building containing *habitable rooms*.
  - (ii) The floor on which a removable pan is placed must be impervious.
  - (iii) A room containing a composting toilet must be separated from *habitable rooms* by way of a permanently ventilated air lock (which may be a circulation space).
  - (iv) The minimum ventilation *required* under (iii) shall be the greater of—
    - (A) 8000 mm<sup>2</sup> ; or
    - (B) 1/500th of the *floor area* of the circulation space.
  - (v) Access for maintenance or removal of waste from a composting toilet must be by way of an access door which opens directly to the outside of the building.

## PART 3.8.4 LIGHT

### Appropriate *Performance Requirements* :

Where an alternative lighting system is proposed as an *Alternative Solution* to that described in **Part 3.8.4**, that proposal must comply with—

- (a) *Performance Requirement P2.4.4*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### Acceptable construction practice

#### 3.8.4.1 Application

Compliance with this acceptable construction practice for a Class 1 building satisfies *Performance Requirement P2.4.4* for lighting.

#### 3.8.4.2 Natural lighting

Natural lighting must be provided in a Class 1 building to all *habitable rooms*, in accordance with the following:

- (a) Natural lighting must be provided by *windows* that—
  - (i) have an aggregate light transmitting area measured exclusive of framing members, glazing bars or other obstructions of not less than 10% of the *floor area* of the room; and
  - (ii) are open to the sky or face a court or other space open to the sky or an open verandah, carport or the like.
- (b) A *window required* to provide natural light that faces a boundary of an adjoining allotment must not be less than a horizontal distance of 900 mm from that boundary.
- (c) Natural lighting to a room in a Class 1 building may come through a glazed panel or opening from an adjoining room (including an enclosed verandah) if—
  - (i) the glazed panel or opening has an area of not less than 10% of the *floor area* of the room to which it provides light; and
  - (ii) the adjoining room has *windows* with an aggregate light transmitting area of not less than 10% of the combined *floor areas* of both rooms; and
  - (iii) the areas specified in (i) and (ii) may be reduced as appropriate if direct natural light is provided from another source.

(see **Figure 3.8.4.1**)

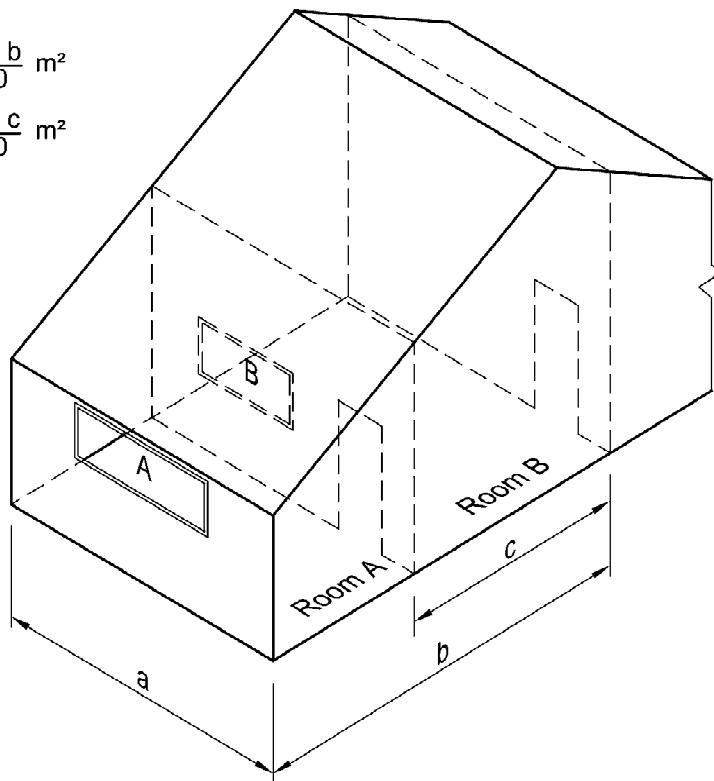


Figure 3.8.4.1

## METHOD OF DETERMINING AREAS OF OPENINGS FOR BORROWED LIGHT

$$A = \frac{a \times b}{10} \text{ m}^2$$

$$B = \frac{a \times c}{10} \text{ m}^2$$



## 3.8.4.3 Artificial lighting

*Sanitary compartments*, bathrooms, shower rooms, airlocks and laundries must be provided with artificial light if natural lighting in accordance with the relevant provisions of 3.8.4.2 is not available—

- (a) at a rate of not less than one light fitting per 16 m<sup>2</sup> of *floor area*; or
- (b) in accordance with AS/NZS 1680.0.

## PART 3.8.5 VENTILATION

### Appropriate *Performance Requirements*:

Where an alternative ventilation system is proposed as an *Alternative Solution* to that described in **Part 3.8.5**, that proposal must comply with—

- (a) *Performance Requirement P2.4.5*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### Explanatory information:

The requirements of this Part are to be read in conjunction with the air movement requirements in **Part 3.12.4**. However, it should be noted that **Part 3.12.4** does not apply in all States and Territories.

### A. Acceptable construction manual

#### 3.8.5.0

- (a) Except for an exhaust fan from a *sanitary compartment*, laundry or bathroom, *Performance Requirement P2.4.5* is satisfied for a mechanical ventilation system if it is installed in accordance with AS 1668.2 — Mechanical ventilation for acceptable indoor-air quality.
- (b) An exhaust fan from a *sanitary compartment*, laundry or bathroom must comply with the acceptable construction practice.

### Acceptable construction practice

#### 3.8.5.1 Application

Compliance with this acceptable construction practice satisfies *Performance Requirement P2.4.5* for ventilation.

#### 3.8.5.2 Ventilation requirements

Ventilation must be provided to a *habitable room*, *sanitary compartment*, bathroom, shower room, laundry and any other room occupied by a person for any purpose by any of the following means:


- (a) Permanent openings, *windows*, doors or other devices which can be opened—
  - (i) with an aggregate opening or openable size not less than 5% of the *floor area* of the room *required* to be ventilated; and

- (ii) open to—
  - (A) a suitably sized court, or space open to the sky; or
  - (B) an open verandah, carport, or the like; or
  - (C) an adjoining room in accordance with (b).
- (b) Natural ventilation to a room may come through a [window](#), opening, ventilating door or other device from an adjoining room (including an enclosed verandah) if—
  - (i) the room to be ventilated or the adjoining room is not a [sanitary compartment](#); and
  - (ii) the [window](#), opening, door or other device has a ventilating area of not less than 5% of the [floor area](#) of the room to be ventilated; and
  - (iii) the adjoining room has a [window](#), opening, door or other device with a ventilating area of not less than 5% of the combined [floor areas](#) of both rooms; and
  - (iv) the ventilating areas specified may be reduced as appropriate if direct natural ventilation is provided from another source.

(See [Figure 3.8.5.1](#))

**Figure 3.8.5.1**

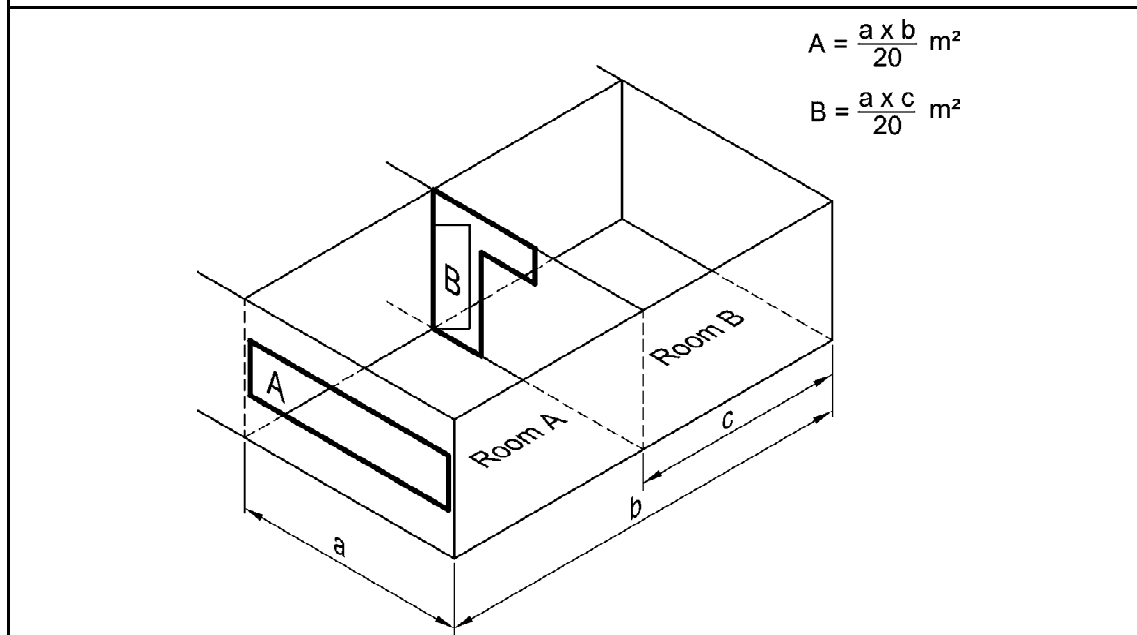**METHOD OF DETERMINING AREAS OF OPENINGS FOR BORROWED VENTILATION**



- (c) An exhaust fan or other means of mechanical ventilation may be used to ventilate a [sanitary compartment](#), laundry or bathroom provided contaminated air exhausts—
  - (i) directly to outside the building by way of ducts; or
  - (ii) into a roof space that—
    - (A) is adequately ventilated by open eaves, and/or roof vents; or
    - (B) is covered by roof tiles without sarking or similar materials which would prevent venting through gaps between the tiles.


### 3.8.5.3 Location of sanitary compartments

*Sanitary compartments* must not open directly into a kitchen or pantry unless—

- (a) access is by an airlock, hallway or other room, (see [Figure 3.8.5.2](#)); or
- (b) the room containing the closet pan is provided with mechanical exhaust ventilation.

**Figure 3.8.5.2**

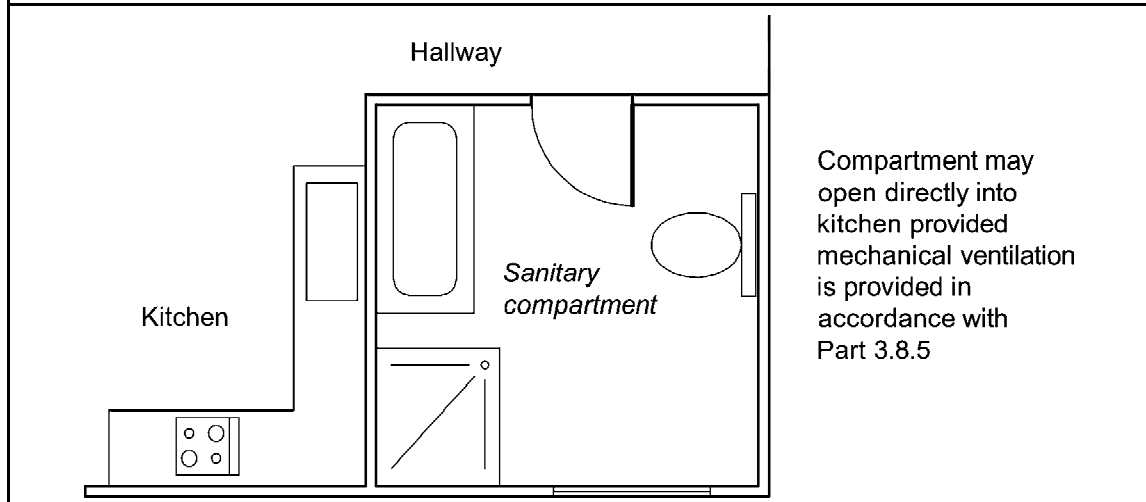**ACCEPTABLE LOCATION OF NON MECHANICALLY VENTILATED SANITARY COMPARTMENT**



## PART 3.8.6 SOUND INSULATION

### Appropriate *Performance Requirements*:

Where an alternative sound insulation system is proposed as an *Alternative Solution* to that described in **Part 3.8.6**, that proposal must comply with—

- (a) *Performance Requirement P2.4.6*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### Acceptable construction practice

#### 3.8.6.1 Application

Compliance with this acceptable construction practice satisfies *Performance Requirement P2.4.6* for sound insulation.

#### 3.8.6.2 Sound insulation requirements

- (a) To provide insulation from airborne and impact sound, a *separating wall* between two or more Class 1 buildings must—
  - (i) achieve the weighted sound reduction index with spectrum adaptation term ( $R_w + C_{tr}$ ) and discontinuous construction requirements, as *required* by **Table 3.8.6.1**; and
  - (ii) be installed in accordance with the appropriate requirements of **3.8.6.3** and **3.8.6.4**.
- (b) For the purpose of this Part, the  $R_w + C_{tr}$  must be determined in accordance with AS/NZS 1276.1 or ISO 717.1, using results from laboratory measurements.

**Table 3.8.6.1 REQUIRED  $R_w$  AIRBORNE AND IMPACT SOUND LEVELS FOR SEPARATING WALLS**


SEPARATING WALL — LOCATION AND PENETRATIONS	DISCONTINUOUS CONSTRUCTION REQUIRED	$R_w + C_{tr}$ (As per <b>Table 3.8.6.2</b> )
Between a bathroom, <i>sanitary compartment</i> , laundry or kitchen and a <i>habitable room</i> (other than a kitchen) in an adjoining Class 1 building (dwelling) (see <b>Figure 3.8.6.1</b> ).	YES	50
In all other cases to those listed above. (See <b>Figure 3.8.6.1</b> )	NO	50

Table 3.8.6.1 REQUIRED  $R_w$  AIRBORNE AND IMPACT SOUND LEVELS FOR SEPARATING WALLS— continued

SEPARATING WALL — LOCATION AND PENETRATIONS	DISCONTINUOUS CONSTRUCTION REQUIRED	$R_w + C_{tr}$ (As per Table 3.8.6.2)
<b>DUCT, SOIL, WASTE, AND WATER SUPPLY PIPES AND STORM WATER PIPES</b>  A duct, soil, waste, or water supply pipe or storm water pipe that passes through a separating wall between Class 1 buildings— <ul style="list-style-type: none"> <li>(a) if the adjacent room is a habitable room (other than a kitchen); or</li> </ul>	<b>NO</b>	<b>40</b>
<ul style="list-style-type: none"> <li>(b) if the room is a kitchen or any other room.</li> </ul>	<b>NO</b>	<b>25</b>
<b>Note:</b>  Discontinuous construction means a wall system having a minimum 20 mm <i>cavity</i> between two separate leaves, with— <ul style="list-style-type: none"> <li>(a) for masonry, where wall ties are <i>required</i> to connect leaves, the ties are of the resilient type; and</li> <li>(b) for other than masonry, there is no mechanical linkage between leaves except at the periphery.</li> </ul> A staggered stud wall is not deemed to be discontinuous construction.		

Figure 3.8.6.1

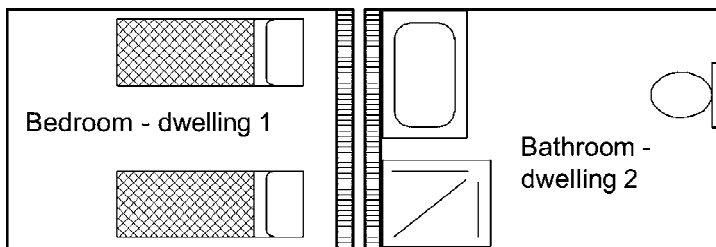
## REQUIRED AIRBORNE AND IMPACT SOUND INSULATION — PLAN VIEW



**Rw + Ctr 50**  
and  
discontinuous construction

**(a) Adjoining bedroom/bathroom**

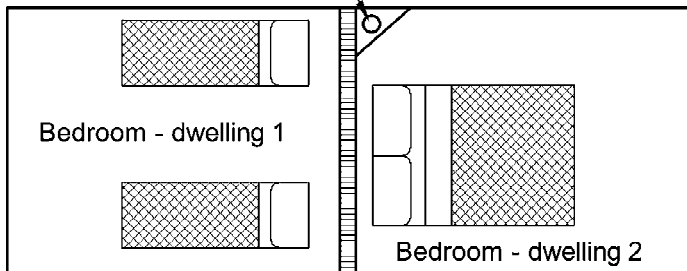Waste pipe - must be separated from the adjoining dwelling if it passes through a separating wall, by a wall with a Rw + Ctr 40, this may be reduced to a Rw + Ctr 25 if the adjoining room is kitchen




**Rw + Ctr 50**

**(b) Adjoining bedrooms****3.8.6.3 General installation requirements for walls**

- (a) To achieve the appropriate level of sound insulation, walls must—
- (i) be constructed in accordance with the appropriate requirements contained in **(b)** to **(f)**; and
  - (ii) at the junction of sound insulated walls with any perimeter walls and roof cladding, be sealed in accordance with **Figure 3.8.6.2**.

Figure 3.8.6.2


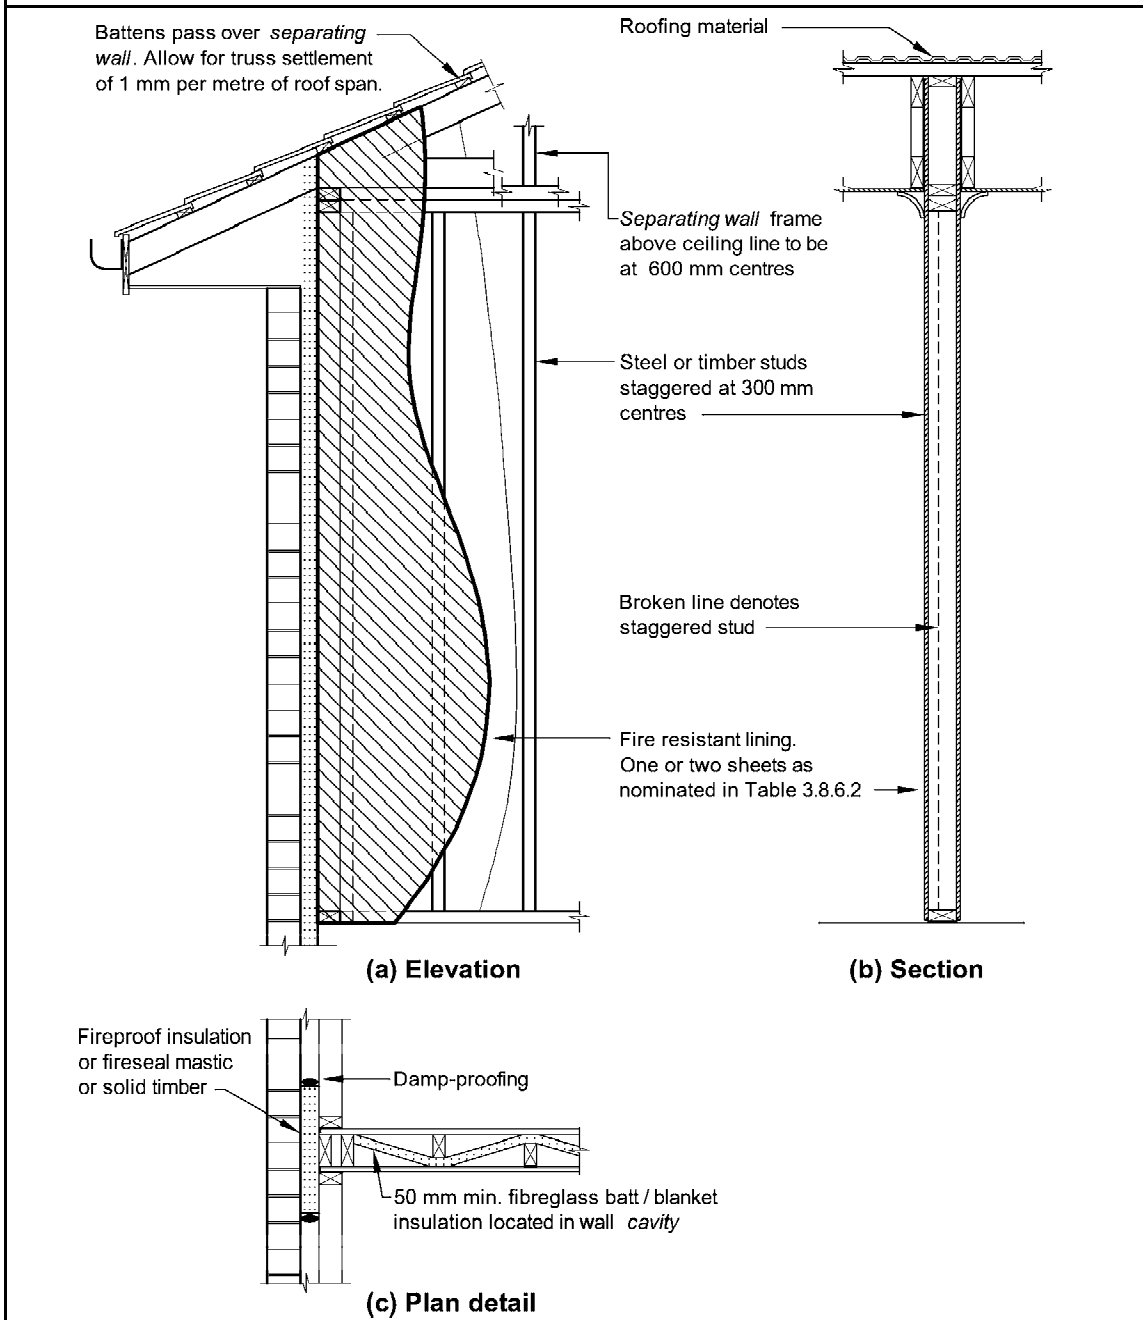
### SOUND INSULATION BETWEEN BUILDINGS - STAGGERED STUD WALL CONFIGURATION



- (b) Masonry units must be laid with all joints filled solid, except for adequately sound insulated articulation joints, including those between the masonry and any adjoining construction.



- (c) Concrete panels must have joints between panels and any adjoining construction filled solid.
- (d) Plasterboard must be installed as follows:
  - (i) If one layer is *required* on both sides of a wall the joints must be staggered on opposite sides (See **Figure 3.8.6.3**).
  - (ii) If two layers are *required*, the first layer must be fastened in accordance with (i) and the second layer joints must not coincide with those of the first layer (See **Figure 3.8.6.3**).
  - (iii) The following joints must be taped and filled solid:
    - (A) Outer layer joints between sheets.
    - (B) Joints between sheets and any adjoining construction.

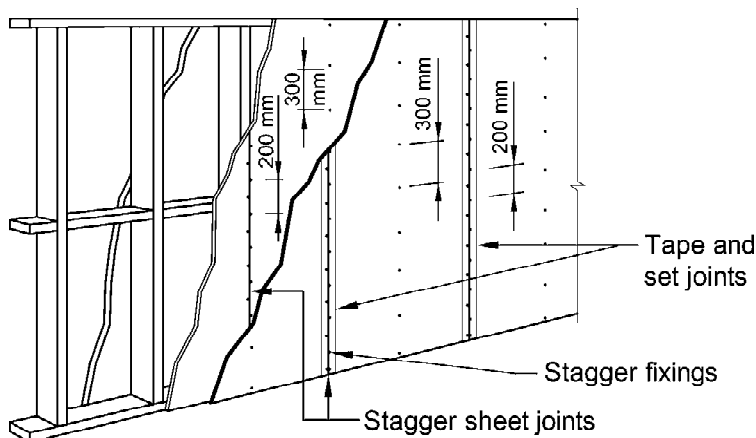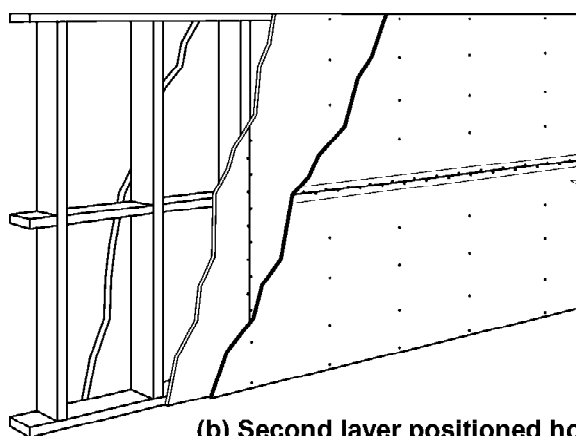**Figure 3.8.6.3****TYPICAL INSTALLATION OF PLASTER SHEETS FOR SOUND INSULATION****(a) Second layer positioned vertically****(b) Second layer positioned horizontally**

- (e) Steel framing and perimeter members must be installed as follows:
  - (i) The section of steel must be not less than 0.6 mm thick.

- (ii) Studs must be not less than 63 mm in depth unless another depth is specified in [Table 3.8.6.2](#).
- (iii) Studs must be fixed to steel top and bottom plates of sufficient depth to permit secure fixing of the plasterboard.
- (iv) All steel members at the perimeter of the wall must be securely fixed to the adjoining structure and bedded in resilient compound or the joints must be caulked so that there are no voids between the steel members and the wall.
- (f) Timber studs and perimeter members must be installed as follows:
  - (i) Studs must be fixed to top and bottom plates of sufficient depth to permit secure fixing of the plasterboard.
  - (ii) Noggings and like members must not bridge between studs supporting different wall leaves.
  - (iii) All timber members at the perimeter of the wall must be securely fixed to the adjoining structure and bedded in resilient compound or the joints must be caulked so there are no voids between the timber members and the wall.

#### 3.8.6.4 Services

- (a) Services must not be chased into concrete or masonry [separating walls](#).
- (b) If a duct, soil, waste, water supply or storm water pipe serves or passes through a [separating wall](#) or is located in a [separating wall](#)—
  - (i) a door or panel providing access to a duct or pipe [required](#) to be separated must—
    - (A) not open into any [habitable room](#), other than a kitchen; and
    - (B) in any other part must be firmly fixed so as to overlap the frame or rebate of the frame by not less than 10 mm and be constructed of—
      - (aa) wood, plasterboard or blockboard not less than 33 mm thick; or
      - (bb) compressed fibre reinforced cement sheeting not less than 9 mm thick; or
      - (cc) other suitable material with a mass per unit area not less than 24.4 kg/m<sup>2</sup>; and
  - (ii) in the case of a water supply pipe, it must—
    - (A) only be installed in discontinuous construction; and
    - (B) in the case of a water supply pipe that serves one dwelling, not be fixed to the wall leaf on the side of any other dwelling and have a clearance not less than 10 mm to the other wall leaf.
- (c) Electrical outlets must be offset from each other—
  - (i) in masonry walling, not less than 100 mm; and
  - (ii) in timber or steel framed walling, not less than 300 mm.

**Table 3.8.6.2 ACCEPTABLE FORMS OF CONSTRUCTION**

Description	$R_w + C_{tr}$ (not less than)	Construction
-------------	-----------------------------------	--------------

Table 3.8.6.2 ACCEPTABLE FORMS OF CONSTRUCTION — continued

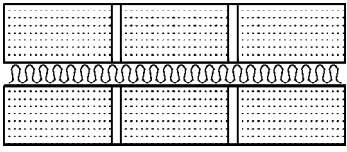
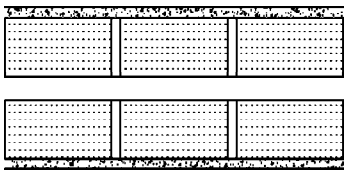
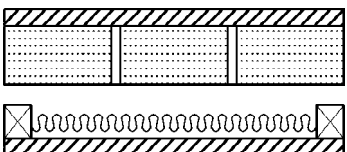
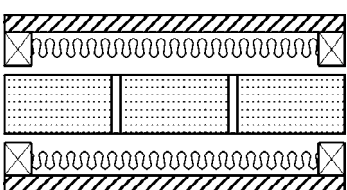

<b>Wall construction type: Masonry</b>		
<p>Two leaves of 110 mm clay brick masonry with:</p> <p>(a) <b>cavity</b> not less than 50 mm between leaves; and</p> <p>(b) 50 mm thick glass wool insulation with a density of 11 kg/m<sup>3</sup> or 50 mm thick polyester insulation with a density of 20 kg/m<sup>3</sup> in the <b>cavity</b>.</p>	50	
<p>Two leaves of 110 mm clay brick masonry with:</p> <p>(a) <b>cavity</b> not less than 50 mm between leaves; and</p> <p>(b) 13 mm cement render on each outside face.</p>	50	
<p>Single leaf of 110 mm clay brick masonry with:</p> <p>(a) a row of 70 mm x 35 mm timber studs or 64 mm steel studs at 600 mm centres, spaced 20 mm from the masonry wall; and</p> <p>(b) 50 mm thick mineral insulation or glass wool insulation with a density of 11 kg/m<sup>3</sup> positioned between studs; and</p> <p>(c) one layer of 13 mm plasterboard fixed to outside face of studs and outside face of masonry.</p>	50	
<p>Single leaf of 90 mm clay brick masonry with:</p> <p>(a) a row of 70 mm x 35 mm timber studs or 64 mm steel studs at 600 mm centres, spaced 20 mm from each face of the masonry wall; and</p> <p>(b) 50 mm thick mineral insulation or glass wool insulation with a density of 11 kg/m<sup>3</sup> positioned between studs in each row; and</p> <p>(c) one layer of 13 mm plasterboard fixed to studs on each outside face.</p>	50	
<p>Single leaf of 220 mm brick masonry with 13 mm cement render on each face.</p>	50	

Table 3.8.6.2 ACCEPTABLE FORMS OF CONSTRUCTION — continued



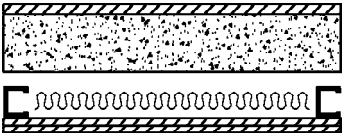
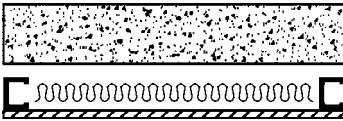
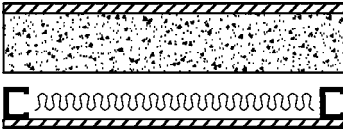
<b>Wall construction type: Concrete</b>		
150 mm thick plain off form concrete.	50	
200 mm thick concrete panel with one layer of 13 mm plasterboard or 13 mm cement render on each face.	50	
100 mm thick concrete panel with: (a) a row of 64 mm steel studs at 600 mm centres, spaced 25 mm from the concrete panel; and (b) 80 mm thick polyester insulation or 50 mm thick glass wool insulation with a density of 11 kg/m <sup>3</sup> , positioned between studs; and (c) two layers of 13 mm plasterboard fixed to outside face of studs and one layer of 13 mm plasterboard fixed to outside face of concrete panel.	50	
125 mm thick concrete panel with: (a) a row of 64 mm steel studs at 600 mm centres, spaced 20 mm from the concrete panel; and (b) 70 mm polyester insulation with a density of 9 kg/m <sup>3</sup> , positioned between studs; and (c) one layer of 13 mm plasterboard fixed to the outside face of the studs.	50	
<b>Wall construction type: Autoclaved aerated concrete</b>		
75 mm thick autoclaved aerated concrete wall panel with: (a) a row of 64 mm steel studs at 600 mm centres, spaced 20 mm from the autoclaved aerated concrete wall panel; and (b) 75 mm thick glass wool insulation with a density of 11 kg/m <sup>3</sup> positioned between studs; and (c) one layer of 10 mm moisture resistant plasterboard or 13 mm fire protective grade plasterboard fixed to outside face of studs and outside face of autoclaved aerated concrete wall panel.	50	

Table 3.8.6.2 ACCEPTABLE FORMS OF CONSTRUCTION — continued

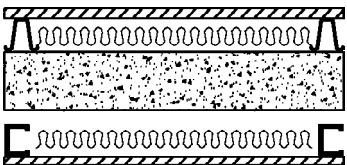
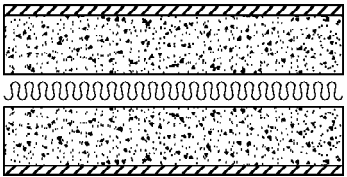
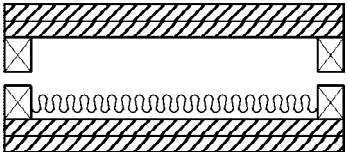

<p>75 mm thick autoclaved aerated concrete wall panel with:</p> <ul style="list-style-type: none"> <li>(a) a row of 64 mm steel studs at 600 mm centres, spaced 35 mm from the autoclaved aerated concrete panel wall; and</li> <li>(b) 28 mm metal furring channels fixed to the outside face of the autoclaved aerated concrete wall panel, with 50 mm thick polyester insulation with a density of 9 kg/m<sup>3</sup> positioned between furring channels and one layer of 13 mm fire protective grade plasterboard fixed to furring channels; and</li> <li>(c) 105 mm thick glass wool insulation with a density of 7 kg/m<sup>3</sup> positioned between studs; and</li> <li>(d) one layer of 13 mm fire protective grade plasterboard fixed to the outside face of the studs.</li> </ul>	50	
<p>Two leaves of 75 mm autoclaved aerated concrete wall panel with:</p> <ul style="list-style-type: none"> <li>(a) a <i>cavity</i> not less than 30 mm between panels containing 50 mm glass wool insulation with a density of 11 kg/m<sup>3</sup>; and</li> <li>(b) one layer of 10 mm plasterboard fixed to outside face of each panel.</li> </ul>	50	
<b>Wall construction type: Timber and steel framing</b>		
<p>Two rows of 90 x 35 mm timber studs or two rows of 64 mm steels studs at 600 mm centres with:</p> <ul style="list-style-type: none"> <li>(a) an air gap not less than 20 mm between the rows of studs; and</li> <li>(b) 50 mm thick glass wool insulation or 60 mm thick polyester insulation with a density of 11 kg/m<sup>3</sup>; positioned between one row of studs, and</li> <li>(c) two layers of 13 mm fire protective grade plasterboard or one layer of 6 mm fibre cement sheet and one layer of 13 mm fire protective grade plasterboard, fixed to outside face of studs.</li> </ul>	50	

Table 3.8.6.2 ACCEPTABLE FORMS OF CONSTRUCTION — continued

Two rows of 64 mm steel studs at 600 mm centres with:		
(a) an air gap not less than 80 mm between the rows of studs; and		
(b) 200 mm thick polyester insulation with a density of 14 kg/m <sup>3</sup> ; positioned between studs; and		
(c) one layer of 13 mm fire-protective grade plasterboard and one layer 13 mm plasterboard on one outside face and one layer of 13 mm fire-protective grade plasterboard on the other outside face	50	

**Explanatory information:**

The wall configurations shown in [Table 3.8.6.2](#) are typical examples. Other proprietary methods are available for meeting the  $R_w + C_{tr}$  requirements of [3.8.6.2](#).

**STATE AND TERRITORY VARIATIONS**

In Northern Territory Part 3.8.6 acceptable construction practice is replaced with the following.

**Acceptable construction practice****3.8.6.1 Application**

Compliance with this Part satisfies [Performance Requirement P2.4.6](#) for sound insulation.

**3.8.6.2 Sound insulation requirements**

- (a) A [separating wall](#) between two or more Class 1 buildings must—
  - (i) achieve the weighted sound reduction index ( $R_w$ ) and impact sound resistance [required](#) by [Table 3.8.6.1](#); and
  - (ii) be installed in accordance with the appropriate requirements of [3.8.6.3](#) and [3.8.6.4](#); and
- (b) for the purpose of this Part, the  $R_w$  may be determined in accordance with AS/NZS 1276.1 or ISO 717.1.


**Table 3.8.6.1 REQUIRED  $R_w$  AND SOUND IMPACT LEVELS FOR SEPARATING WALLS**

SEPARATING WALL—LOCATION AND PENETRATIONS		IMPACT SOUND RESISTANCE (As per <a href="#">Table 3.8.6.2</a> )	$R_w$ (As per <a href="#">Table 3.8.6.3</a> )
<b>TYPE A</b>	Between a bathroom, <a href="#">sanitary compartment</a> , laundry or kitchen and a <a href="#">habitable room</a> (other than a kitchen) in an adjoining Class 1 building (dwelling) (see <a href="#">Figure 3.8.6.1</a> ).	YES	50

Table 3.8.6.1 REQUIRED  $R_w$  AND SOUND IMPACT LEVELS FOR SEPARATING WALLS—continued

SEPARATING WALL—LOCATION AND PENETRATIONS	IMPACT SOUND RESISTANCE (As per Table 3.8.6.2)	$R_w$ (As per Table 3.8.6.3)
<b>TYPE B</b> In all other cases to those listed as Type A. (See Figure 3.8.6.1)	NO	45
<b>SOIL AND WASTE PIPES</b> A waste pipe or other penetration that serves or passes through a <i>separating wall</i> between houses— (a) If the adjacent room is a <i>habitable room</i> (other than a kitchen); or	NO	45
(b) If the room is a kitchen or any other room.	NO	30

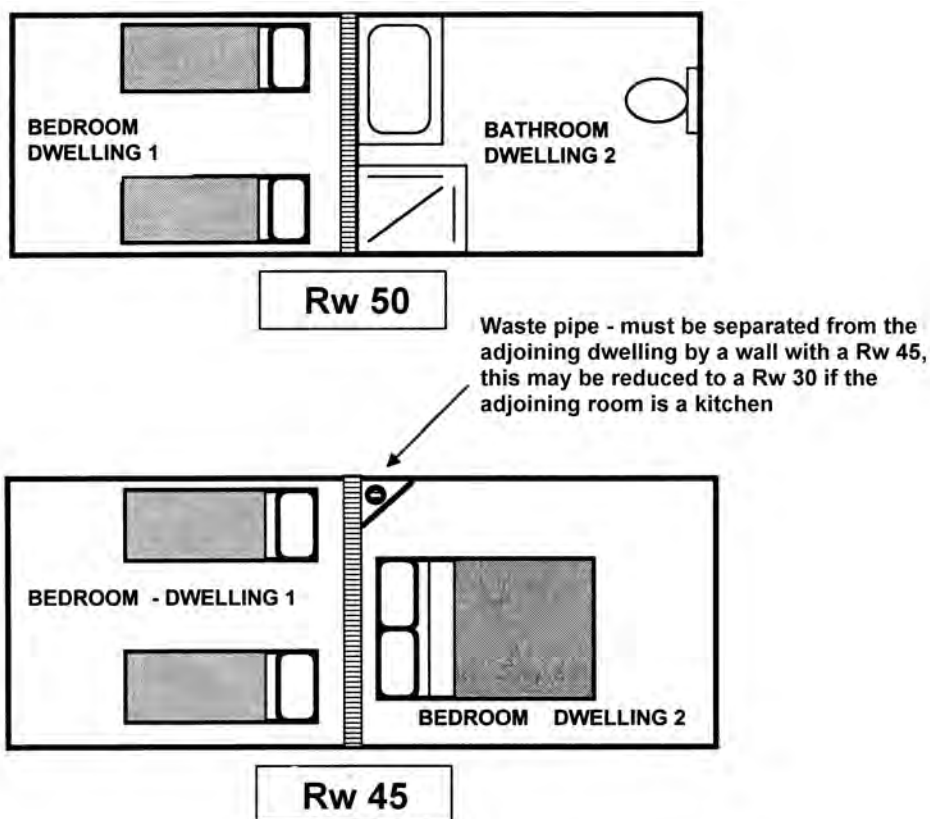Figure 3.8.6.1

REQUIRED  $R_w$  — PLAN VIEW

## 3.8.6.3 General installation requirements for walls


- (a) To achieve the appropriate  $R_w$  and impact sound resistance, walls must—
- (i) be installed in accordance with the appropriate requirements contained in (b) to (f); and

- (ii) at the junction of sound insulated walls with perimeter walls and roof cladding, be sealed in accordance with any relevant detail in [Figure 3.8.6.3](#).
- (b) Masonry units must—
  - (i) be laid with all joints filled solid, including those between the masonry and any adjoining construction; and
  - (ii) not be chased for services.
- (c) Joints between concrete slabs, wall units and any adjoining construction must be filled solid.
- (d) Plasterboard must be installed as follows:
  - i If one layer is [required](#) under this Part, joints must be staggered with the joints in sheets on the opposite face of the wall.
  - ii If 2 layers are [required](#), the first layer must be fixed according to [\(i\)](#) and the second layer must be fixed to the first layer with nails, screws or adhesive so that the joints do not coincide with those of the first layer.
  - iii Joints between sheets or between sheets and any adjoining construction must be taped and filled solid.
  - iv Fire-protective grade plasterboard (when nominated) must be the grade manufactured for use in [fire-resisting](#) construction.



**Figure 3.8.6.2**

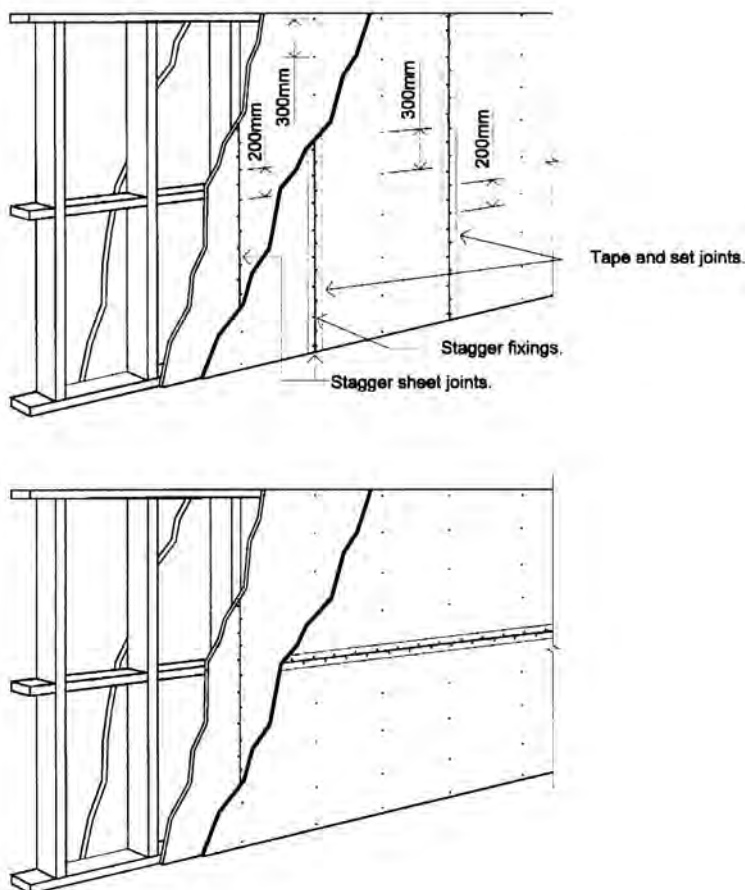**TYPICAL INSTALLATION OF PLASTER SHEETS FOR SOUND INSULATION**



- (e) Steel studs and perimeter members must be installed as follows:
- (i) The section of steel must be not less than 0.6 mm thick.
  - (ii) Studs must be not less than 63 mm in depth unless another depth is specified in the Table.
  - (iii) Studs must be fixed to steel top and bottom plates of sufficient depth to permit secure fixing of the plasterboard.
  - (iv) All steel members at the perimeter of the wall must be securely fixed to the adjoining structure and bedded in resilient compound or the joints must be caulked so that there are no voids between the steel members and the wall.

- (f) Timber studs and perimeter members must be installed as follows:
- (i) Studs must be fixed to top and bottom plates of sufficient depth to permit secure fixing of the plasterboard.
  - (ii) Noggings and like members must not bridge between studs supporting different wall leaves.
  - (iii) All timber members at the perimeter of the wall must be securely fixed to the adjoining structure and bedded in resilient compound or the joints must be caulked so there are no voids between the timber members and the wall.

#### 3.8.6.4 Soil and waste pipes

If a soil or waste pipe passes through a *separating wall*—

- (a) a door or panel providing access to the pipe must not open into any *habitable room*, other than a kitchen; and
- (b) an access door or panel in any other part must be firmly fixed so as to overlap the frame or rebate of the frame by not less than 10 mm, be fitted with a sealing gasket along all edges and constructed of—
  - (i) wood, plasterboard or blockboard not less than 38 mm thick; or
  - (ii) compressed fibre reinforced cement sheeting not less than 9 mm thick; or
  - (iii) other suitable material with a mass per unit area not less than 24.4 kg/m<sup>2</sup>.

#### Explanatory information:

The wall configurations shown in [Tables 3.8.6.2](#) and [3.8.6.3](#) are typical examples. Other proprietary methods are available for meeting the  $R_w$  and sound impact levels *required* by [Table 3.8.6.1](#).

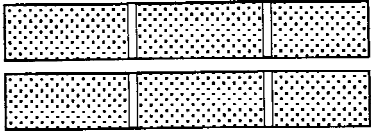
Table 3.8.6.2	
CONSTRUCTION OF WALLS TO: (A) REDUCE IMPACT SOUND; AND (B) ACHIEVE A 50 $R_w$	
WALL CONSTRUCTION TYPE	DESIGN DIAGRAM — PLAN VIEW
<b>CAVITY BRICKWORK</b> 2 leaves 90 mm brick masonry with— <ul style="list-style-type: none"> <li>(a) all joints filled solid with mortar; and</li> <li>(b) an air space not less than 40 mm between the leaves; and</li> <li>(c) the leaves connected only by ties in accordance with AS 3700 and wall tie spacing details as set out in <a href="#">Part 3.3</a>.</li> </ul>	

Table 3.8.6.2

CONSTRUCTION OF WALLS TO:


(A) REDUCE IMPACT SOUND; AND

(B) ACHIEVE A 50 Rw

**WALL CONSTRUCTION TYPE****DESIGN DIAGRAM — PLAN VIEW****SINGLE LEAF BRICKWORK**

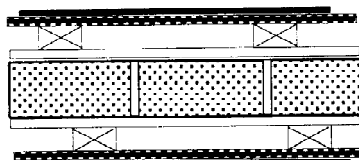
80 mm thick brick masonry with—

- (a) each face rendered 13 mm thick; and
- (b) 50x12 mm thick timber battens at not more than 610 mm centres fixed to each face but not recessed into the render; and
- (c) one layer of 12 mm thick softboard nailed to the battens; and
- (d) 6 mm thick medium density hardboard adhesive-fixed to the softboard.

**CONCRETE BLOCKWORK**

190 mm thick concrete block masonry with—

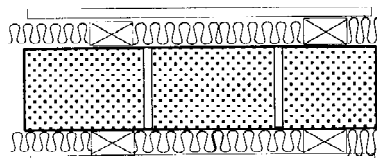- (a) each face of the blocks fitted with 50x50 mm timber battens, spaced at not more than 610 mm centres, screw-fixed into resilient plugs with rubber inserts; and
- (b) the space between the battens completely filled with mineral or glass wool blanket or batts not less than 50 mm thick; and
- (c) the outer face of the battens finished with plasterboard not less than 10 mm thick.

**TIMBER FRAMED WALLING**

70 x 45 mm F5 staggered timber studs at 600 mm centres both sides on 120x35 mm F5 timber plates with—

- (a) one layer of 16 mm fire protective grade plasterboard on both faces; and
- (b) 50 mm glass fibre batts.

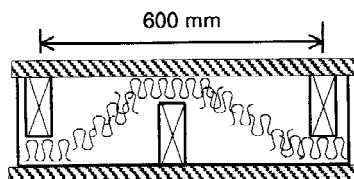


Table 3.8.6.2

**CONSTRUCTION OF WALLS TO:** (A) REDUCE IMPACT SOUND; AND  
(B) ACHIEVE A 50  $R_w$


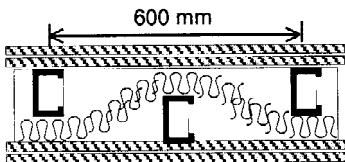
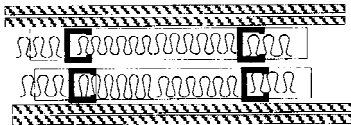
WALL CONSTRUCTION TYPE	DESIGN DIAGRAM — PLAN VIEW
<b>TIMBER FRAMED WALLING</b> 70 x 45 mm F5 timber double studs at 450 – 600 mm centres with an air space not less than 20 mm between studs with two layers of 13 mm fire protective grade plasterboard on both faces.	
<b>STEEL STUD WALLING</b> 64 mm staggered metal studs (0.75 mm base metal thickness) at 600 mm centres both sides, clipped in 92 mm metal tracks with— (a) two layers of 13 mm fire protective grade plasterboard to each side; and (b) 50 mm glasswool <i>cavity</i> batts.	
<b>STEEL STUD WALLING</b> 64 mm double metal studs (0.75 mm base metal thickness) at 600 mm centres with an air space not less than 20 mm between studs, in separate frames with no mechanical links with— (a) two layers of 13 mm fire protective grade plasterboard to each side; and (b) 50 mm glasswool <i>cavity</i> batts.	

Table 3.8.6.3

**$R_w$  APPLICABLE TO CONSTRUCTION**










WALL CONSTRUCTION TYPE	$R_w$	DESIGN DIAGRAM — PLAN VIEW
<b>CLAY BRICKWORK</b>		
(a) 110 mm thick in one or more leaves and with a mass per unit area of not less than 290 kg/m <sup>2</sup> .	45	
(b) 80 mm thick, pressed brick and rendered 13 mm on one side, the mass per unit area of the unrendered wall being not less than 215 kg/m <sup>2</sup> .	45	

Table 3.8.6.3

Rw APPLICABLE TO CONSTRUCTION


WALL CONSTRUCTION TYPE	Rw	DESIGN DIAGRAM — PLAN VIEW
<b>CALCIUM SILICATE BRICKWORK</b>		
(a) 90 mm thick calcium silicate brick with one layer of 10 mm fire protective grade plasterboard on each side.	45	
(b) 90 mm thick calcium silicate brick with one layer of 10 mm fire protective plasterboard and one layer of fire protective plasterboard on metal furring channels.	45	
<b>CONCRETE BLOCKWORK</b>		
(a) 190 mm solid units (or thicker) Material density 2200 kg/m <sup>3</sup>	45	
(b) 110 mm solid units (or thicker) Material density 2200 kg/m <sup>3</sup> Material thickness — 83 mm min. 10 mm plasterboard or 12 mm render on each face.	45	
<b>CONCRETE WALL</b>		
In-situ concrete — 125 mm thick and with a density of not less than 2200 kg/m <sup>3</sup> .	45	
<b>STEEL STUD WALLING</b>		
(a) With 2 layers of 16 mm thick fire-protective grade plasterboard fixed to each face.	45	
(b) With 2 layers of 13 mm plasterboard on both sides of 75 mm studs	45	

**Table 3.8.6.3****R<sub>w</sub> APPLICABLE TO CONSTRUCTION**

<b>WALL CONSTRUCTION TYPE</b>	<b>R<sub>w</sub></b>	<b>DESIGN DIAGRAM — PLAN VIEW</b>
<b>TIMBER STUD WALLING</b>		
70 x 45 mm timber studs at 450 – 600 mm centres with (a) one layer of 16 mm fire protective grade plasterboard on one face; and (b) 50 mm glass fibre batts; and (c) one layer of 16 mm fire protective grade plasterboard on metal resilient channel.	<b>49</b>	
70 x 45 mm timber studs at 450 – 600 mm centres with two layers of 16 mm fire protective grade plasterboard on both sides.	<b>46</b>	
<b>DUCTS OR OTHER CONSTRUCTION SEPARATING SOIL AND WASTE PIPES FROM UNITS</b>		
<b>MASONRY</b>		
Not less than 90 mm thick.	<b>30</b>	
<b>PLASTERBOARD</b>		
(a) 2 layers of plasterboard each 10 mm thick, fixed to timber studs not less than 75x50 mm and spaced at not more than 400 mm centres.	<b>30</b>	
(b) 2 layers of plasterboard each 13 mm thick, one on each side of steel studs not less than 50 mm deep and spaced at not more than 400 mm centres.	<b>30</b>	

Figure 3.8.6.3
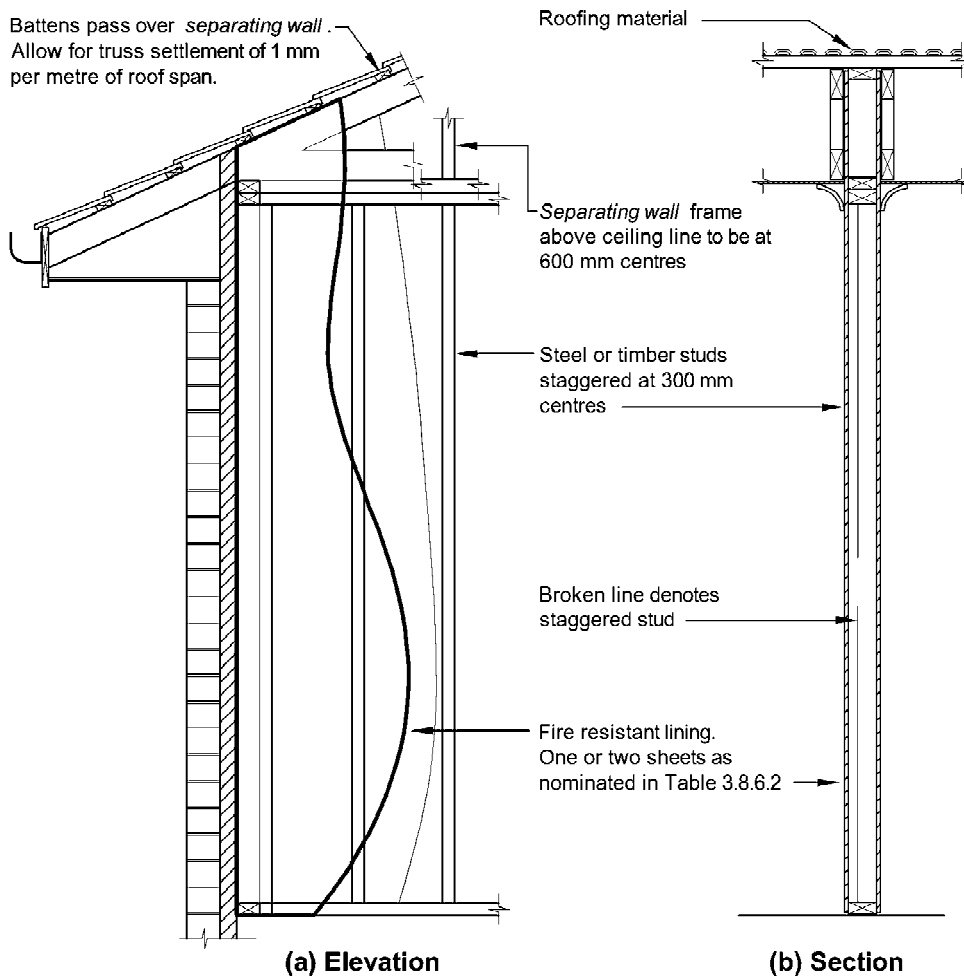
## SOUND INSULATION BETWEEN UNITS — DOUBLE STUD WALL CONFIGURATION



# PART 3.9

---

## SAFE MOVEMENT AND ACCESS

- 3.9.1 Stair Construction
- 3.9.2 Balustrades
- 3.9.3 Swimming Pool Access
- 3.9.4 Swimming Pool Water Recirculation Systems



## **PART 3.9 CONTENTS**

---

### **PART 3.9 SAFE MOVEMENT AND ACCESS**

#### **3.9.1 Stair construction**

- 3.9.1 Definitions
  - 3.9.1.1 Application
  - 3.9.1.2 General requirements
  - 3.9.1.3 Stair construction
  - 3.9.1.4 Riser and going dimensions
  - 3.9.1.5 Thresholds

#### **3.9.2 Balustrades**

- 3.9.2.1 Application
- 3.9.2.2 When balustrades or other barriers are required
- 3.9.2.3 Balustrades or other barrier construction

#### **3.9.3 Swimming pool access**

- 3.9.3.0 Acceptable construction manual
- 3.9.3.1 Application
- 3.9.3.2 Safety fencing location
- 3.9.3.3 Safety fencing construction
- 3.9.3.4 Gates and fittings

#### **3.9.4 Swimming pool water recirculation systems**

- 3.9.4.0 Acceptable construction manual

## PART 3.9.1 STAIR CONSTRUCTION

### Appropriate *Performance Requirements* :

Where an alternative stair system is proposed as an *Alternative Solution* to that described in **Part 3.9.1**, that proposal must comply with—

- (a) *Performance Requirement P2.5.1*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### Definitions

#### 3.9.1

The following definitions are used in this Part:


**Flight** means that part of a stair that has a continuous series of *risers*, including *risers* of *winders*, not interrupted by a *landing* or floor (see **Figure 3.9.1.1**).

#### Explanatory information:

A *flight* is the area of a stair that has a continuous slope created by the nosing line of treads. The length of a *flight* is limited to restrict the distance a person could fall down a stair. Quarter *landings*, as shown in **Figure 3.9.1.1**, are considered sufficient to halt a person's fall and therefore are considered for the purposes of this document not to be part of the *flight*.

**Figure 3.9.1.1**
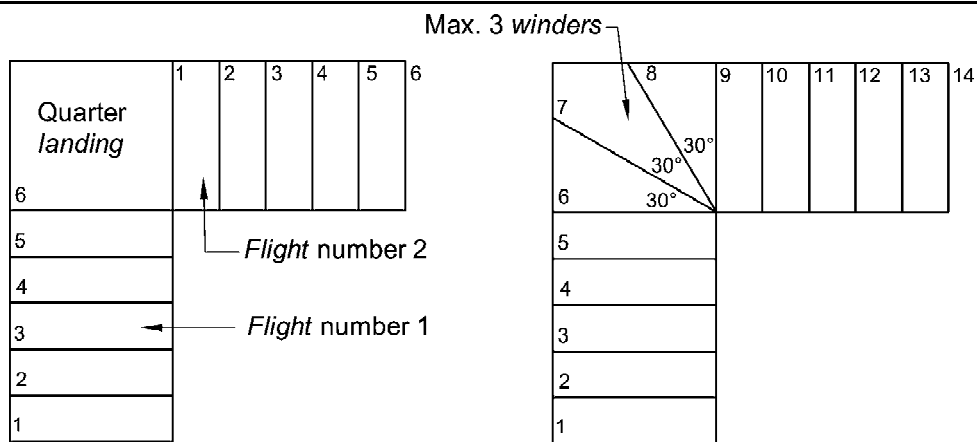
#### IDENTIFICATION OF STAIR FLIGHTS — Plan view



(a) Quarter landing stair - 2 flights

(b) Continuous stair - 1 flight

**Going** means the horizontal dimension from the front to the back of a tread less any overhang from the next tread above (see [Figure 3.9.1.2](#)).

**Landing** means an area at the top or bottom of a *flight* or between two *flights*.

**Riser** means the height between consecutive treads.

**Spiral stair** means a stair with a circular plan, winding around a central post with steps that radiate from a common centre or several radii (see [Figure 3.9.1.4](#)).

**Tapered tread** means a stair tread with a walking area that grows smaller towards one end.

**Winders** means treads within a straight *flight* that are used to change direction of the stair (see [Figure 3.9.1.1](#)).

### Acceptable construction practice

#### 3.9.1.1 Application

Compliance with this acceptable construction practice satisfies *Performance Requirement P2.5.1*, provided the stair complies with the appropriate structural requirements of the *Housing Provisions*.

#### 3.9.1.2 General requirements

- (a) Stairs serving *habitable rooms*, including external stairs must comply with [3.9.1.3](#) and [3.9.1.4](#).
- (b) Stairs serving only non-*habitable rooms*, such as attics, storerooms and the like that are not used on a regular or daily basis, must be constructed in accordance with—
  - (i) the provisions of this Part; or
  - (ii) AS 1657.

#### 3.9.1.3 Stair construction

Stairs must be constructed in accordance with the following:

- (a) Each *flight* must have not more than 18 nor less than 2 *risers*.
- (b) The nominal dimension of *goings* and *risers* of a stair must be constant throughout each stair *flight* except that the *going* of *winders* in lieu of a quarter or half *landing* may vary from the *going* of the straight treads within the same *flight* provided that the *going* of all such *winders* is constant.
- (c) Treads must be of solid construction (not mesh or other perforated material) if the stairway is more than 10 m high or connects more than 3 storeys.
- (d) A *flight* of stairs must not have more than 3 *winders* in lieu of each quarter *landing* or 6 *winders* in lieu of each half *landing*.
- (e) The *riser* opening must not allow a 125 mm sphere to pass through between the treads.
- (f) \* \* \* \* \*
- (g) Treads must have a slip-resistant finish or a suitable non-skid strip near the edge of the nosings.

- (h) **Landings** must—
- (i) be not less than 750 mm long and where this involves a change in direction, the length is measured 500 mm from the inside edge of the **landing** (see **Figure 3.9.1.5**, Diagram a); and
  - (ii) have a gradient not steeper than 1:50; and
  - (iii) be provided where the sill of a threshold of a doorway opens on to a stair that provides a change in floor level or floor to ground level greater than 3 **risers** or 570 mm (see **Figure 3.9.1.5**, Diagram b).

### 3.9.1.4 Riser and going dimensions

The **riser** and **going** dimensions for each **flight**, except for the **going** of **winders** in lieu of a quarter or half **landing**, must comply with the following:

- (a) The **going** (G), **riser** (R) and slope relationship quantity (2R+G) must be in accordance with **Figure 3.9.1.2**.
- (b) The point for measurement of the **going** (G) in the slope relationship quantity as described in **Figure 3.9.1.3** must be—
  - (i) for **tapered treads** (other than treads in a **spiral stair**)—
    - (A) not more than 1 m wide, the middle of the unobstructed width of the stair (see **Figure 3.9.1.3**, Diagram b); and
    - (B) more than 1 m in width, 400 mm from the unobstructed width of each side of the stair (see **Figure 3.9.1.3**, Diagram c); and
  - (ii) for treads in **spiral stairs**, the point seven tenths of the unobstructed distance from the face of the centre pole or support towards the handrail side (see **Figure 3.9.1.4**).

**Figure 3.9.1.2**

**STAIR RISER AND GOING DIMENSIONS (mm)**

STAIR TYPE	RISER (R)		GOING (G)		SLOPE RELATIONSHIP (2R+G)	
	(see Figure below)		(see Figure below)		(2R+G)	
	Max	Min	Max	Min	Max	Min
<b>Stairs (other than spiral)</b>	190	115	355	240	700	550
<b>Spiral</b>	220	140	370	210	680	590

125 mm sphere must not pass through treads

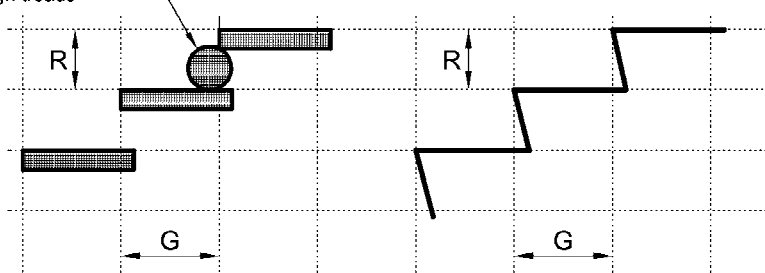


Figure 3.9.1.3

## MEASUREMENT OF SLOPE RELATIONSHIP — Plan view

Diagram a. Stair with 2 flights

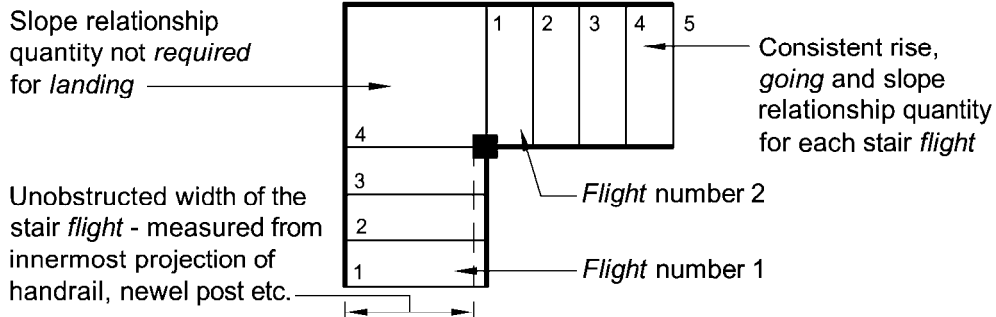


Diagram b. Tapered treads — not more than 1 m wide

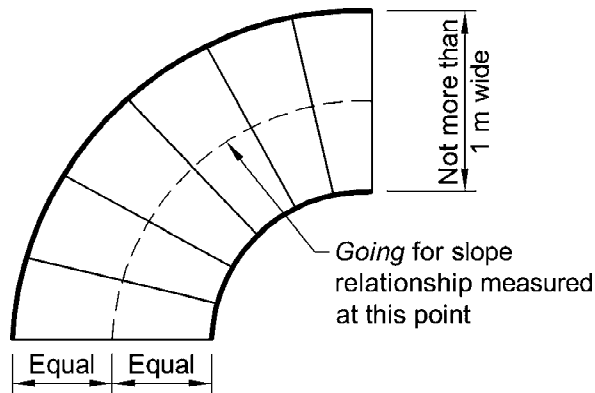


Diagram c. Tapered treads — more than 1 m in width


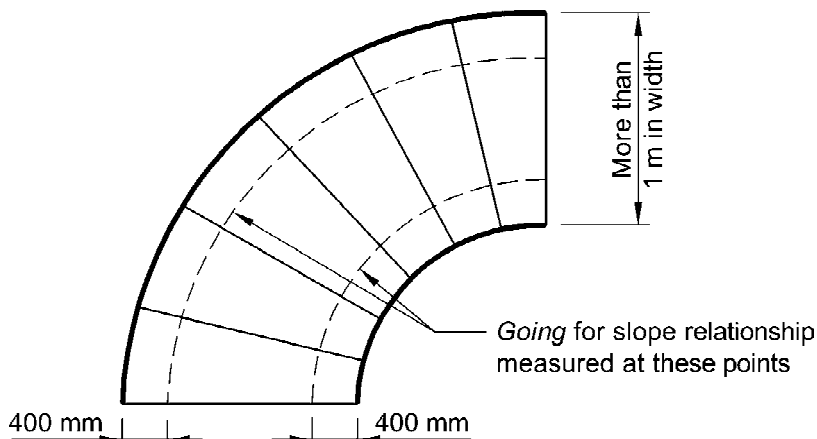


Figure 3.9.1.4

## SPIRAL STAIRS
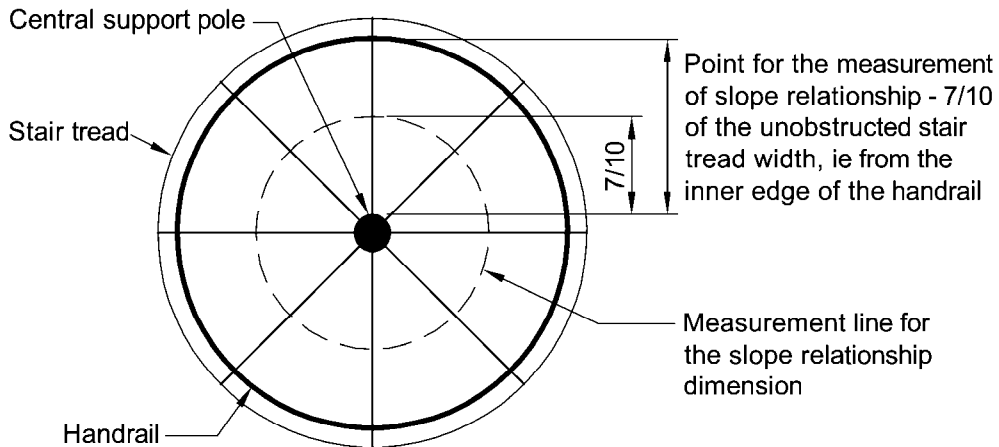
## Diagram a. Measurement for slope relationship



## Diagram b. Measurement for openings in stairs


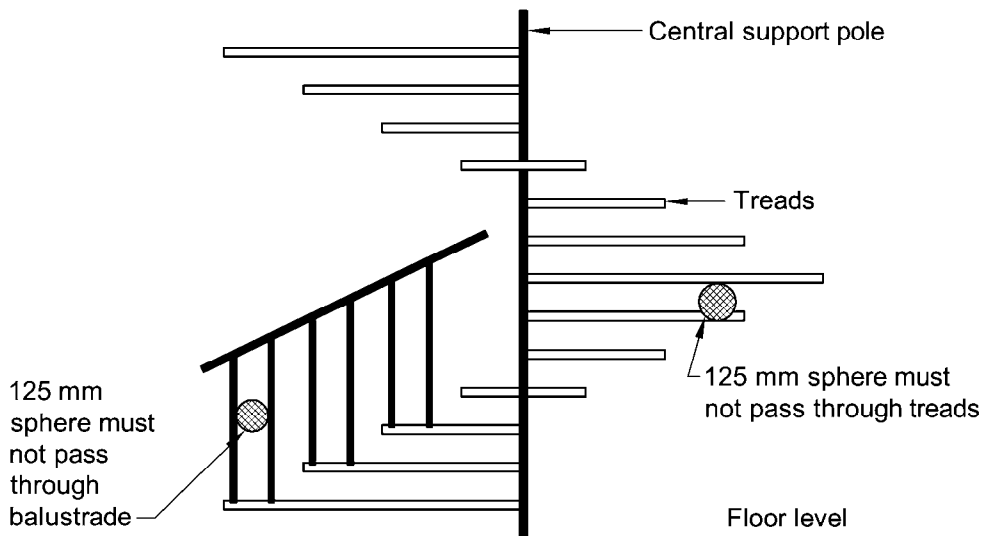



Figure 3.9.1.5

## LANDINGS
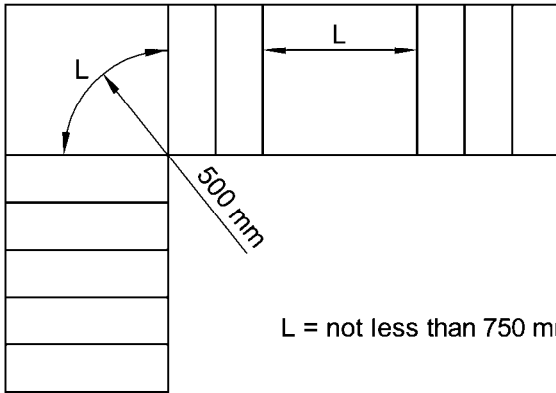
## Diagram a. Stairway landing



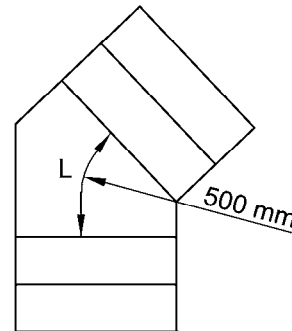
(i) Example A




(ii) Example B

L = not less than 750 mm

## Diagram b. Threshold landing

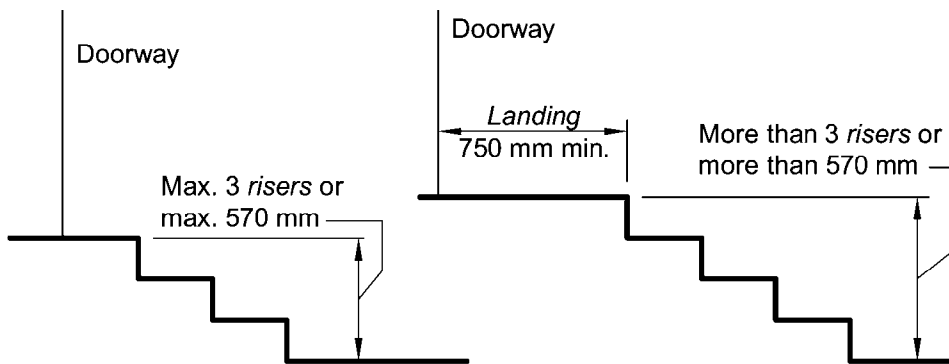

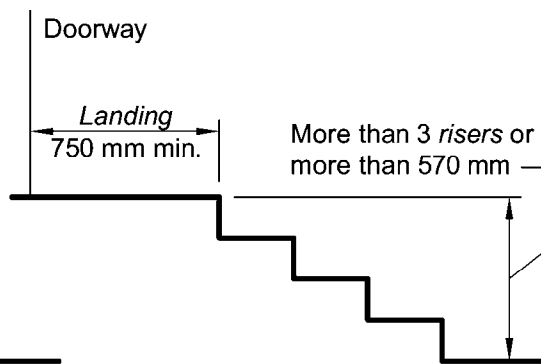(i) Landing not required



(ii) Landing required

## 3.9.1.5 Thresholds

Where a threshold is more than 190 mm above the adjoining surface it must incorporate steps having *riser* and *going* dimensions in accordance with [3.9.1.4](#)

## PART 3.9.2 BALUSTRADES

### Appropriate *Performance Requirements*:

Where an alternative balustrade or other barrier is proposed as an *Alternative Solution* to that described in **Part 3.9.2**, that proposal must comply with—

- (a) *Performance Requirement P2.1*; and
- (b) *Performance Requirement P2.5.2*; and
- (c) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### Acceptable construction practice

#### 3.9.2.1 Application

Compliance with this acceptable construction practice satisfies *Performance Requirement P2.5.2* for balustrades or other barriers.

#### 3.9.2.2 When balustrades or other barriers are required

- (a) A continuous balustrade or other barrier must be provided along the side of any roof to which public access is provided, any stairway or ramp, any floor, corridor, hallway, balcony, deck, verandah, mezzanine, access bridge or the like and along the side of any delineated path of access to a building, if—
  - (i) it is not bounded by a wall; and
  - (ii) its level above the surface beneath, is more than—
    - (A) 4 m where it is possible for a person to fall through an openable *window*; or
    - (B) 1 m in any other case (see **Figure 3.9.2.3**).
- (b) The requirements of (a) do not apply to—
  - (i) areas referred to in **3.9.1.2(b)**; or
  - (ii) a retaining wall unless the retaining wall forms part of, or is directly associated with a delineated path of access to a building from the road, or a delineated path of access between buildings.

#### 3.9.2.3 Balustrades or other barrier construction

- (a) The height of a balustrade or other barrier must be in accordance with the following:
  - (i) The height must not be less than 865 mm above the nosings of the stair treads or the floor of a ramp.
  - (ii) The height must not be less than—



- (A) 1 m above the floor of any access path, balcony, *landing* or the like (see [Figure 3.9.2.1](#)); or
  - (B) 865 mm above the floor of a *landing* to a stair or ramp where the balustrade or other barrier is provided along the inside edge of the *landing* and does not exceed a length of 500 mm; or
  - (C) 865 mm above the floor beneath an openable *window*.
- (b) A transition zone may be incorporated where the balustrade or other barrier height changes from 865 mm on the stair *flight* or ramp to 1 m at the *landing* (see [Figure 3.9.2.2](#)).
- (c) Openings in balustrades (including decorative balustrades) or other barriers must be constructed so that any opening does not permit a 125 mm sphere to pass through it and for stairs, the space is tested above the nosing line.
- (d) A balustrade or other barrier must be designed to take loading forces in accordance with AS/NZS 1170.1.
- (e) For floors more than 4 m above the surface beneath, any horizontal elements within the balustrade or other barrier between 150 mm and 760 mm above the floor must not facilitate climbing.
- (f) A wire balustrade must be constructed in accordance with the following and is deemed to meet the requirements of (c):
- (i) For horizontal wire systems—
    - (A) when measured with a strain indicator, it must be in accordance with the tension values in [Table 3.9.2.1](#); or
    - (B) must not exceed the maximum deflections in [Table 3.9.2.3](#).
  - (ii) For non-continuous vertical wire systems, when measured with a strain indicator, must be in accordance with the tension values in [Table 3.9.2.1](#) (see Note 4).
  - (iii) For continuous vertical or continuous near vertical sloped wire systems—
    - (A) must have wires of no more than 2.5 mm diameter with a lay of 7×7 or 7×19 construction; and
    - (B) changes in direction at support rails must pass around a pulley block without causing permanent deformation to the wire; and
    - (C) must have supporting rails, constructed with a spacing of not more than 900 mm, of a material that does not allow deflection that would decrease the tension of the wire under load; and
    - (D) when the wire tension is measured with a strain indicator, it must be in accordance with the tension values in [Table 3.9.2.2](#) and measured in the furthestmost span from the tensioning device.

#### Explanatory information:

1. For the purpose of this clause, a wire balustrade consist of a series of tensioned wire rope connected to either vertical or horizontal supports serving as a guard to minimise the risk of a person falling from a roof, stairway, raised floor level or the like.
2. A wire balustrade excludes wire mesh fences and the like.

3. To assist in the application of [3.9.2.3\(f\)](#), the following terms have been defined:
  - (a) Continuous — where the wire spans three or more supports.
  - (b) Non-continuous — where the wire only spans between two supports.
  - (c) Pulley block — a device consisting of a wheel in which a wire runs around to change its direction.
  - (d) Permissible deflection — is the allowable bending of the wire.
  - (e) Support rails — are horizontal components of the balustrade system that span across the top and bottom to provide structural support.
4. [Tables 3.9.2.1](#) and [3.9.2.2](#) contains tension requirements for wires in vertical and horizontal wire balustrades systems with varying post spacings, wire spacings and wire types. The figures contained in the table were derived from testing the spacing combinations in order to prevent the passage of a 125 mm diameter solid cone penetrating between the wires at a predetermined force.
5. Care needs to be taken to ensure that wire tension will be maintained during the life of the balustrade. In some situations, it may be necessary to incorporate "lock-off" devices to prevent to loosening of the wire.
6. Likewise, if a threaded anchor bears against a soft wood post or rail, the anchor may indent the post or rail, thus loosening the wire.
7. Temperature effects on the tension of the wire may be significant but there is little that can be done to allow for temperature variation in service. The shorter the wire span, the lesser the effect will be.
8. Stainless steel wire with a lay of 1 x 19 has the greatest elastic modulus and will take up the same load with less extension than equivalent wires with other lays.
9. Sharp ends of wires at terminations and swages need to be removed for the safety of children and other people. No wire end should protrude more than half the diameter of the wire from the swage or termination fitting.

**Table 3.9.2.1 WIRE BALUSTRADE CONSTRUCTION – REQUIRED TENSION FOR STAINLESS STEEL HORIZONTAL WIRES**

			Clear distance between posts (mm)								
			600	800	900	1000	1200	1500	1800	2000	2500
Wire dia. (mm)	Lay	Wire spacing (mm)	Minimum <i>required</i> tension in Newtons (N)								
2.5	7x7	60	55	190	263	415	478	823	1080	1139	X
		80	382	630	730	824	1025	1288	X	X	X
		100	869	1218	1368	X	X	X	X	X	X
2.5	1x19	60	35	218	310	402	585	810	1125	1325	X
		80	420	630	735	840	1050	1400	1750	X	X
		100	1140	1565	X	X	X	X	X	X	X
3.0	7x7	60	15	178	270	314	506	660	965	1168	1491
		80	250	413	500	741	818	1083	1370	1565	X
		100	865	1278	1390	1639	X	X	X	X	X

Table 3.9.2.1 WIRE BALUSTRADE CONSTRUCTION – REQUIRED TENSION FOR STAINLESS STEEL HORIZONTAL WIRES —  
continued

3.0	1x19	60	25	183	261	340	520	790	1025	1180	X
		80	325	555	670	785	1015	1330	1725	1980	X
		100	1090	1500	1705	1910	X	X	X	X	X
4.0	7x7	60	5	73	97	122	235	440	664	813	1178
		80	196	422	480	524	760	1100	1358	1530	2130
		100	835	1182	1360	1528	1837	2381	2811	3098	X
4.0	1x19	60	5	5	10	15	20	147	593	890	1280
		80	30	192	300	415	593	1105	1303	1435	1844
		100	853	1308	1487	1610	2048	2608	3094	3418	3849
4.0	7x19	60	155	290	358	425	599	860	1080	1285	1540
		80	394	654	785	915	1143	1485	1860	2105	2615
		100	1038	1412	1598	1785	2165	2735	X	X	X

**Notes:**

- 1 Lay = number of strands by the number of individual wires in each strand. For example a lay of 7x19 consists of 7 strands with 19 individual wires in each strand.
- 2 Where a change of direction is made in a run of wire, the tensioning device is to be placed at the end of the longest span.
- 3 If a 3.2 mm wire is used the tension figures for 3.0 mm wire are applied.
- 4 This table may also be used for a set of non-continuous (single) vertical wires forming a balustrade using the appropriate clear distance between posts as the vertical clear distance between the rails.
- 5 X = Not allowed because the required tension would exceed the safe load of the wire.
- 6 Tension measured with a strain indicator.

**Table 3.9.2.2 CONTINUOUS WIRE BALUSTRADE CONSTRUCTION – REQUIRED TENSION FOR VERTICAL OR NEAR VERTICAL STAINLESS STEEL WIRES**

Wire dia. (mm)	Lay	Widest spacing between wires (mm)	Maximum clear spacing between rails (mm)
			900
			<i>Required</i> tension in Newtons (N)
2.5	7x19	80	145
		100	310
		110	610
2.5	7x7	80	130
		100	280
		110	500

**Notes:**

Table 3.9.2.2 CONTINUOUS WIRE BALUSTRADE CONSTRUCTION – REQUIRED TENSION FOR VERTICAL OR NEAR VERTICAL STAINLESS STEEL WIRES— continued

1	Lay = number of strands by the number of individual wires in each strand. For example a lay of 7x19 consists of 7 strands with 19 individual wires in each strand.
2	Vertical wires require two pulley blocks to each 180 <sup>0</sup> change of direction in the wire.
3	Near vertical wires may only require one pulley block for each change of direction.
4	Tension measured with a strain indicator.
5	The table only includes 7x7 and 7x19 wires due to other wires not having sufficient flexibility to make the necessary turns.

Table 3.9.2.3 WIRE BALUSTRADE CONSTRUCTION – MAXIMUM PERMISSIBLE DEFLECTION FOR STAINLESS STEEL WIRES

		Clear distance between posts (mm)					
		600	900	1200	1500	1800	2000
Wire dia. (mm)	Wire spacing (mm)	Maximum permissible deflection of each wire in mm when a 2 kg mass is suspended at mid span					
2.5	60	17	11	9	8	8	8
	80	7	5	5	5	X	X
3.0	60	19	13	8	7	7	7
	80	8	6	6	5	5	5
4.0	60	18	12	8	8	7	7
	80	8	6	4	4	4	4

**Notes:**

- Where a change of direction is made in a run of wire the 2 kg mass must be placed at the middle of the longest span.
- If a 3.2 mm wire is used the deflection figures for 3.0 mm wire are applied.
- This table may also be used for a set of non-continuous (single) vertical wires forming a balustrade using the appropriate clear distance between posts as the vertical clear distance between the rails. The deflection (offset) is measured by hooking a standard spring scale to the mid span of each wire and pulling it horizontally until a force of 19.6 N is applied.
- X = Not allowed because the required tension would exceed the safe load of the wire.
- This table has been limited to 60 mm and 80 mm spaces for 2.5 mm, 3 mm and 4 mm diameter wires because the required wire tensions at greater spacings would require the tension to be beyond the wire safe load limit, or the allowed deflection would be impractical to measure.

(g) A glass balustrade must comply with AS 1288.

Figure 3.9.2.1

**BALUSTRADE OR OTHER BARRIER CONSTRUCTION**

**Note:** For the purposes of this Figure, a 125 mm sphere must not pass between rails or through the gap when tested above the nosing line.

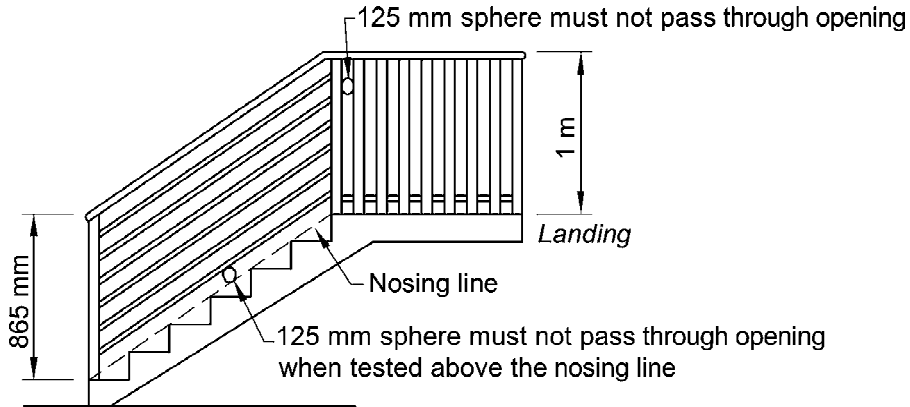
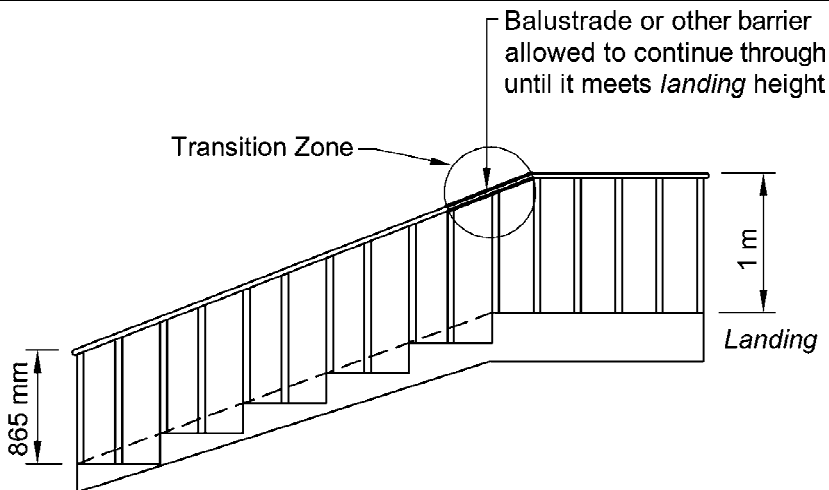
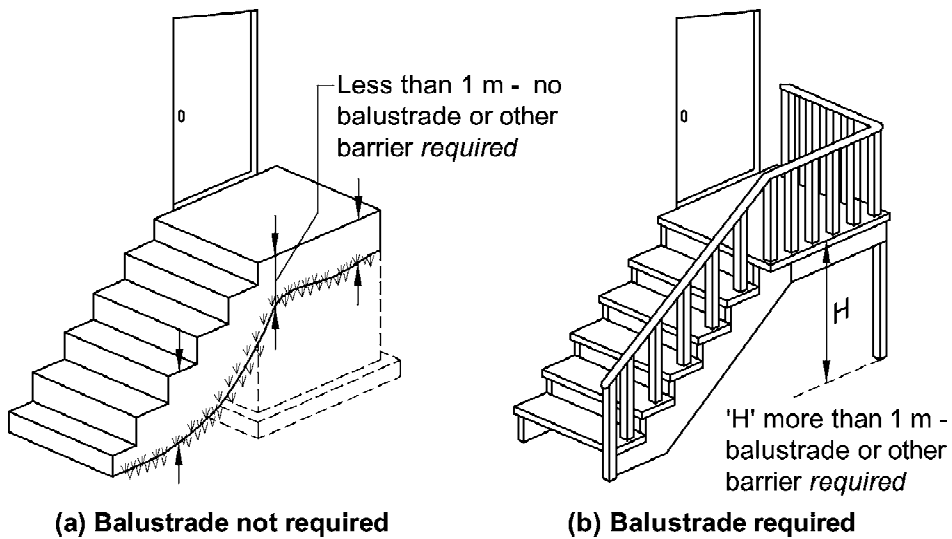


Figure 3.9.2.2

**TRANSITION ZONES**

**Figure 3.9.2.3****BALUSTRADES OR OTHER BARRIERS — WHEN REQUIRED**

## PART 3.9.3 SWIMMING POOL ACCESS

### Appropriate *Performance Requirements*:

Where an alternative *swimming pool* safety fence is proposed as an *Alternative Solution* to that described in **Part 3.9.3**, that proposal must comply with—

- (a) *Performance Requirement P2.5.3*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### STATE AND TERRITORY VARIATIONS

#### 1. Part 3.9.3 does not apply in New South Wales.

**Note** Restriction of access to *swimming pools* in New South Wales is regulated under the Swimming Pools Act 1992.

#### 2. Part 3.9.3 does not apply in Queensland.

**Note:** Restriction of access to *swimming pools* in Queensland is regulated under the Building Act 1975.

#### 3. Part 3.9.3 does not apply in Western Australia.

**Note:** Restriction of access to private *swimming pools* in Western Australia is regulated under the Local Government (Miscellaneous Provisions) Act 1960 and the Building Regulations 1989 as amended.

#### 4. Part 3.9.3 does not apply in the Northern Territory.

### A. Acceptable construction manual

#### 3.9.3.0

*Performance Requirement P2.5.3* is satisfied for a *swimming pool* associated with a Class 1 building, with a depth of water more than 300 mm if it has safety fencing installed in accordance with AS 1926.1 — Swimming pool safety.

### B. Acceptable construction practice

#### 3.9.3.1 Application

Compliance with this acceptable construction practice satisfies *Performance Requirement P2.5.3* for *swimming pools* with a depth of water more than 300 mm, installed on allotments associated with Class 1 buildings.

### **3.9.3.2 Safety fencing location**





- (a) Safety fencing must be located in accordance with one of the options shown in [Figure 3.9.3.1](#).
- (b) The location of safety fencing must ensure that the effective fencing height is not reduced by nearby objects or projections (see [Figure 3.9.3.4](#)).

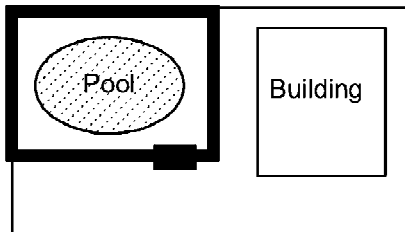


Figure 3.9.3.1


## TYPICAL EXAMPLES OF SAFETY FENCING
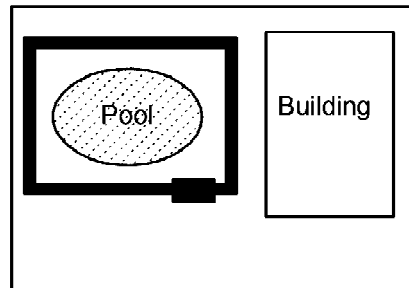
## Legend:


- |   |   |
|---|---|
|  Gate complying with AS 1926.1                           |  Fence, retaining wall or other barrier complying with AS 1926.1 |
|  Child resistant door or window complying with AS 1926.1 |  Allotment boundary  |




(a) Separate access - utilising boundary fence



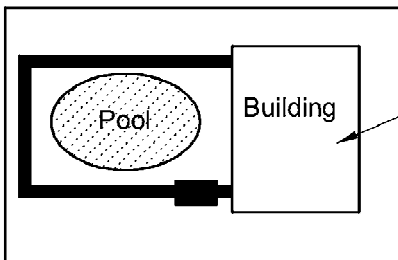
(c) Separate access - individual fence



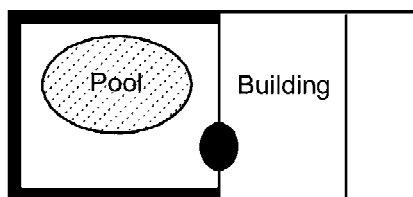(b) Separate access - utilising building wall



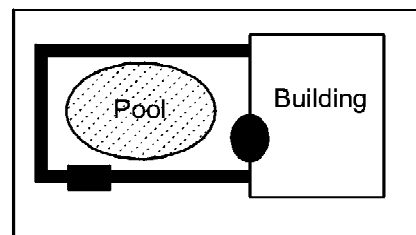(d) Building access - utilising boundary fence and building wall



(e) Building and separate access - utilising building wall



## 3.9.3.3 Safety fencing construction

Safety fences and gates must comply with the following:

- (a) The strength and rigidity of fencing components and elements must comply with AS 1926.1.
- (b) The effective height of fencing must be not less than 1.2 m, except for fencing constructed of perforated or mesh material with apertures more than 13 mm but less than 100 mm, in which case the effective height must be not less than that shown in **Figure 3.9.3.3**.
- (c) Retaining walls or other similar barriers which form part of the safety fencing must comply with **Figure 3.9.3.5**.
- (d) The clearance between the bottom of the fencing and the finished ground level must not be more than 100 mm.
- (e) Projections or indentations on the outside surface of the fencing must not exceed the dimensions shown in **Figure 3.9.3.2(a)**.
- (f) Horizontal or near horizontal fencing components, such as rails, rods, wires or bracing, that could be used as holds for climbing must—
  - (i) if located on the outside of the fencing; or
  - (ii) if located on the inside of the fencing and the vertical members are spaced more than 10 mm apart,be spaced in accordance with **Figures 3.9.3.2 (b), (c) and (d)**.
- (g) The clear gap between adjacent vertical or near vertical members must not be more than 100 mm.

**Figure 3.9.3.2**

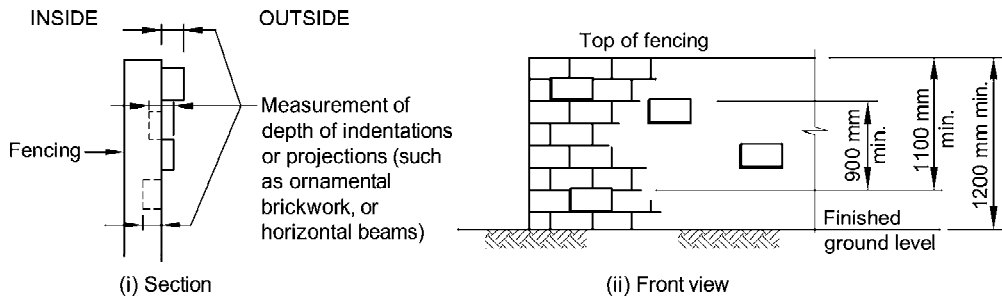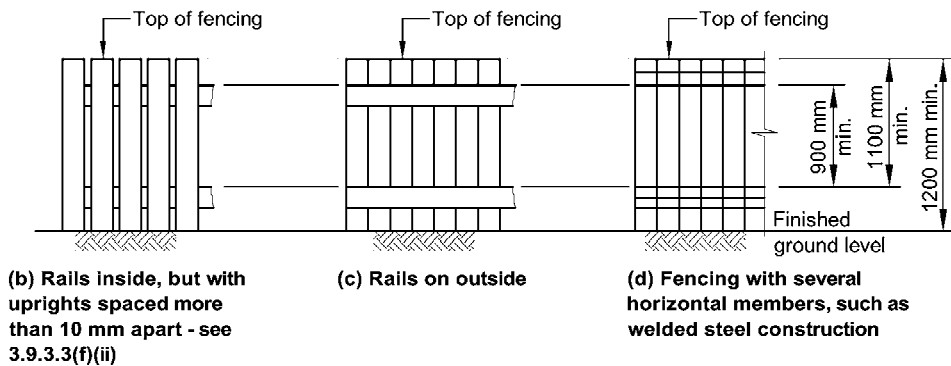**SPACING OF ACCESSIBLE HORIZONTAL MEMBERS, PROJECTIONS OR INDENTATIONS IN FENCING**

**(a) Fencing with projections such as ornamental brick or stonework****Figure 3.9.3.3**

**CHAIN WIRE OR MESH FENCE**

**Note:** Fencing material with an aperture more than 13 mm, but less than 100 mm.


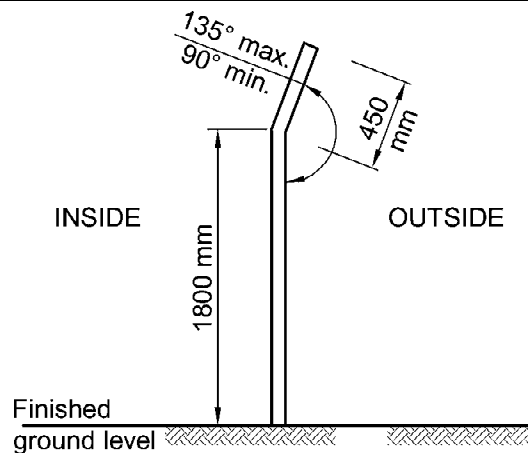
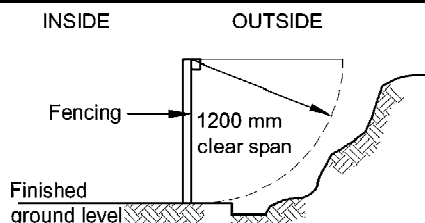



Figure 3.9.3.4

**EFFECTIVE FENCING HEIGHT**

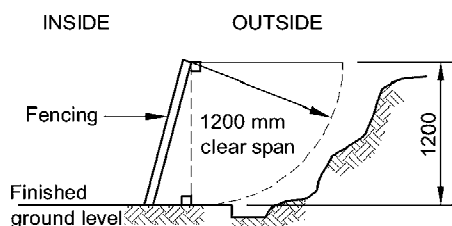(a) Example A - acceptable




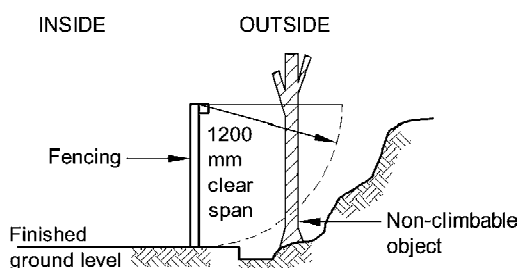(b) Example B - acceptable



(c) Example C - acceptable

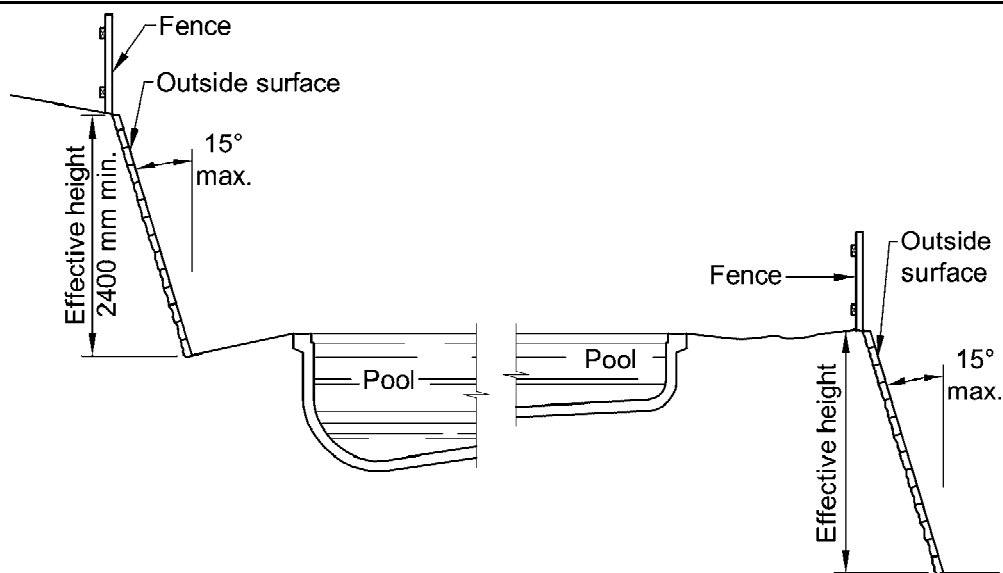Figure 3.9.3.5

**RETAINING WALLS AND OTHER SUCH BARRIERS****3.9.3.4 Gates and fittings**

Gates and fittings must comply with the relevant requirements of [3.9.3.2](#) and the following:

- (a) Gates must swing outwards from the pool area.

- (b) Gates must be fitted with a self closing device that will return the gate to the closed position and operate the latching device—
  - (i) from any position from resting on the latching mechanism to fully open; and
  - (ii) from a stationary start without the application of a manual force.
- (c) Gates must be fitted with a latching device—
  - (i) that will automatically operate on the closing of the gate and prevent the gate from being re-opened without manual release; and
  - (ii) that cannot be inadvertently adjusted in operation or adjusted without the use of tools; and
  - (iii) located and shielded in accordance with one of the options shown in [Figure 3.9.3.7](#).

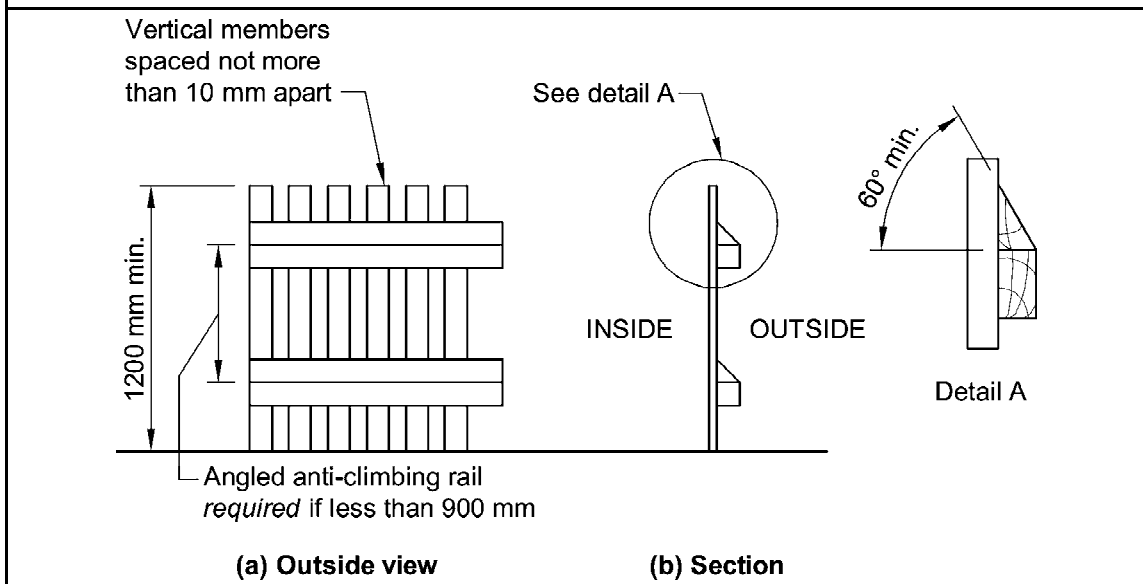
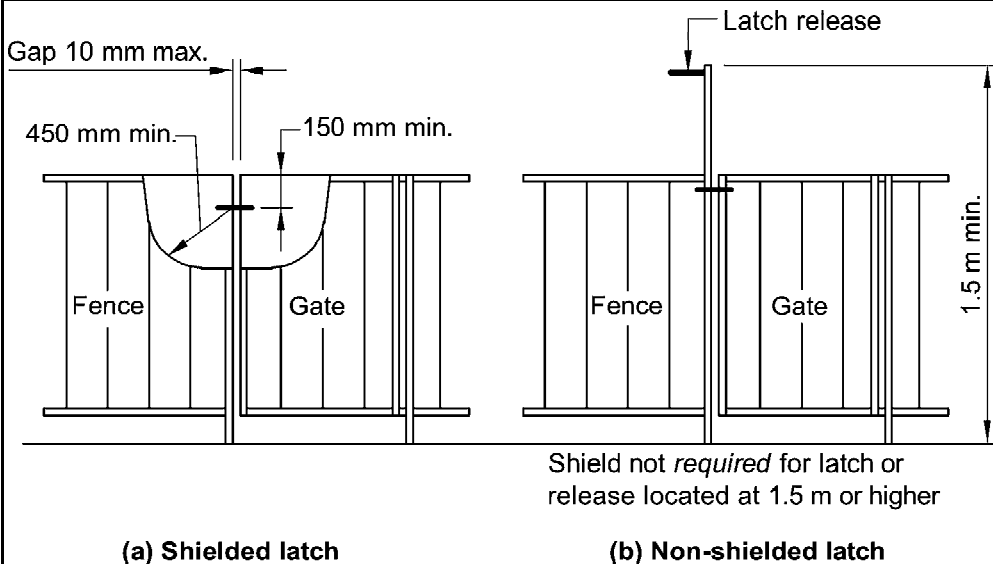
**Figure 3.9.3.6****HORIZONTAL MEMBERS NOT ACTING AS A HOLD FOR CLIMBING**

Figure 3.9.3.7

## LOCATION AND SHIELDING OF GATE LATCHES

**Explanatory information:**

Safety fencing should consist of barriers or walls of sufficient height and designed and constructed without openings and footholds that would enable a young child to climb through or over the fence and provided with child-resistant self-closing and latching devices on gates and doors and if incorporating an external wall of a building, any doors and openable [windows](#) to the pool area should be fitted with self-closing and latching devices that are child-resistant.

It should be noted that in NSW, Qld, WA and NT restriction of access to [swimming pools](#) is regulated under other legislation. ACT, NSW, SA and Tas impose additional requirements for [swimming pools](#) which may include provisions affecting the design of pools and pool surrounds, drainage of [swimming pools](#) and electrical installations.

The provisions of AS 1926.2 provide a number of options for the location of pool safety fencing. One option consists of enclosing the pool with isolation safety fencing completely separating the pool area from any other part of the allotment and any buildings. Alternatively the pool area should be separated from other parts of the allotment, any buildings and neighbouring allotments with barriers complying with the standards for safety fencing including the external wall of a building provided there is no access from the building to the pool area. Where possible, tool sheds, garages, barbeques and clotheslines should be located outside the pool area to reduce the likelihood of self-closing gates being propped open in order to gain access.

If access is provided from the building to the pool area any access door and [window](#) opening to the pool area must be protected with child-resistant doorsets and child-resistant openable portions of [window](#).

[Swimming pool](#) safety fencing should be designed and constructed so as to be non-climbable by young children having regard to the height of the fence, any horizontal climbable members, openings and footholds in the fence and the operation of self-closing and latching gates.

Typical examples of satisfactory safety fencing are illustrated in AS 1926.1.

## PART 3.9.4 SWIMMING POOL WATER RECIRCULATION SYSTEMS

### Appropriate *Performance Requirements*:

Where an alternative *swimming pool* water recirculation system is proposed as an *Alternative Solution* to that described in **Part 3.9.4**, that proposal must comply with—

- (a) *Performance Requirement P2.5.4*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### A. Acceptable construction manual

#### 3.9.4.0

*Performance Requirement P2.5.4* is satisfied for a *swimming pool* with a depth of water more than 300 mm if—

- (a) for a spa pool, it complies with AS 1926.3 except that the specified distance between two outlets connected to a common line may be not less than 600 mm; and
- (b) for all other *swimming pools*, it complies with AS 1926.3.

### Explanatory information:

The requirements for water recirculation systems in *swimming pools* make provisions for the safety of users by means of minimising the risk of entrapment or injury of people using the pool and provide for the safe operation of skimmer boxes and outlet systems.

The BCA definition of *swimming pool* is specific in including a bathing or wading pool and a spa. Therefore, the *Deemed-to-Satisfy Provision*, if chosen as the *Building Solution*, applies the requirements of AS 1926.3 to all types of pools defined as *swimming pools* under the BCA, irrespective of the definition of *swimming pool* stated in the Standard.

### STATE AND TERRITORY VARIATIONS

**In South Australia, after 3.9.4.0 insert the following:**

**SA 3.9.4.1** *Swimming pools required* to comply with AS 1926.3 must—

- (a) Wherever a manual shut-off valve is fitted to a secondary outlet from a *swimming pool*, a permanent label must be fixed to the valve. The label must be in capital letters not less than 25 mm high, in a colour contrasting with the background and printing that is resistant to ultra-violet light, water and pool chemicals, and state:

**WARNING**  
**RE-OPEN THIS VALVE IMMEDIATELY AFTER USING A VACUUM CLEANER**



<b>THE POOL MUST NOT BE USED WHILE A VACUUM CLEANER IS IN USE</b>
---

(b) For the purpose of clause 5.1 of AS 1926.3, a skimmer box is an outlet.

# PART 3.10

---

## **ADDITIONAL CONSTRUCTION REQUIREMENTS**

**3.10.1 High Wind Areas**

**3.10.2 Earthquake Areas**

## ADDITIONAL CONSTRUCTION REQUIREMENTS

---

### PART 3.10 CONTENTS

---

#### PART 3.10 ADDITIONAL CONSTRUCTION REQUIREMENTS

##### Explanatory Information

#### **3.10.1 High Wind Areas**

3.10.1.0 Acceptable construction manual

#### **3.10.2 Earthquake Areas**

3.10.2.0 Acceptable construction manuals

---

## PART 3.10 EXPLANATORY INFORMATION

---

### Explanatory information:

These provisions have been introduced to address design requirements for increased structural loading conditions that may occur due to geographical, topographical or climatic conditions that are beyond the scope of the preceding Parts of the [Housing Provisions](#).

These provisions are to be read in conjunction with the other relevant requirements of this code.

e.g. For masonry construction in [Part 3.10.1](#), the walls will be *required* to be designed in accordance with AS 3700. However, the lintels, *flashings* and *damp proof courses* can be installed in accordance with [Part 3.3](#).

## PART 3.10.1 HIGH WIND AREAS

### Appropriate Performance Requirements:

Where an alternative method of constructing in *high wind areas* is proposed as an *Alternative Solution* to that described in **Part 3.10.1**, that proposal must comply with—

- (a) *Performance Requirement P2.1*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### Acceptable construction manual

#### 3.10.1.0

*Performance Requirement P2.1* is satisfied for a building constructed in a *high wind area* if it complies with one or more of the following manuals:

- (a) Masonry — AS 3700 Masonry structures.
- (b) The Northern Territory Deemed-to-Comply Standards Manual.
- (c) Timber—
  - (i) \* \* \* \* \*
  - (ii) \* \* \* \* \*
  - (iii) AS 1684.2 — Residential timber-framed construction — Non-cyclonic areas.
  - (iv) AS 1684.3 — Residential timber-framed construction — Cyclonic areas.
- (d) Steel—
  - (i) \* \* \* \* \*
  - (ii) AS 4100 — Steel framing.
  - (iii) AS 4600 — Cold-formed steel structures.
  - (iv) NASH — Residential and low-rise steel framing — Part 1 Design criteria.
- (e) Glazed assemblies:
  - (i) AS 2047 for the following glazed assemblies in an *external wall*:
    - (A) *Windows* excluding those listed in (ii).
    - (B) Sliding doors with a frame.
    - (C) Adjustable louvres.
    - (D) Window walls with one piece framing.
  - (ii) AS 1288 for all glazed assemblies not covered by (i) and the following glazed assemblies:
    - (A) All glazed assemblies not in an *external wall*.

SUPERSEDED  
**ADDITIONAL CONSTRUCTION REQUIREMENTS**

- (B) Hinged doors, including French doors and bi-fold doors.
  - (C) Revolving doors.
  - (D) Fixed louvres.
  - (E) Skylights, roof lights and [windows](#) in other than the vertical plane.
  - (F) Sliding doors without a frame.
  - (G) [Windows](#) constructed on site and architectural one-off [windows](#), which are not design tested in accordance with AS 2047.
  - (H) Second-hand [windows](#), re-used [windows](#), recycled [windows](#) and replacement [windows](#).
  - (I) Heritage [windows](#).
  - (J) Timber [windows](#) in wind classification N3 or C1.
  - (K) Glazing used in balustrades and sloping overhead glazing.
- (f) In cyclonic areas, metal roof assemblies, their connections and immediate supporting members must be capable of remaining in position notwithstanding any permanent distortion, fracture or damage that might occur in the sheet or fastenings under the pressure sequences A to G defined in [Table 3.10.1](#).

**Table 3.10.1 Low-High-Low pressure sequence**

Sequence	Number of cycles	Load
A	4500	0 to 0.45 Pt
B	600	0 to 0.6 Pt
C	80	0 to 0.8 Pt
D	1	0 to 1.0 Pt
E	80	0 to 0.8 Pt
F	600	0 to 0.6 Pt
G	4500	0 to 0.45 Pt

**Note:**

- Pt is the ultimate limit state wind pressure on internal and external surfaces as determined in accordance with AS/NZS 1170.2, modified by an appropriate factor for variability, as determined in accordance with Table B1 of AS/NZS 1170.0.
- The rate of load cycling must be less than 3Hz.
- The single load cycle (sequence D) must be held for a minimum of 10 seconds.

- (g) For the purposes of [\(f\)](#), cyclonic areas are those determined as being located in wind regions C and D in accordance with [Figure 3.10.1.4](#).

**Explanatory information:**

The requirements of [3.10.1.0 \(f\)](#) must be read in conjunction with the provisions of AS/NZS 1170.2. The ABCB commissioned research to establish a national consistent testing regime for metal roof cladding assemblies in cyclonic areas. The results of this research are contained in [3.10.1.0 \(f\)](#).

## ADDITIONAL CONSTRUCTION REQUIREMENTS

Low cycle fatigue cracking of metal roof cladding elements during tropical cyclones is a complex process where small changes in load, geometry or material properties can significantly affect the fatigue performance of the cladding system (includes immediate supports, fixings and cladding). The consequences of failure of an element can quickly lead to more elements progressively failing. These failed elements become wind driven debris and so pose a threat to people and other structures as potential missiles.

The fatigue loading sequence defined in [Table 3.10.1](#) is to simulate the wind load induced by a cyclonic event. In order to have a repeatable standard test that can be performed by different testing laboratories within a reasonable time frame on different types of test equipment, the loading sequence is a simplification of the dynamic wind loading environment. In the formulation of the fatigue loading sequence assumptions such as cyclone counts, load range, cyclone duration, wind direction change, building orientation and building geometry have been made.

If a system does not successfully resist the fatigue loading sequence in [Table 3.10.1](#), it does not comply.

The test section consists of cladding elements, fastenings and immediate supporting members assembled together in a manner identical to those parts of the particular roof which the test section is intended to replicate.

### STATE AND TERRITORY VARIATIONS

#### **Add 3.10.1.0(h) in the Northern Territory.**


- (h) Masonry veneer — Masonry veneer construction must be designed so that the structural framing to which the masonry veneer is tied will ensure the stability of the masonry veneer.

# ADDITIONAL CONSTRUCTION REQUIREMENTS

Figure 3.10.1.4

## WIND REGIONS

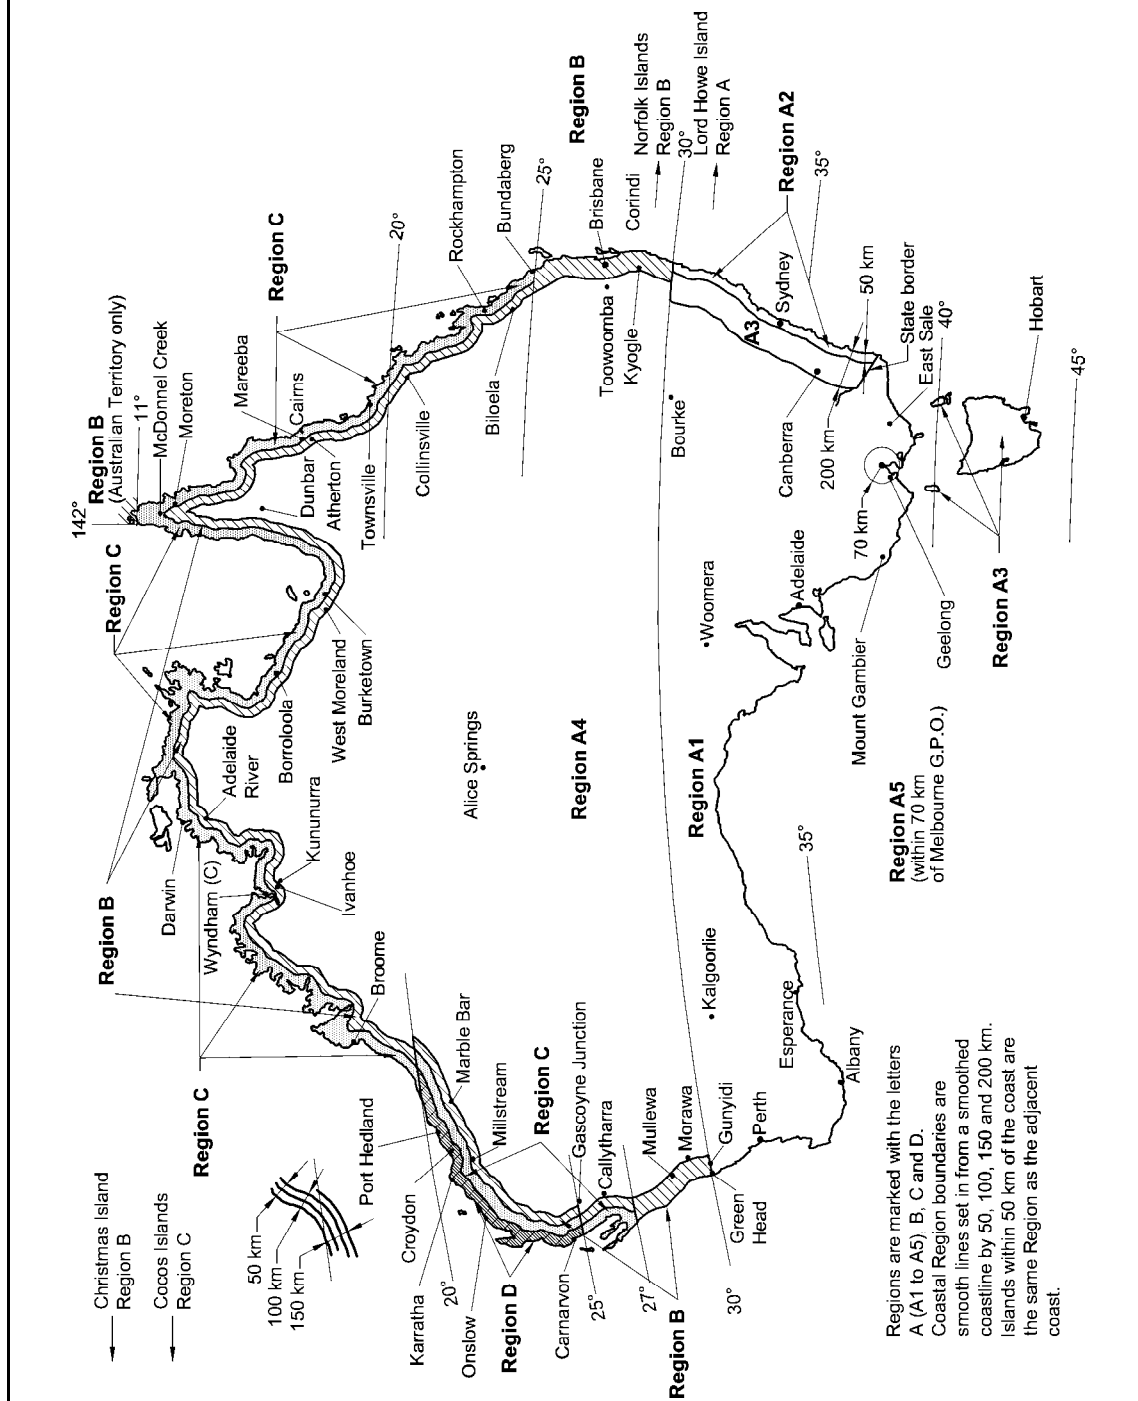**Note:** *High wind areas* exist outside the wind regions indicated on this map.





**ADDITIONAL CONSTRUCTION REQUIREMENTS**

---

**Explanatory information:****Construction in *high wind areas***

The intent of building construction in *high wind areas* is to ensure the structure has sufficient strength to transfer wind forces to the ground with an adequate safety margin to prevent the collapse of the building and the building being lifted, or slid off its foundations.

To resist these forces it is necessary to have—

- (a) an anchorage system, where the roof is connected by the walls to the footings by a chain of connections; and
- (b) a bracing system to prevent horizontal collapse due to wind forces; and
- (c) continuity of the system where each structural element is interlocked to its adjoining structural element throughout the building.

**Anchorage**

Anchorage of the system is achieved by using a variety of proprietary connectors. Each connector must be capable of carrying the uplift force, because the ability of the building to resist the wind forces is directly related to its weakest link.

Acceptable construction manuals to achieve these requirements are described in this Part.

## PART 3.10.2 EARTHQUAKE AREAS

### Appropriate *Performance Requirements*:

Where an alternative design is proposed as an *Alternative Solution* to that described in **Part 3.10.2**, that proposal must comply with—

- (a) *Performance Requirement P2.1*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### A. Acceptable construction manuals

#### 3.10.2.0

*Performance Requirement P2.1* for Class 1 and 10 buildings constructed in areas subject to seismic activity is satisfied if the building is constructed in accordance with the acceptable construction manuals listed in **Part 3.11**.

### Explanatory information:

Most domestic structures are not *required* to be specifically designed for earthquakes, because the construction system already in place for wind resistance is usually adequate for earthquake resistance.

Accordingly, compliance with other acceptable construction details in the *Housing Provisions* are suitable for areas with an acceleration coefficient below 0.12 provided the building is built in an area that is not considered to be complying with a structural design category of H3 as defined in AS 1170.4 (1993).

Class H3 are typically *sites* identified as having soft soil (having a soil profile with more than 5 m of soft clay, loose sand, silt or uncontrolled fill) which need to be designed in accordance with **Part 3.11**.

# PART 3.11

---

## STRUCTURAL DESIGN MANUALS

### 3.11 Structural Design Manuals

## **PART 3.11 CONTENTS**

---

### **PART 3.11 STRUCTURAL DESIGN MANUALS**

#### **Explanatory Information**

#### **3.11 Structural design manuals**

- 3.11.1 Application
- 3.11.2 Resistance to actions
- 3.11.3 Determination of individual actions
- 3.11.4 Acceptable structural design manuals
- 3.11.5 Loading requirements
- 3.11.6 Determination of structural resistance of materials and forms of construction

---

## PART 3.11 EXPLANATORY INFORMATION

---

### Explanatory information:

This Part of the *Housing Provisions* contains a list of deemed-to-satisfy codes (structural design manuals) that can be used to design building elements using engineering principles.

These provisions can be used in conjunction with both the *Performance Requirements* (listed in Section 2) and the *Deemed-to-Satisfy Provisions* (listed in Section 3 — Parts 1 to 12). This combined approach is acceptable and meets the requirements of the *Housing Provisions*.

## PART 3.11 STRUCTURAL DESIGN MANUALS

### Appropriate *Performance Requirements*:

Where it is proposed to use an alternative structural design manual as an *Alternative Solution* to that described in **Part 3.11**, that proposal must comply with—

- (a) *Performance Requirement P2.1*; and
- (b) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### Acceptable construction manuals

#### 3.11.1 Application

*Performance Requirement P2.1* is satisfied by complying with—

- (a) **3.11.2**, **3.11.3** and **3.11.6**; or
- (b) for the earthquake resistance component of **P2.1**, **3.11.5** and **3.11.6**; or
- (c) the relevant provisions of other Parts of Section 3 of the *Housing Provisions* relating to structural elements.; or
- (d) any combination thereof.

#### 3.11.2 Resistance to actions

The resistance of a building or structure must be greater than the most critical action effect resulting from different combinations of actions, where—

- (a) the most critical action effect on a building or structure must be determined in accordance with **3.11.3** and the general design procedures contained in AS/NZS 1170.0; and
- (b) the resistance of a building or structure must be determined in accordance with **3.11.6**.

#### 3.11.3 Determination of individual actions

The magnitude of individual actions must be determined in accordance with the following:

- (a) Permanent actions:
  - (i) the design or known dimensions of the building or structure; and
  - (ii) the unit weight of the construction; and
  - (iii) AS/NZS 1170.1.
- (b) Imposed actions:
  - (i) the known loads that will be imposed during the occupation or use of the building or structure; and
  - (ii) *construction activity actions*; and

- (iii) AS/NZS 1170.1.
- (c) Wind, snow and earthquake actions:
  - (i) the applicable annual probability of design event for safety, determined by—
    - (A) assigning the building or structure an Importance Level in accordance with [Table 3.11.3a](#); and
    - (B) determining the corresponding annual probability of exceedance for safety in accordance with [Table 3.11.3b](#); and
  - (ii) for wind actions, AS/NZS 1170.2 or AS 4055; and
  - (iii) for snow and ice actions, AS/NZS 1170.3 ; and
  - (iv) for earthquake actions, AS 1170.4 (2007).
- (d) In cyclonic areas, metal roof cladding, their connections and immediate supporting members must be capable of remaining in position notwithstanding any permanent distortion, fracture or damage that might occur in the sheet or fastenings under the pressure sequences A to G defined in [Table 3.10.1](#).
- (e) For the purposes of [\(d\)](#), cyclonic areas are those determined as being located in wind regions C and D in accordance with [Figure 3.10.1.4](#).
- (f) Action not covered in [\(a\)](#), [\(b\)](#) and [\(c\)](#) above:
  - (i) the nature of the action; and
  - (ii) the nature of the building or structure; and
  - (iii) the Importance Level of the building or structure determined in accordance with [Table 3.11.3a](#); and
  - (iv) AS/NZS 1170.1.
- (g) For the purposes of [\(f\)](#) the actions include but are not limited to—
  - (i) liquid pressure action; and
  - (ii) ground water action; and
  - (iii) rainwater action (including ponding action); and
  - (iv) earth pressure action; and
  - (v) differential movement; and
  - (vi) time dependent effects (including creep and shrinkage); and
  - (vii) thermal effects; and
  - (viii) ground movement caused by—
    - (A) swelling, shrinkage or freezing of the subsoil; and
    - (B) landslip or subsidence; and
    - (C) siteworks associated with the building or structure; and
  - (ix) [construction activity actions](#).

Table 3.11.3a IMPORTANCE LEVELS OF BUILDINGS AND STRUCTURES

Importance Level	Building types
1	Buildings or structures presenting a low degree of hazard to life and <i>other property</i> in the case of failure.
2	Buildings or structures not included in Importance Level 1.

Table 3.11.3b DESIGN EVENTS FOR SAFETY

Importance Level	Annual probability of exceedance			
	Wind		Snow	Earthquake
	Non-cyclonic	Cyclonic		
1	1:100	1:200	1:100	1:250
2	1:500	1:500	1:150	1:500

### 3.11.4 \* \* \* \* \*

This clause has deliberately been left blank.

### 3.11.5 Loading requirements

A Class 1 and 10 building must be designed to resist earthquake loads as determined in accordance with AS 1170.4 (1993).

### 3.11.6 Determination of structural resistance of materials and forms of construction

The structural resistance of materials and forms of construction must be determined in accordance with the following:

- (a) Steel construction:
  - (i) AS/NZS 4600 — Cold-formed steel structures.
  - (ii) NASH — Residential and low-rise steel framing — Part 1 Design criteria.
  - (iii) AS 4100 — Steel structures.
- (b) Aluminium construction:
  - (i) AS/NZS 1664 — Aluminium structures, Part 1 — Limit state design.
  - (ii) AS/NZS 1664 — Aluminium structures, Part 2 — Allowable stress design.
- (c) Timber construction:
  - AS 1720.1 — Timber structures — design methods.
- (d) Footings:
  - (i) AS 2870 — Residential slabs and footings — construction.
  - (ii) AS 3600 — Concrete structures.
- (e) Piling:



AS 2159 — Piling — Design and installation.

- (f) Concrete construction (including reinforced and prestressed concrete):  
AS 3600 — Concrete structures.
- (g) Masonry (including masonry-veneer, *unreinforced masonry* and *reinforced masonry*):  
AS 3700 — Masonry structures except that AS 1170.4 (2007) must be used to determine earthquake actions.
- (h) Composite steel and concrete:  
AS 2327.1 — Composite construction in structural steel and concrete.
- (i) Glazed assemblies:
  - (i) AS 2047 for the following glazed assemblies in an *external wall*:
    - (A) Windows excluding those listed in (ii).
    - (B) Sliding doors with a frame.
    - (C) Adjustable louvres.
    - (D) Window walls with one piece framing.
  - (ii) AS 1288 for all glazed assemblies not covered by (i) and the following glazed assemblies:
    - (A) All glazed assemblies not in an external wall.
    - (B) Hinged doors, including French doors and bi-fold doors.
    - (C) Revolving doors.
    - (D) Fixed louvres.
    - (E) Skylights, roof lights and windows in other than the vertical plane.
    - (F) Sliding doors without a frame.
    - (G) Windows constructed on site and architectural one-off windows, which are not design tested in accordance with AS 2047.
    - (H) Second-hand windows, re-used windows, recycled windows and replacement windows.
    - (I) Heritage windows.
    - (J) Glazing used in balustrades and sloping overhead glazing.

#### Explanatory information:

The reference to heritage windows in **3.11.6(i)(ii)(I)** is intended to apply to windows in heritage buildings. The method of determining a heritage building is normally covered by the relevant State or Territory authority.

# PART 3.12

---

## ENERGY EFFICIENCY

- 3.12.1 Building Fabric
- 3.12.2 External Glazing
- 3.12.3 Building Sealing
- 3.12.4 Air Movement
- 3.12.5 Services

## PART 3.12 CONTENTS

---

### PART 3.12 ENERGY EFFICIENCY

#### **3.12 Energy efficiency**

3.12 Definitions

3.12.0 Application of Part 3.12

#### **3.12.1 Building fabric**

3.12.1 Application

3.12.1.1 Building fabric thermal insulation

3.12.1.2 Roofs

3.12.1.3 Roof lights

3.12.1.4 External walls

3.12.1.5 Floors

3.12.1.6 Attached Class 10a buildings

#### **3.12.2 External Glazing**

3.12.2 Application

3.12.2.1 External glazing

3.12.2.2 Shading

#### **3.12.3 Building Sealing**

3.12.3 Application

3.12.3.1 Chimneys and flues

3.12.3.2 Roof lights

3.12.3.3 External windows and doors

3.12.3.4 Exhaust fans

3.12.3.5 Construction of roofs, walls and floors

3.12.3.6 Evaporative coolers

#### **3.12.4 Air Movement**

3.12.4 Application

3.12.4.1 Air movement

3.12.4.2 Ventilation openings

3.12.4.3 Ceiling fans and evaporative coolers

#### **3.12.5 Services**

3.12.5 Application

3.12.5.0 Acceptable construction manual

3.12.5.1 Insulation of services

3.12.5.2 Central heating water piping

3.12.5.3 Heating and cooling ductwork

## PART 3.12 ENERGY EFFICIENCY

### Appropriate *Performance Requirements*:

Where an alternative energy efficiency design is proposed as an *Alternative Solution* to that described in **Part 3.12**, that proposal must comply with—

- (a) *Performance Requirement P2.6.1*; and
- (b) *Performance Requirement P2.6.2*; and
- (c) the relevant *Performance Requirements* determined in accordance with **1.0.10**.

### STATE AND TERRITORY VARIATIONS

1. **Part 3.12 does not apply in New South Wales.**

**Note:** The New South Wales Additions contain energy efficiency provisions that apply in New South Wales.

- 2. In the Northern Territory, **Part 3.12** is replaced with BCA 2005 **Part 3.12**.
- 3. In Tasmania, **Part 3.12** is replaced with BCA 2005 **Part 3.12** until 1 January 2010.

### Definitions

### 3.12

The following definitions are used in this Part:

**Conditioned space** means a space within a building that is heated or cooled by the building's *domestic services*, excluding a non-*habitable room* in which a heater with a capacity of not more than 1.2 kW is installed.

**Piping** means an assembly of pipes, with or without valves or other fittings, connected together for the conveyance of liquids.

**R-Value** means the thermal resistance ( $\text{m}^2\cdot\text{K}/\text{W}$ ) of a component calculated by dividing its thickness by its thermal conductivity.

**Reflective insulation** means a building membrane with a reflective surface such as a reflective foil laminate, reflective barrier, foil batt or the like capable of reducing radiant heat flow.

### Explanatory information:

- 1. Typical *R-values* achieved by adding *reflective insulation* are given in the explanatory information accompanying **Figures 3.12.1.1, 3.12.1.3 and 3.12.1.4**. Information on specific products may be obtained from *reflective insulation* manufacturers.
- 2. The surface of *reflective insulation* may be described in terms of its emittance (or infra-red emittance) or in terms of its reflectance (or solar reflectance). Generally, for the surface of a particular *reflective insulation* –

emittance + reflectance = 1

3. Some types of *reflective insulation* may also serve the purposes of waterproofing or vapour proofing.

**Solar Heat Gain Coefficient (SHGC)** means the fraction of incident irradiance on *glazing* or a *roof light* that adds heat to a building's space.

**Total R-Value** means the sum of the *R-Values* of the individual component layers in a composite element including any building material, insulation material, airspace and associated surface resistances.

**Total U-Value** means the thermal transmittance ( $\text{W/m}^2\cdot\text{K}$ ) of the composite element allowing for the effect of any airspace and associated surface resistances.

**Ventilation opening** means an opening in the *external wall*, floor or roof of a building designed to allow air movement into or out of the building by natural means including a permanent opening, an openable part of a *window*, a door or other device which can be held open.

### 3.12.0 Application of Part 3.12

- (a) *Performance Requirement P2.6.1* for the thermal performance of the building is satisfied by complying with—
  - (i) for the building *fabric*, **Part 3.12.1**; and
  - (ii) for external *glazing* and shading, **Part 3.12.2**; and
  - (iii) for building sealing, **Part 3.12.3**; and
  - (iv) for air movement, **Part 3.12.4**.

#### STATE AND TERRITORY VARIATIONS

**In Victoria, delete 3.12.0(a) and (b)(i) and insert 3.12.0(a) as follows:**

- (a) *Performance Requirement P2.6.1* for the thermal performance of a building is satisfied by complying with—
  - (i) for building *fabric*, **Part 3.12.1**; and
  - (ii) for external *glazing* and shading, **Part 3.12.2**; and
  - (iii) for building sealing, **Part 3.12.3**; and
  - (iv) for air movement, **Part 3.12.4**, and

in the case of a new Class 1 building, having either a rainwater tank connected to all sanitary flushing systems, or a solar water heater system, installed in accordance with the Plumbing Regulations 2008.

- (b) *Performance Requirement P2.6.2* for the energy efficiency of—
  - (i) a hot water supply system, is satisfied by complying with **3.12.5.0**; and
  - (ii) a central heating water system and heating and cooling ductwork, is satisfied by complying with **3.12.5.1** to **3.12.5.3**.

## PART 3.12.1 BUILDING FABRIC

### 3.12.1 Application

- (a) The provisions of **3.12.1.1** to **3.12.1.5** apply to—
  - (i) a Class 1 building; and
  - (ii) a Class 10a building with a *conditioned space*.
- (b) The provisions of **3.12.1.6** apply to a Class 1 building with an attached Class 10a building.

#### Acceptable construction practice

#### 3.12.1.1 Building fabric thermal insulation

- (a) Where *required*, insulation must comply with AS/NZS 4859.1 and be installed so that it—
  - (i) abuts or overlaps adjoining insulation other than at supporting members such as studs, noggings, joists and the like where the insulation must butt against the member; and
  - (ii) forms a continuous barrier with ceilings, walls, bulkheads, floors or the like that inherently contribute to the thermal barrier; and
  - (iii) does not affect the safe or effective operation of a *domestic service* or fitting.
- (b) Where *required*, *reflective insulation* must be installed with—
  - (i) the necessary airspace, to achieve the required *R-Value* between a reflective side of the *reflective insulation* and a building lining or cladding; and

#### Explanatory information: Airspace adjoining reflective insulation

For *reflective insulation* and the adjoining airspace to achieve its tested *R-Value*, the airspace needs to be a certain width. This width varies depending on the particular type of *reflective insulation* and the *R-Value* to be achieved.

- (ii) the *reflective insulation* closely fitted against any penetration, door or *window* opening; and
  - (iii) the *reflective insulation* adequately supported by framing members; and
  - (iv) each adjoining sheet of roll membrane being—
    - (A) overlapped not less than 150 mm; or
    - (B) taped together.
- (c) Where *required*, bulk insulation must be installed so that—
  - (i) it maintains its position and thickness, other than where it crosses roof battens, water pipes, electrical cabling or the like; and

### Explanatory information: Compression of bulk insulation

The *R-Value* of bulk insulation is reduced if it is compressed. The allocated space for bulk insulation must therefore allow the insulation to be installed so that it maintains its correct thickness. This is particularly relevant to wall and cathedral ceiling framing whose members can only accommodate a limited thickness of insulation. In some instances, larger framing members or thinner insulation material, such as polystyrene boards, may be necessary to ensure that the insulation achieves its *required R-Value*.

- (ii) in a ceiling, where there is no bulk insulation or *reflective insulation* in the *external wall* beneath, it overlaps the *external wall* by not less than 50 mm.

### Explanatory information:

1. The *R-Value* of *reflective insulation* and its adjoining airspace is affected by the width of the airspace between a reflective side of the *reflective insulation* and the building lining or cladding. For further information on *reflective insulation*, refer to the explanatory information accompanying **Figure 3.12.1.1**.
2. Care should be taken when installing insulation to ensure that it does not interfere with the safety or performance of *domestic services* and fittings such as heating flues, recessed light fittings, light transformers, gas appliances and general plumbing and electrical components. This includes providing appropriate clearance as detailed in relevant legislation and referenced standards such as for electrical, gas and fuel oil installations.
3. Artificial cooling of buildings in some climates can cause condensation to form inside the layers of the building *envelope*. Such condensation can cause significant structural or cosmetic damage to the *envelope* before it is detected. Associated mould growth may also create health risks to the occupants. Effective control of condensation is a complex issue. In some locations a fully sealed vapour barrier may need to be installed on the more humid, or generally warmer, side of the insulation.

## 3.12.1.2 Roofs

- (a) A roof must achieve the total *Total R-Value* specified in **Table 3.12.1.1** for the direction of heat flow.
- (b) In *climate zones* 1, 2 and 3, the *Total R-Value* specified in **Table 3.12.1.1** is reduced by R0.5 for each of the following:
  - (i) The roof upper surface has a solar absorptance value of not more than 0.55.
  - (ii) The roof space is ventilated by—
    - (A) gable vents, ridge vents, eave vents, roof vents or the like that—
      - (aa) are evenly distributed to allow an unobstructed flow of air; and
      - (bb) are located to ensure, where practicable, there are no dead airspaces; and
      - (cc) have an aggregate fixed open area of not less than 1.0% of the ceiling area; or
    - (B) not less than 2 wind-driven roof ventilators having an aggregate opening area of not less than 0.14 m<sup>2</sup> in conjunction with gable vents, ridge vents,

eave vents, roof vents or the like having an aggregate fixed open area of not less than 0.2% of the ceiling area; or

- (C) a tiled roof without *sarking-type material* at roof level.

**Table 3.12.1.1 ROOFS—MINIMUM TOTAL R-VALUE**

Climate zone	1	2		3	4	5	6	7	8
		Altitude less than 300 m	Altitude 300 m or more						
Minimum Total R-Value	2.7	2.7	3.0	2.7	3.5	3.2	3.7	4.3	4.8
Direction of heat flow	Downwards		Downwards and upwards		Upwards				
Note: Altitude means the height above the Australian Height Datum at the location where the building is to be constructed.									

**Explanatory information:**

1. The roof space ventilation option, in *climate zones* 1, 2 and 3, applies to a pitched roof with a flat ceiling to ensure that efficient cross ventilation is achieved in the roof space to remove hot air. Roof space ventilation is generally not suitable for most flat, skillion, cathedral ceiling and similar roof types because of the lack of space between the ceiling and roof.
2. Care should be taken to ensure that the roof *ventilation openings* do not allow rain penetration and that they comply with appropriate bushfire provisions.
3. Gaps between roof tiles with sarking (or *reflective insulation* at rafter level) and metal sheet roofing are not acceptable methods of providing roof space ventilation.
4. Compliance with the ventilation provisions in **3.12.1.2(b)(ii)(B)** may result in the ingress of wind driven rain or fine dust, or stimulate the growth of mould or fungus in the roof enclosure. Consideration should therefore be given to the surrounding environmental features prior to adopting this as an alternative to the roof insulation provisions in **3.12.1.2(b)(i)**.
5. A light coloured roof reduces the flow of heat from solar radiation better than a dark colour roof. A roof with a solar absorptance value of less than 0.55 means the roof is of a light colour such as white, off-white, cream or dull zinc aluminium. Typical absorptance values based on ASTM E903 are as follows.

**Typical Absorptance Values**

Colour	Value
Slate (dark grey)	0.90
Red, green	0.75
Yellow, buff	0.60
Zinc aluminium — dull	0.55
Galvanised steel — dull	0.55



*Typical Absorptance Values— continued*

Colour	Value
Light grey	0.45
Off white	0.35
Light cream	0.30

6. The direction of heat flow in [Table 3.12.1.1](#) is considered to be the predominant direction of heat flow for the hours of occupation of the building. It takes into account the higher rate of occupancy of houses at night time rather than day time.

- (c) A roof that—
- (i) is *required* to achieve a minimum *Total R-Value*; and
  - (ii) has metal sheet roofing fixed to metal purlins, metal rafters or metal battens; and
  - (iii) does not have a ceiling lining or has a ceiling lining fixed directly to those metal purlins, metal rafters or metal battens (see [Figure 3.12.1.1\(b\)](#)),
- must have a thermal break, consisting of a material with an *R-Value* of not less than 0.2, installed between the metal sheet roofing and its supporting member.
- (d) A roof, or roof and associated ceiling, is deemed to have the *Total R-Value required* by [Table 3.12.1.1](#) if it complies with [Figure 3.12.1.1](#).

**Figure 3.12.1.1 TYPICAL INSULATION OPTIONS FOR TYPICAL ROOF AND CEILING CONSTRUCTION**

<i>Climate zones</i>	1, 2 (below 300 m altitude)	2 (at or above 300 m altitude)	3	4	5	6	7	8
Minimum <i>required Total R-Value</i>	2.7	3.0	2.7	3.5	3.2	3.7	4.3	4.8
Direction of heat flow	Downwards	Downwards and upwards		Upwards				
(a) and (b) Flat roof, skillion roof and cathedral ceiling —Unventilated roof space								
Tiled roof (clay or concrete)	<i>Total R-Value</i> of roof and ceiling materials	0.43	0.37		0.37			
	Minimum added <i>R-Value</i> of insulation	2.27	2.63	2.33	3.13	2.83	3.33	3.93
Metal roof	<i>Total R-Value</i> of roof and ceiling materials	0.41	0.35		0.35			
	Minimum added <i>R-Value</i> of insulation	2.29	2.65	2.35	3.15	2.85	3.35	3.95

Figure 3.12.1.1 TYPICAL INSULATION OPTIONS FOR TYPICAL ROOF AND CEILING CONSTRUCTION— continued

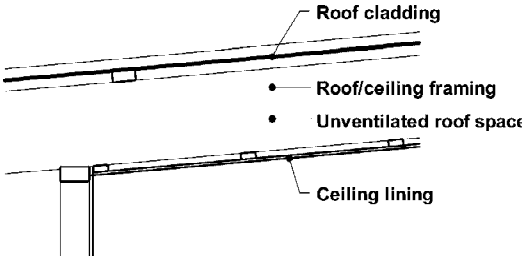
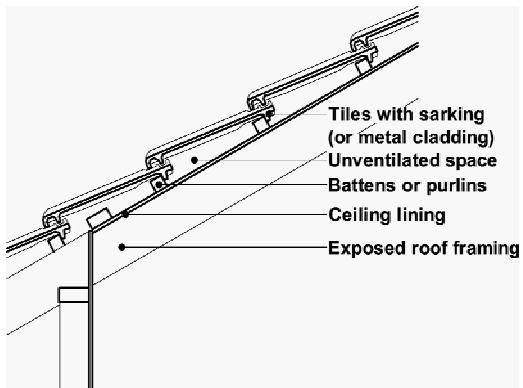
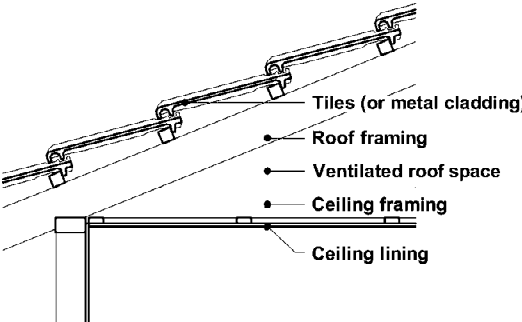
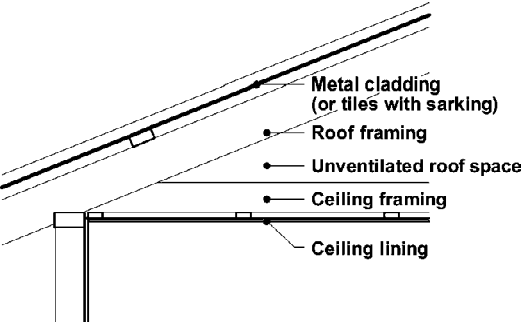
Climate zones	1, 2 (below 300 m altitude)	2 (at or above 300 m altitude)	3	4	5	6	7	8
(a) Flat roof, skillion roof and cathedral ceiling — Ceiling lining under rafters	(b) Flat roof, skillion roof and cathedral ceiling — Exposed rafters							
								
Minimum required Total R-Value	2.7	3.0	2.7	3.5	3.2	3.7	4.3	4.8
Direction of heat flow	Downwards	Downwards and upwards	Upwards					
(c) Pitched roof with flat ceiling — Ventilated roof space								
Tile roof (clay or concrete)	Total R-Value of roof and ceiling materials	0.73	0.22		0.22			
	Minimum added R-Value of insulation	1.97	2.78	2.48	3.28	2.98	3.48	4.08
Metal roof	Total R-Value of roof and ceiling materials	0.71	0.20		0.20			
	Minimum added R-Value of insulation	1.99	2.80	2.50	3.30	3.00	3.50	4.10

Figure 3.12.1.1 TYPICAL INSULATION OPTIONS FOR TYPICAL ROOF AND CEILING CONSTRUCTION— continued

Climate zones		1, 2 (below 300 m altitude)	2 (at or above 300 m altitude)	3	4	5	6	7	8
(d) Pitched roof with flat ceiling — Unventilated roof space									
Tile roof (clay or concrete)	Total R-Value of roof and ceiling materials	0.55	0.40	0.40					
	Minimum added R-Value of insulation	2.15	2.60	2.30	3.10	2.80	3.30	3.90	4.40
Metal roof	Total R-Value of roof and ceiling materials	0.53	0.38	0.38					
	Minimum added R-Value of insulation	2.17	2.62	2.32	3.12	2.82	3.32	3.92	4.42
(c) Pitched roof with flat ceiling —Ventilated roof space					(d) Pitched roof with flat ceiling — Unventilated roof space				
									

**Notes:**

- Altitude means the height in metres above the Australian Height Datum where the building is to be constructed.
- Required** insulation can be installed under the roof cladding, above the ceiling lining or in a combination of both locations.
- The **Total R-Value** of the roof and ceiling construction in **Figure 3.12.1.1** is based on there being a roof space. If the roof space is filled, the roof space **R-Value** needs to be subtracted from the **Total R-Value** of the roof and ceiling materials.
- The **Total R-Value** of the roof and ceiling construction in **Figure 3.12.1.1(d)** for tiled roofs are based on there being **sarking-type material** which would prevent ventilation of the roof space through the gaps in the roof tiles.

**Explanatory information:**

- Typical construction:

**Figures 3.12.1.1, 3.12.1.3 and 3.12.1.4** provide examples of various roofs and ceiling, walls and floors. The **Total R-Value required** is achieved by adding the **Total R-Value** of the basic element, i.e. roof and ceiling, walls or floors, and the **R-Value** of any additional insulation incorporated in that element (described in **Figures 3.12.1.1, 3.12.1.3 and**

**3.12.1.4** as the “minimum added *R-Value* of insulation”). The *Total R-Value* of the basic roof and ceiling has been determined by adding together the *R-Values* of the outdoor air film, roof cladding, roof airspace, ceiling sheet lining and internal film.

2. The *Total R-Value* of the roof and ceiling materials may need to be adjusted if other building elements such as sarking are also installed. For example, sarking or sheet insulation under tiles may change a roof space from “ventilated” to “unventilated”.

3. Thermal bridging:

Irrespective of the framing material used, the minimum added *R-Value* specified in **Figures 3.12.1.1, 3.12.1.3 and 3.12.1.4** is deemed to include the effect of thermal bridging created by framing members in situations other than described in 4.

4. Thermal break:

Because of the high thermal conductance of metal, a thermal break is to be provided where the ceiling lining of a house is fixed directly to the underside of the metal purlins or metal battens of a metal deck roof or where there is no ceiling lining. The purpose of the thermal break is to ensure that the thermal performance of this form of roof construction is comparable to that of a similar roof with timber purlins or timber battens.

A thermal break may be provided by materials such as timber, expanded polystyrene strips, plywood or compressed bulk insulation. The material used as a thermal break must separate the metal purlins or metal battens from the metal deck roofing and achieve the specified *R-Value*. *Reflective insulation* alone is not suitable for use as a thermal break because it requires an adjoining airspace to achieve the specified *R-Value* (see item 6).

For the purposes of **3.12.1.2(c)(ii)**, expanded polystyrene strips of not less than 12 mm thickness, compressed bulk insulation, and timber of not less than 20 mm thickness are considered to achieve an *R-Value* of not less than 0.2.

5. Location of insulation:

The thermal performance of the roof may vary depending on the position of the insulation, the climatic conditions, the design of the house and the way in which it is operated. For example, insulation installed under the roof, rather than on the ceiling, of a conditioned house with a large roof space is less effective because of the additional volume of roof air space that would need to be heated or cooled. Conversely, for an unconditioned house, the use of *reflective insulation* is more effective when placed directly under the roof.

6. Choice of insulation:

There are a number of different insulation products that may be used to achieve the minimum added *R-Value*. However, care should be taken to ensure that the choice made is appropriate for the construction and climatic conditions as the location and relationship between options in **Figures 3.12.1.1, 3.12.1.3 and 3.12.1.4** may not be suitable in all circumstances for both practical and technical reasons. For instance, in some *climate zones*, *insulation* should be installed with due consideration of condensation and associated interaction with adjoining building materials.

*Reflective insulation* and its adjoining airspace is considered to achieve the following *R-Values* when used in conjunction with the *Total R-Value* of a pitched roof and flat ceiling construction described in **Figure 3.12.1.1**. To achieve these values, the *reflective insulation* must be laid directly under the roof cladding and have a minimum airspace of 15 mm between a reflective side of the *Reflective insulation* and the adjoining lining or roof cladding (see **3.12.1.1(b)**).

The actual *R-Value* added by *reflective insulation* and its adjoining airspace should be determined for each product in accordance with the standard prescribed in **3.12.1.1(a)**, which takes into consideration factors such as the number of adjacent airspaces,

dimensions of the adjacent airspace, whether the space is ventilated and the presence of an anti-glare coating. When *reflective insulation* has an anti-glare coating on one side, the emittance value of that side will be greater than the value of the uncoated side.

Also, where another emittance value for *reflective insulation* is used (other than the value used in the table below), care should be taken to ensure that the number of airspaces allowed for is consistent with the form of construction and whether the airspace is reflective, partially reflective or non-reflective. Where bulk insulation fills the airspace, the *Total R-Value* should be reduced to take account of the loss of airspace.

Emittance of added <i>reflective insulation</i>	Direction of heat flow	<i>R-Value</i> added by <i>reflective insulation</i>					
		Pitched roof ( $\geq 10^\circ$ ) with horizontal ceiling		Flat skillion or pitched roof ( $\leq 10^\circ$ ) with horizontal ceiling	Pitched roof with cathedral ceilings		
		Ventilated roof space	Non-ventilated roof space		22° pitch	30° pitch	45° pitch
0.2 outer 0.05 inner	Downwards	1.21	1.12	1.28	0.96	0.86	0.66
0.2 outer 0.05 inner	Upwards	0.59	0.75	0.68	0.72	0.74	0.77
0.9 outer 0.05 inner	Downwards	1.01	0.92	1.06	0.74	0.64	0.44
0.9 outer 0.05 inner	Upwards	0.40	0.55	0.49	0.51	0.52	0.53

**Notes:**

- 1 The direction of heat flow applicable in each climate zones specified in [Table 3.12.1.1](#)
- 2 Ventilated roof space means ventilated at least in accordance with [3.12.1.2\(b\)\(ii\)](#).

- (e) Where, for operational or safety reasons, ceiling insulation cannot be installed at or around exhaust fans or recessed downlights, a reduction of insulation of 1% or more of the ceiling area must be compensated for by proportionately increasing the *R-Value* of insulation in the remainder of the ceiling in accordance with [Table 3.12.1.1a](#).

**Table 3.12.1.1a ADJUSTMENT OF MINIMUM R-VALUE FOR A REDUCTION OF CEILING INSULATION**

Percentage of reduced ceiling insulation of the Building	Additional percentage of the minimum added ceiling insulation <i>required</i> for each <i>climate zone</i>					
	1, 2 and 3	4	5	6	7	8
1% to less than 2%	15%	20%	20%	20%	25%	25%
2% to less than 3%	25%	30%	30%	30%	45%	50%
3% to less than 4%	35%	50%	40%	50%	70%	85%
4% to less than 5%	50%	70%	60%	80%	105%	140%
5% and greater	Not permitted					

**Explanatory information:**

When considering the reduction of insulation because of exhaust fans and recessed downlights, 1% of the ceiling area for a 200 m<sup>2</sup> sized house would permit 2 bathroom

heater-light assemblies, a laundry exhaust fan, a kitchen exhaust fan and either approximately 25 recessed downlights with 100 mm clearance to the insulation or approximately 10 recessed downlights with 200 mm clearance to the insulation.

### 3.12.1.3 Roof lights

- (a) *Roof lights* serving a *habitable room* or an interconnecting space such as a corridor, hallway, stairway or the like—
- (i) if the total area of the *roof lights* is more than 1.5% but not more than 10% of the *floor area* of the room or space, must comply with **Table 3.12.1.2**; or
  - (ii) if the total area of the *roof lights* is more than 10% of the *floor area* of the room or space they serve, may only be used where—
    - (A) compliance with the natural lighting requirements in **3.8.4.2** can only be achieved by a *roof light*; and
    - (B) the transparent and translucent elements of the *roof lights*, including any imperforate ceiling diffuser, achieve—
      - (aa) an *SHGC* of not more than 0.25; and
      - (bb) a *Total U-Value* of not more than 1.3.
- (b) The aggregate area of *roof lights* serving a building must not exceed 3% of the total area of the floor of the storey served.

**Table 3.12.1.2 ROOF LIGHTS — THERMAL PERFORMANCE OF TRANSPARENT AND TRANSLUCENT ELEMENTS**

<i>Roof light</i> shaft index (see Note 1)	Total area of <i>roof lights</i> serving the room or space as a percentage of the <i>floor area</i> of the room or space		
	More than 1.5% and up to 3%	More than 3% and up to 5%	More than 5% and up to 10%
<b>Less than 0.5</b>	<i>SHGC</i> of not more than 0.75 and a <i>Total U-Value</i> of not more than 5.0	<i>SHGC</i> of not more than 0.50 and a <i>Total U-Value</i> of not more than 5.0	<i>SHGC</i> of not more than 0.25 and a <i>Total U-Value</i> of not more than 2.5
<b>0.5 to less than 1.0</b>	<i>Total U-Value</i> of not more than 5.0	<i>SHGC</i> of not more than 0.70 and a <i>Total U-Value</i> of not more than 5.0	<i>SHGC</i> of not more than 0.35 and a <i>Total U-Value</i> of not more than 2.5
<b>1.0 to less than 2.5</b>	<i>Total U-Value</i> of not more than 5.0	<i>Total U-Value</i> of not more than 5.0	<i>SHGC</i> of not more than 0.45 and a <i>Total U-Value</i> of not more than 2.5
<b>2.5 and above</b>	<i>Total U-Value</i> of not more than 5.0	<i>Total U-Value</i> of not more than 5.0	<i>Total U-Value</i> of not more than 2.5

**Notes:**

- The *roof light* shaft index is determined by measuring the distance from the centre of the shaft at the roof to the centre of the shaft at the ceiling level and dividing it by the average internal dimension of the shaft opening at the ceiling level (or the diameter for a circular shaft) in the same units of measurement.

Table 3.12.1.2 ROOF LIGHTS — THERMAL PERFORMANCE OF TRANSPARENT AND TRANSLUCENT ELEMENTS— continued

Roof light shaft index (see Note 1)	Total area of <i>roof lights</i> serving the room or space as a percentage of the <i>floor area</i> of the room or space		
	More than 1.5% and up to 3%	More than 3% and up to 5%	More than 5% and up to 10%
2.	The total area of <i>roof lights</i> is the combined area for all <i>roof lights</i> serving the room or space.		
3.	The area of a <i>roof light</i> is the area of the roof opening that allows light to enter the building.		
4.	The thermal performance of an imperforate ceiling diffuser may be included in the <i>Total U-Value</i> of the <i>roof light</i> .		

**Explanatory information:**

The *SHGC* and *Total U-Values* are expressed as Australian National Average Conditions (ANAC) values, not National Fenestration Rating Council (NFRC).

**3.12.1.4 External walls**

- (a) Each part of an *external wall* must satisfy one of the options in **Table 3.12.1.3**, except for—
- (i) in *climate zones* 1, 2 and 3 south of latitude 20° south, an *external wall* facing the south orientation sector, as described in **Figure 3.12.2.1**; and
  - (ii) opaque non-glazed openings such as doors (including garage doors), vents, penetrations, shutters and the like; and
  - (iii) *glazing*; and
  - (iv) a storey of a building complying with **(b)** or **(c)**.
- (b) In *climate zones* 1 and 2, the requirements of **(a)** do not apply to the storey of a building provided—
- (i) the *external walls* achieve a surface density of not less than 220 kg/m<sup>2</sup>; and
  - (ii) the external surface of the *external walls* achieves a solar absorptance of not more than 0.45; and
  - (iii) the external *glazing* complies with **3.12.2.1** with the applicable value for C<sub>SHGC</sub> in **Table 3.12.2.1** reduced by—
    - (A) 15%, when the *external walls* are shaded with a verandah, balcony, eaves, carport or the like which projects at a minimum angle of 15 degrees in accordance with **Figure 3.12.1.2**; and
    - (B) 25%, when the *external walls* are not shaded in accordance with **(A)** but the floor is concrete slab-on-ground and there is another storey above; and
  - (iv) the *habitable rooms* contain ceiling fans.

**Explanatory information:**

Surface density is the mass of one vertical square metre of wall.

Table 3.12.1.3 — OPTIONS FOR EACH PART OF AN EXTERNAL WALL

Climate zone	Options
1	(a) Achieve a minimum <i>Total R-Value</i> of 1.9.
	(b) (i) Achieve a minimum <i>Total R-Value</i> of 1.4; and (ii) be constructed on a flooring system that is in direct contact with the ground, such as a concrete slab-on-ground or the like.
	(c) For a masonry <i>external wall</i> with a surface density of not less than 220 kg/m <sup>2</sup> , shade the <i>external wall</i> of the storey with a verandah, balcony, eaves, carport or the like, which— (i) for an <i>external wall</i> facing the north and south orientation sectors as described in <b>Figure 3.12.2.1</b> , projects at a minimum angle of 15 degrees; and (ii) for an <i>external wall</i> facing the north east, east, south east, south west, west and north west orientation sectors as described in <b>Figure 3.12.2.1</b> , projects at a minimum angle of 45 degrees, in accordance with <b>Figure 3.12.1.2</b> .
	(d) For a weatherboard, sheet clad or masonry veneer <i>external wall</i> — (i) incorporate reflective insulation with an emittance of not more than 0.05 inwards; and (ii) be constructed on a flooring system that is in direct contact with the ground, such as a concrete slab-on-ground or the like; and (iii) shade the <i>external wall</i> of the storey with a verandah, balcony, eaves, carport or the like which projects at a minimum angle of 15 degrees in accordance with <b>Figure 3.12.1.2</b> .
2 (below 300 m altitude)	(a) Achieve a minimum <i>Total R-Value</i> of 1.9.
	(b) (i) Achieve a minimum <i>Total R-Value</i> of 1.4; and (ii) be constructed on a flooring system that is in direct contact with the ground, such as a concrete slab-on-ground or the like.
	(c) (i) Achieve a surface density of not less than 220 kg/m <sup>2</sup> ; and (ii) shade the <i>external wall</i> of the storey with a verandah, balcony, eave, carport or the like which projects at a minimum angle of 15 degrees in accordance with <b>Figure 3.12.1.2</b> .
	(d) (i) Achieve a surface density of not less than 220 kg/m <sup>2</sup> ; and (ii) be constructed on a flooring system that is in direct contact with the ground, such as a concrete slab-on-ground or the like.



Table 3.12.1.3 — OPTIONS FOR EACH PART OF AN EXTERNAL WALL— continued

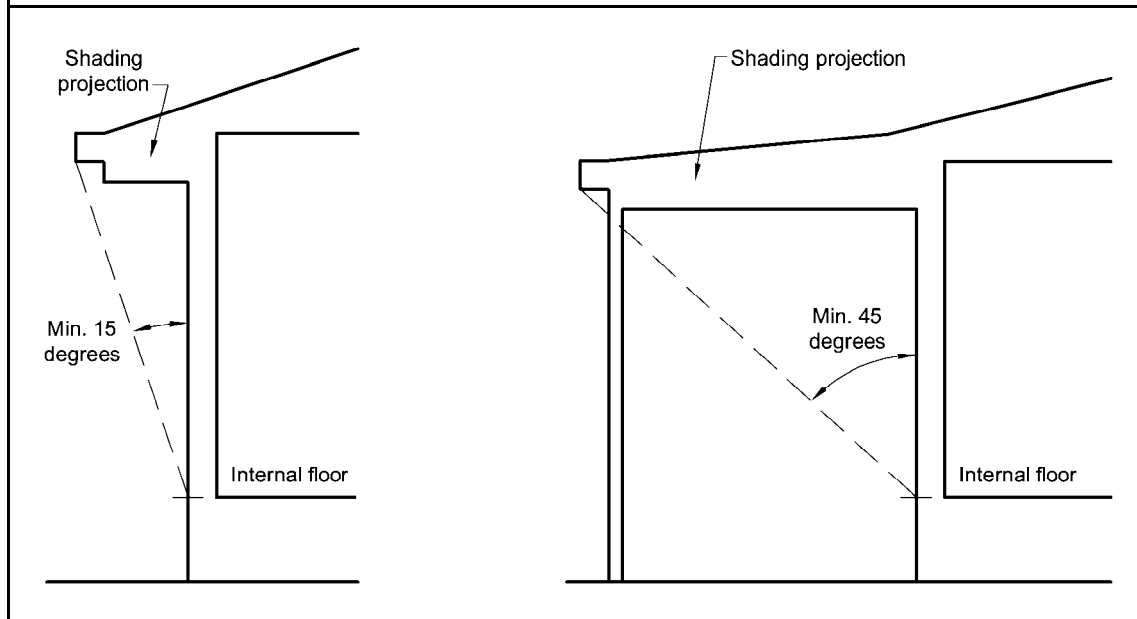
Climate zone	Options
2 (at or above 300 m altitude)	(a) Achieve a minimum <i>Total R-Value</i> of 1.9.
	(b) (i) Achieve a surface density of not less than 220 kg/m <sup>2</sup> ; and (ii) incorporate insulation with an <i>R-Value</i> of not less than 0.5.
	(c) (i) Achieve a surface density of not less than 220 kg/m <sup>2</sup> ; and (ii) be constructed on a flooring system that is in direct contact with the ground, such as a concrete slab-on-ground or the like.
	(d) (i) Achieve a surface density of not less than 220 kg/m <sup>2</sup> ; and (ii) have masonry internal walls.
3	(a) Achieve a minimum <i>Total R-Value</i> of 1.9.
	(b) (i) Achieve a minimum <i>Total R-Value</i> of 1.4; and (ii) be constructed on a flooring system that is in direct contact with the ground, such as a concrete slab-on-ground or the like.
4	(a) Achieve a minimum <i>Total R-Value</i> of 2.2.
	(b) (i) Achieve a surface density of not less than 220 kg/m <sup>2</sup> ; and (ii) incorporate insulation with an <i>R-Value</i> of not less than 0.5
	(c) (i) Achieve a surface density of not less than 220 kg/m <sup>2</sup> ; and (ii) be constructed on a flooring system that is in direct contact with the ground, such as a concrete slab-on-ground or the like.
	(d) (i) Achieve a surface density of not less than 220 kg/m <sup>2</sup> ; and (ii) have masonry internal walls.
5	(a) Achieve a minimum <i>Total R-Value</i> of 1.9.
	(b) (i) Achieve a surface density of not less than 220 kg/m <sup>2</sup> ; and (ii) incorporate insulation with an <i>R-Value</i> of not less than 0.5.
	(c) (i) Achieve a surface density of not less than 220 kg/m <sup>2</sup> ; and (ii) be constructed on a flooring system that is in direct contact with the ground, such as a concrete slab-on-ground or the like.
	(d) (i) Achieve a surface density of not less than 220 kg/m <sup>2</sup> ; and (ii) have masonry internal walls.

Table 3.12.1.3 — OPTIONS FOR EACH PART OF AN EXTERNAL WALL— continued

Climate zone	Options
6	(a) Achieve a minimum <i>Total R-Value</i> of 2.2.
	(b) (i) Achieve a surface density of not less than 220 kg/m <sup>2</sup> ; and
	(ii) incorporate insulation with an <i>R-Value</i> of not less than 0.5; and
	(iii) be constructed on a flooring system that is in direct contact with the ground, such as a concrete slab-on-ground or the like.
	(c) (i) Achieve a surface density of not less than 220 kg/m <sup>2</sup> ; and
	(ii) incorporate insulation with an <i>R-Value</i> of not less than 1.0.
7	(a) Achieve a minimum <i>Total R-Value</i> of 2.4.
	(b) (i) Achieve a surface density of not less than 220 kg/m <sup>2</sup> ; and
	(ii) incorporate insulation with an <i>R-Value</i> of not less than 1.0.
8	(a) Achieve a minimum <i>Total R-Value</i> of 3.3.
	(b) (i) Achieve a surface density of not less than 220 kg/m <sup>2</sup> ; and
	(ii) incorporate insulation with an <i>R-Value</i> of not less than 1.5.

Figure 3.12.1.2

## MEASUREMENT OF A PROJECTION FOR WALL SHADING

**Explanatory information:**

Guttering can be considered as providing shading if attached to a shading projection.

- (c) In *climate zones* 4, 6, 7 and 8, where the minimum *Total R-Value* specified in **Table 3.12.1.3** cannot be achieved by any part of an *external wall* of a storey, the deficit may be compensated by the performance of the *glazing* in that storey, provided the sum of the conductance of the *external walls* and of the *glazing* in that storey is not more than the maximum *required*, where—
- (i) the design conductance is calculated—
    - (A) for the *external walls*, by dividing their areas by their *Total R-Values*; and
    - (B) for the *glazing*, by multiplying its area by its *Total U-Value*; and
  - (ii) the *required* maximum conductance is calculated—
    - (A) for the *external walls*, by dividing their areas by their *required* minimum *Total R-Values*; and
    - (B) for the *glazing*, in accordance with **3.12.2.1(a)(i)**.

#### Explanatory information:

Following is a typical example of the application of **3.12.1.4(c)**:

A single-storey house is to be built in *climate zone* 6 with *external walls* of *cavity* clay masonry on a concrete slab-on-ground floor. This construction could satisfy the requirements of option (b) for *climate zone* 6 in **Table 3.12.1.3** if the walls incorporate insulation with an *R-Value* of not less than 0.5. The owner prefers not to insulate the *cavity* clay masonry and needs to calculate a *Total U-Value* for the *glazing* that ensures the conductance through the proposed design will be no more than through the *required* walls and *glazing*. The area of the *external walls* total 144 m<sup>2</sup> (measured at their internal faces, from floor to ceiling), of which 94 m<sup>2</sup> is *cavity* clay masonry and 50 m<sup>2</sup> is *glazing*. For purposes of *glazing* calculations, the area of the floor of the storey (measured to the internal faces of the bounding walls) is 200 m<sup>2</sup>, and the air movement level is “standard”. (See **Part 3.12.2**.)

**3.12.2.1(a)(i)** *requires* the conductance through the *glazing* to be no more than the area of the floor multiplied by the constant  $C_U$  for *climate zone* 6 ( $200 \text{ m}^2 \times 1.4 = 280$ ). For 50 m<sup>2</sup> of *glazing*, this could be achieved by single clear *glazing* in timber frames ( $50 \text{ m}^2 \times 5.6 = 280$ ). The *Total U-Value* of 5.6 for single clear *glazing* in timber frames is taken from the table of “Worst Case Whole Glazing Element Performance Values” in the explanatory information to **3.12.2.1**. Total conductance through the *cavity* clay masonry walls with R0.5 insulation added would be their area divided by their *Total R-value* ( $94 / [0.68 + 0.5] = 79.7$ ). Total conductance of masonry and *glazing* together is, therefore, *required* to be no more than 280 plus 79.7 (= 359.7).

Total conductance through the proposed *cavity* clay masonry walls without insulation is the area divided by the reduced *Total R-value* ( $94 / 0.68 = 138.2$ ). Conductance through the proposed improved *glazing* cannot exceed the *required* limit less the total conductance through the proposed walls ( $359.7 - 138.2 = 221.5$ ). The owner can calculate the *required* maximum *Total U-value* for the *glazing* by dividing the figure for conductance through the improved *glazing* by the area of *glazing* ( $221.5 / 50 = 4.43$ ). This *Total U-value* can be achieved by clear double-*glazing* in timber frames. Since the actual *Total U-Value* of clear double-*glazing* in timber frames (3.8) is less than the *required Total U-Value* (4.43), the calculations could be fine tuned to allow lower performance *glazing* to be used in some of the *glazing* elements.

- (d) A wall in **Table 3.12.1.3** that—

- (i) has lightweight external cladding such as weatherboards, fibre cement or metal sheeting fixed to the metal frame; and
- (ii) does not have a wall lining or has a wall lining that is fixed directly to the metal frame (see [Figure 3.12.1.3\(a\)](#) and [\(b\)](#)),

must have a thermal break, consisting of a material with an *R-Value* of not less than 0.2, installed between the external cladding and the metal frame.

**Explanatory information:**

1. The thermal performance of metal and timber framed walls is affected by conductive thermal bridging by the framing members and convective thermal bridging at gaps between the framing and any added bulk insulation. Metal framed walls are more prone to conductive thermal bridging than timber framed walls.
2. Because of the high thermal conductance of metal, a thermal break is needed when a metal framing member directly connects the external cladding to the internal lining or the internal environment. The purpose of the thermal break is to ensure that the thermal performance of the metal framed wall is comparable to that of a similarly clad timber framed wall.

A thermal break may be provided by materials such as timber battens, plastic strips or polystyrene insulation sheeting. The material used as a thermal break must separate the metal frame from the cladding and achieve the specified *R-Value*.

For the purposes of [3.12.1.4\(d\)\(ii\)](#), expanded polystyrene strips of not less than 12 mm thickness and timber of not less than 20 mm thickness are deemed to achieve an *R-Value* of not less than 0.2.

The *R-Value* of the thermal break is not included when calculating the *Total R-Value* of the wall, if the thermal break is only applied to the metal frame, because this calculation is done for locations free of framing members.

- (e) A wall is deemed to have the *Total R-Value required* by [Table 3.12.1.3](#) if it complies with [Figure 3.12.1.3](#).

**Figure 3.12.1.3 TYPICAL INSULATION OPTIONS FOR TYPICAL WALL CONSTRUCTION**

<i>Climate zones</i>		1, 2, 3 and 5	4 and 6	7	8
Minimum <i>required Total R-Value</i> for walls		1.9	2.2	2.4	3.3
Typical wall construction <i>R-Values</i>					
(a) Weatherboard	<i>Total R-Value</i> of wall materials	0.47 (including an airspace)			
	Minimum added <i>R-Value</i> of insulation	1.43	1.73	1.93	2.83

Figure 3.12.1.3 TYPICAL INSULATION OPTIONS FOR TYPICAL WALL CONSTRUCTION— continued

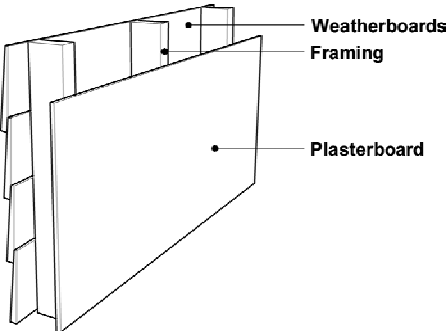
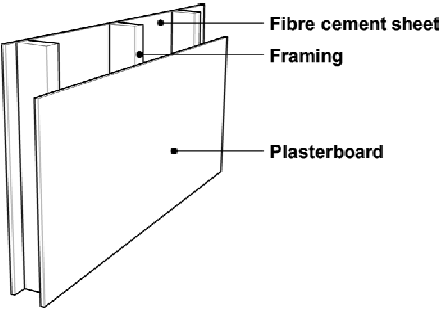
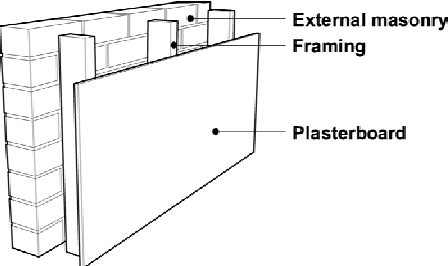
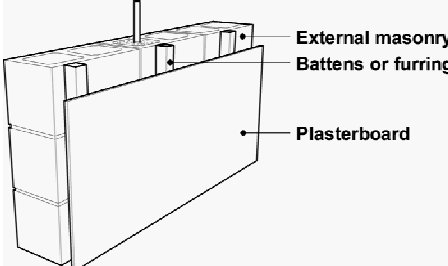
Climate zones		1, 2, 3 and 5	4 and 6	7	8
Minimum <i>required Total R-Value</i> for walls		1.9	2.2	2.4	3.3
Typical wall construction <i>R-Values</i>					
(b) Cement or metal sheet	<i>Total R-Value</i> of wall materials	0.41 (including an airspace)			
	Minimum added <i>R-Value</i> of insulation	1.49	1.79	1.99	2.89
(c) Clay masonry veneer (minimum 110 mm external masonry)	<i>Total R-Value</i> of wall materials	0.55 (including an airspace)			
	Minimum added <i>R-Value</i> of insulation	1.35	1.65	1.85	2.75
(d) Concrete blockwork masonry (minimum 140 mm masonry)	<i>Total R-Value</i> of wall materials	0.53 (including an airspace)			
	Minimum added <i>R-Value</i> of insulation	1.37	1.67	1.87	2.77
(a) Weatherboard		(b) Cement sheet			
					
(c) Clay masonry veneer		(d) Concrete blockwork masonry			
					

Figure 3.12.1.3 TYPICAL INSULATION OPTIONS FOR TYPICAL WALL CONSTRUCTION— continued

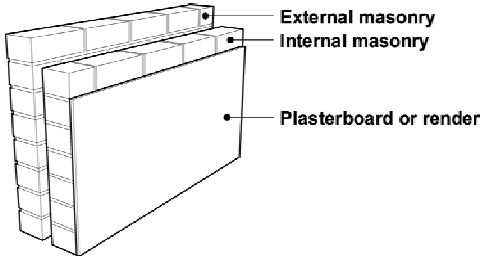
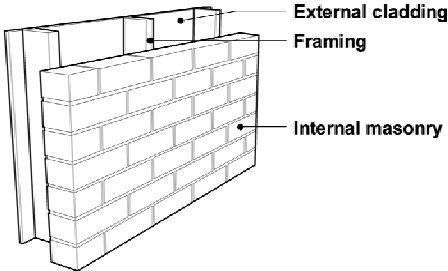
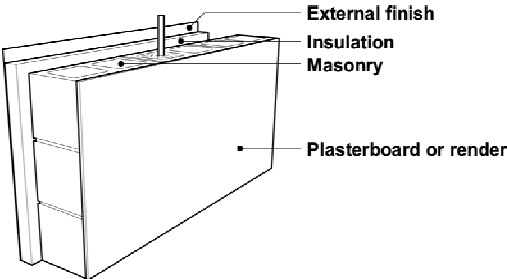
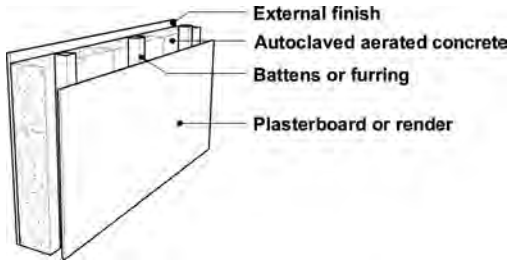
Climate zones		1, 2, 3 and 5	4 and 6	7	8
Minimum <b>required Total R-Value</b> for walls		1.9	2.2	2.4	3.3
Typical wall construction <b>R-Values</b>					
(e) <b>Cavity clay masonry</b> (minimum 110 mm external, minimum 90 mm internal)	<b>Total R-Value</b> of wall materials	0.68 (including an airspace)			
	Minimum added <b>R-Value</b> of insulation	1.22	1.52	1.72	2.62
(f) <b>Externally insulated clay masonry</b> (minimum 110 mm masonry)	<b>Total R-Value</b> of wall materials	0.52 (including an airspace)			
	Minimum added <b>R-Value</b> of insulation	1.38	1.68	1.88	2.78
(g) <b>Externally insulated concrete masonry</b> (minimum 140 mm masonry)	<b>Total R-Value</b> of wall materials	0.45 (including an airspace)			
	Minimum added <b>R-Value</b> of insulation	1.45	1.75	1.95	2.85
(h) <b>Autoclaved aerated concrete masonry</b> (minimum 200 mm thick, minimum 350 kg/m <sup>3</sup> density)	<b>Total R-Value</b> of wall materials	2.41 (including an airspace)			
	Minimum added <b>R-Value</b> of insulation	Nil	Nil	Nil	0.89
(e) <b>Cavity clay masonry</b> 		(f) <b>Externally insulated clay masonry</b> 			

Figure 3.12.1.3 TYPICAL INSULATION OPTIONS FOR TYPICAL WALL CONSTRUCTION— continued

Climate zones	1, 2, 3 and 5	4 and 6	7	8
Minimum <b>required Total R-Value</b> for walls	1.9	2.2	2.4	3.3
Typical wall construction <b>R-Values</b>				
<b>(g) Externally insulated concrete masonry</b> 		<b>(h) Autoclaved aerated concrete masonry</b> 		

**Explanatory information:**

- Figure 3.12.1.3** provides examples of typical types of wall construction. The **Total R-Value required** is achieved by adding the **R-Value** of the basic wall and the **R-Value** of any additional insulation incorporated. The **Total R-Value** of the basic typical wall construction has been arrived at by adding together the **R-Values** for outdoor air film, wall cladding or veneer, wall **cavity** or airspace, internal lining and internal air film. Where a **cavity** or airspace is filled the **Total R-Value** should be reduced by 0.17 to take account of the loss of the **cavity** or airspace.
- Reflective insulation** with one reflective surface having an emittance and direction as indicated, is considered to achieve the following **R-Values** when used in conjunction with the **Total R-Value** of a wall construction, as described in **Figure 3.12.1.3**. The actual **R-Value** added by **reflective insulation** should be determined for each product in accordance with the standard prescribed in **3.12.1.1(a)**, which takes into consideration factors such as the number of adjacent air spaces, dimensions of the adjacent airspace, whether the airspace is ventilated and the presence of an anti-glare coating.

Wall construction	Reflective air space details	<b>R-Value</b> added by <b>reflective insulation</b>
Concrete or masonry with internal plasterboard on battens	One 20 mm reflective airspace located between <b>reflective insulation</b> (of not more than 0.05 emittance inwards) and plasterboard	0.48
<b>External wall</b> cladding (70 mm timber frame with internal lining)	One 70 mm reflective airspace located between <b>reflective insulation</b> (of not more than 0.05 emittance inwards) and plasterboard	0.43

— continued

Wall construction	Reflective air space details	R-Value added by reflective insulation
Masonry veneer (70 mm timber frame with internal lining)	a. One 70 mm reflective airspace located between <i>reflective insulation</i> and plasterboard; and b. One 25 mm anti-glare airspace located between <i>reflective insulation</i> (of not more than 0.2 emittance outwards) and masonry	0.95
<i>Cavity</i> masonry	a. No airspace between the <i>reflective insulation</i> and the inner leaf of masonry; and b. One 35 mm anti-glare airspace located between <i>reflective insulation</i> (of not more than 0.2 emittance outwards) and the outer leaf of masonry	0.50

3. For further information on *reflective insulation*, refer to the explanatory information following **Figure 3.12.1.1**.

4. Walls with a surface density of 220 kg/m<sup>2</sup> or more are deemed to achieve acceptable levels of thermal performance in certain *climate zones* due to their ability to store heat and therefore slow the heat transfer through the building *fabric*. These walls are defined by surface density (kg/m<sup>2</sup>), which is the mass of one vertical square metre of wall, in order to reduce the complexity when measuring the mass of walls with voids.

The following are examples of some typical wall constructions that achieve a surface density of 220 kg/m<sup>2</sup>:

- (a) Two leaves each of 90 mm thick or greater clay or concrete masonry.
- (b) 140 mm thick or greater dense-weight hollow concrete or clay blocks with—
  - (i) 10 mm plasterboard or render; and
  - (ii) at least one concrete grouted horizontal bond beam; and
  - (iii) vertical cores filled with concrete grout at centres not exceeding 1000 mm.
- (c) 140 mm thick or greater concrete wall panels and dense-weight hollow concrete or clay blocks with all vertical cores filled with concrete grout.
- (d) 190 mm thick or greater dense-weight hollow concrete or clay blocks with—
  - (i) at least one concrete grouted horizontal bond beam; and
  - (ii) vertical cores filled with concrete grout at centres not exceeding 1800 mm.
- (e) Earth-wall construction with a minimum wall thickness of 200 mm.



### 3.12.1.5 Floors

- (a) A suspended floor, other than an intermediate floor in a building with more than one storey—
- (i) must achieve the *Total R-Value* specified in **Table 3.12.1.4** for the downwards direction of heat flow; and
  - (ii) with an in-slab heating or cooling system, must be insulated around the vertical edge of its perimeter and underneath the slab with insulation having an *R-Value* of not less than 1.0.

**Table 3.12.1.4 SUSPENDED FLOOR – MINIMUM TOTAL R-VALUE**

<i>Climate zone</i>	4	6	7	8	4	6	7	8
Perimeter treatment	Enclosed				Unenclosed			
Minimum <i>Total R-Value</i>	1.0	1.0	1.5	2.0	2.0	2.0	2.5	3.0

**Explanatory information:**



1. An enclosed perimeter means that the area beneath the floor is enclosed by ground-to-floor cladding such as masonry or fibre cement sheet. Air movement between the area beneath the floor and any wall cavities should also be prevented by flashing or the like.
2. The ground-to-floor cladding can have the *required* sub-floor vents and still be considered enclosed.
3. An under-tile or in-screed heating system in a bathroom, amenity area or the like, is not considered to be an in-slab system.

- (b) A floor is deemed to have the *Total R-Value required* by (a)(i) for the relevant *climate zone* if it complies with the appropriate construction in **Figure 3.12.1.4**.

**Figure 3.12.1.4 TYPICAL INSULATION OPTIONS FOR TYPICAL SUSPENDED FLOOR CONSTRUCTION (for a floor without a floor heating system)**

<i>Climate zone</i>	4	6	7	8	4	6	7	8
Perimeter treatment	Enclosed				Unenclosed			
Minimum <i>required Total R-Value</i>	1.0	1.0	1.5	2.0	2.0	2.0	2.5	3.0
(a) Suspended timber floor								
<i>Total R-Value of floor materials</i>	0.7							
Minimum <i>R-Value of insulation</i>	0.3	0.3	0.8	1.3	1.3	1.3	1.8	2.3

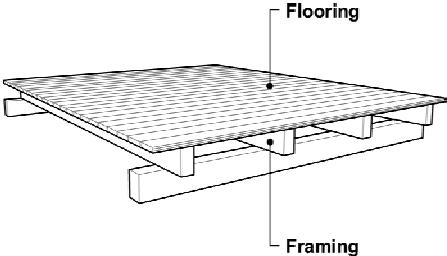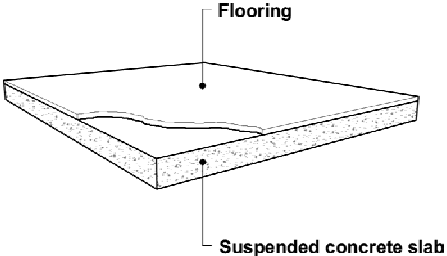Figure 3.12.1.4 TYPICAL INSULATION OPTIONS FOR TYPICAL SUSPENDED FLOOR CONSTRUCTION (for a floor without a floor heating system)— continued

Climate zone	4	6	7	8	4	6	7	8
(b)	Suspended concrete slab							
Total R-Value of floor materials	0.65							
Minimum R-Value of insulation	0.35	0.35	0.85	1.35	1.35	1.35	1.85	2.35
(a) Suspended timber floor				(b) Suspended concrete floor				
								

#### Explanatory information:

- Figure 3.12.1.4 provides examples of two typical types of suspended floor construction. The **Total R-Value required** is achieved by adding the **R-Value** of the basic floor and the **R-Value** of any additional insulation that is incorporated. It also includes an allowance for floor coverings.
- Any non-reflective building membrane fixed between or under floor joists is considered to add an **R-Value** of 0.2 to the **Total R-Value** of the base construction described in Figure 3.12.1.4. **Reflective insulation** will achieve a higher value and will need to be determined for each product in accordance with AS/NZS 4859.1.
- A reflective or non-reflective building membrane should be installed with due consideration of condensation in some **climate zones** and associated interaction with adjoining building materials.
- For further information on **reflective insulation**, refer to the explanatory information accompanying Figure 3.12.1.1.


- (c) A concrete slab-on-ground—
- with an in-slab heating or cooling system; or
  - in **climate zone** 8,
- must have insulation installed around the vertical edge of its perimeter.
- (d) Insulation **required** by (c) must—
- have an **R-Value** of not less than 1.0; and
  - be water resistant; and
  - be continuous from the adjacent finished ground level—
- (A) to a depth of 300 mm; or

- (B) for the full depth of the vertical edge of the concrete slab-on-ground (see [Figure 3.12.1.5](#)).

#### Explanatory information:

An under-tile or in-screed heating system in a bathroom, amenity area or the like, is not considered to be an in-slab heating system.

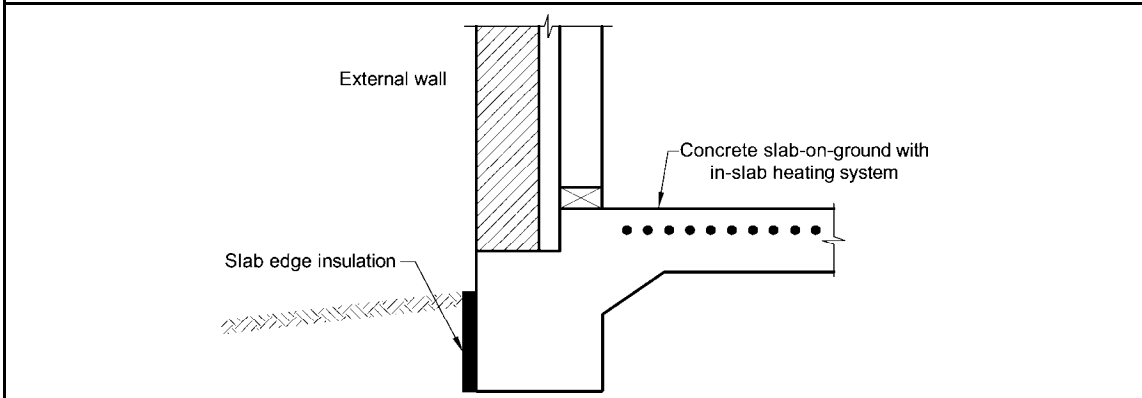**Figure 3.12.1.5**  
**INSULATION OF SLAB EDGE**



#### Explanatory information:

Care should be taken to ensure that the type of termite management system selected is compatible with the slab edge insulation.

### 3.12.1.6 Attached Class 10a buildings

A Class 10a building attached to a Class 1 building must—

- (a) have an external *fabric* that achieves the *required* level of thermal performance for a Class 1 building; or
- (b) be separated from the Class 1 building with construction having the *required* level of thermal performance for the Class 1 building; or
- (c) in *climate zones* 4 and 5—
  - (i) be enclosed with masonry walls other than where there are doors and *glazing*; and
  - (ii) be separated from the Class 1 building with a masonry wall that extends to the ceiling; and
  - (iii) achieve a *Total R-Value* in the roof equivalent to that *required* by [Table 3.12.1.1](#) for the Class 1 building.

#### Explanatory information:

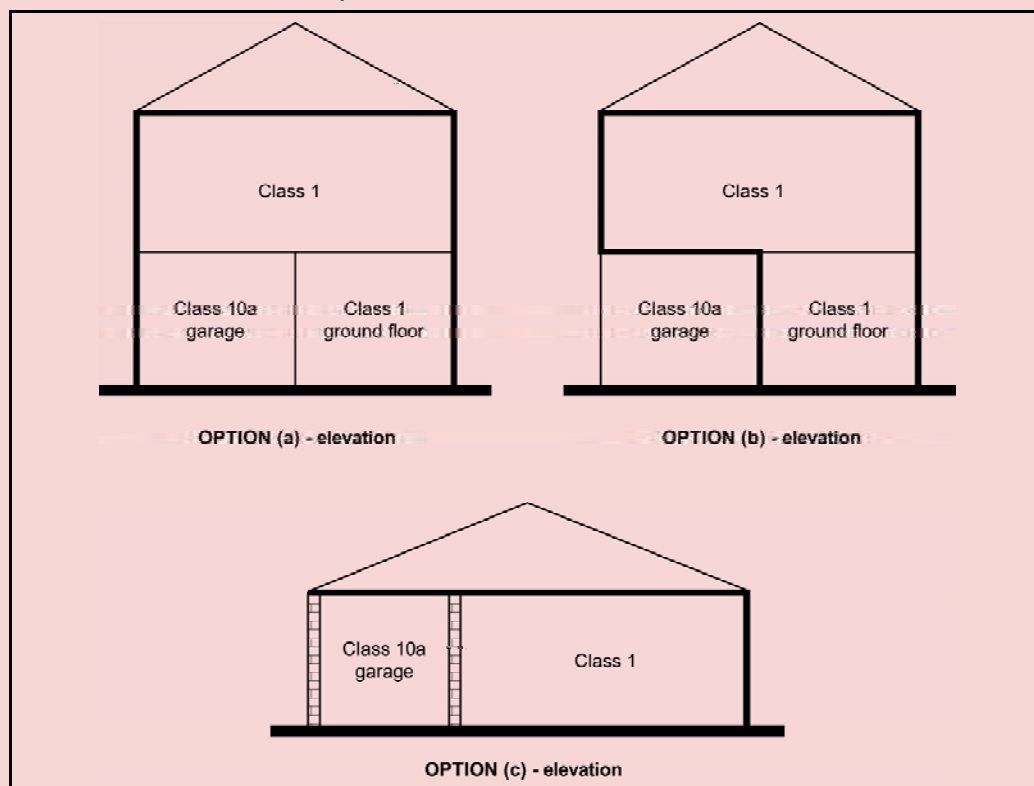
The attachment of a Class 10a building, such as a garage, glasshouse, solarium, pool enclosure or the like should not compromise the thermal performance of the Class 1 building. In addition, the Class 10a building may be insulated and so assist the Class 1 building achieve the *required* thermal performance.

The following are examples of a Class 1 building with an attached Class 10a garage.

In **(a)**, the thermal performance *required* for the Class 1 building may be achieved by the outside walls and floor of the Class 10a garage.

In **(b)**, the thermal performance *required* for the Class 1 building may be achieved by the walls and floor of the Class 1 building as if the Class 10a garage is an under floor space with an enclosed perimeter.

In **(c)**, in *climate zones* 4 and 5, the thermal performance of the Class 1 building may be achieved by ensuring that the roof of the Class 10a building satisfies **Table 3.12.1.1** and the walls are of masonry construction.



## PART 3.12.2 EXTERNAL GLAZING

### 3.12.2 Application

This Part applies to—

- (a) a Class 1 building; and
- (b) a Class 10a building with a *conditioned space*.

#### Acceptable construction practice

#### 3.12.2.1 External glazing

- (a) The aggregate conductance and the aggregate solar heat gain of the *glazing* in each storey, including any mezzanine, of a building must not exceed the allowances obtained by multiplying the area of the floor of the storey, including any mezzanine, measured within the enclosing walls, by—
  - (i) for conductance, the constant  $C_U$ ; and
  - (ii) for solar heat gain, the constant  $C_{SHGC}$ ,  
obtained from [Table 3.12.2.1](#).

**Table 3.12.2.1 CONSTANTS FOR CONDUCTANCE AND SOLAR HEAT GAIN**

Floor construct'n	Air Movement (refer notes)	Constant	Climate zone							
			1	2	3	4	5	6	7	8
Floor in direct contact with the ground	Standard	$C_U$	2.4	2.5	1.6	1.2	2.2	1.4	1.4	0.7
		$C_{SHGC}$	0.09	0.15	0.10	0.13	0.17	0.19	0.26	0.32
	High	$C_U$	2.4	2.5	1.6	1.2	2.2	1.4	1.4	0.7
		$C_{SHGC}$	0.10	0.17	0.11	0.15	0.20	0.22	0.30	0.37
Suspended floor	Standard	$C_U$	2.4	2.5	1.6	1.2	2.2	1.1	1.1	0.7
		$C_{SHGC}$	0.07	0.11	0.08	0.09	0.13	0.19	0.26	0.32
	High	$C_U$	2.4	2.5	1.6	1.2	2.2	1.1	1.1	0.7
		$C_{SHGC}$	0.08	0.13	0.09	0.10	0.15	0.22	0.30	0.37

Notes:

- A storey has Standard air movement if it complies with [3.12.4.1](#).
- A storey has High air movement if the total *ventilation opening* area serving the *habitable rooms* is not less than twice that required by [3.12.4.1](#).
- Where the *ventilation opening* area serving the *habitable rooms* is between Standard and High, interpolation may be used to determine the applicable  $C_{SHGC}$ .

**Explanatory information:**

1. A floor in direct contact with the ground includes a concrete slab-on-ground or concrete slab-on-fill.
  2. A suspended floor includes a suspended timber floor, suspended steel framed floor or suspended concrete floor.
  3. In general, a floor in direct contact with the ground more readily assimilates solar heat gains than a suspended floor. Consequently, lower stringency levels apply to *glazing* in a storey that has a floor in direct contact with the ground.
  4. Whether a storey has Standard or High air movement depends upon the total *ventilation opening* area provided to *habitable rooms* on that storey. For example, in *climate zone 2*, a storey with ceiling fans in every habitable room reaches Standard air movement when the *ventilation opening* area serving each *habitable room* is 5% of the floor area of that room (refer **3.12.4.1**). The same storey achieves High air movement when it has an additional *ventilation opening* area of the same amount (in this case, 5% of the total floor area of the *habitable rooms*). The additional *ventilation opening* area can be distributed to any of the *habitable rooms* on the storey.
- (b) The aggregate conductance and the aggregate solar heat gain of the *glazing* in each storey of a building must be calculated by adding the conductance and solar heat gain of each *glazing* element in accordance with the following formulae:

(i) For conductance—

$$(A_1 \times U_1) + (A_2 \times U_2) + (A_3 \times U_3) + \dots$$

where—

$A_{1, 2, \text{ etc}}$  = the area of each *glazing* element; and

$U_{1, 2, \text{ etc}}$  = the *Total U-Value* of each *glazing* element; and

(ii) For solar heat gain—

$$(A_1 \times SHGC_1 \times E_1) + (A_2 \times SHGC_2 \times E_2) + (A_3 \times SHGC_3 \times E_3) + \dots$$

where—

$A_{1, 2, \text{ etc}}$  = the area of each *glazing* element; and

$SHGC_{1, 2, \text{ etc}}$  = the *SHGC* of each *glazing* element; and

$E_{1, 2, \text{ etc}}$  = the solar exposure factor for each *glazing* element obtained from **Table 3.12.2.2**.

**Explanatory information:**

1. By referring to “*glazing* elements”, **3.12.2.1** requires *Total U-Values* and *SHGCs* to be assessed for the combined effect of glass and frames. The measurement of these *Total U-Values* and *SHGCs* is specified in the Technical Protocols and Procedures Manual for Energy Rating of Fenestration Products by the Australian Fenestration Rating Council (AFRC).
2. *Total U-Values* and *SHGCs* are shown for some simple types of *glazing* elements in the table below. (Smaller numbers indicate better *glazing* element performance). The table

gives worst case assessments, which can be improved by obtaining generic or custom product assessments from suppliers, manufacturers, industry associations (including their online resources) and from competent assessors.

#### WORST CASE WHOLE GLAZING ELEMENT PERFORMANCE VALUES

Glass description	Aluminium framing		Timber or uPVC framing	
	<i>Total U-Value</i>	<i>SHGC</i>	<i>Total U-Value</i>	<i>SHGC</i>
Single clear	7.9	0.81	5.6	0.77
Tinted single	7.9	0.65	5.6	0.61
Clear double (3/6/3)	6.2	0.72	3.8	0.68

3. Typical ranges of generic ratings are set out in the table below to illustrate the levels of performance available through such assessments. Numbers from this table should not be used in compliance calculations.

#### INDICATIVE RANGES OF WHOLE GLAZING ELEMENT PERFORMANCE VALUES

Glass description	Comment	Aluminium framing		Timber or uPVC framing	
		<i>Total U-Value</i> range	<i>SHGC</i> range	<i>Total U-Value</i> range	<i>SHGC</i> range
Single (monolithic or laminated)					
Clear	Minimal variation in glass U-Value and <i>SHGC</i> for different glass thicknesses.	7.9 - 5.5	0.81 – 0.64	5.6 – 4.3	0.77 – 0.51
Tinted	Glass <i>SHGC</i> depends on glass thickness and type of tint.	7.9 – 5.6	0.65 – 0.33	5.6 – 4.3	0.61 – 0.25
Coated	Glass U-Value and <i>SHGC</i> depend on coating type.	7.8 – 3.8	0.68 – 0.36	5.5 – 2.9	0.64 – 0.27
Tinted + coated	Glass U-Value depends on coating type. Glass <i>SHGC</i> depends on coating type, type of tint and glass thickness.	7.8 – 3.8	0.45 – 0.31	5.5 – 3.1	0.42 – 0.23
Double					
Clear	Glass U-Value depends on cavity width.	6.2 – 3.1	0.72 – 0.63	3.8 – 2.5	0.68 – 0.47

INDICATIVE RANGES OF WHOLE GLAZING ELEMENT PERFORMANCE VALUES					
Glass description	Comment	Aluminium framing		Timber or uPVC framing	
		<i>Total U-Value</i> range	<i>SHGC</i> range	<i>Total U-Value</i> range	<i>SHGC</i> range
Single (monolithic or laminated)					
Tinted	Glass U-Value depends on cavity width. Glass <i>SHGC</i> depends on type of tint, tinted glass thickness and on <i>cavity</i> width.	6.2 – 3.1	0.57 – 0.36	3.8 – 2.5	0.57 – 0.27
Coated	Glass U-Value depends on cavity width and type of coating. Glass <i>SHGC</i> depends on type of coating and cavity width.	6.1 – 2.4	0.60 – 0.22	3.8 – 2.1	0.59 – 0.17
Tinted + Coated	Glass U-Value depends on cavity width and type of coating. Glass <i>SHGC</i> depends on type of coating, tinted glass thickness and cavity width.	6.1 – 2.5	0.41 – 0.21	3.8 – 2.1	0.37 – 0.16

4. Custom assessments consider *glazing* element components in most detail and return the highest levels of assessed performance for a given type of *glazing* element. Generic assessments consider the components of *glazing* elements in less detail and return lower levels of assessed performance.

Table 3.12.2.2 SOLAR EXPOSURE FACTOR (E)

P/H (refer <a href="#">Figure 3.12.2.2</a> )	Orientation Sector (refer <a href="#">Figure 3.12.2.1</a> )							
	North	North east	East	South east	South	South west	West	North west
<b>CLIMATE ZONE 1</b>								
<b>0.00</b>	0.52	0.84	1.29	1.24	0.87	1.27	1.32	0.85
<b>0.05</b>	0.44	0.74	1.19	1.13	0.75	1.17	1.23	0.75
<b>0.10</b>	0.41	0.68	1.11	1.07	0.68	1.09	1.15	0.69
<b>0.15</b>	0.39	0.64	1.06	1.00	0.61	1.02	1.08	0.64
<b>0.20</b>	0.37	0.59	1.01	0.94	0.55	0.94	1.00	0.60
<b>0.25</b>	0.35	0.56	0.95	0.88	0.52	0.89	0.96	0.57
<b>0.30</b>	0.33	0.52	0.90	0.82	0.48	0.85	0.92	0.53



Table 3.12.2.2 SOLAR EXPOSURE FACTOR (E) — continued

P/H (refer <a href="#">Figure 3.12.2.2</a> )	Orientation Sector (refer <a href="#">Figure 3.12.2.1</a> )							
	North	North east	East	South east	South	South west	West	North west
0.35	0.32	0.49	0.84	0.76	0.45	0.80	0.88	0.50
0.40	0.30	0.45	0.79	0.69	0.42	0.75	0.83	0.47
0.50	0.27	0.41	0.72	0.64	0.38	0.67	0.75	0.42
0.60	0.25	0.37	0.66	0.59	0.34	0.60	0.66	0.38
0.70	0.24	0.34	0.59	0.53	0.32	0.56	0.62	0.35
0.80	0.22	0.31	0.53	0.47	0.30	0.52	0.58	0.32
0.90	0.20	0.28	0.49	0.44	0.27	0.48	0.53	0.30
1.00	0.19	0.26	0.45	0.41	0.25	0.43	0.48	0.28
1.10	0.18	0.24	0.41	0.37	0.23	0.41	0.45	0.27
1.20	0.18	0.23	0.37	0.33	0.22	0.39	0.42	0.26
1.30	0.17	0.22	0.35	0.32	0.22	0.36	0.40	0.24
1.40	0.17	0.21	0.32	0.30	0.22	0.32	0.37	0.22
1.50	0.16	0.20	0.30	0.28	0.20	0.31	0.36	0.22
1.60	0.15	0.18	0.28	0.26	0.18	0.29	0.34	0.21
1.70	0.14	0.18	0.28	0.24	0.18	0.29	0.32	0.20
1.80	0.13	0.18	0.27	0.22	0.17	0.28	0.30	0.18
1.90	0.13	0.18	0.25	0.22	0.17	0.26	0.29	0.17
2.00	0.12	0.17	0.23	0.21	0.16	0.24	0.28	0.17
<b>CLIMATE ZONE 2</b>								
0.00	0.72	1.05	1.22	1.04	0.72	1.12	1.34	1.11
0.05	0.60	0.92	1.10	0.92	0.60	1.01	1.23	0.99
0.10	0.55	0.85	1.04	0.86	0.57	0.94	1.14	0.90
0.15	0.51	0.79	0.98	0.81	0.53	0.89	1.07	0.84
0.20	0.47	0.74	0.92	0.76	0.50	0.84	1.00	0.78
0.25	0.45	0.69	0.87	0.72	0.47	0.80	0.96	0.73
0.30	0.43	0.65	0.83	0.68	0.45	0.76	0.92	0.69
0.35	0.41	0.60	0.78	0.65	0.43	0.72	0.87	0.64
0.40	0.39	0.56	0.73	0.61	0.40	0.67	0.83	0.60
0.50	0.36	0.50	0.67	0.55	0.37	0.61	0.75	0.53
0.60	0.33	0.44	0.60	0.49	0.33	0.55	0.67	0.45
0.70	0.31	0.40	0.55	0.45	0.31	0.51	0.62	0.42
0.80	0.29	0.37	0.50	0.41	0.29	0.46	0.58	0.39

Table 3.12.2.2 SOLAR EXPOSURE FACTOR (E) — continued

P/H (refer <a href="#">Figure 3.12.2.2</a> )	Orientation Sector (refer <a href="#">Figure 3.12.2.1</a> )							
	North	North east	East	South east	South	South west	West	North west
0.90	0.27	0.34	0.46	0.38	0.27	0.43	0.52	0.35
1.00	0.26	0.30	0.43	0.35	0.24	0.40	0.47	0.32
1.10	0.24	0.29	0.39	0.33	0.23	0.37	0.44	0.30
1.20	0.23	0.27	0.35	0.30	0.22	0.34	0.41	0.28
1.30	0.22	0.26	0.34	0.29	0.22	0.32	0.39	0.26
1.40	0.21	0.24	0.32	0.28	0.21	0.30	0.36	0.24
1.50	0.20	0.24	0.30	0.26	0.20	0.29	0.33	0.23
1.60	0.19	0.23	0.28	0.25	0.19	0.27	0.31	0.22
1.70	0.18	0.22	0.26	0.23	0.18	0.26	0.29	0.21
1.80	0.17	0.20	0.24	0.22	0.17	0.26	0.28	0.20
1.90	0.17	0.19	0.23	0.21	0.17	0.24	0.27	0.19
2.00	0.17	0.19	0.22	0.21	0.16	0.22	0.27	0.19
<b>CLIMATE ZONE 3</b>								
0.00	0.56	1.04	1.42	1.18	0.66	1.16	1.36	1.01
0.05	0.47	0.94	1.32	1.08	0.57	1.05	1.26	0.90
0.10	0.44	0.85	1.25	1.02	0.54	0.99	1.19	0.83
0.15	0.41	0.79	1.17	0.96	0.50	0.93	1.13	0.78
0.20	0.38	0.73	1.10	0.90	0.46	0.87	1.06	0.73
0.25	0.36	0.69	1.05	0.85	0.44	0.83	1.00	0.68
0.30	0.35	0.64	0.99	0.81	0.42	0.79	0.95	0.64
0.35	0.34	0.60	0.93	0.76	0.40	0.75	0.90	0.60
0.40	0.32	0.56	0.88	0.71	0.38	0.72	0.84	0.56
0.50	0.30	0.49	0.81	0.65	0.35	0.64	0.77	0.50
0.60	0.28	0.43	0.74	0.58	0.31	0.57	0.71	0.44
0.70	0.26	0.39	0.67	0.53	0.29	0.53	0.65	0.40
0.80	0.24	0.35	0.59	0.47	0.27	0.50	0.60	0.35
0.90	0.22	0.32	0.54	0.44	0.25	0.46	0.56	0.32
1.00	0.20	0.29	0.50	0.40	0.24	0.43	0.53	0.29
1.10	0.20	0.28	0.46	0.37	0.22	0.40	0.48	0.28
1.20	0.19	0.26	0.42	0.34	0.21	0.37	0.43	0.26
1.30	0.18	0.24	0.39	0.33	0.20	0.35	0.42	0.25
1.40	0.17	0.22	0.35	0.31	0.20	0.32	0.41	0.23

Table 3.12.2.2 SOLAR EXPOSURE FACTOR (E) — continued

P/H (refer <a href="#">Figure 3.12.2.2</a> )	Orientation Sector (refer <a href="#">Figure 3.12.2.1</a> )							
	North	North east	East	South east	South	South west	West	North west
1.50	0.17	0.21	0.34	0.29	0.18	0.32	0.38	0.22
1.60	0.17	0.20	0.33	0.27	0.16	0.31	0.35	0.21
1.70	0.16	0.19	0.31	0.25	0.16	0.29	0.34	0.20
1.80	0.15	0.19	0.30	0.24	0.16	0.28	0.33	0.19
1.90	0.15	0.18	0.28	0.24	0.15	0.26	0.30	0.18
2.00	0.15	0.18	0.25	0.24	0.15	0.24	0.27	0.17
<b>CLIMATE ZONE 4</b>								
0.00	0.72	1.19	1.40	1.05	0.57	0.99	1.31	1.12
0.05	0.61	1.10	1.31	0.97	0.49	0.91	1.22	1.02
0.10	0.56	1.00	1.24	0.91	0.46	0.85	1.17	0.94
0.15	0.49	0.94	1.18	0.86	0.44	0.81	1.11	0.87
0.20	0.43	0.87	1.12	0.82	0.41	0.76	1.05	0.81
0.25	0.40	0.82	1.07	0.78	0.39	0.73	1.00	0.76
0.30	0.37	0.76	1.02	0.74	0.38	0.69	0.95	0.71
0.35	0.33	0.71	0.97	0.71	0.36	0.66	0.90	0.66
0.40	0.30	0.66	0.92	0.67	0.34	0.62	0.85	0.62
0.50	0.29	0.58	0.83	0.61	0.31	0.58	0.79	0.53
0.60	0.27	0.50	0.74	0.56	0.29	0.53	0.72	0.45
0.70	0.26	0.44	0.68	0.52	0.27	0.49	0.66	0.40
0.80	0.24	0.38	0.63	0.49	0.25	0.45	0.59	0.36
0.90	0.22	0.35	0.59	0.46	0.23	0.42	0.55	0.33
1.00	0.20	0.31	0.55	0.42	0.22	0.39	0.51	0.30
1.10	0.20	0.29	0.50	0.39	0.21	0.37	0.48	0.27
1.20	0.19	0.26	0.46	0.37	0.20	0.35	0.45	0.25
1.30	0.17	0.24	0.43	0.35	0.18	0.34	0.41	0.23
1.40	0.16	0.23	0.39	0.34	0.17	0.33	0.38	0.21
1.50	0.16	0.21	0.38	0.32	0.17	0.31	0.35	0.21
1.60	0.16	0.20	0.38	0.30	0.16	0.29	0.33	0.20
1.70	0.15	0.19	0.35	0.29	0.15	0.27	0.32	0.18
1.80	0.14	0.18	0.32	0.27	0.14	0.25	0.32	0.17
1.90	0.14	0.17	0.30	0.25	0.14	0.24	0.29	0.16
2.00	0.13	0.17	0.28	0.23	0.14	0.24	0.26	0.16

Table 3.12.2.2 SOLAR EXPOSURE FACTOR (E) — continued

P/H (refer <a href="#">Figure 3.12.2.2</a> )	Orientation Sector (refer <a href="#">Figure 3.12.2.1</a> )							
	North	North east	East	South east	South	South west	West	North west
<b>CLIMATE ZONE 5</b>								
0.00	0.82	1.09	1.19	0.96	0.68	1.04	1.30	1.16
0.05	0.69	0.96	1.07	0.85	0.57	0.92	1.19	1.04
0.10	0.63	0.88	1.01	0.79	0.54	0.86	1.11	0.94
0.15	0.57	0.82	0.95	0.75	0.51	0.81	1.05	0.88
0.20	0.51	0.76	0.89	0.70	0.48	0.76	0.99	0.83
0.25	0.48	0.72	0.85	0.67	0.46	0.72	0.95	0.77
0.30	0.45	0.67	0.80	0.64	0.43	0.69	0.90	0.72
0.35	0.42	0.63	0.76	0.60	0.41	0.65	0.85	0.67
0.40	0.39	0.58	0.71	0.57	0.38	0.62	0.81	0.62
0.50	0.37	0.52	0.65	0.52	0.36	0.56	0.73	0.55
0.60	0.35	0.46	0.58	0.47	0.33	0.51	0.65	0.48
0.70	0.32	0.42	0.54	0.43	0.31	0.47	0.59	0.44
0.80	0.30	0.37	0.50	0.40	0.28	0.43	0.52	0.40
0.90	0.28	0.34	0.46	0.37	0.26	0.40	0.49	0.35
1.00	0.26	0.31	0.42	0.34	0.25	0.37	0.46	0.31
1.10	0.25	0.28	0.39	0.32	0.23	0.35	0.43	0.29
1.20	0.24	0.26	0.36	0.30	0.22	0.33	0.40	0.27
1.30	0.23	0.25	0.34	0.28	0.21	0.31	0.37	0.26
1.40	0.21	0.23	0.32	0.27	0.20	0.29	0.34	0.24
1.50	0.21	0.22	0.30	0.25	0.19	0.28	0.32	0.23
1.60	0.20	0.22	0.29	0.23	0.18	0.27	0.30	0.21
1.70	0.19	0.21	0.27	0.22	0.18	0.25	0.29	0.20
1.80	0.18	0.20	0.25	0.21	0.17	0.23	0.27	0.20
1.90	0.18	0.19	0.24	0.21	0.17	0.22	0.26	0.19
2.00	0.17	0.17	0.24	0.21	0.16	0.21	0.25	0.19
<b>CLIMATE ZONE 6</b>								
0.00	0.84	1.08	1.15	0.87	0.61	1.05	1.40	1.24
0.05	0.71	0.97	1.05	0.78	0.52	0.96	1.30	1.13
0.10	0.65	0.90	0.99	0.74	0.49	0.91	1.25	1.04
0.15	0.58	0.83	0.93	0.69	0.47	0.86	1.18	0.97
0.20	0.52	0.77	0.88	0.65	0.44	0.82	1.12	0.91

Table 3.12.2.2 SOLAR EXPOSURE FACTOR (E) — continued

P/H (refer <a href="#">Figure 3.12.2.2</a> )	Orientation Sector (refer <a href="#">Figure 3.12.2.1</a> )							
	North	North east	East	South east	South	South west	West	North west
0.25	0.48	0.72	0.84	0.62	0.42	0.78	1.06	0.85
0.30	0.44	0.68	0.80	0.59	0.40	0.75	1.01	0.80
0.35	0.40	0.63	0.75	0.57	0.38	0.71	0.95	0.75
0.40	0.36	0.58	0.71	0.54	0.36	0.67	0.90	0.69
0.50	0.33	0.51	0.66	0.49	0.33	0.63	0.83	0.60
0.60	0.30	0.43	0.61	0.45	0.31	0.58	0.76	0.51
0.70	0.28	0.39	0.56	0.42	0.29	0.54	0.71	0.45
0.80	0.26	0.35	0.50	0.38	0.26	0.50	0.66	0.40
0.90	0.24	0.32	0.46	0.35	0.25	0.46	0.61	0.38
1.00	0.22	0.29	0.42	0.32	0.23	0.42	0.56	0.36
1.10	0.21	0.26	0.40	0.30	0.23	0.41	0.52	0.32
1.20	0.20	0.24	0.37	0.29	0.23	0.39	0.48	0.29
1.30	0.19	0.23	0.34	0.27	0.21	0.36	0.45	0.27
1.40	0.18	0.22	0.32	0.26	0.19	0.34	0.42	0.26
1.50	0.17	0.21	0.30	0.25	0.19	0.32	0.40	0.24
1.60	0.16	0.19	0.28	0.24	0.18	0.31	0.38	0.21
1.70	0.16	0.19	0.27	0.23	0.18	0.29	0.36	0.20
1.80	0.15	0.18	0.26	0.22	0.17	0.28	0.34	0.20
1.90	0.15	0.18	0.25	0.21	0.17	0.27	0.32	0.19
2.00	0.14	0.17	0.24	0.21	0.17	0.26	0.31	0.17
<b>CLIMATE ZONE 7</b>								
0.00	0.96	1.17	1.21	0.94	0.64	0.91	1.19	1.18
0.05	0.83	1.05	1.10	0.83	0.54	0.81	1.09	1.07
0.10	0.76	0.97	1.04	0.80	0.51	0.76	1.03	0.98
0.15	0.69	0.91	0.98	0.75	0.48	0.72	0.97	0.92
0.20	0.62	0.85	0.93	0.70	0.45	0.68	0.91	0.86
0.25	0.56	0.80	0.89	0.67	0.43	0.65	0.87	0.81
0.30	0.51	0.75	0.84	0.64	0.41	0.62	0.82	0.75
0.35	0.46	0.70	0.80	0.61	0.40	0.59	0.78	0.69
0.40	0.40	0.65	0.76	0.58	0.38	0.55	0.74	0.64
0.50	0.36	0.58	0.71	0.54	0.35	0.51	0.69	0.57
0.60	0.32	0.51	0.65	0.50	0.33	0.47	0.63	0.51

Table 3.12.2.2 SOLAR EXPOSURE FACTOR (E) — continued

P/H (refer <a href="#">Figure 3.12.2.2</a> )	Orientation Sector (refer <a href="#">Figure 3.12.2.1</a> )							
	North	North east	East	South east	South	South west	West	North west
0.70	0.30	0.45	0.60	0.47	0.30	0.44	0.58	0.45
0.80	0.28	0.40	0.54	0.44	0.28	0.41	0.53	0.40
0.90	0.26	0.36	0.51	0.41	0.27	0.38	0.48	0.36
1.00	0.25	0.33	0.48	0.37	0.25	0.35	0.44	0.32
1.10	0.24	0.30	0.45	0.36	0.24	0.33	0.41	0.29
1.20	0.22	0.28	0.41	0.34	0.23	0.31	0.38	0.27
1.30	0.21	0.26	0.39	0.32	0.22	0.30	0.36	0.25
1.40	0.19	0.23	0.36	0.30	0.21	0.28	0.33	0.24
1.50	0.19	0.22	0.34	0.29	0.20	0.27	0.32	0.22
1.60	0.18	0.21	0.33	0.27	0.20	0.26	0.31	0.21
1.70	0.18	0.20	0.30	0.26	0.19	0.25	0.29	0.20
1.80	0.17	0.20	0.28	0.24	0.18	0.24	0.27	0.19
1.90	0.17	0.19	0.27	0.24	0.18	0.22	0.26	0.18
2.00	0.16	0.19	0.27	0.23	0.18	0.21	0.25	0.18
<b>CLIMATE ZONE 8</b>								
0.00	0.85	1.12	1.20	0.96	0.68	1.01	1.27	1.16
0.05	0.71	0.99	1.09	0.85	0.57	0.90	1.16	1.04
0.10	0.65	0.90	1.02	0.79	0.54	0.84	1.09	0.95
0.15	0.59	0.85	0.96	0.75	0.51	0.78	1.04	0.89
0.20	0.52	0.79	0.90	0.70	0.48	0.73	0.98	0.83
0.25	0.49	0.74	0.86	0.67	0.45	0.70	0.93	0.78
0.30	0.45	0.70	0.82	0.64	0.43	0.67	0.88	0.73
0.35	0.42	0.65	0.77	0.61	0.41	0.64	0.84	0.68
0.40	0.39	0.60	0.73	0.57	0.39	0.61	0.79	0.63
0.50	0.36	0.53	0.67	0.53	0.36	0.56	0.73	0.56
0.60	0.34	0.46	0.60	0.48	0.33	0.50	0.66	0.49
0.70	0.32	0.41	0.55	0.45	0.31	0.47	0.60	0.44
0.80	0.30	0.37	0.50	0.41	0.29	0.43	0.53	0.40
0.90	0.28	0.33	0.46	0.38	0.27	0.40	0.50	0.36
1.00	0.25	0.30	0.42	0.35	0.25	0.37	0.47	0.33
1.10	0.24	0.29	0.40	0.33	0.24	0.35	0.43	0.29
1.20	0.23	0.28	0.37	0.31	0.23	0.33	0.39	0.26

Table 3.12.2.2 SOLAR EXPOSURE FACTOR (E) — continued


P/H (refer <a href="#">Figure 3.12.2.2</a> )	Orientation Sector (refer <a href="#">Figure 3.12.2.1</a> )							
	North	North east	East	South east	South	South west	West	North west
<b>1.30</b>	0.22	0.26	0.35	0.30	0.22	0.31	0.37	0.25
<b>1.40</b>	0.21	0.23	0.32	0.29	0.20	0.29	0.34	0.24
<b>1.50</b>	0.20	0.22	0.31	0.27	0.19	0.27	0.32	0.23
<b>1.60</b>	0.20	0.21	0.30	0.25	0.18	0.25	0.31	0.22
<b>1.70</b>	0.19	0.21	0.28	0.23	0.18	0.24	0.29	0.21
<b>1.80</b>	0.19	0.20	0.25	0.22	0.17	0.23	0.28	0.20
<b>1.90</b>	0.17	0.19	0.24	0.22	0.16	0.23	0.26	0.19
<b>2.00</b>	0.16	0.18	0.23	0.21	0.16	0.22	0.24	0.19

Note:

Exposure factors for P/H values between those shown in [Table 3.12.2.2](#) can be interpolated.

Figure 3.12.2.1
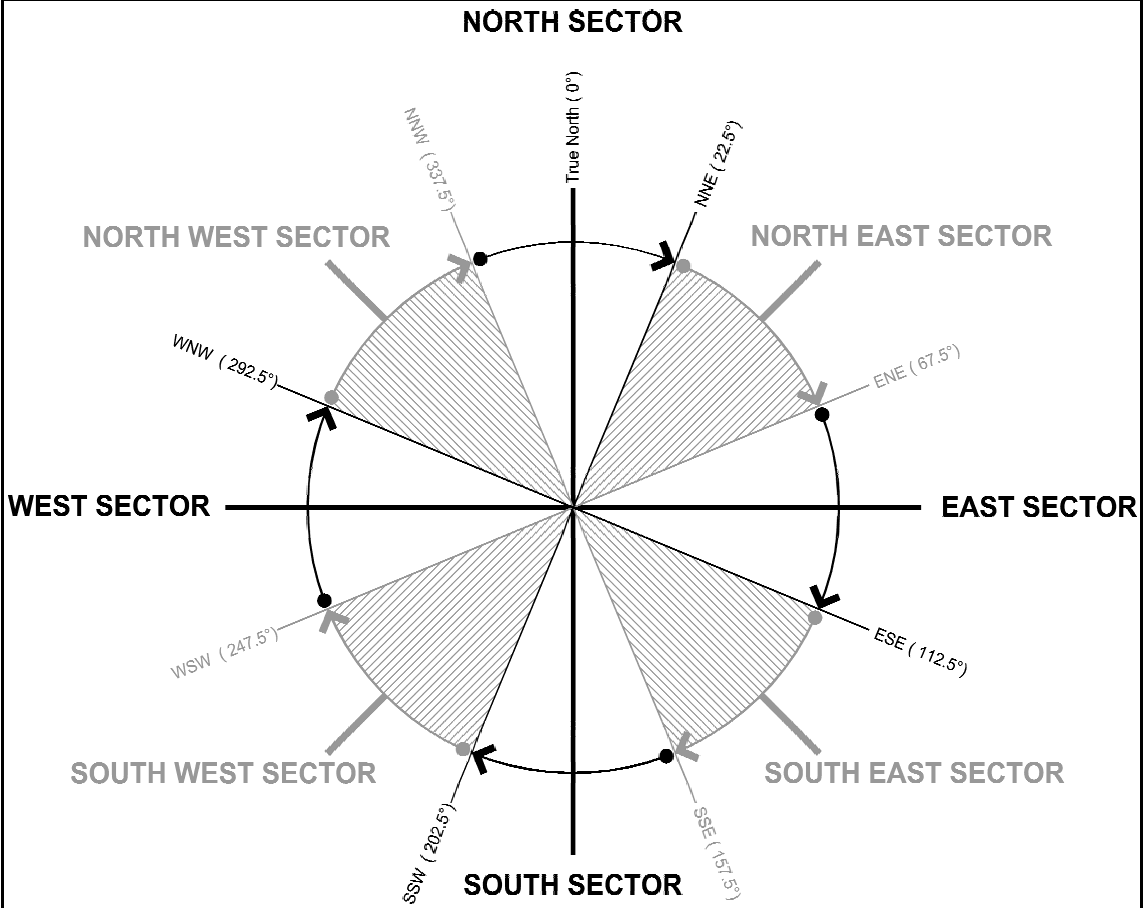
## ORIENTATION SECTORS




## Explanatory information:

1. The direction that a wall or *glazing* element faces is the direction of a perpendicular line from the wall or *glazing* element.
2. **Figure 3.12.2.1** is based on True North and all angles are measured clockwise from True North. Survey angles on site plans are usually marked in angles from True North. These angles can be used to establish True North for a particular site.
3. Magnetic North, found by a magnetic compass, varies from True North over time and by different amounts in different locations. Magnetic North is not an acceptable approximation of True North.
4. The eight orientation sectors shown in **Figure 3.12.2.1** do not overlap at their boundaries. North sector, for example, begins just clockwise after the NNW line and ends exactly on the NNE line. The start and end of other sectors are determined in a similar way, as indicated by the outer curved arrows.



Figure 3.12.2.2
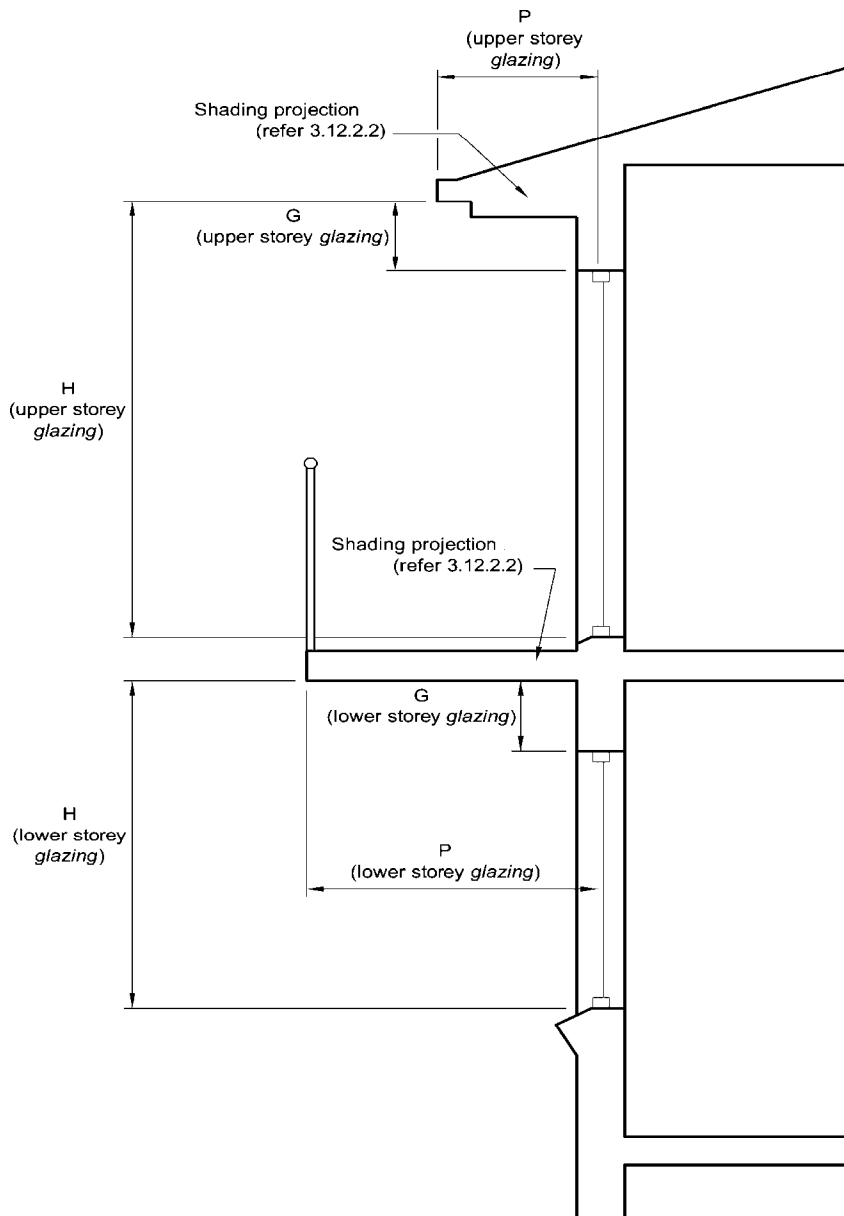
## METHOD OF MEASURING P AND H

**Notes:**

1. An external shading device that complies with [3.12.2.2\(b\)](#) is considered to achieve a P/H value of 2.00.
2. Where G exceeds 500 mm, the value of P must be halved.

**3.12.2.2 Shading**

Where shading is [required](#) to comply with [3.12.2.1](#), it must-

- (a) be provided by an external permanent projection, such as a verandah, balcony, fixed canopy, eaves, shading hood or carport, which-
  - (i) extends horizontally on both sides of the *glazing* for a distance not less than the projection distance P in **Figure 3.12.2.2**; or
  - (ii) provide the equivalent shading to **(i)** with a reveal or the like; or
- (b) be provided by an external shading device, such as a shutter, blind, vertical or horizontal building screen with blades, battens or slats, which-
  - (i) is capable of restricting at least 80% of the summer solar radiation; and
  - (ii) if adjustable, is readily operated either manually, mechanically or electronically by the building occupants.

**Explanatory information:**

1. Shading devices can include fixed louvres, shading screens and other types of perforated or fixed angle slatted shades. However, such devices need to be designed for the climate and latitude to ensure that summer sun penetration is restricted, while winter sun access is achieved.
2. Gutters can only be considered as providing shading if attached to a shading projection such as a verandah, fixed canopy, eaves, shading hood, balcony or the like.
3. Shading devices can be either attached or located adjacent to the building. For example, a free-standing lattice screen may be considered to provide shading to *glazing* if it complies with **3.12.2.2(b)**.

## PART 3.12.3 BUILDING SEALING

### 3.12.3 Application

- (a) This Part applies to—
- (i) a Class 1 building; and
  - (ii) a Class 10a building with a *conditioned space*,
- (b) excluding the following:
- (i) A building in *climate zones* 1, 2, 3 and 5 where the only means of air-conditioning is by using an evaporative cooler.
  - (ii) A permanent building *ventilation opening* that is necessary for the safe operation of a gas appliance.
  - (iii) A Class 10a building used for the accommodation of vehicles.

#### Explanatory information:

1. An evaporatively cooled building in *climate zones* 4 and 6 needs to be sealed because of the likelihood of heating being needed during colder periods.
2. Appropriate ventilation for gas appliances can be obtained from relevant legislation, reference standards and product installation manuals.

### STATE AND TERRITORY VARIATIONS

In South Australia 3.12.3 is replaced with the following:

#### 3.12.3 Application

This Part applies to a Class 1 building excluding a permanent building *ventilation opening* that is necessary for the safe operation of a gas appliance.

#### Explanatory information:

1. Appropriate ventilation for gas appliances can be obtained from relevant legislation, reference standards and product installation manuals.

### Acceptable construction practice

#### 3.12.3.1 Chimneys and flues

The chimney or flue of an open solid-fuel burning appliance must be provided with a damper or flap that can be closed to seal the chimney or flue.

#### Explanatory information:

1. The requirements of this Part are to be read in conjunction with the fire safety requirements in **Part 3.7.3**.

2. A solid-fuel burning device is a heater that burns material such as timber, coal and the like. This clause does not apply to gas and liquid fuel burning devices.

### 3.12.3.2 Roof lights

- (a) A *roof light* must be sealed, or capable of being sealed, when serving—
- (i) a *conditioned space*; or
  - (ii) a *habitable room* in *climate zones* 4, 6, 7 and 8.
- (b) A *roof light required* by (a) must be constructed with—
- (i) an imperforate ceiling diffuser or the like installed at the ceiling or internal lining level; or
  - (ii) a weatherproof seal if it is a roof *window*; or
  - (iii) a shutter system readily operated either manually, mechanically or electronically by the occupant.

#### STATE AND TERRITORY VARIATIONS

**3.12.3.2 does not apply in South Australia.**

### 3.12.3.3 External windows and doors

- (a) A seal to restrict air infiltration must be fitted to each edge of an external door, openable *window* and other such opening—
- (i) when serving a *conditioned space*; or
  - (ii) in *climate zones* 4, 6, 7 and 8, when serving a *habitable room*.
- (b) The following need not comply with (a):—
- (i) An external louvre door, louvre *window* or other such opening.
  - (ii) A *window* complying with the maximum air infiltration rates specified in AS 2047.

#### Explanatory information:

Requirements for the sealing of louvres are under consideration for future inclusion in the Housing Provisions. The outcome will depend on the availability of complying products.

- (c) A seal *required* by (a) may be a foam or rubber compressible strip, fibrous seal or the like.

#### STATE AND TERRITORY VARIATIONS

**In South Australia 3.12.3.3 is replaced with the following:**

#### 3.12.3.3 External doors

External swing doors must be fitted with a draught protection device to the bottom edge of each leaf.

### 3.12.3.4 Exhaust fans

An exhaust fan must be fitted with a sealing device such as a self-closing damper, filter or the like when serving—

- (a) a *conditioned space*; or
- (b) a *habitable room* in *climate zones* 4, 6, 7 and 8.

#### Explanatory information:

An exhaust fan is considered to be adequately sealed if it is fitted with a filter such as the type commonly used in kitchen range hoods.

#### STATE AND TERRITORY VARIATIONS

In South Australia 3.12.3.4 is replaced with the following:

### 3.12.3.4 Exhaust fans

An exhaust fan must be fitted with a sealing device such as a self-closing damper or the like when serving a *conditioned space* or a *habitable room*.

### 3.12.3.5 Construction of roofs, walls and floors

- (a) Roofs, *external walls*, external floors and any opening such as a *window*, door or the like must be constructed to minimise air leakage in accordance with (b) when forming part of the external *fabric* of—
  - (i) a *conditioned space*; or
  - (ii) a *habitable room* in *climate zones* 4, 6, 7 and 8.
- (b) Construction *required* by (a) must be—
  - (i) enclosed by internal lining systems that are close fitting at ceiling, wall and floor junctions; or
  - (ii) sealed by caulking, skirting, architraves, cornices or the like.

#### Explanatory information:

1. A close fitting internal lining system is considered to include an allowance for minimum lining movement gaps at wall, floor and ceiling junctions.
2. Caulking includes sealant, expanded foam or other gap filling material.

#### STATE AND TERRITORY VARIATIONS

3.12.3.5 does not apply in South Australia.

### 3.12.3.6 Evaporative coolers

An evaporative cooler must be fitted with a self-closing damper or the like when serving—

- (a) a heated space; or

- (b) a *habitable room* in *climate zones* 4, 6, 7 or 8.

## PART 3.12.4 AIR MOVEMENT

### 3.12.4 Application

This Part applies to a *habitable room* in a Class 1 building.

#### Acceptable construction practice

#### 3.12.4.1 Air movement

- (a) Air movement must be provided to *habitable rooms* in accordance with **Table 3.12.4.1**.
- (b) Air movement *required* by (a) may be provided through an opening from an adjoining room (including an enclosed verandah) if—
  - (i) the adjoining room is not a *sanitary compartment*; and
  - (ii) the opening between the adjoining room and the *habitable room* complies with **Table 3.12.4.1** as if it were a *ventilation opening* to the *habitable room* or a proportion thereof if some ventilation is provided from another source; and
  - (iii) the *ventilation opening* to the adjoining room complies with **Table 3.12.4.1** for the total area of the floor of the adjoining room and the proportion of the *habitable room* that is ventilated from the adjoining room.
- (c) The requirements of (a) do not apply to buildings in Region D severe tropical cyclone areas (see **Figure 3.10.1.4**) provided—
  - (i) the *external walls* are shaded with a verandah, balcony, eaves, carport or the like that projects at a minimum angle of 15 degrees in accordance with **Figure 3.12.1.2**; and
  - (ii) the *external walls* achieve a minimum *Total R-Value* of 2.5; and
  - (iii) the roof achieves an additional R1.5 to that *required* by **3.12.1.2**.

**Table 3.12.4.1 PROVISION FOR AIR MOVEMENT**

<i>Climate zones</i>	Minimum total <i>ventilation opening</i> area per <i>habitable room</i> (percentage of the area of the floor of the <i>habitable room</i> )		
	Without a ceiling fan or evaporative cooler	With a ceiling fan	With an evaporative cooler
1	15%	12.5%	15% (see Note)
2	10%	5%	10% (see Note)
3	12.5%	7.5%	7.5%
4	10%	5%	5%
5	7.5%	5%	7.5% (see Note)

Table 3.12.4.1 PROVISION FOR AIR MOVEMENT— continued

Climate zones	Minimum total <i>ventilation opening</i> area per <i>habitable room</i> (percentage of the area of the floor of the <i>habitable room</i> )		
	Without a ceiling fan or evaporative cooler	With a ceiling fan	With an evaporative cooler
6, 7 and 8	As <i>required</i> by <b>Part 3.8.5</b>		
<b>Note:</b> Because evaporative coolers are less effective than ceiling fans in more humid locations, the requirement for ventilation openings in <i>climate zones</i> 1, 2 and 5 with an evaporative cooler is the same as without one.			

**Explanatory information:**

In humid locations, such as Darwin and Cairns, evaporative coolers would not provide the same cooling effect as in dryer climates. Although they would provide some benefit from the air movement if operated in a “fan-only” mode, they would cause discomfort, possible condensation and possible mould growth if operated in an evaporative “water-on” mode. However, even though a concession is not given in *climate zones* 1, 2 and 5, there are locations, particularly in *climate zone* 5, where evaporative coolers would be effective.

**3.12.4.2 Ventilation openings**

- (a) In *climate zones* 1, 2, 3, 4 and 5, the total *ventilation opening* area *required* by **Table 3.12.4.1** to a *habitable room* must—
- (i) be connected by a breeze path complying with **(b)** to another *ventilation opening* in another room or space; or
  - (ii) be provided by a minimum of two *ventilation openings* located within the same *habitable room*, with each *ventilation opening* having an area of not less than 25% of the area *required* by **Table 3.12.4.1**.
- (b) A breeze path *required* by **(a)(i)** must—
- (i) pass through not more than two openings in the internal walls with each opening having an area of not less than 1.5 m<sup>2</sup>; and
  - (ii) have a distance along the breeze path between *ventilation openings* of not more than 20 m.

**Explanatory information:**

1. *Ventilation openings* should be designed to allow the interior of the building to take full advantage of any natural breeze. Careful consideration should be given to the type and location of openings to ensure optimum effect is achieved and that internal “dead air pockets” are avoided.
2. An opening may serve more than one breeze path.
3. Two openings are stated in **(b)(i)** as the limit of the number of openings permitted in a breeze path. These are typically doorways. Larger openings, such as those between adjoining lounge and dining areas in the same space are unlikely to restrict air movement significantly.



### 3.12.4.3 Ceiling fans and evaporative coolers

A ceiling fan or evaporative cooler *required* to comply with [Table 3.12.4.1](#) must—

- (a) be permanently fixed; and
- (b) have a speed controller; and
- (c) for a ceiling fan, have a blade rotation diameter of not less than 900 mm.

#### Explanatory information:

The fan should be installed to ensure it achieves optimum performance in providing air movement for the building occupants. As a general rule a 900 mm diameter fan will serve a *floor area* of 20 m<sup>2</sup>. However, this may vary depending on the various factors including the blade design, the ceiling clearance and the power of the fan.

## PART 3.12.5 SERVICES

### 3.12.5 Application

This Part applies to—

- (a) a Class 1 building; and
- (b) a Class 10a building.

#### A. Acceptable construction manual

#### 3.12.5.0

- (a) A hot water supply system must be designed and installed in accordance with Section 8 of AS/NZS 3500.4 or clause 3.38 of AS/NZS 3500.5.
- (b) A solar hot water supply system in *climate zones* 1, 2 and 3 is not *required* to comply with (a).

#### Explanatory information:

See **3.12.0** for the relevant *Performance Requirement* that is satisfied by compliance with **3.12.5.0**.

#### STATE AND TERRITORY VARIATIONS

- 1. In Victoria, delete 3.12.5.0
- 2. In South Australia, 3.12.5.0 is replaced with the following:

##### SA 3.12.5.0

A heated water service must be designed and installed in accordance with the Waterworks Act 1932 and the Waterworks Regulations 1996.

#### Explanatory information:

The design and installation of heated water services in South Australia is regulated by Directions issued by the South Australian Water Corporation pursuant to Regulation 17 of the Waterworks Regulations 1996.

#### B. Acceptable construction practice

#### 3.12.5.1 Insulation of services

Thermal insulation for central heating water *piping* and heating and cooling ductwork must be—

- (a) protected against the effects of weather and sunlight; and
- (b) able to withstand the temperatures within the *piping* or ductwork.

#### Explanatory information:

The Acceptable Construction Manual described in **3.12.5.0** is for use with hot water systems that provide hot water for general domestic use in areas such as bathrooms, kitchens, laundries and the like.

The central heating water *piping* provisions apply to hot water systems designed to heat the building.

### 3.12.5.2 Central heating water piping

Central heating water *piping* that is not within a *conditioned space* must be thermally insulated to achieve the minimum *Total R-Value* in accordance with **Table 3.12.5.1**.

**Table 3.12.5.1 CENTRAL HEATING WATER PIPING—MINIMUM TOTAL R-VALUE**

<i>Piping</i> to be insulated	Minimum <i>Total R-Value</i> for each <i>climate zone</i>		
	1, 2, 3 and 5	4, 6 and 7	8
<b>1. Internal <i>piping</i></b>			
(a) All flow and return <i>piping</i> that is— <ul style="list-style-type: none"> <li>(i) within an unventilated wall space; or</li> <li>(ii) within an internal floor between storeys; or</li> <li>(iii) between ceiling insulation and a ceiling.</li> </ul> (b) All hot water <i>piping</i> encased within a concrete floor slab (except that which is part of a floor heating system).	0.2	0.2	0.2
<b>2. <i>Piping</i> located within a ventilated wall space, an enclosed building sub-floor or a roof space</b>			
(a) All flow and return <i>piping</i> . (b) Cold water supply <i>piping</i> — within 500 mm of the connection to the central water heating system. (c) Relief valve <i>piping</i> — within 500 mm of the connection to the central water heating system.	0.3	0.45	0.6

Table 3.12.5.1 CENTRAL HEATING WATER PIPING—MINIMUM TOTAL R-VALUE—continued

<i>Piping</i> to be insulated	Minimum <i>Total R-Value</i> for each <i>climate zone</i>		
	1, 2, 3 and 5	4, 6 and 7	8
<b>3. <i>Piping</i> located outside the building or in an unenclosed building sub-floor or roof space</b>			
(a) All flow and return <i>piping</i> .	0.3	0.6	0.6
(b) Cold water supply <i>piping</i> — within 500 mm of the connection to the central water heating system.			
(c) Relief valve <i>piping</i> — within 500 mm of the connection to the central water heating system.			

**Explanatory information:**

- The insulation levels in the following table are typical examples of materials that can be used to insulate central heating water *piping*. Other methods are available for meeting the *Total R-Values required* by Table 3.12.5.1.
- Piping* within a timber member, such as that passing through a wall stud, is considered to have sufficient insulation for the purposes of Table 3.12.5.1.

Insulation	<i>Total R-Value</i>
9 mm of closed cell polymer	0.2
13 mm of closed cell polymer	0.3
19 mm of closed cell polymer	0.45
25 mm of closed cell polymer	0.6

**3.12.5.3 Heating and cooling ductwork**

- Heating and cooling ductwork and fittings must—
  - achieve the *Total R-Value* in Table 3.12.5.2 ; and
  - use thermal insulation material in accordance with AS/NZS 4859.1; and
  - be sealed against air loss—
    - by closing all openings in the surface, joints and seams of ductwork with adhesives, mastics, sealants or gaskets in accordance with AS 4254 for a Class C seal; or
    - for flexible ductwork, with a draw band in conjunction with a sealant or adhesive tape.
- Duct insulation located under a suspended floor, in an attached Class 10a building and in a roof space must—
  - be protected by an outer sleeve of protective sheeting to prevent the insulation becoming damp; and

- (ii) have the outer protective sleeve sealed with adhesive tape not less than 48 mm wide creating an airtight and waterproof seal.
- (c) The requirements of (a) do not apply to heating and cooling ductwork and fittings located within the insulated building *envelope* including a service riser within the *conditioned space*, internal floors between storeys and the like.

#### Explanatory information:

Ductwork within a fully insulated building may still benefit from insulation particularly when the system is only operating for short periods.

In some *climate zones* condensation may create problems with uninsulated ductwork and insulation should still be considered.

**Table 3.12.5.2 HEATING AND COOLING DUCTWORK AND FITTINGS—MINIMUM TOTAL R-VALUE**

Ductwork element	Minimum <i>Total R-Value</i> for ductwork and fittings in each <i>climate zone</i>					
	Evaporative cooling system	Heating-only system or refrigerated cooling-only system		Combined heating and refrigerated cooling system		
	All <i>climate zones</i>	1, 2, 3, 4, 5, 6 and 7	8	1, 3, 4, 6 and 7	2 and 5	8
Ductwork	0.6	1.0	1.5	1.5 (see note)	1.0	1.5
Fittings	0.4					
Note: The minimum <i>Total R-Value required</i> for ductwork may be reduced by 0.5 for combined heating and refrigerated cooling systems in <i>climate zones</i> 1, 3, 4, 6 and 7 if the ducts are— (a) under a suspended floor with an enclosed perimeter; or (b) in a roof space that has insulation of not less than R0.5 directly beneath the roofing.						

#### Explanatory information:

- For information on an enclosed perimeter, refer to the explanatory information following [Table 3.12.1.4](#).
- Insulation for refrigerated cooling ductwork should have a vapour barrier to prevent possible damage by condensation.
- The insulation levels in the following table are typical examples of materials that can be used to insulate ductwork and fittings and the *R-Values* they contribute. Other methods are available for meeting the *Total R-Values required* by [Table 3.12.5.2](#).

Insulation	<i>R-Value</i>
8 mm polyurethane spray	R0.3
40 mm polyester fibre insulation (250 g/m <sup>2</sup> )	R0.6
70 mm polyester fibre insulation (450 g/m <sup>2</sup> )	R1.0

Insulation	<i>R-Value</i>
90 mm polyester fibre insulation (800 g/m <sup>2</sup> )	R1.5
25 mm mineral wool or fibreglass insulation (480 g/m <sup>2</sup> )	R0.6
38 mm mineral wool or fibreglass insulation (560 g/m <sup>2</sup> )	R1.0
50 mm mineral wool or fibreglass insulation (840 g/m <sup>2</sup> )	R1.5

4. The air films and surfaces of the ductwork and fittings are considered to contribute an *R-Value* of not more than R0.15 to the *Total R-Values*. A greater value, such as for the addition of foil backing to the insulation or a plastic protective sheet, would need to be supported by appropriate documentary evidence.
5. Any flexible ductwork used for the transfer of products, initiating from a heat source that contains a flame, must also have the fire hazard properties *required* by 3.7.1.9.

# **ADDITIONS**

**Commonwealth of Australia**

**Australian Capital Territory**

**New South Wales**

**Northern Territory**

**Queensland**

**South Australia**

**Tasmania**

**Victoria**

**Western Australia**

## **APPENDIX A CONTENTS**

---

### **APPENDIX A ADDITIONS**



**CONTENTS**

**COMMONWEALTH OF AUSTRALIA**

Footnote: Other Legislation Affecting Buildings

## **Footnote: OTHER LEGISLATION AFFECTING BUILDINGS**

In addition to any applicable provisions of this Code, there are a number of other legislative technical requirements affecting the design, construction and/or performance of buildings that practitioners may need to be aware of, including, but not necessarily limited to, the following list. Additional legislative instruments such as regulations, codes and standards may exist under the legislation listed.

### **1. Australian Capital Territory**

#### **1.1 Administering agency:**

Department of Transport and Regional Services

#### **Relevant legislation:**

Australian Capital Territory (Planning and Land Management) Act 1988

Parliament Act 1974

### **2. Defence Buildings**

#### **2.1 Administering agency:**

Department of Defence

#### **Relevant legislation:**

Defence Act 1903

Defence (Areas Control) Regulations

Infrastructure Management

Defence Safety Manual

Contamination Manual

Defence Energy, Water and Waste Strategy

Manual of Fire Protection Engineering

Requirements for the Provision of Disabled Access and other Facilities for Disabled Persons in Defence Facilities

Defence Green Building Requirements

### **3. Disability Discrimination**

#### **3.1 Administering agency:**

Attorney-General's Department

#### **Relevant legislation:**

Disability Discrimination Act 1992

### **4. Environment**

#### **4.1 Administering agency:**

Department of the Environment and Water Resources

**Relevant legislation:**

Energy Efficiency in Government Operations (2006)

Environmental Protection and Biodiversity Conservation Act 1999

**5. Jervis Bay Territory****5.1 Administering Agency**

Department of Transport and Regional Services

**Relevant Legislation**

Jervis Bay Territory Acceptance Act 1915

**6. Occupational Health and Safety****6.1 Administering Agency:**

Department of Employment and Workplace Relations

**Relevant Legislation:**

Occupational Health and Safety Act 1991

Occupational Health and Safety (Safety Standards) Regulations 1994

**7. Territory of Christmas Island****7.1 Administering Agency:**

Department of Transport and Regional Services

**Relevant Legislation:**

Christmas Island Act 1958

## CONTENTS

### AUSTRALIAN CAPITAL TERRITORY

#### Structure

ACT 1 \* \* \* \* \*

#### Health and amenity

ACT 2 Control of Litter on Building Sites

ACT 3 Waste Management

ACT 6 Swimming pools

Footnote: Other Legislation Affecting Buildings

## AUSTRALIAN CAPITAL TERRITORY ADDITIONS

### Application of Australian Capital Territory additions

This Appendix contains additional provisions for application in the Australian Capital Territory as follows:

ACT 1 — \* \* \* \* \*

This clause has been deliberately left blank.

### HEALTH AND AMENITY

### ACT 2 — CONTROL OF LITTER ON BUILDING SITES

#### ACT 2.1 PERFORMANCE PROVISIONS

##### Objective

The *Objective* of this provision is to prevent wind blown litter from building sites fouling roads and public land.

##### Functional Statement

Building litter must be prevented from spreading around the site and beyond the site boundary.

##### Performance Requirement

Sufficient containers must be provided on building sites to store building waste that is likely to become windblown.

#### ACT 2.2 ACCEPTABLE CONSTRUCTION PRACTICE

The requirements of **ACT 2.1** (*Performance Requirement*) are satisfied by:

On site building waste that is stored in suitable size plastic or metal bins and removed from the site at regular intervals.

##### Note:

Building Waste includes: plastic containers and plastic and paper wrappings or any waste that can be carried by wind.

**ACT 3 — WASTE MANAGEMENT****ACT 3.1 PERFORMANCE PROVISIONS****Objective**

The *Objective* of this provision is to safeguard people from injury caused by infection or contamination from solid waste.

**Functional Statement**

Buildings must be provided with space and facilities for the collection, and safe hygienic holding prior to disposal of solid waste arising from the intended use of the building.

**Performance Requirement**

Where provision is made within buildings for the collection and temporary holding of solid waste, the design shall accommodate screening, volume of waste, disposal, logistics and access.

**ACT 3.2 ACCEPTABLE CONSTRUCTION PRACTICE**

The requirements of **ACT 3.1** (*Performance Requirement*) are satisfied by garbage facilities that are designed and constructed in accordance with the Development Control Code for Best Practice Waste Management in the ACT.

**ACT 6 — SWIMMING POOL CONSTRUCTION****Application:**

This requirement is to be applied in conjunction with **Part 3.9.3**.

**ACT 6.1 Swimming pool construction**

Indoor or outdoor permanent bathing, wading and *swimming pools* must—

- (a) where the capacity of the pool exceeds 10 m<sup>3</sup>—
  - (i) be of the recirculation type in which the water circulation is maintained through the pool by pumps, the water drawn from the pool being clarified and disinfected before being returned to the pool; and
  - (ii) have an outlet sump with antivortex cover or grating and have a skimming weir or overflow gutter or channel at high water level; and
  - (iii) have means of egress provided in the form of ladders, steps in the floor of the pool or a ramp; and
- (b) be capable of being completely emptied and any discharge or overflow and pool backwash filter must be connected to the sewer drainage system.

## **Footnote: OTHER LEGISLATION AFFECTING BUILDINGS**

In addition to any applicable provisions of the Building Act 2004 and this Code, there are a number of other legislative technical requirements affecting the design, construction and/or performance of buildings that practitioners may need to be aware of, including, but not necessarily limited to, the following list. Additional legislative instruments such as regulations, codes and standards may exist under the legislation listed.

### **1. Construction Occupations**

#### **1.1 Administering Agency**

ACT Planning and Land Authority

#### **Relevant Legislation**

Construction Occupations (Licensing) Act 2004

### **2. Electricity and Gas Safety**

#### **2.1 Administering Agency**

ACT Planning and Land Authority

#### **Relevant Legislation**

Electricity Safety Act 1971

Gas Safety Act 2000

### **3. Environmental Protection and Nature Conservation**

#### **3.1 Administering Agency**

Department of Territory and Municipal Services

#### **Relevant Legislation**

Environment Protection Act 1997

Nature Conservation Act 1980

### **4. Fences and Party Walls**

#### **4.1 Administering Agency**

ACT Planning and Land Authority

#### **Relevant Legislation**

Common Boundaries Act 1981

### **5. Heritage Conservation**

#### **5.1 Administering Agency**

Department of Territory and Municipal Services

#### **Relevant Legislation**

Heritage Act 2004

## **6. Land Use and Development Control**

### **6.1 Administering Agency**

ACT Planning and Land Authority

#### **Relevant Legislation**

Planning and Development Act 2007

Unit Titles Act 2001

## **7. Machinery, Scaffolding and Lifts**

### **7.1 Administering Agency**

Chief Minister's Department

Department of Justice and Community Safety

#### **Relevant Legislation**

Machinery Act 1949

Scaffolding and Lifts Act 1912

## **8. Occupational Health and Safety**

### **8.1 Administering Agency**

Chief Minister's Department

Department of Justice and Community Safety

#### **Relevant Legislation**

Occupational Health and Safety Act 1989

Work Safety Act 2008

## **9. Public Health**

### **9.1 Administering Agency**

ACT Health

#### **Relevant Legislation**

Public Health Act 1997

## **10. Roads and Public Places**

### **10.1 Administering Agency**

Department of Territory and Municipal Services

#### **Relevant Legislation**

Roads and Public Places Act 1937

## **11. Utilities**

### **11.1 Administering Agency**



ACT Planning and Land Authority  
Department of Justice and Community Safety  
Department of Territory and Municipal Services  
Department of Treasury

**Relevant Legislation**

Utilities Act 2000

## **12. Waste**

### **12.1 Administering Agency**

Department of Territory and Municipal Services

**Relevant Legislation**

Waste Minimisation Act 2001

## **13. Water and Sewerage**

### **13.1 Administering Agency**

ACT Planning and Land Authority

**Relevant Legislation**

Water and Sewerage Act 2000

## CONTENTS

### **NEW SOUTH WALES**

#### **New South Wales Additions**

NSW 1.1 Performance Provisions  
NSW 1.2 Acceptable Construction Practice  
NSW O2.6 Objective  
NSW F2.6 Functional Statement  
NSW P2.6 Performance Requirements  
NSW 3.12 Energy efficiency acceptable construction  
NSW 3.12.1 Application of NSW Part 3.12.1  
NSW 3.12.1.1 Compliance with BCA provisions  
NSW 3.12.2 External Glazing  
NSW 3.12.3 Application of NSW Part 3.12.3  
NSW 3.12.3.1 Compliance with BCA provisions  
NSW 3.12.4 Air Movement  
NSW 3.12.5 Application of NSW Part 3.12.5  
NSW 3.12.5.1 Compliance with BCA provisions

Footnote: Other Legislation Affecting Buildings

## NEW SOUTH WALES ADDITIONS

### Application of New South Wales additions

This Appendix contains additional provisions for application in New South Wales as follows:

#### NSW 2 ENERGY EFFICIENCY

##### Note 1.

In NSW, Class 1 and 2 buildings, Class 4 parts of buildings, and certain Class 10 buildings are subject to BASIX (the Building Sustainability Index), the web-based planning tool designed to assess the potential performance of these buildings against a range of sustainability indices including thermal comfort and energy. Commitments made under BASIX become a condition of the relevant development consent or complying development certificate.

BASIX applies to these types of new buildings in NSW; to alterations and additions to buildings of those classes where the work is subject to BASIX; and also where an applicant elects to comply with BASIX.

The following provisions are therefore designed to complement requirements that arise under BASIX and which are implemented via the development consent.

Where BASIX is not applied to alterations and additions to these types of buildings, the provisions will also complement council development controls that require energy efficiency measures to be incorporated as part of the alterations and additions. For example: [NSW Part 3.12.1](#) specifies installation requirements for, and the standards that must be met by, insulation required by any of the foregoing.

##### Note 2.

All definitions in the national BCA that are applicable to the national BCA [Parts 2.6](#) and [3.12](#) are also applicable to [NSW Parts 2.6](#) and [3.12](#).

## NSW PART 2.6 ENERGY EFFICIENCY PERFORMANCE PROVISIONS

Delete PART 2.6 and substitute NSW PART 2.6 as follows:

### NSW O2.6 Objective

The *Objective* is to reduce greenhouse gas emissions by efficiently using energy.

### NSW F2.6 Functional Statement

To reduce greenhouse gas emissions, a building, including its *domestic services*, is to be capable of efficiently using energy.

### Performance Requirements

#### NSW P2.6.1(a) Building Fabric

- (i) Thermal insulation in a building must be installed in a manner and have characteristics, which facilitate the efficient use of energy for artificial heating and cooling.
- (ii) A building must have, to the degree necessary, thermal breaks installed between the framing and external cladding, to facilitate efficient thermal performance of the building envelope.

#### Application

- (a) **NSW P2.6.1(a)** only applies to thermal insulation in a Class 1 or 10 building where a development consent specifies that the insulation is to be provided as part of the development.
- (b) In **(a)**, the term development consent has the meaning given by the Environmental Planning and Assessment Act 1979.
- (c) **NSW P2.6.1(a)(ii)** only applies to a metal framed roof and a metal framed wall.

#### Explanatory Information

- (i) In NSW, provision of thermal insulation of the building fabric may be nominated as a commitment on a BASIX (Building Sustainability Index) Certificate and form part of the conditions of development consent or complying development certificate relating to the development.
- (ii) BASIX is applicable to alterations and additions the cost of which exceeds specified minimum values, or where an applicant elects to comply with BASIX. Where BASIX is not applicable, a council's development controls may also specify the provision of thermal insulation in such alterations or additions.
- (iii) Thermal breaks between metal framing and cladding material of minimum thickness will reduce energy loss and contribute to the efficient thermal performance of the building.

**NSW P2.6.1(b) Building Sealing**

A building must have, to the degree necessary, a level of building sealing against air leakage to facilitate the efficient use of energy for artificial heating and cooling appropriate to—

- (a) the function and use of the building; and
- (b) the internal environment; and
- (c) the geographic location of the building.

**Limitation:**

**NSW P2.6.1(b)** does not apply to—

- (a) existing buildings being relocated; or
- (b) Class 10a buildings
  - (i) without a *conditioned space*; or
  - (ii) for the accommodation of vehicles; or
- (c) parts of buildings that cannot be fully enclosed; or
- (d) a building ventilation opening that is necessary for the safe operation of a gas appliance.

**Explanatory Information**

1. The term "cannot be fully enclosed" means parts of buildings with permanent openings such as balconies, shade rooms, rooms with fixed louvres, mesh or other material that allows air flow. Adjustable louvres are considered to provide full enclosure to the opening they accommodate.  
  
Such rooms are unlikely to be conditioned given the high air flow rates; therefore application of the Performance Requirement to these parts of buildings would not result in reduction in energy use.
2. Appropriate ventilation for gas appliances can be obtained from relevant legislation, referenced standards and product installation manuals.

**NSW P2.6.2 Building Services**

A building's *domestic services*, including any associated distribution system and components must have features that, to the degree necessary, facilitate the efficient use of energy appropriate to—

- (a) the *domestic service* and its usage; and
- (b) the geographic location of the building; and
- (c) the location of the *domestic service*; and
- (d) the energy source.

**Limitation**

**NSW P2.6.2** does not apply to existing services associated with an existing building being relocated.

## **VERIFICATION METHODS**

Verification Methods under the BCA are not applicable in NSW. This subject matter is dealt with by BASIX.

## NSW PART 3.12 ENERGY EFFICIENCY ACCEPTABLE CONSTRUCTION

---

Delete Part 3.12 and substitute NSW Part 3.12 as follows:

Note:

The definitions that apply to the national BCA [Part 3.12](#) also apply to [NSW Part 3.12](#).

## NSW PART 3.12.1 BUILDING FABRIC THERMAL INSULATION

### Appropriate *Performance Requirements*:

Where an *Alternative Solution* to **NSW 3.12.1** is proposed, that proposal must comply with—

- (a) *Performance Requirement NSW P2.6.1(a)*; and
- (b) relevant *Performance Requirements* determined in accordance with **1.0.10**.

### NSW 3.12.1 Application of NSW Part 3.12.1

- (a) Compliance with **NSW 3.12.1.1** satisfies **NSW P2.6.1(a)** for thermal insulation and thermal breaks.
- (b) **NSW PART 3.12.1** only applies to thermal insulation in a Class 1 or 10 building where a development consent specifies that the insulation is to be provided as part of the development.
- (c) In **(b)**, the term development consent has the meaning given by the Environmental Planning and Assessment Act 1979.
- (d) The Deemed-to-Satisfy provisions of this Part for thermal breaks apply to all Class 1 buildings and Class 10a buildings with a conditioned space.

### NSW 3.12.1.1 Compliance with BCA provisions

- (a) Thermal insulation in a building must comply with the national BCA provisions of **3.12.1.1**.
- (b) A thermal break must be provided between the external cladding and framing as follows—
  - (i) for a metal framed roof, in accordance with national BCA provisions of **3.12.1.2(c)**; and
  - (ii) for a metal framed wall, in accordance with national BCA provisions of **3.12.1.4(d)**.



## NSW PART 3.12.2 EXTERNAL GLAZING

---

Note:

The national BCA [Part 3.12.2](#) does not apply in NSW as the subject matter is dealt with by BASIX.

## NSW PART 3.12.3 BUILDING SEALING

### Appropriate *Performance Requirements*:

Where an *Alternative Solution* to **NSW 3.12.3** is proposed, that proposal must comply with—

- (a) *Performance Requirement NSW P2.6.1(b)* ; and
- (b) relevant *Performance Requirements* determined in accordance with **1.0.10**.

### NSW 3.12.3 Application of NSW Part 3.12.3

- (a) Compliance with **NSW 3.12.3.1** satisfies **NSW P2.6.1(b)** for building sealing.
- (b) **NSW Part 3.12.3** is not applicable to—
  - (i) existing buildings being relocated; or
  - (ii) Class 10a buildings
    - (A) without a *conditioned space*; or
    - (B) for the accommodation of vehicles; or
  - (iii) parts of buildings that cannot be fully enclosed; or
  - (iv) a building ventilation opening that is necessary for the safe operation of a gas appliance.

### NSW 3.12.3.1 Compliance with BCA provisions

The sealing of a building must comply with the national BCA provisions **3.12.3.1** to **3.12.3.6**.

#### Explanatory Information

1. The term "cannot be fully enclosed" means parts of buildings with permanent openings such as balconies, shade rooms, rooms with fixed louvres, mesh or other material that allows air flow. Adjustable louvres as considered to provide full enclosure to the opening they accommodate.  
  
Such rooms are unlikely to be conditioned given the high air flow rates; therefore applications of the Performance Requirement to these parts of buildings would not result in reduction in energy use.
2. Appropriate ventilation for gas appliances can be obtained from relevant legislation, referenced standards and product installation manuals.

## NSW PART 3.12.4 AIR MOVEMENT

---

**Note:**

The national BCA [Part 3.12.4](#) does not apply in NSW as the subject matter is dealt with by BASIX.

## NSW PART 3.12.5 BUILDING SERVICES

### Appropriate *Performance Requirements*:

Where an *Alternative Solution* to **NSW 3.12.5** is proposed, that proposal must comply with—

- (a) *Performance Requirement NSW P2.6.2* ; and
- (b) relevant *Performance Requirements* determined in accordance with **1.0.10**.

### NSW 3.12.5 Application of NSW Part 3.12.5

- (a) Compliance with **NSW 3.12.5.1** satisfies **NSW P2.6.2** for building services.
- (b) **NSW Part 3.12.5** is not applicable to existing services associated with an existing building being relocated.

### NSW 3.12.5.1 Compliance with BCA provisions

Building services must comply with the national BCA provisions **3.12.5.0** to **3.12.5.3**.

## Footnote: OTHER LEGISLATION AFFECTING BUILDINGS

In addition to any applicable provisions of the Environmental Planning and Assessment Act 1979, the Environmental Planning and Assessment Regulation 2000 and this Code, there is a variety of other regulatory provisions, including legislation, regulation and departmental policies that impose requirements affecting the design, construction and/or performance of buildings in NSW

The following is a non-definitive list of such provisions. It does not include Commonwealth provisions that may apply in NSW, nor planning and environmental standards that may impose building requirements in individual circumstances. It is meant as an indicative guide only and is not to be relied upon in any way as a substitute for further research, investigation and legal advice needed to determine building standards in individual circumstances.

### 1. Children's Services

#### 1.1 Administering Agency

Department of Community Services

#### Relevant Legislation

Children's Services Regulation 2004

### 2. Crown Land – Construction Approval

#### 2.1 Administering Agency

Department of Lands

#### Relevant Legislation

Crown Lands Act 1989

Crown Lands Regulation 2006

## 2.2 **Administering Agency**

Office of Emergency Services

### **Relevant Legislation**

Rural Fires Act 1997

## 3. **Dining Rooms**

### 3.1 **Administering Agency**

Department of Health

### **Relevant Legislation**

Food Regulation 2004

## 4. **Electrical Installations**

### 4.1 **Administering Agency**

Department of Water and Energy

### **Relevant Legislation**

Electricity (Consumer Safety) Regulation 2006

### 4.2 **Administering Agency**

Workcover Authority

### **Relevant Legislation**

Occupational Health and Safety Regulations 2001

### 4.3 **Administering Agency**

Department of Energy, Utilities and Sustainability

### **Relevant Legislation**

Electricity Supply (General) Regulation 2001

## 5. **Fire Prevention in Existing Buildings**

### 5.1 **Administering Agency**

Department of Planning

### **Relevant Legislation**

Environmental Planning and Assessment Regulation 2000

## 6. **Gas Installations**

### 6.1 **Administering Agency**

Department of Water and Energy

### **Relevant Legislation**

Gas Supply Act 1996

Dangerous Goods (Gas Installations) Regulation 1998

## 6.2 Administering Agency

Workcover Authority

### Relevant Legislation

Occupational Health and Safety Regulation 2001

## 7. Historic Buildings

### 7.1 Administering Agency

Department of Planning

### Relevant Legislation

Heritage Regulation 2005

## 8. Lift Installations

### 8.1 Administering Agency

Workcover Authority

### Relevant Legislation

Occupational Health and Safety Regulation 2001

## 9. Moveable Dwellings (in Caravan Parks)

### 9.1 Administering Agency

Department of Local Government

### Relevant Legislation

Local Government Act 1993

### 9.2 Administering Agency

Department of Local Government

Department of Planning

### Relevant Legislation

Local Government (Manufactured Home Estates, Caravan Parks, Camping Grounds and Moveable Dwellings) Regulation 2005

## 10. Occupational Health and Safety

### 10.1 Administering Agency

Workcover Authority

### Relevant Legislation

Occupational Health and Safety Regulation 2001

## 11. Planning Controls

### 11.1 Administering Agency

Department of Planning

**Relevant Legislation**

Environmental Planning and Assessment Act 1979

Environmental Planning and Assessment Regulation 2000

## **12. Sanitary Plumbing, Water Supply and Sewerage**

### **12.1 Administering Agency**

Department of Local Government

**Relevant Legislation**

Local Government Act 1993

Local Government (General) Regulation 2005

### **12.2 Administering Agency**

Department of Water and Energy

**Relevant Legislation**

NSW Plumbing and Drainage Code 2006

## **13. Septic Tank Installations**

### **13.1 Administering Agency**

Department of Local Government

**Relevant Legislation**

Local Government Act 1993

Local Government (General) Regulation 2005

## **14. Sleeping Accommodation**

### **14.1 Administering Agency**

Department of Health

**Relevant Legislation**

Public Health (General) Regulation 2002

## **15. Swimming Pool Fences**

### **15.1 Administering Agency**

Department of Local Government

**Relevant Legislation**

Swimming Pools Act 1992

Swimming Pools Regulation 1998

## CONTENTS

### NORTHERN TERRITORY

Footnote: Other Legislation Affecting Buildings



## NORTHERN TERRITORY ADDITIONS

The Northern Territory has no additions to the Housing Provisions.

### Footnote: OTHER LEGISLATION AFFECTING BUILDINGS

In addition to any applicable provisions of the Building Act, Building Regulations and this Code, there are a number of other legislative technical requirements affecting the design, construction and/or performance of buildings that practitioners may need to be aware of, including, but not necessarily limited to, the following list. Additional legislative instruments such as regulations, codes and standards may exist under the legislation listed.

#### 1. Accommodation

##### 1.1 Administering Agency

Department of Health and Community Services

##### Relevant Legislation

Public Health Act

#### 2. Child Care

##### 2.1 Administering Agency

Department of Health and Community Services

##### Relevant Legislation

Community Welfare Act

Community Welfare (Child Care) Regulations

#### 3. Crown Land

##### 3.1 Administering Agency

Department of Planning and Infrastructure

##### Relevant Legislation

Crown Lands Act

#### 4. Electrical Installations

##### 4.1 Administering Agency

Department of Employment, Education and Training

##### Relevant Legislation

Electrical Workers and Contractors Act

Electricity Reform Act

Electricity Reform (Safety and Technical) Regulations

## **5. Fences — dividing**

### **5.1 Administering Agency**

Department of Justice

#### **Relevant Legislation**

Fences Act

## **6. Gas Installations**

### **6.1 Administering Agency**

Department of Employment, Education and Training

#### **Relevant Legislation**

Work Health Act

Work Health (Occupational Health and Safety) Regulations

## **7. Historic Building**

### **7.1 Administering Agency**

Department of Natural Resources, Environment and the Arts

#### **Relevant Legislation**

Heritage Conservation Act

## **8. Occupational Health and Safety**

### **8.1 Administering Agency**

Department of Employment, Education and Training

#### **Relevant Legislation**

Work Health Act

## **9. Planning Controls**

### **9.1 Administering Agency**

Department of Planning and Infrastructure

#### **Relevant Legislation**

Planning Act

Planning Scheme

## **10. Plumbing Installations**

### **10.1 Administering Agency**

Department of Planning and Infrastructure

#### **Relevant Legislation**

Plumbers and Drainers Licensing Act

Building Act

## **11. Stormwater Drainage (Municipal Roads)**

### **11.1 Administering Agency**

Council or Municipality in which building is located

#### **Relevant Legislation**

Local Government Act

## **12. Stormwater Drainage (Territory Roads)**

### **12.1 Administering Agency**

Department of Planning and Infrastructure

#### **Relevant Legislation**

Control of Roads Act

## **13. Swimming Pools**

### **13.1 Administering Agency**

Department of Local Government, Housing and Sport

#### **Relevant Legislation**

Swimming Pool Safety Act

## **14. Water Supply and Sewage Services**

### **14.1 Administering Agency**

Power and Water Corporation

#### **Relevant Legislation**

Water Supply and Sewerage Services Act

## CONTENTS

### QUEENSLAND

Footnote: Other Legislation Affecting Buildings

## QUEENSLAND ADDITIONS

---

Queensland has no additions to the *Housing Provisions*.

### **Footnote: OTHER LEGISLATION AFFECTING BUILDINGS**

All legislative technical requirements affecting the design, construction and/or performance of buildings are consolidated into the Building Act 1975 and other legislative instruments under that Act, such as regulations, codes (including this Code) and standards.

## CONTENTS

### **SOUTH AUSTRALIA**

#### **Acceptable Construction Manual**

SA 1 Application

#### **Health and Amenity**

SA 2 Water efficiency

SA 3 Wet Areas

#### **Safe movement and access**

SA 4 \* \* \* \* \*

SA 5 Access for People with Disabilities

SA 6 Access for Inspection and Maintenance

SA 7 Heated Water Services

Footnote: Other Legislation Affecting Buildings

## SOUTH AUSTRALIA ADDITIONS

### Application of South Australian variations

This Appendix contains additional provisions for application in South Australia as follows:

#### SA ACCEPTABLE CONSTRUCTION MANUAL

### SA 1 APPLICATION

Compliance with the *Deemed-to-Satisfy Provisions* of the South Australian Housing Code for Class 1a and Class 10a buildings satisfies the *Performance Requirements* in **Section 2** as modified by any variations and additions for South Australia.

#### HEALTH AND AMENITY

### SA 2 WATER EFFICIENCY

#### Limitation:

**SA 2** applies to new Class 1 buildings and, extensions to existing Class 1 buildings where the *roof catchment area* is not less than 50 m<sup>2</sup> -

- (a) located in *Council* areas, excluding the Municipal Council of Roxby Downs and the District Council of Coorbera;
- (b) where an extension incorporates a water closet or a water heater or laundry cold water outlet.

For the purposes of this part, *Council* means: A municipal or district Council as constituted under the Local Government Act 1999.

#### SA 2.1 PERFORMANCE PROVISIONS

##### Objective

The *Objective* is to efficiently use all available water supplies.

##### Functional Statement

A building is to be constructed in a way that efficiently uses all available water supplies to reduce the amount required from the mains reticulated water supply.

##### Performance Requirement

A building must provide an additional water supply (other than the mains reticulated potable water supply) which must be plumbed to at least a water closet or a water heater or all the cold water laundry outlets.

#### SA 2.2 ACCEPTABLE CONSTRUCTION PRACTICE

### SA 2.2.0 Definitions

The following definitions are used in this part:

*Rainwater tank* means a vessel for the storage of *surface water* collected from the *roof catchment area* of the building.

*Roof catchment area* means the area of the roof (expressed in square metres), measured on the horizontal (no allowance for slope or vertical surfaces) and includes the plan area of the gutters.

### SA 2.2.1 Application

Compliance with the acceptable construction practice provisions of [SA 2.2](#) for water efficiency satisfies [Performance Requirement SA 2.1](#).

### SA 2.2.2 Rainwater tank capacity

- (a) Where the *roof catchment area* of the building is not less than 50 m<sup>2</sup>, the building must be designed to ensure that *surface water* run-off from not less than 50m<sup>2</sup> of the *roof catchment area* is:
  - (i) collected by a drainage system complying with [Clauses 3.5.1](#) and [3.5.2](#) of the Building Code of Australia and;
  - (ii) stored in a *rainwater tank*, the storage capacity of which is not less than 1 kilolitre (1000 litres); and
  - (iii) plumbed to at least a water closet or a water heater or all laundry cold water outlets.
- (b) Where the *roof catchment area* of the building is less than 50m<sup>2</sup>, all the *surface water* run-off from the *roof catchment area* must be collected, stored and plumbed in accordance with [\(a\)\(i\)](#), [\(a\)\(ii\)](#) and [\(a\)\(iii\)](#).

#### Explanatory information:

[Clause SA 2.2.2](#) requires the *rainwater tank* to be plumbed to a water closet, water heater or all laundry cold water outlets. The South Australian Water Corporation regulates the plumbing work required to comply with this provision under the *Waterworks Act 1932* and the *Waterworks Regulations 1996*.

### SA 2.2.3 Rainwater tank overflow

The *rainwater tank* must be fitted with an overflow device that disposes of overflow from the *rainwater tank* in accordance with:

- (a) any specific requirements of the relevant authority; and
- (b) [Part 3.1.2](#) of the Building Code of Australia.

### SA 2.2.4 Rainwater tank water quality

The inlet and overflow of the *rainwater tank* must be fitted with mosquito proof, non-degradable screens.

#### Explanatory information:

[Clause SA 2.2.4](#) requires the fitting of mosquito proof, non-degradable screens to the *rainwater tank*. The quality of the water stored in the *rainwater tank* should be managed in accordance with the Department of Health and Ageing monograph titled "*Guidance on the use of rainwater tanks*".



**SA 2.2.5 Rainwater tank stands**

Where a *rainwater tank* is supported on a stand or other structure, the supporting structure must comply with [Clause 3.11.2](#).

**SA 3 WET AREAS****SA 3.1 PERFORMANCE PROVISIONS****Objective**

As per [Section 2 Objectives](#) for *wet areas*.

**Functional Statement**

As per [Section 2 Functional Statement](#) for *wet areas*.

**Performance Requirement**

Floors in bathrooms, or rooms containing a shower or a sanitary fixture, must be installed in a manner that will prevent accumulation of water on the surface which could create unhealthy or hazardous conditions.

**SA 3.2 ACCEPTABLE CONSTRUCTION PRACTICE****SA 3.2.1 Application**

[Performance Requirements P2.4.1](#) and [SA3.1](#) are satisfied for *wet areas* in Class 1 and 10 buildings if they are waterproofed in accordance with AS 3740 and the additional requirements of Minister's Specification SA F1.7.

**SAFE MOVEMENT AND ACCESS****SA 4 \* \* \* \* \***

This clause has been deliberately left blank.

**SA 5 ACCESS FOR PEOPLE WITH DISABILITIES****Limitation:**

SA 5 applies to Class 1 buildings in developments of 20 or more dwellings.

**SA 5.1 PERFORMANCE PROVISIONS****Objective**

Provide, as far as is reasonable, people with safe, equitable and dignified access to a degree necessary to—

- (a) buildings; and
- (b) the services and facilities within.

**Functional Statement**

A building to a degree necessary is, as far as is reasonable, to provide safe, equitable and dignified access for people to the services and facilities within.

**Performance Requirement**

Buildings and immediate surrounds must have appropriate features to a degree necessary to enable people with disabilities to safely and equitably—

- (a) negotiate the route from the road boundary to and within the building using a wheelchair; and
- (b) have access to spaces within the building, including facilities *required* under **P2.4.3**.

**SA 5.2 ACCEPTABLE CONSTRUCTION PRACTICE****SA 5.2.1 Application**

Compliance with the acceptable construction practice provisions of **Part SA 5.2** for access for people with disabilities satisfies *Performance Requirement SA 5.1*.

**SA Part 5.2** applies to certain Class 1 buildings where access is *required* under **Clause SA 5.2.2**.

**SA 5.2.2 Access to buildings**

In developments consisting of 20 or more dwellings, access must be provided to and within one dwelling or 5% of the total number of dwellings, whichever is the greater.

**SA 5.2.3 Parts of buildings to be accessible**

- (a) Access for people with disabilities must be provided from the entrance doorway to areas normally used by the occupants. A path of travel providing *required* access must not include a stairway or other impediment which would prevent a person in a wheelchair using it.
- (b) Access, finishes and fittings must comply with the provisions of AS 1428.1.
- (c) In every Class 1 building to which access for people with disabilities is *required*, one closet pan and washbasin and one shower must be provided for use by people with disabilities.

**SA 6 ACCESS FOR INSPECTION AND MAINTENANCE****SA 6.1 PERFORMANCE PROVISIONS****Objective**

The *Objective* is to safeguard people from injury and illness resulting from the creation of hazardous spaces between buildings.

**Functional Statement**

The space between buildings must not allow hazardous conditions to arise due to accumulation of rubbish that cannot be readily removed.

**Performance Requirement**

The space between buildings must be sufficient to allow access for inspection and maintenance to avoid hazardous conditions arising due to accumulation of rubbish that could—

- (a) bridge termite barriers; or
- (b) harbour vermin; or
- (c) create a fire hazard.

## SA 6.2 ACCEPTABLE CONSTRUCTION PRACTICE

### SA 6.2.1 Application

Compliance with the acceptable construction provision of **SA 6.2** for acceptable separation between buildings for Class 1 and 10 buildings satisfies *Performance Requirement SA 6.1*.

### SA 6.2.2 Minimum separation between buildings

Unless the space between external columns is not infilled, every part of an *external wall* of a building must be not less than 600 mm from—

- (a) any boundary of the allotment, unless that wall is on or abutting that boundary; or
- (b) the *external wall* of any other building on the same allotment, unless the two buildings are abutting.

## ENERGY EFFICIENCY

## SA 7 HEATED WATER SERVICES

### Limitation:

**SA 7** applies to heated water services installed to serve—

- (a) Class 1 buildings; or
- (b) alterations or additions to Class 1 buildings that involve the installation of a new or replacement heated water service.

### SA 7.1 DEFINITIONS

The following definitions are used in this Part:

**Energy Rating** means an Energy Rating as specified in AS 4552.

**Renewable Energy Certificates** means Renewable Energy Certificates issued under the Commonwealth Government's Mandatory Renewable Energy Target.

### SA 7.2 PERFORMANCE PROVISIONS

#### Objective

As per Section 2 *Objective O2.6*.

#### Functional Statement

As per Section 2 *Functional Statement F2.6*.

#### Performance Requirement

Heated water services must have greenhouse gas emission profiles not exceeding 100 kilograms of carbon dioxide equivalent per gigajoule of heated water (100 kgCO<sub>2</sub>-e/GJ).

### SA 7.3 VERIFICATION METHOD

Compliance with [Performance Requirement SA 7.2](#) is verified when greenhouse gas emissions calculated using the method described below do not exceed the specified [Performance Requirement](#).

- (a) Determine the peak daily thermal demand to be met by the heated water service (in MJ). This must be the value for either the large or small household demand, as specified for Zone 3, from Table A2 of Appendix A of AS 4234, subject to the restriction outlined in A4.1 of AS 4234.
- (b) Calculate the annual hot water demand (in GJ per year of delivered heat) by summing the daily hot water demand (in MJ) for each day of a continuous 365-day calendar year, and then multiplying the result by 0.001. For each day, the daily hot water demand is determined by multiplying the peak daily thermal demand by the relevant seasonal load profile load multiplier from Table A4 of AS 4234.
- (c) Calculate annual energy use as follows:
  - (i) For **electric heated water services**, calculate the annual energy used (in MJ) to supply the annual hot water demand. The hourly and seasonal load profile must be set out as in Table A3 and A4 and the cold water temperature for Zone 3 as in Table A5 of AS 4234. The calculation should use the actual performance parameters for the electric water heater as measured in AS 1056.1.
  - (ii) For **natural gas or LPG heated water services**, calculate the annual energy used (in MJ) to supply the annual hot water demand. The hourly and seasonal load profile must be as set out in Table A3 and A4 and the cold water temperature for Zone 3 as in Table A5 of AS 4234. The calculation should use the actual performance parameters for the gas water heater as measured in AS 4552 and the calculation procedures in AS 4552.
  - (iii) For **solar heated water services (electric or gas boosted) and heat pump heated water services**, calculate the annual energy used (in MJ) as per the performance evaluation procedures in AS 4234.
  - (iv) For **other types of heated water services**, calculate the annual energy used (MJ) to supply the annual hot water demand as per the calculation procedure in AS 4234 based on the relevant loads and load profiles defined in Tables A3, A4, A5 and A6 of AS 4234.
- (d) Calculate the annual greenhouse gas emissions (in kgCO<sub>2</sub>-e/y) by multiplying the annual energy used for the heated water service (in MJ per year) by 0.001, and then multiplying the result by the relevant South Australian full fuel cycle greenhouse coefficient (in kgCO<sub>2</sub>-e/GJ), as published in the most recent version of the Australian Government Department of Climate Change's National Greenhouse Accounts (NGA) Factors publication.
- (e) Calculate the average greenhouse gas emissions per unit of delivered heat (in kgCO<sub>2</sub>-e/GJ) by dividing the annual greenhouse gas emissions (in kgCO<sub>2</sub>-e/y) by the annual hot water demand (in GJ per year of delivered heat).

### SA 7.4 ACCEPTABLE CONSTRUCTION PRACTICE

Compliance with the acceptable construction practice provisions of [SA 7.4](#) for heated water services satisfies [Performance Requirement SA 7.2](#).

The heated water service must be one of the following:

- (a) A natural gas or LPG heated water service (instantaneous, continuous flow or storage) that has an [Energy Rating](#) of 5 stars or more and a tank volume, if applicable, of 700 litres or less.

**Explanatory information:**

[Energy Ratings](#) are provided for each model of gas water heater in the Australian Gas Association Directory of certified gas appliances and components.

- (b) An electric boosted solar heated water service or heat pump heated water service (air source or solar boosted), with a single tank, that:
- (i) For systems with a tank volume of 400 litres or more and 700 litres or less, is eligible for at least 38 [Renewable Energy Certificates](#) in Zone 3; or
  - (ii) For systems with a tank volume of more than 220 litres and less than 400 litres, is eligible for at least 27 [Renewable Energy Certificates](#) in Zone 3; or
  - (iii) For systems with a tank volume of 220 litres or less, is eligible for at least 17 [Renewable Energy Certificates](#) in Zone 3.

**Explanatory information:**

References to Zone 3 are as specified in AS 4234.

Numbers of [Renewable Energy Certificates](#) are provided for each model of solar heated water heater service, and are listed in Schedule 7, Part 2 of the (Commonwealth) Renewable Energy (Electricity) Regulations 2001.

- (c) An electric boosted solar water preheat product, with a series connected instantaneous booster or a second tank, that:
- (i) For systems with a preheat tank volume of 200 litres or more and 350 litres or less, is eligible for at least 38 [Renewable Energy Certificates](#) in Zone 3; or
  - (ii) For systems with a preheat tank volume of more than 110 litres and less than 200 litres, is eligible for at least 27 [Renewable Energy Certificates](#) in Zone 3; or
  - (iii) For systems with a preheat tank volume of 110 litres or less, is eligible for at least 17 [Renewable Energy Certificates](#) in Zone 3.
- (d) A natural gas or LPG boosted solar heated water service, with a total tank volume of 700 litres or less, that is eligible for any number of [Renewable Energy Certificates](#).
- (e) A wood combustion heated water service, with no additional heating mechanisms, with a total tank volume of 700 litres or less.
- (f) A wood combustion boosted solar heated water service, with no additional heating mechanisms, with a total tank volume of 700 litres or less.

## Footnote: OTHER LEGISLATION AFFECTING BUILDINGS

In addition to any applicable provisions of the Development Act 1993, the Development Regulations 1993 and this Code, there are a number of other legislative technical requirements

affecting the design, construction and/or performance of buildings that practitioners may need to be aware of, including, but not necessarily limited to, the following list. Additional legislative instruments such as regulations, codes and standards may exist under the legislation listed.

## **1. Accommodation**

### **1.1 Administering agency:**

Department for Families and Communities

#### **Relevant legislation:**

Supported Residential Facilities Act 1992

Supported Residential Facilities Regulations 1994

## **2. Asbestos Removal**

### **2.1 Administering agency:**

SafeWork SA, Department of the Premier and Cabinet

#### **Relevant legislation:**

Occupational Health, Safety and Welfare Act 1986

Occupational Health, Safety and Welfare Regulations 1995

## **3. Crown Land**

### **3.1 Administering agency:**

Department for Environment and Heritage

#### **Relevant legislation:**

Crown Lands Act 1929

## **4. Electrical Installations**

### **4.1 Administering agency:**

Office of the Technical Regulator, Department of Transport, Energy and Infrastructure

#### **Relevant legislation:**

Electricity Act 1996

Electricity (General) Regulations 1997

## **5. Fences**

### **5.1 Administering agency:**

Department of Justice

#### **Relevant legislation:**

Fences Act 1975

## **6. Fire Prevention in Existing Buildings**

### **6.1 Administering agency:**

Planning SA, Department of Primary Industries and Resources

**Relevant legislation:**

Development Act 1993

Development Regulations 1993

6.2 **Administering agency:**

SA Fire and Emergency Services Commission

**Relevant legislation:**

Fire and Emergency Services Act 2005

Fire and Emergency Services Regulations 2005

## 7. Gas Installations

7.1 **Administering agency:**

Office of the Technical Regulator, Department of Transport, Energy and Infrastructure

**Relevant legislation:**

Gas Act 1997

Gas Regulations 1997

## 8. Historic Buildings

8.1 **Administering agency:**

Department for Environment and Heritage

**Relevant legislation:**

Heritage Places Act 1993

## 9. Housing

9.1 **Administering agency:**

Department for Families and Communities

**Relevant legislation:**

Housing Improvement Act 1940

Housing Improvement (Standards) Regulations 1992

## 10. Lift Installations

10.1 **Administering agency:**

Safework SA, Department of the Premier and Cabinet

**Relevant legislation:**

Occupational Health, Safety and Welfare Act 1986

Occupational Health, Safety and Welfare Regulations 1995

## **11. Movable Dwellings (in caravan parks)**

### **11.1 Administering agency:**

Department for Consumer and Business Affairs

### **Relevant legislation:**

Residential Tenancies Act 1995

Residential Tenancies (General) Regulations 1995

## **12. Occupational Health and Safety**

### **12.1 Administering agency:**

SafeWork SA, Department of the Premier and Cabinet

### **Relevant legislation:**

Occupational Health, Safety and Welfare Act 1986

Occupational Health, Safety and Welfare Regulations 1995

## **13. Sanitary Plumbing, Water Supply and Sewerage**

### **13.1 Administering agency:**

South Australian Water Corporation

### **Relevant legislation:**

Sewerage Act 1929

Sewerage Regulations 1996

Waterworks Act 1932

Waterworks Regulations 1996

## **14. Septic Tank and Grey Water Installations**

### **14.1 Administering agency:**

Department of Health

### **Relevant legislation:**

Public and Environmental Health Act 1987

Public and Environmental Health (Waste Control) Regulations 1995

## **15. Subdivision of Property**

### **15.1 Administering agency:**

Land Services Group, Department of Transport, Energy and Infrastructure

### **Relevant legislation:**

Community Titles Act 1996

Community Titles Regulations 1996

Real Property Act 1886



Real Property (Land Division) Regulations 1995

Strata Titles Act 1988

Strata Titles Regulations 2003

## **16. Waste management and environment protection**

### **16.1 Administering agency:**

Environment Protection Authority

#### **Relevant legislation:**

Environment Protection Act 1993

Environment Protection (General) Regulations 1994

### **16.2 Administering agency:**

SA Water Corporation

#### **Relevant legislation:**

Sewerage Act 1929

Sewerage Regulations 1996

## CONTENTS

### **TASMANIA**

#### **Fire safety**

TAS 1 Non-Combustible Roof Coverings

#### **Health and Amenity**

TAS 2 Swimming Pool Water Reticulation and Filtration

Footnote: Other Legislation Affecting Buildings

## TASMANIA ADDITIONS

### Application of Tasmanian variations

This Appendix contains additional provisions for application in Tasmania as follows:

#### FIRE SAFETY

##### Limitation:

Tas 1 does not apply to—

1. roof coverings or canopies of PVC, Acrylic, Polycarbonate and GRP sheeting over a balcony, verandah, carport, covered way, swimming pool, barbecue area, or similar open structure attached to a Class 1 building; or
2. Class 1 buildings on land zoned Rural (except Rural Residential) in the Municipality's or City's sealed Planning Scheme, Effective Interim Order, or Special Planning Order if situated at a distance of not less than 30 m from a wooden building or the allotment boundary or not less than 15 m from other buildings; and
3. where, in accordance with [2.](#), a roof is covered with wood shingles or shakes, the shingles or shakes are underlaid with a material having a [Flammability index](#) not greater than 2.

#### TAS 1 — NON-COMBUSTIBLE ROOF COVERINGS

### TAS 1.1 PERFORMANCE PROVISIONS

#### Objective

The fire safety [Objective](#) is to prevent the spread of fire from air-borne embers.

#### Functional Statement

Protect Class 1 buildings from air-borne embers.

#### Performance Requirement

A Class 1 building must be protected from the spread of fire from air-borne embers from other property by the provision of a [non-combustible](#) roof covering.

### TAS 1.2 ACCEPTABLE CONSTRUCTION PRACTICE

#### Tas 1.2.1 Non-combustible roofing

A roof covered with any of the following materials satisfies the [Performance Requirements](#) of [Tas 1.1](#).

- (a) Metal sheeting or tiles.
- (b) Slates.
- (c) Terracotta or cement roofing tiles.

- (d) Fibre cement sheeting or shingles.
- (e) Asphalt shingles except on buildings with rise in storeys exceeding 2.
- (f) Built-up roofing covered with *non-combustible* material.
- (g) Concrete, granolithic, terrazzo, cement mortar, or other similar *non-combustible* materials.

## HEALTH AND AMENITY

### TAS 2 SWIMMING POOL WATER RETICULATION AND FILTRATION

#### Limitation:

Tas 2 does not apply to a *swimming pool* associated with a Class 1 building if the depth of water is less than 300 mm and the volume of the pool does not exceed 15 m<sup>3</sup>.

#### TAS 2.1 PERFORMANCE PROVISIONS

##### Objective

The *Objective* is to safeguard people from illness or injury arising from the use of a *swimming pool*.

##### Functional Statement

*Swimming pools* must provide for the health and safety of swimmers and others.

##### Performance Requirement

*Swimming pools* must be provided with an adequate water recirculation, disinfection and filtration system which is suitable and safe to use.

#### TAS 2.2 ACCEPTABLE CONSTRUCTION PRACTICE

##### Tas 2.2.1 Application

Compliance with the provisions of **Tas 2.2** for a *swimming pool* associated with a Class 1 building with a depth of water more than 300 mm and volume exceeding 15 m<sup>3</sup> satisfies *Performance Requirement Tas 2.1*.

##### Tas 2.2.2 Water recirculation and filtration system

A water recirculation, disinfection and filtration system in a *swimming pool* must provide for—

- (a) the inlet and outlet openings for the purpose of water recirculation to be so located that water movement is continuous from inlet to outlet; and
- (b) \* \* \* \* \*
- (c) the recirculation of water to be so designed that the pool contents are recirculated not less than once-
  - (i) in 6 hours for an outdoor *swimming pool*; or
  - (ii) in 4 hours for an indoor *swimming pool*; and
- (d) the water filtration rates to not exceed 12 250 L/m<sup>2</sup> of sand filter bed per hour, or an equivalent rate in other filter media.

## Footnote: OTHER LEGISLATION AFFECTING BUILDINGS

All legislative technical requirements affecting the design, construction and/or performance of buildings are consolidated into the Building Act 2000 and other legislative instruments under that Act, such as regulations, codes (including this Code) and standards.

## CONTENTS

### VICTORIA

Footnote: Other Legislation Affecting Buildings

## VICTORIA ADDITIONS

### Application of Victorian variations

This Appendix contains additional provisions for application in Victoria as follows:

## Footnote: OTHER LEGISLATION AFFECTING BUILDINGS

In addition to any applicable provisions of the Building Act 1993, Building Regulations 2006 and this Code, there are a number of other legislative technical requirements affecting the design, construction and/or performance of buildings that practitioners may need to be aware of, including, but not necessarily limited to, the following list. Additional legislative instruments such as regulations, codes and standards may exist under the legislation listed.

### 1. **Accommodation – Residential (Boarding Houses, Guest Houses, Hostels, Motels)**

#### 1.1 **Administering Agency**

Department of Human Services

Municipal council

#### **Relevant Legislation**

Health Act 1958

Health (Prescribed Accommodation) Regulations 2001

### 2. **Alpine Resorts**

#### 2.1 **Administering Agency**

Department of Planning and Community Development

Alpine Resorts Management Boards

#### **Relevant Legislation**

Alpine Resorts (Management) Act 1997

### 3. **Asbestos Removal**

#### 3.1 **Administering Agency**

Victorian WorkCover Authority

Environment Protection Authority

#### **Relevant Legislation**

Occupational Health and Safety Act 2004

Environment Protection Act 1970

### 4. **Crown Land**

#### 4.1 **Administering Agency**

Department of Planning and Community Development

Crown Land committees of management

**Relevant Legislation**

Crown Land (Reserves) Act 1978

## 5. Electrical Installations

### 5.1 Administering Agency

Energy Safe Victoria

Electrical transmission and distribution companies

**Relevant Legislation**

Electricity Industry Act 2000

Electricity Industry (Residual Provisions) Act 1993

Electricity Safety Act 1998

State Electricity Commission Act 1958

Electricity Safety (Installations) Regulations 1999

Electricity Safety (Network Assets) Regulations 1999

Standards Australia Wiring Rules, AS/NZS 3000/3013

## 6. Fences - dividing

### 6.1 Administering Agency

Department of Justice

**Relevant Legislation**

Fences Act 1968

## 7. Fire Prevention in Existing Buildings

### 7.1 Administering Agency

Municipal council

**Relevant Legislation**

Building Act 1993

Building Regulations 2006

## 8. Gas Installations

### 8.1 Administering Agency

Energy Safe Victoria

**Relevant Legislation**

Gas Industry Act 2001

Gas Safety Act 1997



Gas Safety (Gas Installation) Regulations 1999

AS5601 – 2004 Gas Installations

## **9. Historic Buildings**

### **9.1 Administering Agency**

Department of Planning and Community Development

Executive Director under the Heritage Act 1995

#### **Relevant Legislation**

Heritage Act 1995

## **10. Moveable Dwellings (in Caravan Parks)**

### **10.1 Administering Agency**

Department of Justice

Municipal council

#### **Relevant Legislation**

Residential Tenancies Act 1997

Residential Tenancies (Caravan Parks and Moveable Dwellings

Registration and Standards) Regulations 1999

## **11. Occupational Health and Safety**

### **11.1 Administering Agency**

Victorian WorkCover Authority

#### **Relevant Legislation**

Occupational Health and Safety Act 2004

Occupational Health and Safety Regulations 2007

Codes of practice published by the WorkCover Authority

## **12. Planning Controls**

### **12.1 Administering Agency**

Department of Planning and Community Development

Municipal council

#### **Relevant Legislation**

Planning and Environment Act 1987

Planning schemes

## **13. Sanitary Plumbing, Water Supply and Sewerage**

### **13.1 Administering Agency**

Plumbing Industry Commission

**Relevant Legislation**

Building Act 1993

Plumbing Regulations 2008

Plumbing Code of Australia

AS/NZS3500 National Plumbing and Drainage Code

**14 Septic Tank Installations****14.1 Administering Agency**

Environment Protection Authority

Municipal council

**Relevant Legislation**

Environment Protection Act 1970

Guidelines For Environmental Management: Code of Practice-Onsite wastewater management

**15. Subdivision of Buildings****15.1 Administering Agency**

Department of Planning and Community Development

Municipal council

**Relevant Legislation**

Subdivision Act 1988

## CONTENTS

### **WESTERN AUSTRALIA**

#### **Hot Water Systems**

#### **Water Use**

Footnote: Other Legislation Affecting Buildings

## WESTERN AUSTRALIA ADDITIONS

### Application of Western Australia additions

This appendix contains additional provisions for application in Western Australia as follows:

### HOT WATER SYSTEMS

#### WA 1.1 PERFORMANCE PROVISIONS

##### Objective

The *Objective* is to reduce greenhouse gas emissions.

##### Functional Statement

In order to reduce greenhouse gas emissions, a building, including its services, is to be capable of efficiently using appropriate sources of energy.

##### Performance Requirement

A building's hot water heating system, including any associated components, must produce low levels of greenhouse gases when heating water.

##### Application

The Performance Provisions of **WA 1.1** apply to Class 1 buildings and associated Class 10a buildings.

The *Performance Requirement* of **WA 1.1** for a building's hot water heating system is satisfied by complying with **WA 1.2**.

#### WA 1.2 ACCEPTABLE CONSTRUCTION PRACTICE

A hot water system must be one of the following:

- (a) A solar hot water system that—
  - (i) complies with AS 2712; and
  - (ii) has been tested in accordance with AS 4234; and
  - (iii) achieves a minimum energy saving of 60% for a hot water demand level of 38 MJ per day for *climate zone* 3.
- (b) A gas hot water system that—
  - (i) complies with AS 4552; and
  - (ii) achieves a minimum energy rating of 5 stars in accordance with AS 4552.
- (c) A heat pump hot water system that—
  - (i) complies with AS 2712; and
  - (ii) has been tested in accordance with AS 4234; and
  - (iii) achieves a minimum energy saving of 60% for a hot water demand level of 38 MJ per day for *climate zone* 3.

**WATER USE****WA 2.1 DEFINITIONS**

The following definitions are used in this Part—

**Potable water** means water intended for human consumption supplied by the holder of an operating licence within the meaning given in the Water Services Licensing Act 1995 section 3.

**WELS** has the meaning given in the Water Efficiency Labelling and Standards Act 2005 of the Commonwealth section 7.

**WA 2.2 PERFORMANCE PROVISIONS****Objective**

The objective is to reduce water demand by using water efficiently and minimising water wastage.

**Functional Statement**

To reduce *potable water* demand, a building is to be capable of using *potable water* efficiently and preventing excessive loss of *potable water*.

**Performance Requirements****(a) Water use efficiency**

A building must have features that, to the degree necessary, facilitate the efficient use of *potable water* appropriate to—

- (i) the geographic location of the building; and
- (ii) the available *potable water* supply for the building; and
- (iii) the function and use of the building.

**(b) Water loss prevention**

A building, including any water holding structure, must have features that, to the degree necessary, prevent the excessive loss of *potable water* appropriate to—

- (i) the geographic location of the building; and
- (ii) the available *potable water* supply for the building; and
- (iii) the function and use of the building; and
- (iv) the effects of permanent features such as topography, structures and buildings.

**(c) Hot water use efficiency**

A building must have features that, to the degree necessary, facilitate the efficient use of hot water appropriate to—

- (i) the geographic location of the building; and
- (ii) the available hot water supply for the building; and
- (iii) the function and use of the building.

**Application**

The Performance Provisions of [WA 2.2](#) apply to Class 1 buildings, associated Class 10a buildings and *swimming pools* associated with a Class 1 building.

A building's water use efficiency is satisfied by complying with [WA 2.3.1](#).

A building's water loss prevention is satisfied by complying with [WA 2.3.2](#).

A building's hot water use efficiency is satisfied by complying with [WA 2.3.3](#).

**WA 2.3 ACCEPTABLE CONSTRUCTION PRACTICE****WA 2.3.1 Water use efficiency**

- (a) All tap fittings other than bath outlets and garden taps must be a minimum of 4 stars *WELS* rated.
- (b) All showerheads must be a minimum of 3 stars *WELS* rated.
- (c) All sanitary flushing systems must be a minimum of 4 stars *WELS* rated dual flush.

**WA 2.3.2 Swimming pool covers and blankets**

An outdoor private *swimming pool* or spa associated with a Class 1 building must be supplied with a cover, blanket or the like that—

- (a) is designed to reduce water evaporation; and
- (b) is accredited under the Smart Approved Watermark Scheme governed by the Australian Water Association, the Irrigation Association of Australia, the Nursery and Garden Industry Australia and the Water Services Association of Australia.

**WA 2.3.3 Hot water use efficiency**

All internal hot water outlets (such as taps, showers and washing machine water supply fittings) must be connected to a hot water system or a re-circulating hot water system with pipes installed and insulated in accordance with AS/NZS 3500: Plumbing and Drainage, Part 4 Heated Water Services. The pipe from the hot water system or re-circulating hot water system to the furthest hot water outlet must not be more than 20 m in length or 2 litres of internal volume.

**Footnote: OTHER LEGISLATION AFFECTING BUILDINGS**

In addition to any applicable provisions of the Local Government (Miscellaneous Provisions) Act 1960, Building Regulations 1989 and this Code, there are a number of other legislative technical requirements affecting the design, construction and/or performance of buildings that practitioners may need to be aware of, including, but not necessarily limited to, the following list. Additional legislative instruments such as regulations, codes and standards may exist under the legislation listed.

**1. Building****1.1 Administering Agency**

Builders Registration Board

**Relevant Legislation**

Builders Registration Act 1939

## **2. Caravan Parks and Camping Grounds**

### **2.1 Administering Agency**

Department of Local Government and Regional Development

#### **Relevant Legislation**

Caravan Park and Camping Grounds Act 1995

Caravan Park and Camping Grounds Regulations 1997

## **3. Child Care**

### **3.1 Administering Agency**

Department for Communities

#### **Relevant Legislation**

Child Care Services Act 2007

Child Care Services Regulations 2007

Child Care Services (Child Care) Regulations 2006

Child Care Services (Family Day Care) Regulations 2006

Child Care Services (Outside School Hours Care) Regulations 2006

Child Care Services (Outside School Hours Family Day Care) Regulations 2006

## **4. Fences**

### **4.1 Administering Agency**

Department of Housing and Works

#### **Relevant Legislation**

Dividing Fences Act 1961

## **5. Health**

### **5.1 Administering Agency**

Department of Health

#### **Relevant Legislation**

Health Act 1911

Health Act (Laundries & Bathrooms) Regulations

Health (Air Handling and Water Systems) Regulations 1994

Health (Asbestos) Regulations 1992

Health (Construction Work) Regulations 1973

Construction Camp Regulations

Health (Treatment of Sewage and Disposal of Effluent and Liquid Waste) Regulations 1974

Health (Rottnest Island) By-laws 1989

Sewerage (Lighting, Ventilation and Construction) Regulations 1971

Model By-Laws Series 'A' and earlier versions where adopted by Local Government

Health Local Laws where adopted by Local Government

## 6. Heritage

### 6.1 Administering Agency

Heritage Council of Western Australia

#### Relevant Legislation

Heritage of Western Australia Act 1990

## 7. Housing

### 7.1 Administering Agency

Department of Housing and Works

#### Relevant Legislation

Housing Act 1980

## 8. Land

### 8.1 Administering Agency

Western Australian Land Information Authority

#### Relevant Legislation

Strata Titles Act 1985

## 9. Occupational Health and Safety

### 9.1 Administering Agency

Department of Consumer and Employment Protection

#### Relevant Legislation

Occupational Safety and Health Act 1984

## 10. Planning Controls

### 10.1 Administering Agency

Department for Planning and Infrastructure

#### Relevant Legislation

Planning and Development Act 2005

Planning and Development (Consequential and Transitional Provisions) Act 2005

## 11. Public Works

### 11.1 Administering Agency



---

Department of Housing and Works

**Relevant Legislation**

Public Works Act 1902

---

# INDEX ABBREVIATIONS AND SYMBOLS

## INDEX

### Abbreviations and Symbols

## INDEX CONTENTS

### INDEX ABBREVIATIONS AND SYMBOLS

Index

Abbreviations and Symbols

## INDEX (TO DEEMED-TO-SATISFY PROVISIONS)

---

### A

#### **Air movement (energy efficiency)**

[PART-3.12.4.1](#) Air movement

#### **Air-handling systems**

[PART-3.8.5.1](#) Application

#### **Airlocks**

[PART-3.8.5.3](#) Location of sanitary compartments

#### **Allowable bearing pressure (foundations)**

[PART-3.2.2.3](#) Foundations for footings and slabs

#### **Allowable encroachments (fire safety)**

[PART-3.7.1.7](#) Allowable encroachments

#### **Alpine areas**

[PART-3.7.5.1](#) Application

#### **Aluminium structures**

[PART-3.11.6](#) Determination of structural resistance of materials and forms of construction

#### **Articulated masonry**

[PART-3.2](#) Definitions

#### **Articulation joints**

[PART-3.3.1.8](#) Vertical articulation joints

#### **Artificial lighting**

[PART-3.8.4.3](#) Artificial lighting

#### **Asphalt shingles**

[PART-3.5.1.0](#) Acceptable construction manuals

### B

#### **Balcony (balustrades)**

[PART-3.9.2.1](#) Application

#### **Balustrades and barriers**

[PART-3.9.2.1](#) Application

#### **Baths**

[PART-3.8.3.1](#) Application

**BCA application**

[PART-1.0.1](#) Adoption

**BCA application (adoption of Standards)**

[PART-1.1.2](#) Adoption of referenced documents

**Bond beams**

[PART-3.3.2.2](#) External wall construction

**Borrowed light**

[PART-3.8.4.1](#) Application

**Breeze paths**

[PART-3.12.4.2](#) Ventilation openings

**Brick ties**

[PART-3.3.3.1](#) Application

**Building classification**

[PART-1.3.1](#) Principles of classification

**Building fabric**

[PART-3.12.1](#) Application

**Building sealing (energy efficiency)**

[PART-3.12.3](#) Application

**Bulk insulation (energy efficiency)**

[PART-3.12.1.1](#) Building fabric insulation

**Bushfire prone areas**

[PART-3.7.4.1](#) Application

## C

**Carports (fire safety)**

[PART-3.7.1.6](#) Class 10a buildings

**Cavity width**

[PART-3.3.4.2](#) Width of cavity

**Ceiling fans**

[PART-3.12.4.3](#) Ceiling fans and evaporative coolers

**Ceiling heights**

[PART-3.8.2.1](#) Application

**Ceiling insulation (energy efficiency)**

[PART-3.12.1.2](#) Roofs

**Central heating**

[PART-3.12.5.2](#) Central heating water piping

**Chimney construction**

[PART-3.7.3.3](#) Chimney construction

**Chimneys and flues (energy efficiency)**

[PART-3.12.3.1](#) Chimneys and flues

**Clad frame**

[PART-3.2](#) Definitions

**Class 10a buildings (energy efficiency)**

[PART-3.12.1.6](#) Attached Class 10a buildings

**Class 10a buildings (fire safety)**

[PART-3.7.1.6](#) Class 10a buildings

**Climate Zone map**

[PART-1.1.1](#) Definitions

**Clothes washing facilities**

[PART-3.8.3.1](#) Application

**Columns (structural steel)**

[PART-3.4.4.3](#) Columns

**Composite steel and concrete**

[PART-3.11.6](#) Determination of structural resistance of materials and forms of construction

**Concrete**

[PART-3.2.3.1](#) Concrete

**Concrete roof tiles**

[PART-3.5.1.1](#) Application

**Concrete structures**

[PART-3.11.6](#) Determination of structural resistance of materials and forms of construction

**Conditioned space**

[PART-3.12](#) Definitions

**Controlled fill**

[PART-3.2](#) Definitions

**Corrosion protection**

[PART-3.3.3.5](#) corrosion protection

**Corrosion protection (metal sheet roofing)**

[PART-3.5.1.3](#) Metal sheet roofing

**Corrosion protection (steel framing)**

[PART-3.4.2.2](#) General

**Corrosion protection (steel)**

[PART-3.4.4.4](#) Corrosion protection

**Corrosion protection (wall ties)**

[PART-3.3.3.2](#) Wall ties

**Cyclonic areas**

[PART-3.10.1.0](#) Acceptable construction manual

**D****Damp proof courses**

[PART-3.3.4.4](#) Damp-proof courses - materials

**Damp-proof course (DPC)**

[PART-3.3.4.1](#) Application

**Damp-proofing (slab on ground)**

[PART-3.2.2.1](#) Excavation for footings

**Definitions**

[PART-1.1.1](#) Definitions

**Design suitability**

[PART-1.2.2](#) Evidence of suitability

**Diagrams (interpretation)**

[PART-1.1.7](#) Interpretation of diagrams

**Domestic services (energy efficiency)**

[PART-3.12.5.1](#) Insulation of services

**Doors (energy efficiency)**

[PART-3.12.3.3](#) External windows and doors

**Doors (glass)**

[PART-3.6.4.1](#) 3.6.5 Doors

**Downpipes**

[PART-3.5.2.1](#) Application

**Drainage**

[PART-3.1.1.0](#) Application

[PART-3.1.2.1](#) Application

**Drainage (roofs)**

[PART-3.5.2.1](#) Application

**Ductwork (fire properties)**

[PART-3.7.1.9](#) Fire hazard properties

## E

### Early fire hazard indices

[PART-1.2.4](#) Early Fire Hazard Indices

[PART-3.7.1.9](#) Fire hazard properties

### Earthworks

[PART-3.1.1.0](#) Application

[PART-3.1.1.1](#) Earthworks

### Eaves and soffit linings

[PART-3.5.3.5](#) Eaves and soffit linings

### Edge beams

[PART-3.2.2.4](#) Slab edge support on sloping sites

[PART-3.2.5.4](#) Minimum edge beam dimensions

### Edge rebates

[PART-3.2.2.7](#) Edge rebates

### Enclosed shower

[PART-3.8.1](#) Definitions

### Energy efficiency

[PART-3.12.1](#) Application

### Energy efficiency (building fabric)

[PART-3.12.1](#) Application

### Energy efficiency (building sealing)

[PART-3.12.3](#) Application

### Energy efficiency (Class 10a)

[PART-3.12.1.6](#) Attached Class 10a buildings

### Evaporative coolers

[PART-3.12.3.6](#) Evaporative coolers

[PART-3.12.4.3](#) Ceiling fans and evaporative coolers

### Evaporative coolers (energy efficiency)

[PART-3.12.3.6](#) Evaporative coolers

### Evidence of suitability

[PART-1.2.2](#) Evidence of suitability

### Excavation

[PART-3.1.1.2](#) Excavation adjacent to vacant adjoining property

[PART-3.1.1.3](#) Excavation adjacent to existing buildings



**Excavation (footings)**

[PART-3.2.2.1](#) Excavation for footings

**Exhaust fans (energy efficiency)**

[PART-3.12.3.4](#) Exhaust fans

**Exhaust ventilation (closet pans, kitchens)**

[PART-3.8.5.1](#) Application

**Existing buildings (footings and slabs)**

[PART-3.2.5.2](#) Footings and slabs to extensions to existing buildings

**Exit (alpine areas)**

[PART-3.7.5.1](#) Application

**Explanatory information**

[PART-1.1.8](#) Explanatory information

**External glazing (energy efficiency)**

[PART-3.12.2](#) Application

**External stairways**

[PART-3.9.1.1](#) Application

**External wall (bond beam)**

[PART-3.3.2.2](#) External wall construction

**External wall (fire resistance)**

[PART-3.7.1.1](#) Application

**External wall (lintels)**

[PART-3.3.2.2](#) External wall construction

**External wall (reinforced masonry)**

[PART-3.3.2.2](#) External wall construction

**External walls (energy efficiency)**

[PART-3.12.1.4](#) External walls

**External walls (fire safety)**

[PART-3.7.1.3](#) External walls of Class 1 buildings

[PART-3.7.1.5](#) Construction of external walls

**External walls (masonry)**

[PART-3.3.1.2](#) External walls

**F****Fibre cement wall cladding**

[PART-3.5.3.3](#) Fibre cement planks and weatherboard cladding

**Fibre sheeting**

[PART-3.5.1.1](#) Application

**Fibre-cement sheet wall cladding**

[PART-3.5.3.4](#) Sheet wall cladding

**Fill**

[PART-3.1.1.4](#) Fill

**Fill (under slabs)**

[PART-3.2.2.2](#) Filling under concrete slabs

**Finished ground level**

[PART-3.2](#) Definitions

**Fire hazard properties**

[PART-3.7.1.9](#) Fire hazard properties

**Fire resistance (building elements)**

[PART-1.2.3](#) Fire resistance of building elements

**Fire resisting construction**

[PART-3.7.1.1](#) Application

**Fire safety**

[PART-3.7.1.1](#) Application

[PART-3.7.3.1](#) Application

**Fire safety (alpine areas)**

[PART-3.7.5.1](#) Application

**Fire safety (bushfire prone areas)**

[PART-3.7.4.1](#) Application

**Fire separation**

[PART-3.7.1.1](#) Application

**Fireplaces (energy efficiency)**

[PART-3.12.3.1](#) Chimneys and flues

**Fireplaces (footings)**

[PART-3.2.5.1](#) Footing and slab construction

[PART-3.2.5.5](#) Footings for fireplaces on Class A and S sites

**Fixing straps and tie down systems**

[PART-3.3.3.3](#) Fixing straps and tie down systems

**Flashings**

[PART-3.3.4.1](#) Application

[PART-3.3.4.6](#) Flashings

**Flashings (roofing)**

[PART-3.5.1.3](#) Metal sheet roofing

**Flashings (wall openings)**

[PART-3.5.3.6](#) Flashings to wall openings

**Flight**

[PART-3.9.1](#) Definitions

**Floors (dampproofing)**

[PART-3.2.2.1](#) Excavation for footings

**Floors (energy efficiency)**

[PART-3.12.1.5](#) Floors

**Floors (sealing for energy efficiency)**

[PART-3.12.3.5](#) Construction of roofs, walls and floors

**Floors (sub-floor ventilation)**

[PART-3.4.1.1](#) Application

**Flues, chimneys and fireplaces**

[PART-3.7.3.1](#) Application

**Footing**

[PART-3.2](#) Definitions

**Footing and slab construction**

[PART-3.2.5.1](#) Footing and slab construction

**Footings (stepped)**

[PART-3.2.2.5](#) Stepped footings

**Footings and slabs**

[PART-3.2.1](#) Application

[PART-3.2.2.1](#) Excavation for footings

**Foundations (footings and slabs)**

[PART-3.2.2.3](#) Foundations for footings and slabs

**Framing (steel)**

[PART-3.4.2.1](#) Application

**Framing (timber)**

[PART-3.4.3.0](#) Acceptable construction manual

**G****Glass (human impact)**

[PART-3.6.4](#) Human impact safety requirements

## Glazing

[PART-3.6.0](#) Acceptable construction manuals

[PART-3.6.1](#) Application

## Glazing area limits (energy efficiency)

[PART-3.12.2.1](#) External glazing

## Going

[PART-3.9.1](#) Definitions

## GRP sheeting

[PART-3.5.1.1](#) Application

## Gutters and downpipes

[PART-3.5.2.1](#) Application

# H

## Habitable room (ceiling heights)

[PART-3.8.2.1](#) Application

## Habitable room (natural light)

[PART-3.8.4.1](#) Application

## Habitable room (sound insulation)

[PART-3.8.6.1](#) Application

## Hearths

[PART-3.7.3.1](#) Application

## Heated floor slabs

[PART-3.12.1.5](#) Floors

## Heating and cooling ductwork

[PART-3.12.5.3](#) Heating and cooling ductwork

## Heating appliances

[PART-3.7.3.5](#) Installation of free standing heating appliances

## Heating appliances (energy efficiency)

[PART-3.12.3.1](#) Chimneys and flues

## Heating appliances (fire safety)

[PART-3.7.3.1](#) Application

## High wind areas

[PART-3.10.1.0](#) Acceptable construction manual

## High wind areas Cyclonic areas

[PART-3.10.1.0](#) Acceptable construction manual

**Hot water supply systems**

[PART-3.12.5.0](#) Acceptable construction manual

**Human impact (glass)**

[PART-3.6.4](#) Human impact safety requirements

**I****Impact sound**

[PART-3.8.6.1](#) Application

**Imposed actions (structural)**

[PART-3.11.1](#) Application

**Insulation (ductwork)**

[PART-3.12.5.3](#) Heating and cooling ductwork

**Insulation (energy efficiency)**

[PART-3.12.1.1](#) Building fabric insulation

**Insulation (services, energy efficiency)**

[PART-3.12.5.1](#) Insulation of services

**Internal walls (unreinforced masonry)**

[PART-3.3.1.3](#) Internal walls

**Interpretation of diagrams**

[PART-1.1.7](#) Interpretation of diagrams

**Isolated piers**

[PART-3.3.1.4](#) Isolated piers

**K****Kitchen exhaust**

[PART-3.8.5.1](#) Application

**Kitchen facilities**

[PART-3.8.3.1](#) Application

**L****Ladders**

[PART-3.9.1.1](#) Application

**Landing**

[PART-3.9.1](#) Definitions

**Landings**

[PART-3.9.1.1](#) Application

[PART-3.9.2.1](#) Application

**Language**

[PART-1.1.6](#) Language

**Laundry (waterproofing)**

[PART-3.8.1](#) Definitions

**Light**

[PART-3.8.4.1](#) Application

**Light (artificial)**

[PART-3.8.4.3](#) Artificial lighting

**Light (natural)**

[PART-3.8.4.2](#) Natural lighting

**Lintels**

[PART-3.3.2.2](#) External wall construction

[PART-3.3.3.1](#) Application

[PART-3.3.3.4](#) Lintels

[PART-3.4.4.1](#) Application

**Loadbearing wall**

[PART-3.2](#) Definitions

**Loads (structural)**

[PART-3.11.1](#) Application

**M****Masonry (reinforced)**

[PART-3.3.2.1](#) Application

**Masonry (unreinforced)**

[PART-3.3.1.1](#) Application

**Masonry (unreinforced, articulation joints)**

[PART-3.3.1.8](#) Vertical articulation joints

**Masonry (weatherproofing)**

[PART-3.3.4.1](#) Application

**Masonry accessories**

[PART-3.3.3.1](#) Application

**Masonry units**

[PART-3.3.1.5](#) Masonry units

**Masonry-veneer external walls**

[PART-3.3.1.2](#) External walls

**Materials (non-combustible)**

[PART-3.7.1.2](#) General concession—non-combustible materials

**Materials (suitability)**

[PART-1.2.1](#) Suitability of materials

**Metal sheet roofing**

[PART-3.5.1.3](#) Metal sheet roofing

**Mixed construction**

[PART-3.2](#) Definitions

**Moisture barriers**

[PART-3.2.2.6](#) Vapour barriers

**Mortar joints**

[PART-3.3.1.7](#) Mortar joints

**Mortar mixes**

[PART-3.3.1.6](#) Mortar mixes

**Multiple classifications**

[PART-1.3.3](#) Multiple classifications

## N

**Natural light**

[PART-3.8.4.2](#) Natural lighting

**Natural ventilation**

[PART-3.8.5.2](#) Ventilation requirements

**Non-combustible materials**

[PART-3.7.1.2](#) General concession—non-combustible materials

## O

**Open fireplace construction**

[PART-3.7.3.2](#) Open fireplace construction

**Openings in external walls**

[PART-3.7.1.3](#) External walls of Class 1 buildings

**Orientation factor (glazing)**

[PART-3.12.2.1](#) External glazing

## P

### Perimeter of building

[PART-3.6](#) Definitions

### Piled footing

[PART-3.2.1](#) Application

### Pipe insulation (central heating)

[PART-3.12.5.2](#) Central heating water piping

### Pipes (sound insulation)

[PART-3.8.6.4](#) Services

### Piping

[PART-3.12](#) Definitions

### Prefinished shower base

[PART-3.8.1](#) Definitions

### Primary building element

[PART-3.1](#) Definitions

### Principles of classification

[PART-1.3.1](#) Principles of classification

### Protection of openings

[PART-3.7.1.1](#) Application

### Protection of steelwork

[PART-3.3.3.5](#) corrosion protection

### PVC sheeting

[PART-3.5.1.1](#) Application

## R

### R-Value

[PART-3.12](#) Definitions

### Rainwater tanks

[PART-3.7.1.7](#) Allowable encroachments

### Referenced documents

[PART-1.4.1](#) Schedule of referenced documents

### Reflective insulation

[PART-3.12](#) Definitions

[PART-3.12.1.1](#) Building fabric insulation

### Reinforced masonry

[PART-3.3.2.1](#) Application



**Reinforcing (concrete)**

[PART-3.2.3.1](#) Concrete

**Riser**

[PART-3.9.1](#) Definitions

**Risers and goings**

[PART-3.9.1.4](#) Riser and going dimensions

**Rolled fill**

[PART-3.2](#) Definitions

**Roof cladding**

[PART-3.5.1.1](#) Application

**Roof insulation**

[PART-3.12.1.2](#) Roofs

**Roof lights (energy efficiency)**

[PART-3.12.1.3](#) Roof lights

[PART-3.12.3.2](#) Roof lights

**Roof lights (fire safety)**

[PART-3.7.1.10](#) Roof lights

**Roof tiling**

[PART-3.5.1.2](#) Roof tiling

**Roof ventilation (energy efficiency)**

[PART-3.12.1.2](#) Roofs

**Roofs (sealing for energy efficiency)**

[PART-3.12.3.5](#) Construction of roofs, walls and floors

**Room heights**

[PART-3.8.2.1](#) Application

## S

**Sanitary compartment (waterproofing)**

[PART-3.8.1](#) Definitions

**Sanitary compartments**

[PART-3.8.3.3](#) Construction of sanitary compartments

**Sanitary compartments (location and ventilation)**

[PART-3.8.5.3](#) Location of sanitary compartments

**Sanitary facilities**

[PART-3.8.3.1](#) Application

**Sarking-type materials**

[PART-3.7.1.9](#) Fire hazard properties

**Separating walls**

[PART-3.7.1.8](#) Separating walls

**Services (energy efficiency)**

[PART-3.12.5.1](#) Insulation of services

**Services (sound insulation)**

[PART-3.8.6.4](#) Services

**Services (steel framing)**

[PART-3.4.2.6](#) Installation of services

**Shading (energy efficiency)**

[PART-3.12.2.2](#) Shading

**Shower enclosure**

[PART-3.8.1](#) Definitions

**Shower screens**

[PART-3.6.4.5](#) 3.6.9 Shower doors, shower screens and bath enclosures

**Shower tray**

[PART-3.8.1](#) Definitions

**Showers**

[PART-3.8.3.1](#) Application

**Shrinkage (timber framing)**

[PART-3.3.1.10](#) Shrinkage allowance for timber framing

**Shrinkage control**

[PART-3.2.5.3](#) Shrinkage control

**Single leaf masonry**

[PART-3.2](#) Definitions

**Site classification**

[PART-3.2.4.1](#) Site classification

**Siteworks**

[PART-3.1.1.0](#) Application

**Siteworks (drainage)**

[PART-3.1.2.1](#) Application

**Slab (edge insulation)**

[PART-3.12.1.5](#) Floors

**Slab edge support**

[PART-3.2.2.4](#) Slab edge support on sloping sites

**Slabs**

[PART-3.2.5.1](#) Footing and slab construction

**Smoke alarms**

[PART-3.7.2.1](#) Application

**Snow areas (fire safety)**

[PART-3.7.5.1](#) Application

**Snow loads**

[PART-3.11.1](#) Application

**Sound insulation**

[PART-3.8.6.1](#) Application

**Spiral stair**

[PART-3.9.1](#) Definitions

**Stair construction**

[PART-3.9.1.1](#) Application

**Stairway (balustrades)**

[PART-3.9.2.1](#) Application

**Standards**

[PART-1.1.2](#) Adoption of referenced documents

[PART-1.4.1](#) Schedule of referenced documents

**Steel (corrosion protection)**

[PART-3.4.4.4](#) Corrosion protection

**Steel (structural members)**

[PART-3.4.4.1](#) Application

**Steel columns**

[PART-3.4.4.3](#) Columns

**Steel floor framing**

[PART-3.4.2.3](#) Steel floor framing

**Steel framing**

[PART-3.4.2.1](#) Application

**Steel framing (corrosion protection)**

[PART-3.4.2.2](#) General

**Steel reinforcement**

[PART-3.2.3.2](#) Steel reinforcement

**Stepped footings**

[PART-3.2.2.5](#) Stepped footings

**Stormwater drainage**

[PART-3.1.2.1](#) Application

[PART-3.5.2.1](#) Application

**Structural (earthquake areas)**

[PART-3.11.1](#) Application

**Structural steel members**

[PART-3.4.4.1](#) Application

**Stump footings**

[PART-3.2.5.6](#) Stump footing details

**Sub-floor ventilation**

[PART-3.3.1.9](#) Sub-floor ventilation

[PART-3.4.1.1](#) Application

**Suitability of materials**

[PART-1.2.1](#) Suitability of materials

**Swimming pools**

[PART-3.9.3.1](#) Application

## T

**Tapered tread**

[PART-3.9.1](#) Definitions

**Termite barriers**

[PART-3.1.3.2](#) Installation of termite barriers

**Termite barriers (slab-on-ground)**

[PART-3.1.3.3](#) Barriers for concrete slab-on-ground

**Termite barriers (suspended floor)**

[PART-3.1.3.4](#) Barriers for suspended floors

**Termite shields (damp proof course)**

[PART-3.3.4.4](#) Damp-proof courses - materials

**Termites**

[PART-3.1-3.1.3](#) Application

**Terracotta roof tiles**

[PART-3.5.1.1](#) Application

**Thresholds**

[PART-3.9.1.5](#) Threshold

**Tie down straps**

[PART-3.3.3.3](#) Fixing straps and tie down systems

**Timber framing**

[PART-3.4.3.0](#) Acceptable construction manual

**Timber framing (shrinkage, masonry veneer)**

[PART-3.3.1.10](#) Shrinkage allowance for timber framing

**Timber wall cladding**

[PART-3.5.3.2](#) Timber weatherboard cladding

**Total R-Value**

[PART-3.12](#) Definitions

**Total U-Value**

[PART-3.12](#) Definitions

**Treads**

[PART-3.9.1.4](#) Riser and going dimensions

## U

**Unobstructed opening**

[PART-3.6](#) Definitions

**Unreinforced masonry**

[PART-3.3.1.1](#) Application

## V

**Vapour barriers**

[PART-3.2.2.1](#) Excavation for footings

[PART-3.2.2.6](#) Vapour barriers

**Ventilation**

[PART-3.8.5.1](#) Application

**Ventilation (sub-floor)**

[PART-3.3.1.9](#) Sub-floor ventilation

[PART-3.4.1.1](#) Application

**Ventilation opening**

[PART-3.12](#) Definitions

**Ventilation openings**

[PART-3.12.4.2](#) Ventilation openings

**Verification method**

- [V2.6.1](#) Application of this Part
- [V2.6.2](#) Alternative Verification Methods
  - [V2.6.2.1](#) Verification using stated value
  - [V2.6.2.2](#) Verification using a reference building

**Vertical articulation joints**

- [PART-3.3.1.8](#) Vertical articulation joints

**Visibility of glazing**

- [PART-3.6.4.6](#) Visibility of glazing

## W

**Waffle raft**

- [PART-3.2](#) Definitions

**Wall cladding**

- [PART-3.5.3.1](#) Application

**Wall ties**

- [PART-3.3.3.1](#) Application
- [PART-3.3.3.2](#) Wall ties

**Walls (sealing for energy efficiency)**

- [PART-3.12.3.5](#) Construction of roofs, walls and floors

**Washbasins**

- [PART-3.8.3.1](#) Application

**Water resistant**

- [PART-3.8.1](#) Definitions

**Waterproof**

- [PART-3.8.1](#) Definitions

**Waterproof membrane**

- [PART-3.8.1](#) Definitions

**Waterproofing**

- [PART-3.8.1](#) Definitions

**Weatherproofing (masonry)**

- [PART-3.3.4.1](#) Application

**Weepholes (bushfire prone areas)**

- [PART-3.7.4.1](#) Application

**Weighted sound reduction index**

- [PART-3.8.6.1](#) Application

**Wet area**

[PART-3.8.1](#) Definitions

**Wet area fixture**

[PART-3.8.1](#) Definitions

**Width of cavity**

[PART-3.3.4.2](#) Width of cavity

**Winders**

[PART-3.9.1](#) Definitions

**Windows (energy efficiency)**

[PART-3.12.3.3](#) External windows and doors

**Windows (natural light)**

[PART-3.8.4.2](#) Natural lighting

## ABBREVIATIONS AND SYMBOLS

Abbreviations and Symbols used in the *Housing Provisions* include:

### ABBREVIATIONS

ABCB	Australian Building Codes Board
AISC	Australian Institute of Steel Construction
ALGA	Australian Local Government Association
AS	Australian Standard
ASTM	American Society for Testing and Materials
BCA	Building Code of Australia
BCC	Building Codes Committee
CSIRO	Commonwealth Scientific and Industrial Research Organisation
FRL	Fire Resistance Level
GRP	glass fibre reinforced polyester
ISO	International Organisation for Standardisation
Low-e	Low emissivity
NATA	National Association of Testing Authorities
Pa	Pascal
PVC	polyvinyl chloride
$R_w$	Weighted Sound Reduction Index
R-Value	Thermal resistance coefficient
SHGC	Solar heat gain coefficient
STC	Sound Transmission Class
UPVC	Unplasticised polyvinyl chloride
U-Value	Heat transfer coefficient

### SYMBOLS AND SI UNITS

°C	degree(s) Celsius
g/m <sup>2</sup>	gram(s) per square metre
K	kelvin(s)
kg	kilogram(s)
kg/m	kilogram(s) per metre
kg/m <sup>2</sup>	kilogram(s) per square metre
kg/m <sup>3</sup>	kilogram(s) per cubic metre
km	kilometre



SUPERSEDED  
INDEX ABBREVIATIONS AND SYMBOLS

---

kPa	kilopascal(s)
kW/m <sup>2</sup>	kilowatt(s) per square metre
L	litre(s)
L/s	litre(s) per second
L/s.m <sup>2</sup>	litre(s) per second square metre
lx	lux
Ø	diameter
F	in relation to steel members means steel fabric
m	metre(s)
m <sup>2</sup>	square metre(s)
m <sup>3</sup>	cubic metre(s)
m/s	metre(s) per second
m <sup>3</sup> /s	cubic metre(s) per second
mm	millimetre(s)
mm <sup>2</sup>	square millimetre(s)
µm	micrometer
MJ/m <sup>2</sup> .annum	megajoule(s) per square metre per annum
MW	megawatt(s)
N	newton(s)
Pa	pascal(s)
MPa	megapascal(s)
°south	degree south
%	percent
>	greater than
<	less than
≤	equal to or less than
≥	equal to or more than

---

# HISTORY OF AMENDMENTS

## CONTENTS

---

### HISTORY OF AMENDMENTS

#### History of amendments

- 1.0 Adoption of BCA96
- 1.1 Amendment No. 1
- 1.2 Amendment No. 2
- 1.3 Amendment No. 3
- 1.4 Amendment No. 4
- 1.5 Amendment No. 5
- 1.6 Amendment No. 6
- 1.7 Amendment No. 7
- 1.8 Amendment No. 8
- 1.9 Amendment No. 9
- 1.10 Amendment No. 10
- 1.11 Amendment No. 11
- 1.12 Amendment No. 12
- 1.13 Amendment No. 13
- 2.0 Adoption of BCA 2004
- 3.0 Adoption of BCA 2005
- 4.0 Adoption of BCA 2006
- 5.0 Adoption of BCA 2007
- 6.0 Adoption of BCA 2008
- 7.0 Adoption of BCA 2009

## HISTORY OF BCA ADOPTION

### 1.0 Adoption of BCA96

The 1996 edition of the BCA was adopted by the Commonwealth, States and Territories as set out in Table 1.0.

**Table 1.0 History of adoption of BCA96**

Administration	Adoption Date
Australian Government	1 July 1997
Australian Capital Territory	1 July 1997
New South Wales	1 July 1997
Northern Territory	7 January 1998
Queensland	1 July 1997
South Australia	1 January 1998
Tasmania	1 July 1997
Victoria	1 August 1997
Western Australia	1 July 1997

### 1.1 Amendment No. 1

- (a) Amendment No. 1 of the 1996 edition of the BCA was adopted by the Commonwealth, States and Territories as set out in Table 1.1.

**Table 1.1 History of adoption of Amendment No. 1 of BCA96**

Administration	Adoption Date
Australian Government	1 July 1997
Australian Capital Territory	1 July 1997
New South Wales	1 July 1997
Northern Territory	7 January 1998
Queensland	1 July 1997
South Australia	1 January 1998
Tasmania	1 July 1997
Victoria	1 August 1997
Western Australia	1 July 1997

- (b) The purpose of Amendment No. 1 is to—
- (i) include typographical changes including spelling, punctuation, cross references and layout; and
  - (ii) include reference to a [Certificate of Conformity](#) issued by the ABCB in A2.2; and

# SUPERSEDED HISTORY OF AMENDMENTS

- (iii) change the reference to the Standards Mark Certificate to refer to JAS–ANZ in A2.2; and
- (iv) update references to Standards.

**Note:**

The revisions contained in Amendment No. 1 to the *Housing Provisions* have not been marked in the text.

## 1.2 Amendment No. 2

- (a) Amendment No. 2 of the 1996 edition of the BCA was adopted by the Commonwealth, States and Territories as set out in Table 1.2.

**Table 1.2 History of adoption of Amendment No. 2 of BCA96**

Administration	Adoption Date
Australian Government	1 January 1998
Australian Capital Territory	1 January 1998
New South Wales	27 February 1998
Northern Territory	7 January 1998
Queensland	1 January 1998
South Australia	1 January 1998
Tasmania	1 January 1998
Victoria	1 January 1998
Western Australia	1 January 1998

- (b) The purpose of Amendment No. 2 is to—
  - (i) include typographical changes including spelling, punctuation, cross references and layout; and
  - (ii) update references to Standards; and
  - (iii) include minor technical changes.

## 1.3 Amendment No. 3

- (a) Amendment No. 3 of the 1996 edition of the BCA was adopted by the Commonwealth, States and Territories as set out in Table 1.3.

**Table 1.3 History of adoption of Amendment No. 3 of BCA96**

Administration	Adoption Date
Australian Government	1 July 1998
Australian Capital Territory	1 July 1998
New South Wales	1 July 1998
Northern Territory	1 July 1998
Queensland	1 July 1998

# SUPERSEDED HISTORY OF AMENDMENTS

**Table 1.3 History of adoption of Amendment No. 3 of BCA96— continued**

Administration	Adoption Date
South Australia	13 July 1998
Tasmania	1 July 1998
Victoria	1 July 1998
Western Australia	1 July 1998

- (b) The purpose of Amendment No. 3 is to—
- (i) incorporate the outcomes of the 1997 ABCB Variations Conference; and
  - (ii) update references to Standards; and
  - (iii) include minor technical changes.

## 1.4 Amendment No. 4

- (a) Amendment No. 4 of the 1996 edition of the BCA was adopted as set out in Table 1.4.

**Table 1.4 History of adoption of Amendment No. 4 of BCA96**

Administration	Adoption Date
Australian Government	1 January 1999
Australian Capital Territory	17 May 1999
New South Wales	1 February 1999
Northern Territory	1 January 1999
Queensland	1 January 1999
South Australia	1 January 1999
Tasmania	1 January 1999
Victoria	1 January 1999
Western Australia	1 January 1999

- (b) The purpose of Amendment No. 4 is to—
- (i) update references to Standards; and
  - (ii) include minor technical changes.

## 1.5 Amendment No. 5

- (a) Amendment No. 5 of the 1996 edition of the BCA was adopted by the Commonwealth, States and Territories as set out in Table 1.5.

**Table 1.5 History of adoption of Amendment No. 5 of BCA96**

Administration	Adoption Date
Australian Government	1 July 1999
Australian Capital Territory	3 November 1999

Table 1.5 History of adoption of Amendment No. 5 of BCA96—continued

Administration	Adoption Date
New South Wales	1 August 1999
Northern Territory	1 July 1999
Queensland	1 July 1999
South Australia	1 July 1999
Tasmania	1 July 1999
Victoria	1 July 1999
Western Australia	1 July 1999

- (b) The purpose of Amendment No. 5 is to—
- (i) update references to Standards; and
  - (ii) expand on the requirements for sub-floor ventilation based on climatic conditions; and
  - (iii) revise the Acceptable Construction Practice for Steel framing; and
  - (iv) include additional details in the Acceptable Construction Practice for fencing of swimming pools; and
  - (v) include minor technical changes.

## 1.6 Amendment No. 6

- (a) Amendment No. 6 of the 1996 edition of the BCA was adopted by the Commonwealth, States and Territories as set out in Table 1.6.

Table 1.6 History of adoption of Amendment No. 6 of BCA96

Administration	Adoption Date
Australian Government	1 January 2000
Australian Capital Territory	10 February 2000
New South Wales	1 January 2000
Northern Territory	1 January 2000
Queensland	1 January 2000
South Australia	17 January 2000
Tasmania	1 January 2000
Victoria	1 January 2000
Western Australia	1 January 2000

- (b) The purpose of Amendment No. 6 is to—
- (i) update references to Standards; and
  - (ii) revise the Acceptable Construction Practice for Footing and Slab Construction; and
  - (iii) replace Sound Transmission Class (STC) with weighted sound reduction index ( $R_w$ ) within Part 3.8.6; and

- (iv) include minor technical changes.

## 1.7 Amendment No. 7

- (a) Amendment No. 7 of the 1996 edition of the BCA was adopted by the Commonwealth, States and Territories as set out in Table 1.7.

**Table 1.7 History of adoption of Amendment No. 7 of BCA96**

Administration	Adoption Date
Australian Government	1 July 2000
Australian Capital Territory	10 July 2000
New South Wales	1 July 2000
Northern Territory	1 July 2000
Queensland	1 July 2000
South Australia	1 July 2000
Tasmania	1 July 2000
Victoria	1 July 2000
Western Australia	1 July 2000

- (b) The purpose of Amendment No. 7 is to—
- (i) update references to Standards; and
  - (ii) include requirements for separation of eaves and verandah spaces that are open to the roof space and common to 2 or more Class 1 buildings; and
  - (iii) reinstate the Acceptable Construction Practice for buildings in bushfire-prone areas, following alignment with the 1999 version of AS 3959; and
  - (iv) change the limitations on winders used in lieu of quarter and half landings within stairways; and
  - (v) include minor technical changes.

## 1.8 Amendment No. 8

- (a) Amendment No. 8 of the 1996 edition of the BCA was adopted by the Commonwealth, States and Territories as set out in Table 1.8.

**Table 1.8 History of adoption of Amendment No. 8 of BCA96**

Administration	Adoption Date
Australian Government	1 January 2001
Australian Capital Territory	11 January 2001
New South Wales	1 January 2001
Northern Territory	1 January 2001
Queensland	1 January 2001
South Australia	1 January 2001



SUPERSEDED  
HISTORY OF AMENDMENTS

**Table 1.8 History of adoption of Amendment No. 8 of BCA96— continued**

Administration	Adoption Date
Tasmania	1 January 2001
Victoria	1 January 2001
Western Australia	1 January 2001

- (b) The purpose of Amendment No. 8 is to—
- (i) update references to Standards; and
  - (ii) include minor technical changes; and
  - (iii) achieve greater consistency between both Volumes of the BCA for stair construction.

## 1.9 Amendment No. 9

- (a) Amendment No. 9 of the 1996 edition of the BCA was adopted by the Commonwealth, States and Territories as set out in Table 1.9.

**Table 1.9 History of adoption of Amendment No. 9 of BCA96**

Administration	Adoption Date
Australian Government	1 July 2001
Australian Capital Territory	12 July 2001
New South Wales	1 July 2001
Northern Territory	1 July 2001
Queensland	1 July 2001
South Australia	2 July 2001
Tasmania	1 July 2001
Victoria	1 July 2001
Western Australia	1 July 2001

- (b) The purpose of Amendment No. 9 is to—
- (i) update references to Standards; and
  - (ii) include minor technical changes; and
  - (iii) clarify which glazing assemblies must comply with AS 2047 and which must comply with AS 1288.

## 1.10 Amendment No. 10

- (a) Amendment No. 10 of the 1996 edition of the BCA was adopted by the Commonwealth, States and Territories as set out in Table 1.10.

**Table 1.10 History of adoption of Amendment No. 10 of BCA96**

Administration	Adoption Date
Australian Government	1 January 2002
Australian Capital Territory	1 January 2002
New South Wales	1 January 2002
Northern Territory	1 January 2002
Queensland	1 January 2002
South Australia	1 January 2002 (except SA2—date to be advised)
Tasmania	1 January 2002
Victoria	1 January 2002
Western Australia	1 January 2002

- (b) The purpose of Amendment No. 10 is to—
- (i) update references to Standards; and
  - (ii) update the requirements for protective coatings for steelwork in locations near saltwater; and
  - (iii) align [Figure 3.6.1](#) dealing with glazing with AS 1288; and
  - (iv) extend the concession for fire separation of windows in non-habitable rooms to windows in bathrooms, laundries and toilets and also include buildings on the same allotment; and
  - (v) replace testing to AS/NZS 1530.3 for timber in bushfire areas with reference to AS/NZS 3837; and
  - (vi) include minor technical changes.

## 1.11 Amendment No. 11

- (a) Amendment No. 11 of the 1996 edition of the BCA was adopted by the Commonwealth, States and Territories as set out in Table 1.11.

**Table 1.11 History of adoption of Amendment No. 11 of BCA96**

Administration	Adoption Date
Australian Government	1 July 2002
Australian Capital Territory	1 July 2002 (except Australian Capital Territory additions—which was adopted on 21 June 2002)
New South Wales	1 July 2002
Northern Territory	1 July 2002
Queensland	1 July 2002
South Australia	1 July 2002
Tasmania	1 July 2002

Table 1.11 History of adoption of Amendment No. 11 of BCA96—continued

Administration	Adoption Date
Victoria	1 July 2002
Western Australia	1 July 2002

- (b) The purpose of Amendment No. 11 is to—
- (i) update references to Standards; and
  - (ii) transfer public policy matters, with respect to structural adequacy, from the AS 1170 series to the BCA; and
  - (iii) introduce new definitions and more detailed provisions on the installation of *flashings* and *damp-proof courses*; and
  - (iv) include minor technical changes.

## 1.12 Amendment No. 12

- (a) Amendment No. 12 of the 1996 edition of the BCA was adopted by the Commonwealth, States and Territories as set out in Table 1.12.

Table 1.12 History of adoption of Amendment No. 12 of BCA96

Administration	Adoption Date
Australian Government	1 January 2003
Australian Capital Territory	1 January 2003
New South Wales	1 January 2003
Northern Territory	1 January 2003
Queensland	1 January 2003
South Australia	1 January 2003
Tasmania	1 January 2003
Victoria	1 January 2003
Western Australia	1 January 2003

- (b) The purpose of Amendment No. 12 is to—
- (i) update references to Standards; and
  - (ii) allow the use of either the 1989 editions or the 2002 editions of the 1170 series of standards; and
  - (iii) include Energy Efficiency measures into the *Housing Provisions*; and
  - (iv) include minor technical changes.

**Note:**

Only substantive typographical corrections are noted in the margin.

### 1.13 Amendment No. 13

- (a) Amendment No. 13 of the 1996 edition of the BCA was adopted by the Commonwealth, States and Territories as set out in Table 1.13.

**Table 1.13 History of adoption of Amendment No. 13 of BCA96**

Administration	Adoption Date
Australian Government	1 July 2003
Australian Capital Territory	1 July 2003
New South Wales	1 July 2003
Northern Territory	1 July 2003
Queensland	1 July 2003 (except for <b>Parts 2.6</b> and <b>3.12</b> which are adopted on 1 September 2003)
South Australia	1 July 2003
Tasmania	1 July 2003
Victoria	1 July 2003
Western Australia	1 July 2003

- (b) The purpose of Amendment No. 13 is to—
- (i) update references to Standards; and
  - (ii) refine the Energy Efficiency provisions and advise of their adoption in Western Australia and Queensland; and
  - (iii) include minor technical changes.

**Note:**

Only substantive typographical corrections are noted in the margin.

## 2.0 Adoption of BCA 2004

- (a)

The 2004 edition of the BCA was adopted by the Commonwealth, States and Territories as set out in Table 2.0.

**Table 2.0 History of adoption**

Administration	Adoption Date
Australian Government	1 May 2004
Australian Capital Territory	1 May 2004
New South Wales	1 May 2004
Northern Territory	1 May 2004
Queensland	1 May 2004
South Australia	1 May 2004

Table 2.0 History of adoption — continued

Administration	Adoption Date
Tasmania	1 May 2004
Victoria	1 May 2004
Western Australia	1 May 2004

- (b) The purpose of BCA 2004 is to—
- (i) remove references to BCA 96; and
  - (ii) clarify the method of determining the Performance Requirements that are relevant to Alternative Solutions; and
  - (iii) update references to other documents; and
  - (iv) revise the acceptable construction practice for footing and slab construction; and
  - (v) prohibit the use of lead on roofs used to collect potable water; and
  - (vi) reform the provisions for sound insulation; and
  - (vii) update the Energy Efficiency provisions; and
  - (viii) include minor technical changes.

### 3.0 Adoption of BCA 2005

- (a) The 2005 edition of the BCA was adopted by the Commonwealth, States and Territories as set out in Table 3.0.

Table 3.0 History of adoption of BCA 2005

Administration	Adoption Date
Australian Government	1 May 2005
Australian Capital Territory	1 May 2005
New South Wales	1 May 2005
Northern Territory	1 May 2005
Queensland	1 May 2005
South Australia	1 May 2005
Tasmania	1 May 2005
Victoria	1 May 2005
Western Australia	1 May 2005

- (b) The purpose of BCA 2005 is to—
- (i) update references to other documents; and
  - (ii) update the provisions for waterproofing of wet areas; and
  - (iii) update balustrading provisions to include wire balustrades; and
  - (iv) include minor technical changes.

## 4.0 Adoption of BCA 2006

- (a) The 2006 edition of the BCA was adopted by the Commonwealth, States and Territories as set out in Table 4.0.

**Table 4.0 History of adoption of BCA 2006**

Administration	Adoption Date
Australian Government	1 May 2006
Australian Capital Territory	1 May 2006
New South Wales	1 May 2006
Northern Territory	1 May 2006
Queensland	1 May 2006
South Australia	1 May 2006, except for South Australian variations P2.6.2, V2.6.2.3 and 3.12.5.4 and South Australian addition SA2 which were adopted on 1 July 2006. The adoption of South Australian variation clause 3.7.4.2 is yet to be advised.
Tasmania	1 May 2006
Victoria	1 May 2006
Western Australia	1 May 2006

- (b) The purpose of BCA 2006 is to—
- (i) update references to other documents; and
  - (ii) convert the W wind speed categories to the N and C wind speed categories; and
  - (iii) include a national testing regime for cladding in cyclonic areas; and
  - (iv) include enhanced energy efficiency provisions; and
  - (v) include minor technical changes.

## 5.0 Adoption of BCA 2007

- (a) The 2007 edition of the BCA was adopted by the Commonwealth, States and Territories as set out in Table 5.0.

**Table 5.0 History of adoption of BCA 2007**

Administration	Adoption Date
Australian Government	1 May 2007
Australian Capital Territory	1 May 2007
New South Wales	1 May 2007
Northern Territory	1 May 2007
Queensland	1 May 2007

Table 5.0 History of adoption of BCA 2007— continued

Administration	Adoption Date
South Australia	1 May 2007, excluding South Australian variation clause 3.7.4.2, (for the purposes of sub-clauses (1) and (2) of Schedule 18 of the Development Regulations 1993): and sub-clause c) of variation clause 3.7.4.2 (for the purpose of sub-clauses (3) and (4) of Schedule 18 of the Development Regulations 1993).
Tasmania	1 May 2007
Victoria	1 May 2007
Western Australia	1 May 2007

- (b) The purpose of BCA 2007 is to—
- (i) update references to other documents; and
  - (ii) clarify that compliance with either the appropriate acceptable construction manuals or the appropriate acceptable construction practice set out in Section 3 is deemed to comply with the [Performance Requirements](#); and
  - (iii) clarify when it is appropriate to use the acceptable construction practice for the installation of glazing and when it is necessary for windows to comply with AS 2047; and
  - (iv) update acceptable construction practice for the installation of glazing to align with recent changes to AS 1288; and
  - (v) update Energy Efficiency provisions including providing clarification and additional information; and
  - (vi) include minor technical changes.

## 6.0 Adoption of BCA 2008

- (a) The 2008 edition of the BCA was adopted by the Commonwealth, States and Territories as set out in Table 6.0.

Table 6.0 History of adoption of BCA 2008

Administration	Adoption Date
Australian Government	1 May 2008
Australian Capital Territory	1 May 2008
New South Wales	1 May 2008
Northern Territory	1 May 2008
Queensland	1 May 2008
South Australia	1 May 2008
Tasmania	1 May 2008
Victoria	1 May 2008

SUPERSEDED  
HISTORY OF AMENDMENTS

Table 6.0 History of adoption of BCA 2008—continued

Administration	Adoption Date
Western Australia	1 May 2008

(b) The purpose of BCA 2008 is to—

- (i) update references to other documents; and
- (ii) include lists of other legislation affecting buildings in the various States and Territories; and
- (iii) include provisions for swimming pool water recirculation systems; and
- (iv) include minor technical changes.

## 7.0 History of adoption of BCA 2009

(a) The 2009 edition of the BCA was adopted by the Commonwealth, States and Territories as set out in Table 7.0.

Table 7.0 Adoption of BCA 2009

Administration	Adoption Date
Australian Government	1 May 2009
Australian Capital Territory	1 May 2009
New South Wales	1 May 2009
Northern Territory	1 May 2009
Queensland	1 May 2009
South Australia	1 May 2009
Tasmania	1 May 2009
Victoria	1 May 2009
Western Australia	1 May 2009

(b) The purpose of BCA 2009 is to—

- (i) update references to other documents; and
- (ii) after expiry of the agreed transition period, except for the 1993 edition of AS 1170.4, delete all references to the older loading standards contained in the AS 1170 series and consequently, all provisions referring to them; and
- (iii) simplify the wire balustrade provisions including the addition of a [Verification Method](#); and
- (iv) clarify the height of rooms in an attic and with a sloping ceiling; and
- (v) clarify the provisions for the construction of [sanitary compartments](#) to enable an unconscious occupant to be removed; and
- (vi) further update the energy efficiency provisions; and
- (vii) include minor technical changes.



---

# LIST OF AMENDMENTS

**SUPERSEDED**  
**LIST OF AMENDMENTS**

---

**CONTENTS**

---

**LIST OF AMENDMENTS**  
**List of Amendments Housing Provisions (Volume Two)**

**SUPERSEDED**  
**LIST OF AMENDMENTS**

## LIST OF AMENDMENTS - BCA 2009 - HOUSING PROVISIONS

This set of notes has been prepared by the Australian Building Codes Board to assist BCA users in identifying changes incorporated in the 2009 edition of the Housing Provisions (Volume Two) of the BCA (BCA 2009).

The notes provide a description of major changes made from the previous edition of the BCA.

While the Australian Building Codes Board has attempted to include all major changes made from the previous edition of the BCA Housing Provisions, the Board does not give any warranty nor accept any liability in relation to the contents of this list of amendments.

BCA Reference	Changes and Commentary
<b>Part 1.1</b>	
1.1.1.2	The following definitions have been inserted or amended:
Breaking surf	New definition "Breaking surf" inserted along with explanatory information to provide examples of where breaking surf is likely to occur. As a result, the term has been italicised where used in the Housing Provisions.
Cavity	The definition of "cavity" has been moved from 3.3 to the definitions in Part 1.1 so that it applies to the whole of the Housing Provisions. Consequently, the term has been italicised where used in the Housing Provisions.
Figure 1.1.4 Climate zones for thermal design	The climate zone map in Figure 1.1.4 has been updated.
Table 1.1.2	In Victoria, the climate zone for Bairnsdale has been changed to 6.
Design wind speed	Reference to AS 1170.2 has been deleted as a consequence of the deletion of all references to the older loading standards contained in the AS 1170 series.
Low rainfall intensity area	New definition of "low rainfall intensity area" inserted along with explanatory information to clarify which areas are considered to have a low rainfall intensity. As a result, the term has been italicised where used in the Housing Provisions.
Sarking-type material	Clarification added that a sarking-type material includes reflective insulation.
Figure 1.1.3	Figure 1.1.3 which is used to illustrate the definition of separating wall has been amended so that the separating walls do not extend above roof level. Any wall above this height is an external wall.
1.1.3(d)	New provision inserted clarifying that where a document listed in Part 1.4 is subject to publication of a new edition, the new edition need not be complied with in order to comply with the Deemed-to-Satisfy Provisions.

# SUPERSEDED LIST OF AMENDMENTS

BCA Reference	Changes and Commentary																										
<b>Part 1.3</b>																											
Figure 1.3.1	Figure amended to clarify which walls are separating walls and which walls are external walls.																										
<b>Part 1.4</b>																											
Table 1.4.1	<p>The following references have been inserted or amended:</p> <table> <tr> <td>Generally</td><td>For consistency with Volume One, a list of the provisions that refer to each referenced document in the Housing Provisions has been included.</td></tr> <tr> <td>AS/NZS 1170 Part 1</td><td>Amdt 2 to AS/NZS 1170 "Structural design actions" Part 1 "Permanent, imposed and other actions" referenced.</td></tr> <tr> <td>AS 1170 Part 1</td><td>After the expiry of the agreed transition period, reference to AS 1170 "Minimum design loads on structures", Part 1 "Dead and live loads and load combinations" 1989 has been deleted.</td></tr> <tr> <td>AS 1170 Part 2</td><td>After the expiry of the agreed transition period, reference to AS 1170 "Minimum design loads on structures", Part 2 "Wind loads" 1989 has been deleted.</td></tr> <tr> <td>AS 1170 Part 3</td><td>After the expiry of the agreed transition period, reference to AS 1170 "Minimum design loads on structures", Part 3 "Snow loads" 1990 has been deleted.</td></tr> <tr> <td colspan="2">Note: The ABCB expects to delete reference to AS 1170 "Minimum design loads on structures" Part 4 "Earthquake loads" 1993 as part of the changes for BCA 2010.</td></tr> <tr> <td>AS 1684 Part 2</td><td>Amdt 1 to AS 1684 "Residential timber-framed construction" Part 2 "Non-cyclonic areas" referenced.</td></tr> <tr> <td>AS 1684 Part 3</td><td>Amdt 1 to AS 1684 "Residential timber-framed construction" Part 3 "Cyclonic areas" referenced.</td></tr> <tr> <td>AS 1684 Part 4</td><td>Amdt 1 to AS 1684 "Residential timber-framed construction" Part 4 "Simplified — non-cyclonic areas" referenced.</td></tr> <tr> <td>AS 1720 Part 1</td><td>The notes to AS 1720 "Timber structures" Part 1 "Design methods" have been deleted due to deletion of all references to the older loading standards contained in the AS 1170 series.</td></tr> <tr> <td>AS/NZS 2908 Part 1</td><td>AS/NZS 2908 "Cellulose cement products", Part 1 "Corrugated sheets" has been deleted because it is no longer referenced in the Housing Provisions.</td></tr> <tr> <td>AS 3700</td><td>The notes to AS 3700 "Masonry structures" have been deleted as a consequence of changes to 3.11.6.</td></tr> <tr> <td>AS 3798</td><td>Reference to AS 3798 "Guidelines on earthworks for commercial and residential developments" has been deleted as a consequence of the deletion of 3.2.2.2(b).</td></tr> </table>	Generally	For consistency with Volume One, a list of the provisions that refer to each referenced document in the Housing Provisions has been included.	AS/NZS 1170 Part 1	Amdt 2 to AS/NZS 1170 "Structural design actions" Part 1 "Permanent, imposed and other actions" referenced.	AS 1170 Part 1	After the expiry of the agreed transition period, reference to AS 1170 "Minimum design loads on structures", Part 1 "Dead and live loads and load combinations" 1989 has been deleted.	AS 1170 Part 2	After the expiry of the agreed transition period, reference to AS 1170 "Minimum design loads on structures", Part 2 "Wind loads" 1989 has been deleted.	AS 1170 Part 3	After the expiry of the agreed transition period, reference to AS 1170 "Minimum design loads on structures", Part 3 "Snow loads" 1990 has been deleted.	Note: The ABCB expects to delete reference to AS 1170 "Minimum design loads on structures" Part 4 "Earthquake loads" 1993 as part of the changes for BCA 2010.		AS 1684 Part 2	Amdt 1 to AS 1684 "Residential timber-framed construction" Part 2 "Non-cyclonic areas" referenced.	AS 1684 Part 3	Amdt 1 to AS 1684 "Residential timber-framed construction" Part 3 "Cyclonic areas" referenced.	AS 1684 Part 4	Amdt 1 to AS 1684 "Residential timber-framed construction" Part 4 "Simplified — non-cyclonic areas" referenced.	AS 1720 Part 1	The notes to AS 1720 "Timber structures" Part 1 "Design methods" have been deleted due to deletion of all references to the older loading standards contained in the AS 1170 series.	AS/NZS 2908 Part 1	AS/NZS 2908 "Cellulose cement products", Part 1 "Corrugated sheets" has been deleted because it is no longer referenced in the Housing Provisions.	AS 3700	The notes to AS 3700 "Masonry structures" have been deleted as a consequence of changes to 3.11.6.	AS 3798	Reference to AS 3798 "Guidelines on earthworks for commercial and residential developments" has been deleted as a consequence of the deletion of 3.2.2.2(b).
Generally	For consistency with Volume One, a list of the provisions that refer to each referenced document in the Housing Provisions has been included.																										
AS/NZS 1170 Part 1	Amdt 2 to AS/NZS 1170 "Structural design actions" Part 1 "Permanent, imposed and other actions" referenced.																										
AS 1170 Part 1	After the expiry of the agreed transition period, reference to AS 1170 "Minimum design loads on structures", Part 1 "Dead and live loads and load combinations" 1989 has been deleted.																										
AS 1170 Part 2	After the expiry of the agreed transition period, reference to AS 1170 "Minimum design loads on structures", Part 2 "Wind loads" 1989 has been deleted.																										
AS 1170 Part 3	After the expiry of the agreed transition period, reference to AS 1170 "Minimum design loads on structures", Part 3 "Snow loads" 1990 has been deleted.																										
Note: The ABCB expects to delete reference to AS 1170 "Minimum design loads on structures" Part 4 "Earthquake loads" 1993 as part of the changes for BCA 2010.																											
AS 1684 Part 2	Amdt 1 to AS 1684 "Residential timber-framed construction" Part 2 "Non-cyclonic areas" referenced.																										
AS 1684 Part 3	Amdt 1 to AS 1684 "Residential timber-framed construction" Part 3 "Cyclonic areas" referenced.																										
AS 1684 Part 4	Amdt 1 to AS 1684 "Residential timber-framed construction" Part 4 "Simplified — non-cyclonic areas" referenced.																										
AS 1720 Part 1	The notes to AS 1720 "Timber structures" Part 1 "Design methods" have been deleted due to deletion of all references to the older loading standards contained in the AS 1170 series.																										
AS/NZS 2908 Part 1	AS/NZS 2908 "Cellulose cement products", Part 1 "Corrugated sheets" has been deleted because it is no longer referenced in the Housing Provisions.																										
AS 3700	The notes to AS 3700 "Masonry structures" have been deleted as a consequence of changes to 3.11.6.																										
AS 3798	Reference to AS 3798 "Guidelines on earthworks for commercial and residential developments" has been deleted as a consequence of the deletion of 3.2.2.2(b).																										

**SUPERSEDED**  
**LIST OF AMENDMENTS**

BCA Reference	Changes and Commentary	
	AS 4055	After the expiry of the agreed transition period, reference to AS 4055 "Wind loads for housing" 1992 has been deleted.
	AS/NZS 4859 Part 1	The note to AS/NZS 4859 "Materials for the thermal insulation of buildings", Part 1 "General criteria and technical provisions" allowing test and calculation reports demonstrating compliance with the standard carried out prior to the introduction of Amdt 1 has been removed after the expiry of the agreed transition period.
	ABCB	Reference to the ABCB "Protocol for House Energy Rating Software Version 2005.1" has been deleted after the agreed transition period with the 2006.1 version.
	The following references have been inserted or amended:	
South Australian Referenced Documents		
	AS 1720.2	The 2006 edition of AS 1720 "Timber structures", Part 2 "Timber Properties" has been referenced.
	AS 4552	The 2005 edition has been referenced and the title corrected to "Gas fired water heaters for hot water supply and/or central heating".
	Department of Climate Change	Due to the amendments to the heated water service requirements, the National Greenhouse Accounts (NGA) Factors has been referenced.
Victorian Referenced Documents		The following references have been inserted or amended:
	Plumbing Regulations	The 2008 edition of the Plumbing Regulations has been referenced.
Part 2.1		
P2.1(b)(xv)	Termite actions have been included as one of the actions to which a building may reasonably be subjected.	
Part 2.4		
V2.4.6 State and Territory variation	Queensland variation deleted.	
Part 2.5		
P2.5.2	For consistency with changes made at BCA 2008 and the Performance Requirement in Volume One, P2.5.2 has been amended so that openable windows are no longer exempted from the requirement to protect people from falling.	
V2.5.1	New Verification Method inserted setting out procedures for the testing of wire balustrades as an alternative to complying with the relevant Deemed-to-Satisfy Provisions contained in 3.9.2.3.	
V2.6.1 State and Territory variation	In V2.6.1 the reference to the Plumbing Regulations 1998 has been updated to the Plumbing Regulations 2008.	

**SUPERSEDED**  
**LIST OF AMENDMENTS**

BCA Reference	Changes and Commentary
<b>Part 2.6</b>	
2.6 State and Territory variation	<ul style="list-style-type: none"> <li>Due to Queensland adopting the main BCA provisions for energy efficiency, the reference to Queensland has been deleted from Note 2.</li> <li>New Note 3 inserted stating that in Tasmania Part 2.6 is replaced with BCA 2005 Part 2.6 until 1 January 2010. Consequently, the reference to Tasmania in Note 2 has been removed.</li> </ul>
<b>Part 3.1</b>	
3.1.2.3(a)	The slope of finished ground surfaces adjacent to buildings has been reduced from 50 mm to 25 mm over the first 1 m for areas of low rainfall intensity.
3.1.2.3(b)	<ul style="list-style-type: none"> <li>Reference to "measured at the edge of the slab" has been removed to reflect the intent that the slab height is measured to the finished slab height, not the top of the slab edge rebate.</li> <li>The requirements for the slab height above the external finished surface has been amended to allow reduced heights in areas of low rainfall intensity or sandy well drained areas and paved or concreted areas.</li> </ul>
3.1.2.3 Explanatory information	Amended as a consequence of changes to 3.1.2.3.
3.1.2.3(a) State and Territory variation	As a consequence of the changes to 3.1.2.3(a), the South Australian variation has been deleted.
Figure 3.1.2.2	Amended as a consequence of changes to 3.1.2.3.
3.1.3.2(a)(i)	Reference to AS 3660.1 deleted from the acceptable construction practice in recognition that the option of compliance with AS 3660.1 is available under 3.1.3.0 as an acceptable construction manual. Consequently, the remaining subclauses have been re-numbered.
<b>Part 3.2</b>	
3.2.2.2(b)	The provision has been deleted as AS 3798 was no longer considered appropriate as a BCA referenced document.
Figure 3.2.2.1 Explanatory information	The reference to AS 3798 has been replaced with a reference to the acceptable construction manuals listed in 3.2.0 due to AS 3798 no longer being considered appropriate as a BCA referenced document.
3.2.3.1(a)(iii)	Allowable concrete slump amended from 80 mm to 100 mm in line with industry practice and to reduce the likelihood of water being added on-site to improve concrete workability.
<b>Part 3.3</b>	
3.3	The definition of "Cavity" has been moved from 3.3 to the definitions in Part 1.1 so that it applies to the whole of the Housing Provisions.

# SUPERSEDED LIST OF AMENDMENTS

BCA Reference	Changes and Commentary
Figure 3.3.1.4	To allow for common construction practices and to align with AS 1684.2, Figure 3.3.1.4 (Diagram a) has been amended by— <ul style="list-style-type: none"> <li>removing unnecessary detail; and</li> <li>reducing the gap to accommodate truss deflection at the trussed roof-wall junction from 15 mm to 10 mm.</li> </ul>
3.3.1.6	The provision has been re-drafted to clarify that mortar must comply with AS 3700 except that the mortar may be mixed by proportions as set out in Table 3.3.1.2. The old (c) and (d) have been deleted because those provisions are covered by AS 3700.
3.3.1.8(g)	New subclause added to prohibit the use of articulation joints over garage doors unless the brickwork is reinforced or lateral support is provided.
3.3.2.2(g)(ii)	After the expiry of the agreed transition period, reference to AS 1170 "Minimum design loads on structures", Part 2 "Wind loads" 1989 has been deleted.
Table 3.3.3.1	The term "breaking surf" has been italicised because it is now a defined term.
3.3.3.4(c)	As a consequence of the inclusion of a new Table for corrosion protection requirements for built-in structural steel members, the reference to Table 3.4.4.2 has been changed to Table 3.3.3.2.
3.3.3.5	New provision added requiring corrosion protection of built-in structural steel members such as lintels, shelf angles, connectors, accessories (other than wall ties) and the like to be in accordance with Table 3.3.3.2.
Table 3.3.3.2	New table inserted for corrosion protection of built-in structural steel members such as lintels, shelf angles, connectors, accessories (other than wall ties) and the like.
Part 3.3.4 Appropriate Performance Requirements	Performance Requirement P2.2.3 has been included in the list of appropriate Performance Requirements because Part 3.3.4 includes Deemed-to-Satisfy Provisions to prevent moisture from the ground entering the building.
3.3.4.2	Amended by allowing mullions located in cavities to be exempted from minimum cavity widths stated in (a) and (b) provided that a vertical DPC is installed between the outer masonry leaf and each mullion.
3.3.4.5(c)(iv)	Amended so that in low rainfall intensity areas, the height of a DPC or flashings serving as a DPC stated in 3.3.4.5(c)(ii) and (iii), may be reduced to 15 mm and 0 mm respectively.
3.3.4.5 explanatory information	Amended as a consequence of changes to 3.3.4.5(c)(iv).
3.3.4.5 State and Territory variation	South Australian variation amended as a consequence of changes to 3.3.4.5.
<b>Part 3.4</b>	
3.4.2.2	The term "breaking surf" has been italicised (three times) because it is now a defined term.
3.4.4.4	The provision has been amended to only refer to corrosion protection of structural steel members that are not built into a masonry wall.

# SUPERSEDED LIST OF AMENDMENTS

BCA Reference	Changes and Commentary
3.4.4.4 explanatory information	Existing notes 1 to 3 (that deal with steelwork in dry locations and over kitchens and the like) have been deleted from the explanatory information because they have been incorporated into Table 3.4.4.2. Information added that corrosion protection for structural steel members built into masonry is dealt with in the new Table 3.3.3.2.
Table 3.4.4.2	Due to the provisions for corrosion protection of built-in structural steel members (including lintels) now being located in the new Table 3.3.3.2, the column containing provisions for lintels has been removed from Table 3.4.4.2.
<b>Part 3.5</b>	
3.5.1.2(b)	A minimum roof pitch (15 degrees) for which the fixing details in Figure 3.5.1.1 are appropriate has been included in addition to the current maximum pitch of 35 degrees.
Figure 3.5.1.1	The Figure has been amended for consistency with AS 2050 "Installation of roof tiles".
Table 3.5.1.1a	The term "breaking surf" has been italicised (four times) because it is now a defined term.
3.5.2.4(d)	For consistency with the acceptable construction manual AS/NZS 3500.3, the requirement to avoid overflow back into the building where high-fronted gutters are installed, has been amended to refer to overflow measures.
Table 3.5.2.2 explanatory information	The explanatory information has been amended as a consequence of the changes made to 3.5.2.4(d).
<b>Part 3.6</b>	
3.6.0(a) State and Territory variation	Queensland variation deleted.
<b>Part 3.7</b>	
3.7.1.4(c) Figure 3.7.1.2b	New provision and figure inserted clarifying the method of measurement between external walls of different height buildings.
Figure 3.7.1.2	Due to the inclusion of new Figure 3.7.1.2b, the existing figure has been renumbered as Figure 3.7.1.2a.
3.7.1.7(b)	Rainwater tanks have been moved from (b)(i), where they were required by (c) to be non-combustible if within 450 mm of the boundary, to (b)(v) where they may be combustible at any distance.
3.7.1.8(a)	"A wall that separates" has been replaced with the defined term "separating wall".
Figure 3.7.1.10	Figure amended to avoid confusion on what is a separating wall and what is an external wall.
3.7.1.8(f)	The word "masonry" has been deleted so that the provisions regarding service openings apply to a separating wall of any material, not just those of masonry.



**SUPERSEDED**  
**LIST OF AMENDMENTS**

BCA Reference	Changes and Commentary
3.7.4.0 State and Territory variation	SA variation amended so that 3.7.4.0 does not apply in South Australia.
3.7.4.1 State and Territory variation	SA variation amended as a result of the relocation of the additional requirements to Table SA 3.7.4.1.
3.7.4.2 State and Territory variation	SA variation amended to include reference to general bushfire risk areas.
3.7.4.3 State and Territory variation	New SA variation inserted.
Table 3.7.4.1	References to "sarking" have been replaced with the defined term "sarking-type material".
Table SA 3.7.4.1	New SA variation inserted to Table 3.7.4.1.
<b>Part 3.8</b>	
Table 3.8.1.1	Due to the relocation of the diagram, under the requirements for inserted baths, the reference to Figure 3.8.1.4 has been amended to Figure 3.8.1.8(c).
Figure 3.8.1.4	The figure has been deleted and moved to be with the other bath details in Figure 3.8.1.8.
Figure 3.8.1.8	New diagram (c) added from Figure 3.8.1.4 so that all bath details are contained in the one figure.
3.8.2.2(e)	Amended to specify the minimum ceiling height for attic rooms, rooms with a sloping ceiling or where there is a projection below the ceiling line.
3.8.3.3 and Figure 3.8.3.3	3.8.3.3 amended to refer to Figure 3.8.3.3 which provides clarification on measurement of the 1.2 m clear space between the closet pan and the doorway.
3.8.6 State and Territory variation	Queensland variation deleted.
<b>Part 3.9</b>	
Figure 3.9.1.3	The titles of Diagrams b and c have been corrected to be consistent with the wording in 3.9.1.4(b)(i)(A) and (B).
3.9.2.2	<ul style="list-style-type: none"> <li>All situations where (a) does not apply have been consolidated into a new (b). Consequently, all the remaining provisions have been re-numbered.</li> <li>Clarification added that the requirement to provide a balustrade or other barrier does not apply to a retaining wall unless it is associated with a delineated path of access to a building from the road or between buildings.</li> </ul>
3.9.2.3(a)(ii)(B)&(C)	Amended to be consistent with the Volume One balustrade requirements on landings and at openable windows.
3.9.2.3(d)	The reference to AS 1170.1 has been deleted as a consequence of the deletion of all references to the older loading standards contained in the AS 1170 series.

# SUPERSEDED LIST OF AMENDMENTS

BCA Reference	Changes and Commentary
3.9.2.3(f)(i)(B)	As part of the revision of the wire balustrade tables, the reference to Table 3.9.2.1 has been changed to Table 3.9.2.3
3.9.2.3(f)(ii)	Reference to Note 4 of Table 3.9.2.1 added.
3.9.2.3(f)(iii)(C)	The maximum spacing between rails for a continuous vertical wire balustrade has been increased from 800 mm to 900 mm to allow a wider range of balustrade designs.
3.9.2.3 explanatory information	Note 4 amended as a consequence of the revision of the wire balustrade tables and a new Note 9 added covering safety issues related to the exposed ends of wires.
Table 3.9.2.1	The table has been amended by revising some tension values, providing a greater range of wires and wire spacings, deleting galvanised wire, deleting deflection values, and providing additional notes.
Table 3.9.2.2	The table has been amended by revising the wire spacings, providing new tension values to each wire listed and providing additional notes.
Table 3.9.2.3	New table providing only deflection values. The table has been derived from the old Table 3.9.2.1 but with revised values. Revised notes have also been included.
Part 3.9.3 State and Territory variation	Note 2 to the NSW variation has been deleted.
3.9.3.4 explanatory information	Additional explanatory information included that, where possible, auxiliary buildings and structures should be located outside the pool area to reduce the likelihood of access to the pool via propped open gates.
<b>Part 3.10</b>	
3.10.1.0(e)(i) State and Territory variation	Queensland variation deleted.
<b>Part 3.11</b>	
3.11.1	<ul style="list-style-type: none"> <li>With the deletion of the older loading standards except for the 1993 edition of AS 1170.4, the provision has been amended to clarify that the relevant Performance Requirements are satisfied — <ul style="list-style-type: none"> <li>by complying with 3.11.2, 3.11.3 and 3.11.6; or</li> <li>for the earthquake resistance component of the Performance Requirements, by complying with 3.11.5 and 3.11.6.</li> </ul> </li> <li>(d) has been amended to allow any combination of using (a) and (b). This allows the use of the newer editions of AS 1170 for permanent, imposed and wind actions along with the 1993 edition of AS 1170.4 for earthquake loads.</li> <li>(e) has been deleted as it is no longer necessary.</li> </ul>
3.11.1 explanatory information	With the deletion of the older loading standards except for the 1993 edition of AS 1170.4, and the consequential changes to 3.11.1, the explanatory information has been deleted as it is no longer required.

# SUPERSEDED LIST OF AMENDMENTS

BCA Reference	Changes and Commentary
3.11.3(c)(ii)	With the deletion of the older loading standards, including AS 4055 (1992), the reference to "AS 4055 (2006)" has been changed to "AS 4055" because it is no longer necessary to distinguish between AS 4055 (2006) and AS 4055 (1992).
3.11.4	Provision deleted as a consequence of the deletion of the older loading standards except for the 1993 edition of AS 1170.4.
3.11.5	With the deletion of the older loading standards except for the 1993 edition of AS 1170.4, the provision has been amended to only refer to determination of earthquake loads. All other references to superceded loading standards have been removed.
3.11.6(g)	With the deletion of the older loading standards except for the 1993 edition of AS 1170.4, the provision has been amended to require earthquake actions on masonry structures to be determined in accordance with AS 1170.4 (2007). This means that AS 1170.4 (1993) cannot be used to determine earthquake actions for masonry structures.
3.11.6 (i)(i) State and Territory variation	Queensland variation deleted.
<b>Part 3.12</b>	
3.12 State and Territory variation	<ul style="list-style-type: none"> <li>Due to Queensland adopting the main BCA provisions for energy efficiency, the reference to Queensland has been deleted from Note 2.</li> <li>New Note 3 inserted stating that in Tasmania Part 3.12 is replaced with BCA 2005 Part 3.12 until 1 January 2010. Consequently, the reference to Tasmania in Note 2 has been removed.</li> </ul>
3.12 explanatory information 1	<ul style="list-style-type: none"> <li>The term "reflective insulation" has been italicised because it is a defined term.</li> <li>New Note 3 added explaining that some types of reflective insulation may also serve other purposes such as waterproofing or vapour proofing.</li> </ul>
3.12.0 State and Territory variation	Reference to Victorian Plumbing Regulations changed from 1998 to 2008.
3.12.1.2(b)(ii)(C)	New provision inserted to clarify that a tiled roof without a sarking type material at roof level is a ventilated roof space.
Figure 3.12.1.1 Notes	The reference in Note 4 to "sarking" has been amended to "sarking-type material" which is a defined term.
3.12.1.2(e)	New provision inserted to compensate for a reduction in ceiling insulation when exhaust fans and downlights are 1% or more of the ceiling area with reference to new Table 3.12.1.2a.
Table 3.12.1.1a	New table inserted. See comments on 3.12.1.2(e).

# SUPERSEDED LIST OF AMENDMENTS

BCA Reference	Changes and Commentary
Table 3.12.1.1 explanatory information	New explanatory information has been added to provide an example of how 3.12.1.2(e) would apply to a typical house.
3.12.1.4(b) explanatory information	Explanation of the term "surface density" has been added.
Table 3.12.1.3	For climate zone 1 clarification has been added that (c) is only applicable to masonry external walls with a surface density of not less than 220 kg/m <sup>2</sup> and the term "surface density" has been explained in Note 1. In (d)(ii) the term "external wall" has also been deleted.
3.12.1.4(d)	Reference to Table 3.12.1.3 has been included so the requirement of (i) for the wall to achieve the minimum Total R-Value became unnecessary and therefore has been deleted. Consequently, the remaining provisions have been re-numbered.
Figure 3.12.1.3	The total R-Value for concrete blockwork masonry has been increased to 0.53 to be consistent with Volume One.
Figure 3.12.1.3 explanatory information	<ul style="list-style-type: none"> <li>Where reference is made to where the cavity or airspace is filled in explanatory information Note 1, clarification has been added that the Total R-Value should be reduced by 0.17.</li> <li>An explanation of the term "surface density" has been added to Note 4.</li> </ul>
3.12.2.1(a)	Clarification added that, when a mezzanine is included in a storey, it is included when calculating glazing allowances for the storey.
3.12.2.1(b) explanatory information	<ul style="list-style-type: none"> <li>In note 1, the reference to guidelines of the National Fenestration Rating Council (NFRC) has been changed to the Technical Protocol and Procedures Manual for Energy Rating of Fenestration Products by the Australian Fenestration Rating Council (AFRC).</li> <li>In line with this change, in Note 2 the reference to the NFRC has been changed to AFRC.</li> </ul>
3.12.3.5(b) explanatory information	New explanatory information has been inserted to clarify that caulking includes sealant, expanded foam or other gap filling material.
3.12.4.1(b)(iii)	Clarification added that the ventilation opening to the adjoining room need only comply with Table 3.12.4.1 for the floor area of the adjoining room and the proportion of the habitable room that is ventilated from the adjoining room.
3.12.5.3(a)(iii)(B)	Clarification added that it is only necessary for the ductwork to be sealed with a draw band in conjunction with either a sealant or adhesive tape.
<b>ACT Appendix</b>	
Footnote	Footnotes for "Land Use and Development Control", "Occupational Health and Safety" and "Utilities" updated.

# SUPERSEDED LIST OF AMENDMENTS

BCA Reference	Changes and Commentary
<b>NSW Appendix</b>	
Footnote	<ul style="list-style-type: none"> <li>In 4.2, the reference to "Occupational Health and Safety Act 2000" has been updated to "Occupational Health and Safety Regulations 2001".</li> <li>New footnote 4.3 inserted.</li> </ul>
<b>SA Appendix</b>	
SA 7 Limitation	The limitation has been amended to apply to all heated water services installed to serve any Class 1 building.
SA 7.1	<p>The following definitions have been deleted—</p> <ul style="list-style-type: none"> <li>Large heated water service</li> <li>Small heated water service</li> </ul>
SA 7.2	Performance Requirement amended by limiting the amount of carbon dioxide permitted to be emitted from heated water services.
SA 7.3	Amended as a result of changes to Performance Requirement SA 7.2.
SA 7.4	Amended as a result of changes to Performance Requirement SA 7.2.
<b>Victoria Appendix</b>	
Footnote	<ul style="list-style-type: none"> <li>Footnote for "Asbestos Removal" has been inserted. Consequently, the following footnotes have been renumbered.</li> <li>Footnotes for "Sanitary Plumbing, Water Supply and Sewerage" and "Septic Tank Legislation" updated.</li> </ul>
<b>Abbreviations and Symbols</b>	
RBM	Abbreviation deleted because it is no longer used in the Housing Provisions.
um	Corrected to "µm".
<b>History of BCA Adoption</b>	
7.0	Clause 7.0 and Table 7.0 have been added in order to set out the adoption dates of the 2009 edition of the BCA in each State and Territory and to summarise the purpose of the changes from BCA 2008.